AD 639916

CLEARINGHOUSE
FOR FEDERAL SCIENTIFIC AND
TECHNICAL INFORMATION

Hardcopy	Microfiche		
$5.00	$1.00	162	pp

ARCHIVE COPY

Code 1

PSDC TR-17

OFFICE OF
CIVIL DEFENSE

CORPS OF ENGINEERS
U.S. ARMY

AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT

Technical Report Prepared for
The Protective Structures Development Center
Joint Civil Defense Support Group
Ft. Belvoir, Virginia
Office of the Chief of Engineers/Bureau of Yards and Docks

Contract No. DA-18-020-ENG-3580
Subtask 1217A

Prepared by:

ENGINEERING AND INDUSTRIAL EXPERIMENT STATION
College of Engineering
University of Florida
Gainesville, Florida

July 15, 1965

DDC
RECEIVED
JUN 17 1966
C

PROTECTIVE STRUCTURES DEVELOPMENT CENTER

FORT BELVOIR, VIRGINIA

Distribution of This Document Is Unlimited

F

ACCESSION for
CFSTI WHITE SECTION ☑
DDC BUFF SECTION ☐
UNANNOUNCED ☐
JUSTIFICATION Per statement on file
BY
DISTRIBUTION/AVAILABILITY CODES
DIST. AVAIL. and/or SPECIAL
1

DISCLAIMER NOTICE

THIS DOCUMENT IS BEST QUALITY PRACTICABLE. THE COPY FURNISHED TO DTIC CONTAINED A SIGNIFICANT NUMBER OF PAGES WHICH DO NOT REPRODUCE LEGIBLY.

AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT

Technical Report Prepared for
The Protective Structures Development Center
Joint Civil Defense Support Group
Ft. Belvoir, Virginia
Office of the Chief of Engineers/Bureau of Yards and Docks

Contract No. DA-18-020-ENG-3580
Subtask 1217A

ENGINEERING AND INDUSTRIAL EXPERIMENT STATION
College of Engineering
University of Florida
Gainesville, Florida

July 15, 1965

Prepared by:

D. W. Taylor
Assistant in Research

Juan O. Gonzalez
Assistant Professor

OCD Review Notice

This report has been reviewed in the Office of Civil Defense and approved for publication. Approval does not signify that the contents necessarily reflect the views and policies of the Office of Civil Defense.

Distribution of this document is unlimited.

ABSTRACT

Ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter were conducted during the period April 21 - June 26, 1965 at Protective Structures Development Center, Fort Belvoir, Virginia. The structure tested was designed to represent a typical "designated area" in the core of a multi-story building, and was erected in the basement of the 1000 Person Shelter, Building 2591, Fort Belvoir, Virginia.

A total of 1000 individual simulated occupants were installed and by adjustment of their operating voltage made to simulate 112 persons for a shelter loading rate of 1 occupant per ten square feet of floor area.

Ventilation rates of from 8 to 25 cubic feet per minute per occupant were employed; the ventilation air was conditioned in accordance with the "1% High Design Day" for the Washington (Springfield, Virginia) area. Thermal responses of the shelter as a whole and of the individual rooms were determined for both diurnal and steady-state tests.

The average thermal response of the shelter as a whole followed closely that predicted, based on an assumption of adiabatic operation, i.e., no heat transfer through the shelter boundary surfaces. Thermal responses of the individual rooms, however, departed from those predicted on an assumption that each room received a quantity of ventilation air commensurate with its occupant loading. It was apparent that rooms not in the direct flow path of the ventilation air did not receive their pro-rata share.

At no ventilation rate tested utilizing the PVK could a habitable thermal environment be maintained in all of the shelter rooms, throughout a complete diurnal cycle, as measured by a criterion of 85 F maximum effective temperature. The side rooms exhibited effective temperatures above 85 F at some time during a diurnal cycle for all air flow rates in both supply and exhaust configurations, except when these rooms were in the direct flow path of the ventilation air (Series flow) or when auxiliary air moving devices, (Punkah Pumps), were deployed. For a criterion of 85 F average effective temperature the entire shelter could be adequately ventilated by a PVK in an exhaust configuration supply 14 cfm of air per occupant when Punkah Pumps were employed and the air was conditioned to follow the diurnal cycle. For these same conditions of supply air, but with the PVK in a supply configuration, 16 cfm were required to render all rooms habitable. When Punkah Pumps were not employed, the side rooms exceeded an average effective temperature of 85 F at some time for all ventilation rates employing a complete diurnal cycle. A ventilation arrangement in which each room received in series, all of the ventilation air, produced the lowest average shelter effective temperatures.

A baffle which caused fresh ventilation air to impinge on the doorways to the "side" rooms blocked the normal egress of thermal currents and resulted in less favorable environmental conditions than when no baffle was employed.

Difficulty was experienced in the utilization of polyethylene film flexible ductwork in that flow patterns were unstable and the duct exhibited a tendency to collapse when bent to pass around obstructions. Flow through the duct could be stabilized by restraining its free end and by obstructing about one-third of the exhaust area.

TABLE OF CONTENTS

	Title	Page No.
	ABSTRACT	ii
I.	FOREWORD	1
II.	OBJECT	4
III.	EXPERIMENTAL DESIGN	5
	Effective Temperature	5
	Condition of Ventilation Air	8
	Volume of Ventilation Air	10
	Ventilation Configurations	12
IV.	EQUIPMENT	14
	The Adiabatic Shelter	14
	Simulated Occupants	19
	Shelter Air Supply	23
	Punkah Pumps	28
	Instrumentation	32
V.	OPERATIONAL PROCEDURES	38
	Diurnal Test	38
	Steady-State Test	39
	Air Change and Air Exchange Measurements	39
VI.	DISCUSSION AND RESULTS	46
	Environmental Responses to Steady-State and Diurnal Tests	46
	Steady-State Responses to Side Rooms	57
	Air Flow Patterns	66
	Shelter Micro-Environmental Patterns	69
	Tracer Gas Measurements	75
	Package Ventilation Kit	77
VII.	CONCLUSIONS	80
VIII.	BIBLIOGRAPHY	83
	APPENDICES	84
	A-1	84
	A-2	87
	A-3	89
	B	91
	C	94

LIST OF FIGURES

	Title	Page No.
Figure No. 1	Temperature Variation with Time, "Average" and "High" Design Days, Fort Belvoir, Virginia	9
Figure No. 2	Theoretical Predicted Effective Temperatures Adiabatic Simulated Protective Shelter	11
Figure No. 3	Configuration Variations and Ventilation Adjuncts	13
Figure No. 4	Adiabatic Simulated Protective Shelter In Basement of 1000 Person Shelter	15
Figure No. 5	Floor Plan and Section Views, Adiabatic Simulated Protective Shelter	17
Figure No. 6	Equipment Diagram, Adiabatic Simulated Shelter	32
Figure No. 7	CO_2 Concentration Vs. Time, Room 3	43
Figure No. 8	CO_2 Concentration Vs. Time, Room 4	45
Figure No. 9	Supply and Environmental Conditions, Adiabatic Simulated Protective Shelter	51-56
Figure No. 10	Ventilation Patterns in a Compartmented Shelter Configuration 1-N	58
Figure No. 11	Ventilation Patterns in a Compartmented Shelter Configuration 1-P	59
Figure No. 12	Ventilation Patterns in a Compartmented Shelter Configuration 2-N	60
Figure No. 13	Ventilation Patterns in a Compartmented Shelter Configuration 2-P	61
Figure No. 14	Ventilation Patterns in a Compartmented Shelter Configuration 3-N	62
Figure No. 15	Major Air Flow Patterns in Room 2, Test 46	67
Figure No. 16	Major Air Flow Patterns in Room 2, Test 47	68
Figure No. 17	Effective Temperature Distribution, Test 47	70
Figure No. 18	Effective Temperature Distribution, Test 48	71
Figure No. 19	Air Flow Pattern in Doorways of Side Rooms During Configuration 2-N	73

LIST OF PHOTOGRAPHS

	Title	Page No.
Photograph No. 1	Bicycle Fan	3
Photograph No. 2	Exterior of "Adiabatic Shelter"	18
Photograph No. 3	Typical Installation of Simocs in Room 4	20
Photograph No. 4	Simoc Water Distribution Unit and Delivery Tubes	22
Photograph No. 5	Installation of Environmental Control Trailer at P.S.D.C. Building 2591	25
Photograph No. 6	Installation of PVK as Seen From Plenum	26
Photograph No. 7	Adaptation of PVK as Supply Fan, Configuration 1-N	27
Photograph No. 8	Variable Speed Drive Unit Used to Actuate Punkah Pumps	29
Photograph No. 9	Operation of Punkah Pump Immediately Prior to "Power" Stroke	30
Photograph No. 10	Operation of Punkah Pumps During "Return" Stroke	31
Photograph No. 11	The Application of "Smoke" Generation to Determine Air Currents	41
Photograph No. 12	Partial Collapse of Exhaust Duct at Junction with Metal Ductwork	78
Photograph No. 13	View Into Exhaust Duct Showing Construction	79

LIST OF TABLES

	Title	Page No.
Table No. I	Observed Metabolic Heat Losses for Sedentary Adults	5
Table No. II	Effective Temperatures	7
Table No. III	Hygrosensor Locations, Adiabatic Simulated Protective Shelter	34
Table No. IV	Thermocouple Locations, Adiabatic Simulated Protective Shelter	36
Table No. V	Index to Shelter Configuration and Test Numbers	47
Table VI	Summary of Ventilation Rates as Determined by Heat Balance Method	74
Table VII	Summary of Ventilation Rates as Determined by Gas Tracer Method	76
Table No. I-B	Index to Temperature Data	Appendix B
Table No. II-B	Temperature Data	Appendix B
Table No. I-C	Effective Temperature Distributions	Appendix C

ACKNOWLEDGEMENTS

The University of Florida wishes to express its appreciation to the staff of the Protective Structures Development Center, Fort Belvoir, Virginia for their efforts in making the test a successful operation.

In particular, we would like to thank Mr. M. M. Dembo for his helpful advice and guidance and Mr. O. W. Svaeri and Mr. N. I. Stein for their many hours of diligent assistance.

I. FOREWORD

An investigation of the thermal response of specialized protective structures, or of areas within conventional buildings designated as shelters, is a useful preliminary to planning the ventilation equipment which must be built into or provided as part of the shelter supply and equipment package. The ventilating or cooling capacity to be provided depends on the anticipated tolerance of the shelter occupants to adverse thermal environments, on the severity of the ambient weather to be expected at the shelter location, and on the ability of the shelter structure to transfer out part of the heat released therein, rather than depending for its removal, entirely on the thermal capacity of the ventilation air.

The thermal response of a structure or area may be determined by computations using a mathematical model, by conducting a simulated occupancy test, or by actual occupancy. The first method is the most economical of time and money, but involves assumptions as to shelter geometry, thermal properties of the surroundings, and mechanisms of heat transfer which may be difficult to make or justify. The latter method, the actual "live" occupancy test, is most expensive to conduct, and if pushed to extremes, may involve danger to health. However, it is capable of answering psychological as well as physiological questions not considered in the mathematical or thermal simulation. Occupancy tests in which the actual shelter is employed, and in which the release of metabolic heat and moisture is simulated by devices, while the shelter is provided with a ventilation supply programmed to duplicate selected ambient conditions, may be expected to provide results of perhaps greater validity than the first method for less effort and danger than the latter.

The Engineering and Industrial Experiment Station of the University of Florida, Gainesville, Florida, has made a series of simulated occupancy tests at various locations throughout the United States. These tests, conducted under Contracts OCD-OS-62-116 and B-64225-(4949A-17) US, for the Office of Civil Defense, Department of Defense, have been largely concerned with shelters of simple geometry, located underground, in environments that permitted some heat loss by transfer to the surroundings. In contrast, the simulated shelter to be tested in the present investigation is of compartmented geometry, has been insulated to prevent heat transfer, and is considered to represent a typical "designated" shelter area in a multi-story building. In addition, the efficacy of air deflecting and air fanning devices is to be considered as they effect a more even distribution of environmental conditions throughout the "rooms" of the shelter.

A criterion frequently selected for evaluation of shelter environments is "effective" temperature. The "effective" temperature represents a combination of the contributions of air temperature, humidity, and motion as they affect a person's subjective evaluation of whether one environment is "better" or "worse" than another. By virtue of a multiplicity of tests, it has been possible to assign numerical values to "effective" temperatures for the environments normally encountered. In the heat stress region above 80 F "effective" temperature, there have been relatively few subjective experiments performed. There is as yet no general agreement as to the level of "effective" temperature which may be successfully tolerated for extended periods by an "average" population. The tolerance level for the

aged and infirm has also not been established. There is a question as to whether the body is irreversibly damaged by high effective temperature transients, or can tolerate these if the average "effective" temperature does not exceed some selected value. Experimental studies are being made of these problems and it is anticipated that conclusions based upon criteria of 85 degree maximum or 85 degree average effective temperature may have to be later modified. Both criteria have been considered in this investigation.

In order to supplement the natural ventilation capabilities of "designated area" shelters, air moving devices capable of being driven by muscular exertion have been developed. One such device, a Package Ventilation Kit shown in the accompanying photograph, may be driven by one to three operators. The fan capacities for various combinations of speed and duct length are indicated in the table. Not shown in the photograph, but provided as a component of the Package Ventilation Kit, is a length of polyethylene duct. By connecting this to the exhaust face of the fan assembly, the PVK can be placed deep within a shelter area and serve in an "exhaust" configuration. It may also be used in a "supply" configuration by placing it in a doorway and forcing ventilation air into a shelter.

The fan portion of a PVK was to be used to supply the ventilation air for the shelter. The scope of the present studies was to investigate its capability to ventilate the shelter, but was not to include evaluation of the fan characteristics such as power consumption, capacity, etc.

Equivalent Length of 20" Diam. Sheet Metal Duct, Ft.	E-2024-4 MODULAR DESIGN W/80 T Sprocket								
	1 Man Pedal Fan 41 rpm			2 Man 52 rpm			3 Man 59 rpm		
	CFM	FAN HP	P_s in. Water	CFM	FAN HP	P_s in. Water	CFM	FAN HP	P_s in. Water
200	2000	0.09	0.12	2500	0.17	0.18	2850	0.25	0.24
300	1750	0.09	0.14	2250	0.18	0.22	2650	0.28	0.31
400	1600	0.09	0.16	2000	0.17	0.24	2450	0.27	0.34
500	1500	0.09	0.17	1900	0.18	0.26	2250	0.26	0.36
600	1450	0.10	0.19	1800	0.19	0.29	2100	0.27	0.38
800	1350	0.10	0.22	1700	0.20	0.35	1950	0.29	0.44
1000	1300	0.11	0.25	1650	0.21	0.39	1850	0.32	0.49
1370	1200	0.13	0.30						
2660	960	0.16	0.40						

FAN AND SYSTEM CHARACTERISTICS
(Interim Prototype Design Ratings)

Photograph No. 1. Bicycle Fan of Package Ventilation Kit

II. OBJECT

The object of the investigation, as defined in the Contract was to make an empirical determination of the capabilities and effectiveness of selected developmental air moving devices to ventilate a compartmentalized above-ground shelter space, by measuring the distribution of ventilation air, air changes, and the thermal environment within the shelter rooms.

III. EXPERIMENTAL DESIGN

The thermal response of a simulated protective shelter will be affected by the volume, condition, and method of distribution of the ventilation air, as well as by the conditions of loading and the thermal environment in which the shelter is located. In the case of the present study, the shelter loading was fixed at 1 occupant per ten square feet of shelter floor area, and the shelter made to approach the adiabatic mode of operation by insulation of its walls, floor, and ceiling, and by control of the temperature of the surrounding space. The remaining variables could be varied independently within limits imposed by the judgement and ingenuity of those conducting the test or by the capabilities of the ventilation equipment to be used. Criteria considered in designing the experiment are discussed below.

Effective Temperature is an index of the body's response to its thermal environment. The body must dispose of the heat which results from metabolic processes, the amount of heat so lost depending on the level of activity. For the restricted activity expected during shelter occupancy, a heat dissipation rate of 400 Btu per hour is usually assumed.[1] The manner and ease with which this quantity of heat is disposed of depends on the surroundings; as the temperature rises, more and more heat is lost by evaporation of moisture from the skin and lungs, as indicated in Table 1.

Table I

Observed Metabolic Heat Losses for Sedentary Adults*

Dry-Bulb Temperature F	Sensible Heat Loss, Btu/hr	Latent Heat Loss	
		Btu/hr	Lb. water/hr
50	335	65	0.062
60	330	70	0.067
70	300	100	0.096
80	220	180	0.173
90	115	285	0.274
100	0	400**	0.384
110	-120	520	0.499

* Values taken from 1964 ASHRAE Guide and Data Book, Chapter 30, Page 338, Table 3.

** 400 Btu/Hr is equivalent to 117 Watts.

[1] Superscript numerals in body of report refer to Bibliography.

If the surroundings are hot, but at a low relative humidity, the body may not suffer undue discomfort and the same might be true of a cool but humid environment in which a larger proportion of metabolic heat would be lost by conduction or radiation. Various combinations of temperature and humidity might be expected to produce similar sensations or physiological responses within the body. The effective temperature index is a method of estimating the body's response to such varying conditions. Some effective temperatures are given in Table II; these values derived from a more complete presentation found in the literature.[2]

The ability of human beings to tolerate adverse environmental conditions has not been established and doubtless varies from individual to individual. Pending establishment of statistical norms to be used in evaluating shelter environments, three differing guide lines or criteria have been selected. One, it is assumed that an effective temperature of 85.0 F may be the upper limit of tolerance and that irreversible body damage may occur if this temperature is exceeded for even short periods. Two, it is considered that the human body may have enough overload capacity so that it can tolerate an average effective temperature of 85.0 F provided that the periods above this value do not exceed 90 F. Finally, from the standpoint of economy of ventilating power, it is felt that effective temperatures below 80 F would probably result in a shelter managerial decision to reduce fan speed consistent with the requirement of some minimum ventilation rate to prevent build up of carbon dioxide within the shelter. From these criteria, the decision was made to consider ventilation air flows which produced maximum shelter effective temperatures of 85 F, those that produced average effective temperatures of 85 F, and not to extend the investigation beyond those conditions which produced minimum effective temperature conditions of 80 F.

TABLE II EFFECTIVE TEMPERATURES
(Air Velocity 20 Feet/Minute)

Dry Bulb Temperatures, Degrees, Fahrenheit	Wet Bulb Temperatures, Degrees, Fahrenheit																									
	88	87	86	85	84	83	82	81	80	79	78	77	76	75	74	73	72	71	70	69	68	67	66	65	64	63	62
110	92.9	92.4	91.8	91.3	90.8	90.2	89.8	89.4	89.0	88.5	88.0	87.6	87.2	86.8	86.4	86.0	85.6	85.3	85.0	84.6	84.2	83.8	83.5	83.1	82.8	82.5	82.2
109	92.7	92.3	91.7	91.2	90.6	90.0	89.6	89.3	88.8	88.3	87.8	87.4	87.0	86.6	86.2	85.8	85.5	85.1	84.8	84.4	84.0	83.6	83.3	83.0	82.6	82.2	81.9
108	92.6	92.1	91.5	90.9	90.4	89.8	89.5	89.1	88.6	88.1	87.6	87.2	86.8	86.4	86.0	85.6	85.3	84.9	84.6	84.2	83.7	83.4	83.1	82.8	82.4	82.0	81.6
107	92.5	91.9	91.3	90.7	90.2	89.7	89.3	88.9	88.4	87.9	87.4	87.1	86.6	86.2	85.8	85.4	85.1	84.7	84.3	83.9	83.5	83.2	82.9	82.5	82.1	81.8	81.3
106	92.3	91.7	91.2	90.5	90.0	89.5	89.2	88.7	88.3	87.7	87.3	86.8	86.4	86.0	85.6	85.2	84.9	84.4	84.1	83.7	83.3	83.0	82.6	82.2	81.9	81.5	81.1
105	92.1	91.5	90.0	90.3	89.8	89.3	89.0	88.5	88.0	87.5	87.0	86.6	86.2	85.7	85.4	85.0	84.7	84.2	83.8	83.4	83.1	82.7	82.4	82.0	81.6	81.3	80.8
104	91.9	91.3	90.7	90.0	89.6	89.2	88.8	88.2	87.7	87.2	86.8	86.4	86.0	85.5	85.2	84.8	84.4	84.0	83.5	83.2	82.8	82.4	82.2	81.8	81.4	81.0	80.6
103	91.7	91.1	90.5	89.8	89.4	89.1	88.5	88.0	87.5	87.0	86.5	86.2	85.7	85.3	84.9	84.5	84.1	83.7	83.3	82.9	82.5	82.2	81.9	81.5	81.1	80.7	80.3
102	91.5	90.8	90.2	89.6	89.3	88.8	88.3	87.7	87.3	86.7	86.3	85.9	85.5	85.0	84.6	84.3	83.8	83.4	83.0	82.6	82.3	81.9	81.6	81.2	80.8	80.4	80.0
101	91.2	90.6	89.9	89.5	89.0	88.6	88.0	87.5	87.0	86.5	86.0	85.7	85.2	84.8	84.4	84.0	83.5	83.1	82.7	82.4	82.0	81.7	81.3	80.9	80.6	80.1	79.7
100	91.0	90.4	89.7	89.4	88.8	88.3	87.7	87.2	86.7	86.2	85.8	85.4	85.0	84.5	84.1	83.7	83.2	82.8	82.5	82.0	81.7	81.4	81.0	80.6	80.2	79.8	79.5
99	90.8	90.2	89.5	89.2	88.5	88.0	87.4	86.9	86.4	86.0	85.5	85.2	84.7	84.3	83.8	83.4	82.9	82.5	82.1	81.7	81.4	81.1	80.6	80.3	79.9	79.5	79.2
98	90.6	89.9	89.4	88.9	88.3	87.7	87.2	86.8	86.2	85.7	85.3	84.9	84.5	84.0	83.5	83.1	82.6	82.2	81.8	81.5	81.1	80.7	80.3	79.9	79.6	79.3	79.0
97	90.3	89.7	89.2	88.6	88.0	87.4	86.9	86.4	85.9	85.5	85.0	84.6	84.1	83.7	83.2	82.7	82.4	81.9	81.6	81.2	80.7	80.3	80.0	79.6	79.3	79.0	78.6
96	90.1	89.5	89.0	88.3	87.7	87.1	86.7	86.1	85.6	85.2	84.8	84.3	83.8	83.3	82.8	82.5	82.1	81.7	81.3	80.8	80.4	80.0	79.7	79.3	79.0	78.7	78.3
95	89.8	89.3	88.6	88.0	87.4	86.8	86.3	85.8	85.3	84.9	84.4	84.0	83.5	83.0	82.6	82.2	81.8	81.4	80.9	80.5	80.0	79.7	79.3	79.0	78.6	78.3	77.9
94	89.6	89.1	88.3	87.7	87.1	86.5	86.0	85.5	85.1	84.6	84.1	83.6	83.2	82.7	82.3	81.9	81.5	81.0	80.6	80.1	79.7	79.3	79.0	78.6	78.3	78.0	77.6
93	89.4	88.8	88.0	87.4	86.8	86.3	85.7	85.3	84.7	84.3	83.7	83.3	82.8	82.4	81.9	81.6	81.1	80.7	80.2	79.8	79.3	79.0	78.6	78.3	78.0	77.6	77.2
92	89.2	88.5	87.8	87.1	86.5	86.0	85.4	84.9	84.4	83.9	83.4	82.9	82.5	82.0	81.6	81.2	80.8	80.3	79.8	79.4	79.0	78.6	78.2	77.9	77.6	77.2	76.9
91	88.9	88.2	87.5	86.8	86.2	85.7	85.1	84.6	84.0	83.5	83.0	82.6	82.1	81.7	81.3	80.9	80.4	79.9	79.4	79.0	78.6	78.2	77.8	77.5	77.2	76.8	76.5
90	88.6	87.9	87.2	86.5	86.0	85.3	84.9	84.2	83.7	83.1	82.7	82.3	81.8	81.4	81.0	80.5	80.0	79.5	79.1	78.6	78.2	77.8	77.5	77.2	76.8	76.6	76.2
89	88.3	8 .6	86.9	86.2	85.6	85.0	84.5	83.9	83.3	82.8	82.4	81.9	81.5	81.1	80.6	80.1	79.6	79.1	78.6	78.3	77.8	77.5	77.1	76.8	76.6	76.2	75.8
88	88.0	87.3	86.6	85.9	85.3	84.7	84.2	83.5	83.0	82.5	82.1	81.5	81.2	80.6	80.2	79.7	79.2	78.7	78.2	77.9	77.5	77.1	76.8	76.5	76.2	75.8	75.5
87		8 .0	86.3	85.7	85.0	84.4	83.8	83.2	82.6	82.2	81.7	81.2	80.7	80.2	79.8	79.3	78.7	78.3	77.8	77.5	77.1	76.8	76.4	76.1	75.8	75.4	75.2
86			86.0	85.3	84.7	84.0	83.4	82.8	82.3	81.8	81.3	80.8	80.3	79.8	79.4	78.8	78.3	77.9	77.5	77.1	76.8	76.4	76.0	75.7	75.4	75.1	74.9
85				85.0	84.3	83.7	83.0	82.4	81.9	81.4	80.9	80.5	79.4	79.4	78.9	78.4	77.9	77.5	77.1	76.7	76.4	76.0	75.6	75.3	75.1	74.8	74.5
84					84.0	83.3	82.7	82.1	81.6	81.0	80.6	80.1	79.5	79.0	78.5	78.0	77.6	77.1	76.7	76.3	76.0	75.6	75.3	75.0	74.8	74.4	74.2
83						83.0	82.3	81.8	81.2	80.7	80.2	79.6	79.1	78.6	78.1	77.6	77.2	76.7	76.3	76.0	75.6	75.3	74.9	74.7	74.4	74.1	73.7
82							82.0	81.5	80.9	80.3	79.8	79.2	78.7	78.2	77.7	77.3	76.8	76.4	76.0	75.7	75.3	75.0	74.6	74.3	74.0	73.7	73.3

* Tabular Values prepared from Effective Temperature Chart - ASHRAE Guide, 1963 - Page 111

The Condition of the Ventilation Air was determined in accordance with the adverse environmental conditions to be expected in the vicinity of Washington, D. C. (Springfield, Virginia) during a typical "hot spell" such as is occasionally experienced during the summer in this area. A five year period of data was available from the weather station at Davison Army Airfield, Fort Belvoir, Virginia. From this it was determined that the month of July was generally warmer than June or August. From the data for July, an "average" July day was determined and curves of hourly wet bulb and dry bulb temperature variation were plotted. On the same plot, the predicted wet and dry bulb temperatures for the so-called "1 percent High Design Day" were located. These values were determined from an extensive compilation of weather data for the design of cooling towers[3] and represent conditions whose thermal severity would normally be exceeded only one percent of the time during a typical summer. Since these were "high design" conditions they substantially exceeded the maximum values previously determined for the "average" July day. Accordingly, the entire wet and dry bulb temperature curves were shifted upward so that their maxima passed through the one percent "high design" values. The original "average day" curves, the "high design" points and the final "high design day" curves are shown on Figure 1.

Since the Environmental Control and Instrumentation Trailer could more readily be programmed to follow a design day of constant dew point, an average dew point was determined from the "high design day" curves of Figure 1 and the equipment set to deliver air with this dew point and a variable dry bulb temperature determined in accordance with the curve for this variable.

It was contemplated that determinations of air distribution patterns and air changes would be made, and that the time involved in such procedures would be great enough that the shelter conditions might be expected to vary if the shelter was following a diurnal cycle. To obviate this difficulty, it was decided to operate the shelter at a series of selected "steady state" conditions that might be expected to occur during a diurnal cycle, yet which could be sustained long enough to permit any desired measurement to be made without change occurring in the shelter temperature. The "steady state" conditions at which it was decided to conduct tests were selected as the maximum, minimum, and average air supply enthalpies which would occur during a diurnal cycle following the "high design day". Air flows, at which these three steady-state temperatures were to be evaluated, were selected in accordance with the effective temperature limitations previously discussed and consonant with the equipment limitations considered in the section which follows.

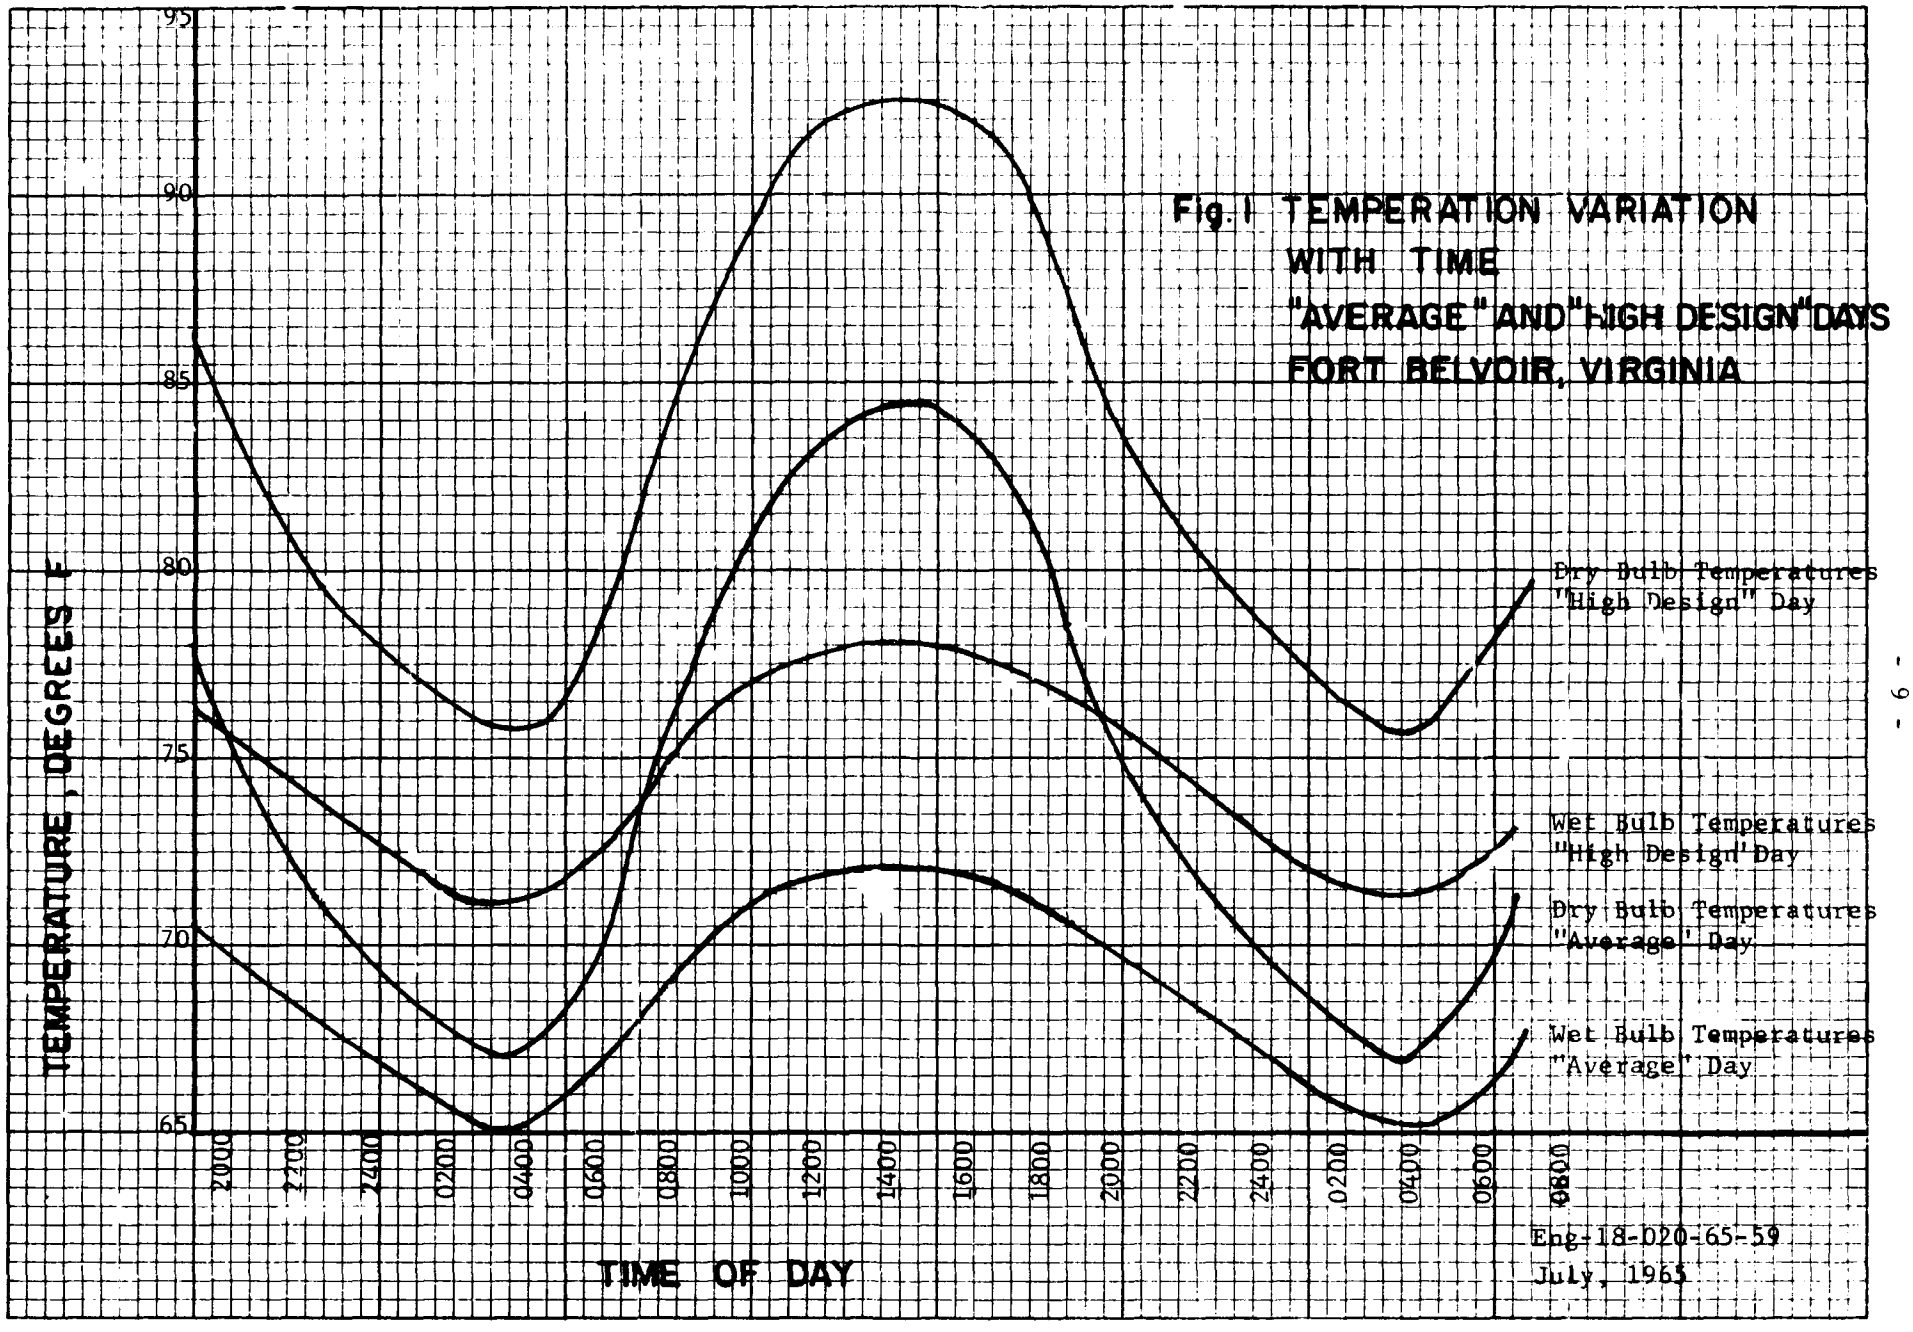
Fig. I TEMPERATION VARIATION
WITH TIME
"AVERAGE" AND "HIGH DESIGN" DAYS
FORT BELVOIR, VIRGINIA
TEMPERATURE, DEGREES F
95
90
85
80
75
70
65
2000
2200
2400
0200
0400
0600
0800
1000
1200
1400
1600
1800
2000
2200
2400
0200
0400
0600
0800
TIME OF DAY
Dry Bulb Temperatures "High Design" Day
Wet Bulb Temperatures "High Design" Day
Dry Bulb Temperatures "Average" Day
Wet Bulb Temperatures "Average" Day
Eng-18-020-65-59
July, 1965

The Volume of Ventilation Air with which it was decided to ventilate the shelter was arrived at from consideration of the properties of the ventilation air, the predicted response of an adiabatic shelter, the interim prototype design ratings of the Package Ventilation Kit fan, the capabilities of the Environmental Control and Instrumentation Trailer which was to supply the conditioned air, and the environmental tolerance limits of humans, as described in a previous section entitled "Effective Temperature". As outlined in the previous section dealing with the "Condition of the Ventilation Air", it was proposed to ventilate the shelter with air which followed a diurnal cycle of temperature and moisture variations typical of a "high design day" in the vicinity of Washington, D.C., and also to perform certain steady state tests in which constant temperature and humidity air would be supplied.

Considering the shelter to be adiabatic, it was possible to predict its overall response to supply air of known conditions. (See Appendix A). When this was done for air with the maximum, average, and minimum enthalpy values to be expected during a diurnal cycle, the curves of Figure 2 resulted. The proposed steady-state per capita ventilation rates were limited to 22.5 cfm per occupant, since this represented a total air flow near the capacity of the air handling equipment. A lower limit of 8 cfm per occupant was selected to be employed with supply air at the minimum enthalpy condition, since this extended the response curve slightly past the 85 F effective temperature point of interest. Between these limits, three other air flows were selected as indicated. The maximum steady-state air flow considered, 22.5 cfm per occupant, is at the limit of capacity of the PVK with two men operating the pedal mechanism and with 200 feet of 20 inch diameter sheet metal duct (or equivalent) attached. The maximum predicted capacity of the PVK with three operators and 200 feet of 20 inch ductwork was indicated to be 2850 cfm, which for the shelter in question would have supplied 25.4 cfm per occupant. Diurnal cycles were conducted at maximum air flow rates up to 25 cfm per occupant.

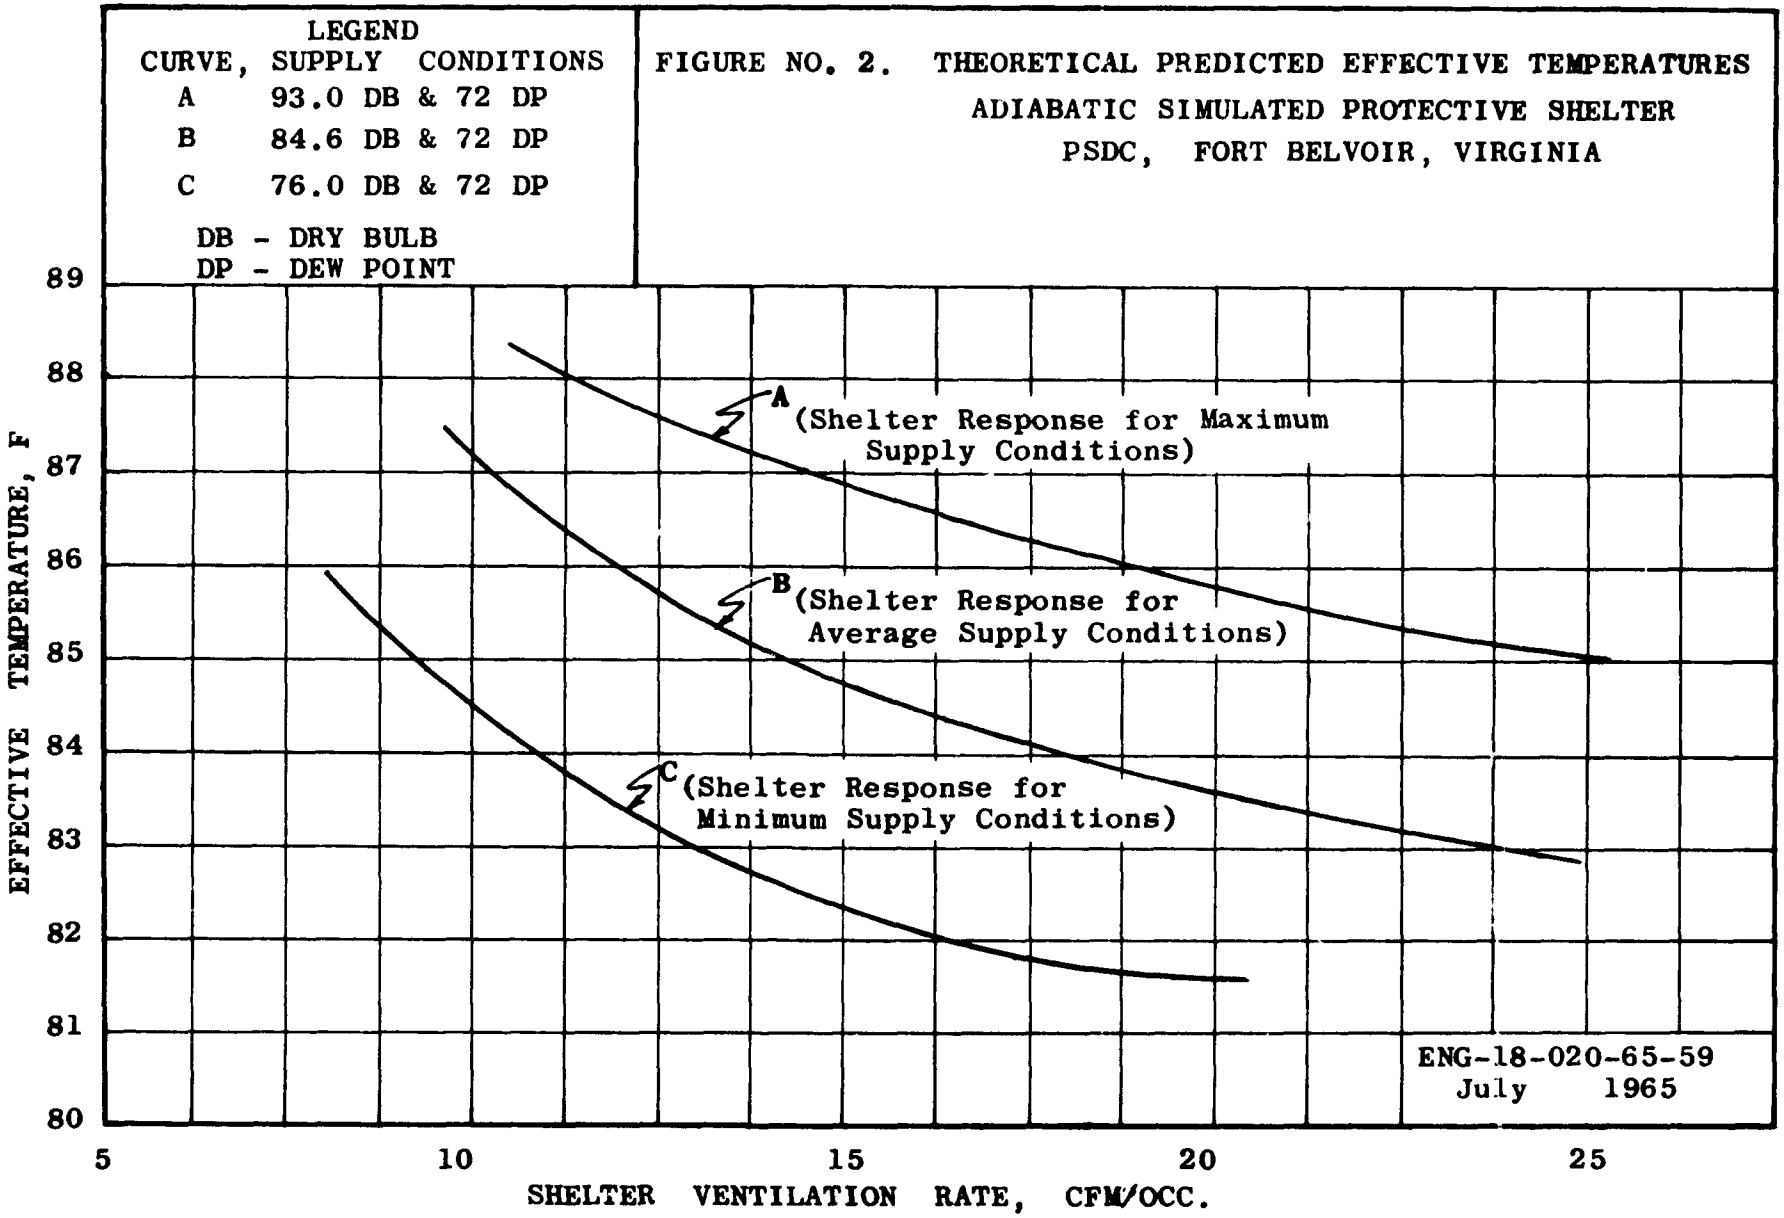

FIGURE NO. 2. THEORETICAL PREDICTED EFFECTIVE TEMPERATURES
ADIABATIC SIMULATED PROTECTIVE SHELTER
PSDC, FORT BELVOIR, VIRGINIA

Ventilation Configurations were selected on the assumption that the shelter occupants would have available, one Package Ventilation Kit (PVK) consisting of fan, driving mechanism and 20 inch diameter plastic ducting, and that they would have some capability to close existing openings in their shelter area and open others. In addition, it was felt that they might have some ability to erect an air-directing baffle. Finally, a recent adaptation of an ancient air moving device[4], the Punkah was to be employed and its effect on air distribution studied.

The three ventilation configurations and their modifications involving devices assigned to improve the ventilation of the two side rooms are shown on Figure 3. It can be seen that basically these configurations involve use of the PVK as a supply fan, as an exhaust fan in a typical compartmented area with possible "dead" areas, and as an exhaust fan in a compartmented area expediently modified structurally to eliminate spaces without forced ventilation. For Configurations 1 and 2 which involve no forced ventilation through Rooms 3 and 4, use of Punkahs and/or air directing baffles was to be considered.

Other configurations were envisioned involving the use of a baffle in a supply-fan application of the PVK and also provision of additional openings into Rooms 3 and 4, but time did not permit their investigation. For this same reason, not all the possible combinations of air temperature, air volume, and configuration could be investigated. As will appear in the section of RESULTS, some lower air flows produced intolerable environmental conditions throughout the entire shelter and after the prediction of this condition was borne out by a test, it was deemed appropriate to eliminate other tests in this area of investigation.

Of the 105 steady-state tests which the combinations of the three air temperatures, the five air flows and the seven ventilating schemes might entail, 55 were performed. The seven ventilating schemes and five air flows would involve 35 diurnal tests if all possibilities were explored; 10 were actually conducted.

Fig. No. 3
CONFIGURATION VARIATIONS & VENTILATION ADJUNCTS

ADIABATIC SIMULATED PROTECTIVE SHELTER
PROTECTIVE STRUCTURES DEVELOPMENT CENTER
FORT BELVOIR, VIRGINIA

CONFIGURATION VARIATIONS (NO ADJUNCTS)

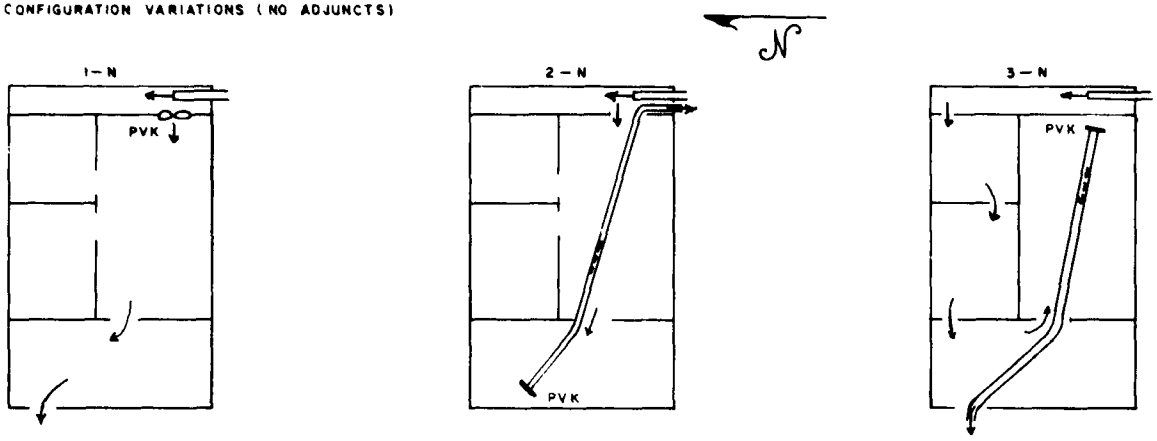

Note 1: Double-headed Arrows Designate Installation of Punkahs
Note 2: 4' Wide X 7' High Baffle

CONFIGURATION LETTER LEGEND

- N — No Adjunct
- P — Punkahs in Doorway of Rooms 3 & 4
- B — Baffle at Supply Location
- PB — Punkahs and Baffles Employed

CONFIGURATION VARIATIONS (WITH ADJUNCTS)

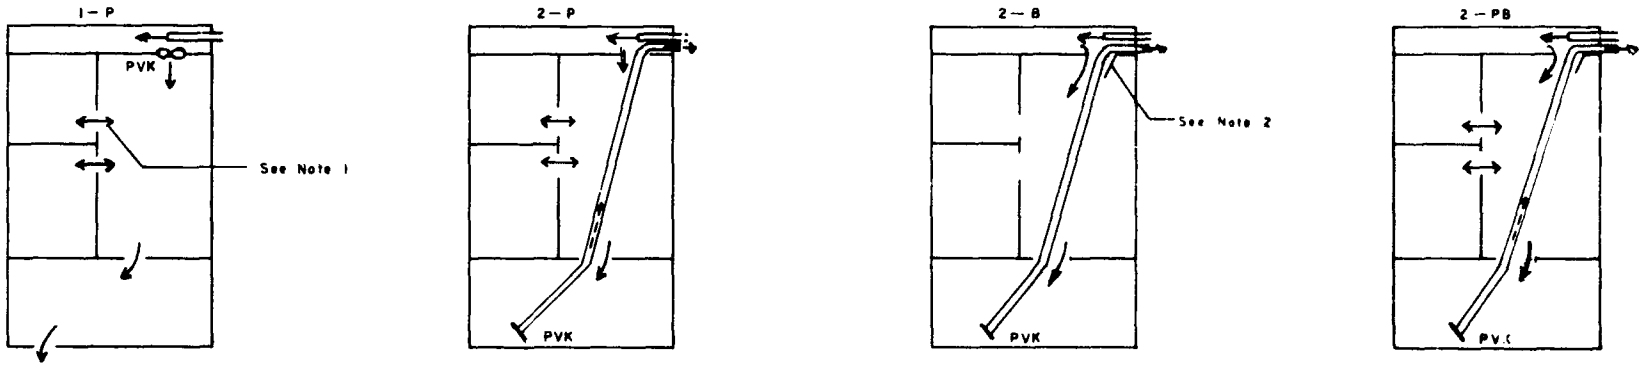

ENG-18-020-65-59
JULY, 1965

IV. EQUIPMENT

The equipment utilized in the ventilation studies herein reported, comprised a simulated protective shelter, an Environmental Control and Instrumentation Trailer designed for the conduct of controlled tests of protective structures, devices to simulate the metabolic heat and moisture releases of human beings, and miscellaneous instrumentation to measure or control the experimental variables.

The Adiabatic Shelter, which was utilized in this series of tests was designed by the Protective Structures Development Center and was constructed by Engineer troops from Fort Belvoir, Virginia. The structure simulated a "designated area" type of shelter located in the core of a multi-story building. Similar shelter areas were assumed to exist above and below the typical area under consideration. From this assumption, and the work of others[5] in the testing of "designated area" shelters, it was concluded that the simulated shelter should be adiabatic in operation, that is all cooling would be by ventilation air, none by heat transfer through the walls, floor or ceiling. The results of experiments conducted in such a structure would err on the side of safety, that is "real" structures of the type considered here have been found[6] to transfer out by conduction and radiation an amount of heat varying from zero to about 10 percent of the total released by their occupants.

To ensure a stable and controllable environment for the test structure, it was erected in the basement area of the 1000 Person Shelter, Building 2591, Fort Belvoir, Virginia. Figure 4 shows the relationship of the test shelter to Building 2591 and to the Environmental Control Unit. The original design of the structure provided for a ceiling of transparent plastic film in order to permit observation and to provide illumination. It was initially felt that thermostatic control of the temperature of the basement room would suffice to prevent heat losses from the shelter walls. A preliminary test was made of the structure as originally designed and built in order to establish the "adiabatic" quality of the test structure. Twelve pairs of thermocouples were distributed throughout the shelter in locations where temperatures on either side of the exterior walls and ceilings could be sensed. Two heat sources were placed within the shelter and adjusted to release 7.0 KW (about 50% of the total anticipated metabolic load). Temperature measurements were made until equilibrium conditions were established at an average ΔT of 8.8 degrees. From this temperature gradient and the overall shelter boundary area (excluding the floor which was already covered with 2 inches of insulating foamed plastic), an overall heat transfer coefficient "U" value was calculated as 1.23 Btu/hr ft^{2}deg. F.

Considering the precision of other measurements to be made, it was felt that "adiabatic" operation could be assumed, if heat loss through the walls and ceiling could be kept at or below 3% of the total heat released. For the "U" value just determined, and a total heat release of 44,800 Btu/hr (112 occupants) this would imply a maximum permissible ΔT of 0.5 degrees. This was considered to be beyond the capability of the thermostatic heat controls available.

Fig. No. 4 ADIABATIC SIMULATED PROTECTIVE SHELTER IN BASEMENT OF 1000-PERSON SHELTER FORT BELVOIR, VIRGINIA

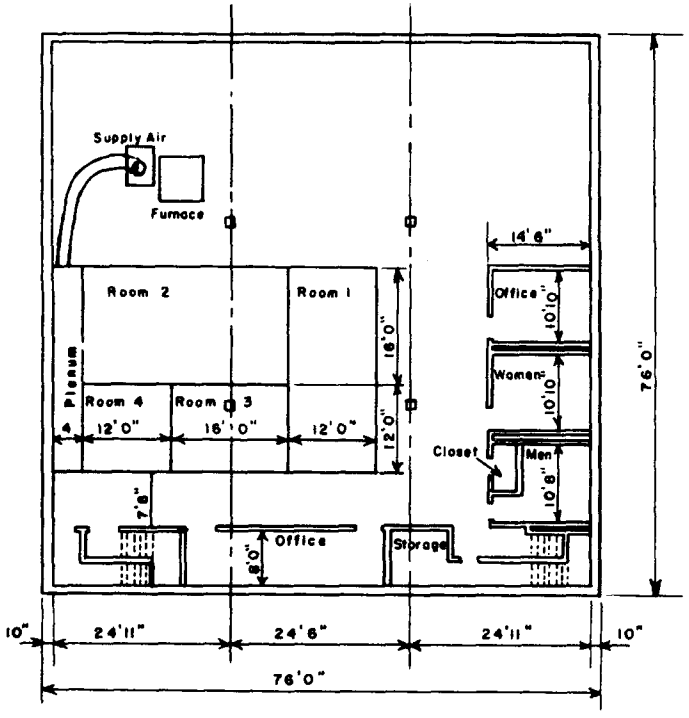

BASEMENT PLAN

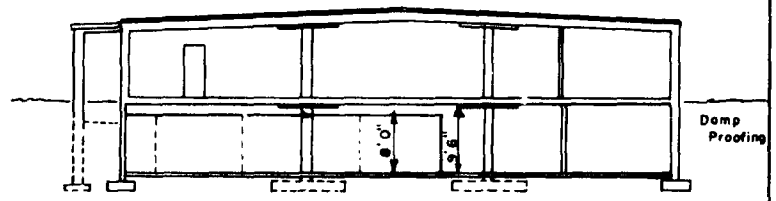

ELEVATION

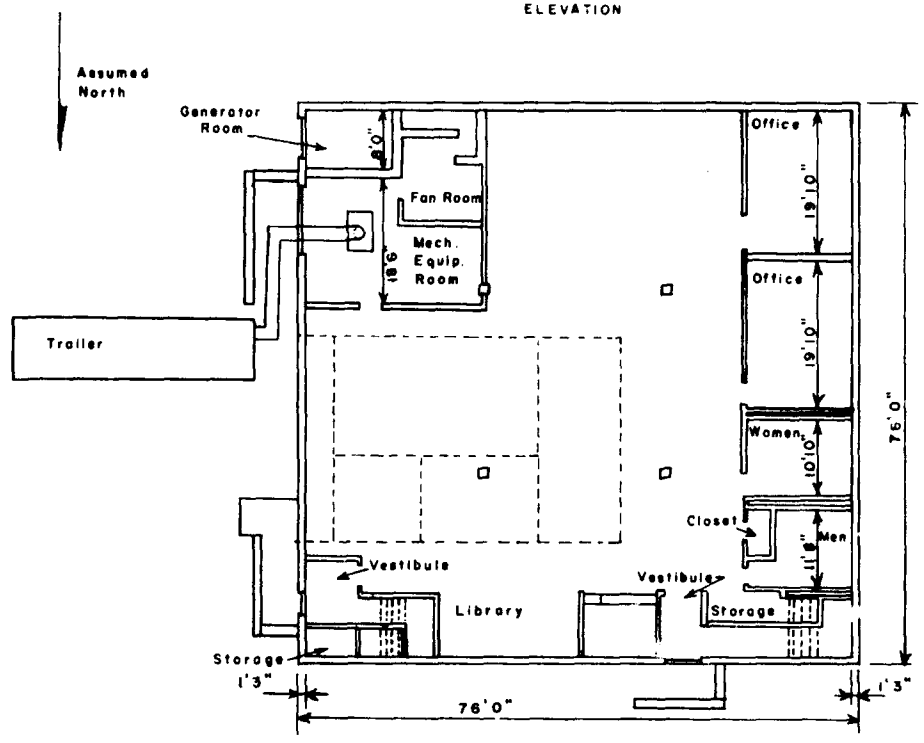

FIRST FLOOR PLAN

ENG-18-020-65-59
JULY, 1965

By greatly decreasing the overall heat transfer coefficient ("U"), much higher ΔT values could be tolerated without exceeding the 3% maximum permissible heat loss. Data from the ASHRAE "Guide"[7] were examined and it was determined that application of 1 inch of foamed plastic slab insulation to the exterior walls of the shelter and to the roof would reduce the "U" value to 0.171 and increase the permissible ΔT to 3.6 degrees which was considered within the capability of the temperature control system to maintain. Calculation of the two "U" values for the shelter is outlined in Appendix A. The construction of the shelter as finally tested is shown in Figure 5. Attention is called to the fact that two types of wall construction were employed, as shown in Photograph 2, necessitating different application of insulating material and resulting in walls with differing thermal resistance. In addition, the ventilation openings shown on Figure 5 are directly applicable to Configuration 1 only and are not the same as openings provided for other Configurations (The RESULTS section for each Configuration includes a sketch of the shelter which shows the change in relative location of various ventilation openings.)

After construction, the two inch foamed plastic blocks on the floor of the shelter were covered with 6 mil plastic film which was carefully sealed to the walls. All joints in the walls were caulked and/or taped and the entire inside of the shelter was painted with a black polyester base paint to seal pores and reduce absorption of carbon dioxide during later tracer gas measurements.

The basement room, in which the simulated shelter was located, was equipped with ductwork connected to the building's heating and cooling system. During the conduct of the test, this system was split in such a way that temperature control of the basement room could be independent of that of the ground level room. In this way, the basement could be kept at or near the temperature existing within the shelter and thus the temperature drop across the shelter walls could be reduced, aiding in maintaining the "adiabatic" shelter concept. To supplement the capacity of the building's heating system, a small oil fired furnace of 150,000 Btu per hour capacity was installed in the basement, and two OCD-Mass Occupant Simulators were employed to further heat and distribute the warmed air.

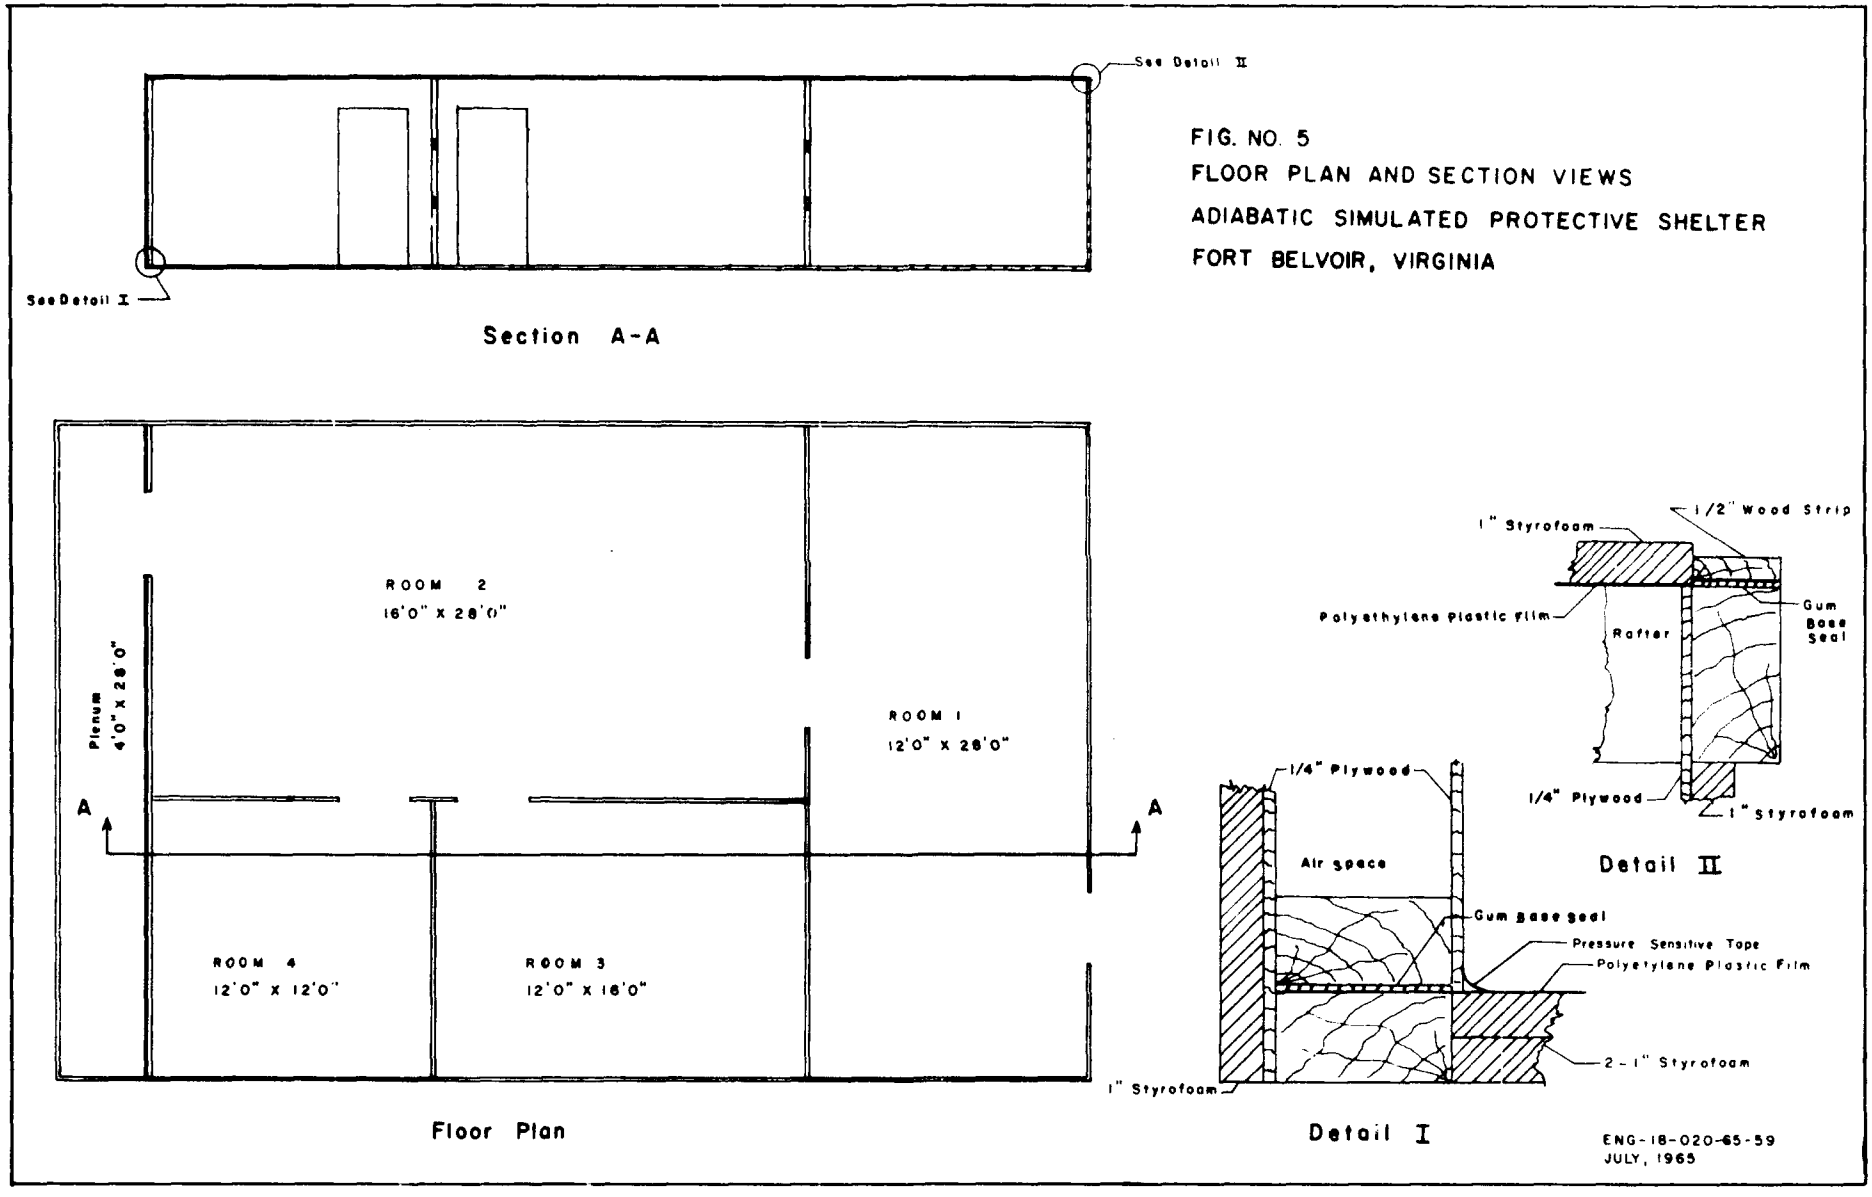

FIG. NO. 5
FLOOR PLAN AND SECTION VIEWS
ADIABATIC SIMULATED PROTECTIVE SHELTER
FORT BELVOIR, VIRGINIA

Photograph No. 2 . Exterior of "Adiabatic Shelter" (View Facing North East)

Simulated Occupants were used in order to "load" the shelter. These devices, familiarly labeled "Simocs", were designed to approximate the metabolic heat release of human beings. The individual type of Simoc was copied from a design originated by the United States Bureau of Standards and used by them in a pioneer test of protective shelter environment under simulated occupancy conditions. It consisted of two concentric cylinders of sheet metal, 38 inches high. The outer cylinder had a diameter of 22 inches and was closed at one end by a conial cap 5-1/2 inches high. Both the cylinder and cone were covered by a closely fitted sheath of toweling material of the type known as "huck" and commonly used for drying dishes. The inner cylinder had a diameter of 15 inches. This inner cylinder was insulated with 1/2 inch of glass fiber on its exterior surface and was open at top and bottom. The entire device rested on a two foot square sheet metal base with a retaining rim of 2 inches on all sides. At the center of this base, an electric socket was mounted and fitted with a 660-watt cone-type electric heating element. The exterior appearance and typical arrangement of the Simocs may be seen in Photograph 3.

Variable voltage transformers were employed to control the voltage impressed on the heater element of the Simoc. It might be here mentioned that transformer losses, appreciable for this type installation, were included in the heat released within the shelter and were charged to the shelter heat supply, since all power entering the shelter was metered at the shelter entrance, and the transformers were located within the shelter area.

Availability of "Simocs" limited the number which could be placed in the shelter to 100, instead of the 112 which the shelter floor area would require for the recommended loading rate of 1 occupant per 10 square feet of floor area. However by operating the cone heaters at a slightly higher voltage than normally necessary to simulate the heat generated by one individual, the output of each "Simoc" was increased approximately 12 percent so that the 100 actual Simoc units simulated 112 occupants. The cone heaters, whose rated output is 660 watts were not visibly glowing when operated at the 131 watts necessary to simulate 1-1/8 occupants each. This, coupled with the insulated inner liner of the "Simoc" reduced radiative heat transfer.

By supplying water to the apex of the cone which made up the "head" of the Simoc, the entire top and a circumferential band of cloth could be wetted. The heat from the device caused the water to evaporate, thus simulating the latent heat release from the skin and lungs of a human occupant. Since the total heat output of the electric resistance element was kept constant, the latent heat fraction could be varied as more or less water was supplied.

Photograph No. 3 . Typical Installation of Simocs in Room 4
(View Facing North)

Water was supplied to the Simocs via individual supply lines from a rotary metering device (one such device is shown in Photograph No. 4). The metering device was driven by a 3 rpm clock drive motor connected in series with a rotating cam switch whose relative periods of "on" and "off" operation could be manually adjusted. In this fashion, the amount of water supplied the Simocs, and hence the latent heat fraction of the total heat released, could be varied in accordance with the values shown in Table I. Here it may be seen that the latent heat fraction of the total load varies directly with the dry bulb temperature. At and above 100 F, all heat lost by the body is by evaporation of moisture. Six metering devices or units were in service during the test program (two units were employed in Room 1, two in Room 2, and one each in Rooms 3 and 4).

At the beginning of the test, all of the metering devices were programmed by a single rotating cam and therefore, all units delivered water at the same rate. It early became apparent however, that dry bulb temperatures in the various rooms would differ significantly and that different water rates would therefore be required. Test 1 of the complete testing program was conducted under these conditions, after which additional metering tanks and timers were installed and the water supply to the rooms controlled separately in accordance with the temperature in that room.

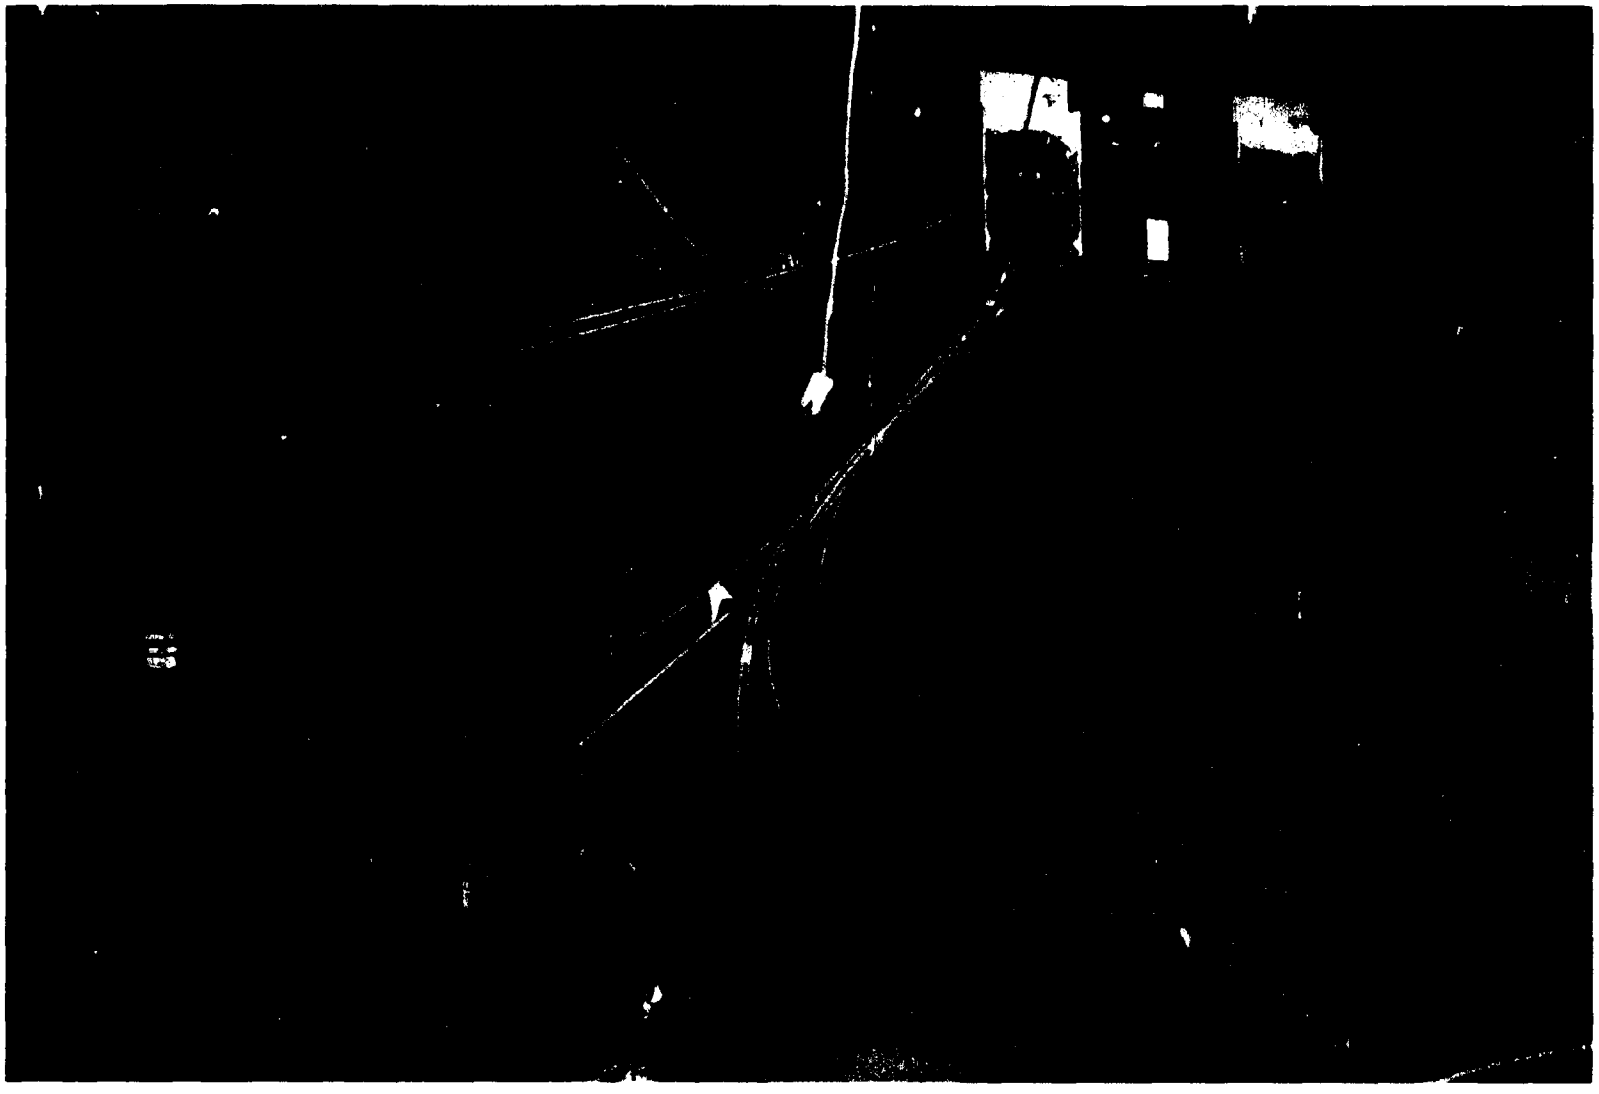

Photograph No. 4 . Simoc Water Distribution Unit and Delivery Tubes (South East Corner of Room 1)

Shelter Air Supply

As mentioned in the section entitled "The Adiabatic Shelter", the structure to be tested was designed to simulate a "designated area" shelter space in the core of a multi-story building. Ventilation of such spaces may be assumed to be by outside air at essentially ambient conditions. This air might be forced through the shelter by the pressure of wind, by thermal "stack effects", or, as in the configurations tested in this series of experiments, by a Package Ventilation Kit. In any case, a realistic simulated occupancy test must include furnishing the ventilation air at conditions appropriate for the period being simulated. For the series of tests under discussion, this period was to be a typical "hot spell" occurring during summer months in the vicinity of Washington, D.C. As explained in the section entitled "Experimental Design", this involved certain steady state air conditions as well as complete diurnal cycles in which air conditions changed hourly.

In order to provide the desired control of the shelter ventilation air supply conditions, use was made of an Environmental Control and Instrumentation Trailer built for the Office of Civil Defense for tests similar to those to be conducted. Essentially, this comprised an adjustable volume air handling unit supplying a combination air washer and reheat section. The air washer could be supplied with either heated or refrigerated spray water and hence could deliver air at a selected constant dew point to the reheat section. The reheat coils were supplied with thermostatically controlled hot water and could thus deliver the air at a selected dry bulb temperature. The dew point of the conditioned air was manually adjusted, while the dry bulb temperature was controlled by a rotating plastic cam whose profile was cut to represent the variations in dry bulb temperature occurring during the type day selected for simulation. The orientation of the Environmental Control Unit with respect to Building 2591 may be seen in Photograph 5.

The air was delivered to a plenum at the east end of the shelter via a combination of rigid and flexible ductwork. As shown on Figure 4, this duct entered an exhaust opening in the equipment room of the upper floor of Building 2591 and thus reached the lower floor.

During the operation of the test, the air supply to the shelter was adjusted as follows. The desired steady-state or diurnal conditions of temperature and dew point were selected (see section, "Design of Experiment"), as was the air flow rate. A preliminary adjustment was made in the speed or the volume controls of the main fan in the Environmental Control Trailer. The voltage control to the PVK unit's driving motor (1/4 H.P., D.C.) was adjusted until an auxiliary duct into the shelter air supply plenum indicated no flow into or out of the plenum. Under these conditions, pressure in the plenum was essentially atmospheric and it could be assumed that all the air supplied to the plenum was being utilized by the PVK and supplied to the shelter. A traverse was then made of the main supply duct at its exhaust into the plenum, and the flow rate computed. If the desired flow rate was not obtained on the first trial, the speed of the main fan was readjusted, as indicated, and the

speed of the PVK fan changed to again produce atmospheric pressure in the plenum. This process was continued until the desired air flow was being delivered to the shelter via the plenum which was being kept at atmospheric pressure by the PVK unit. A portion of the plenum is shown in Photograph 6. The main and auxiliary ducts may be seen in the background, the PVK fan in the foreground. The shelter side (or delivery side) of the fan installation is shown in Photograph 7. The shroud around the fan is readily apparent.

Photograph No. 5 . Installation of Environmental Control Trailer at P.S.D.C. Building 2591

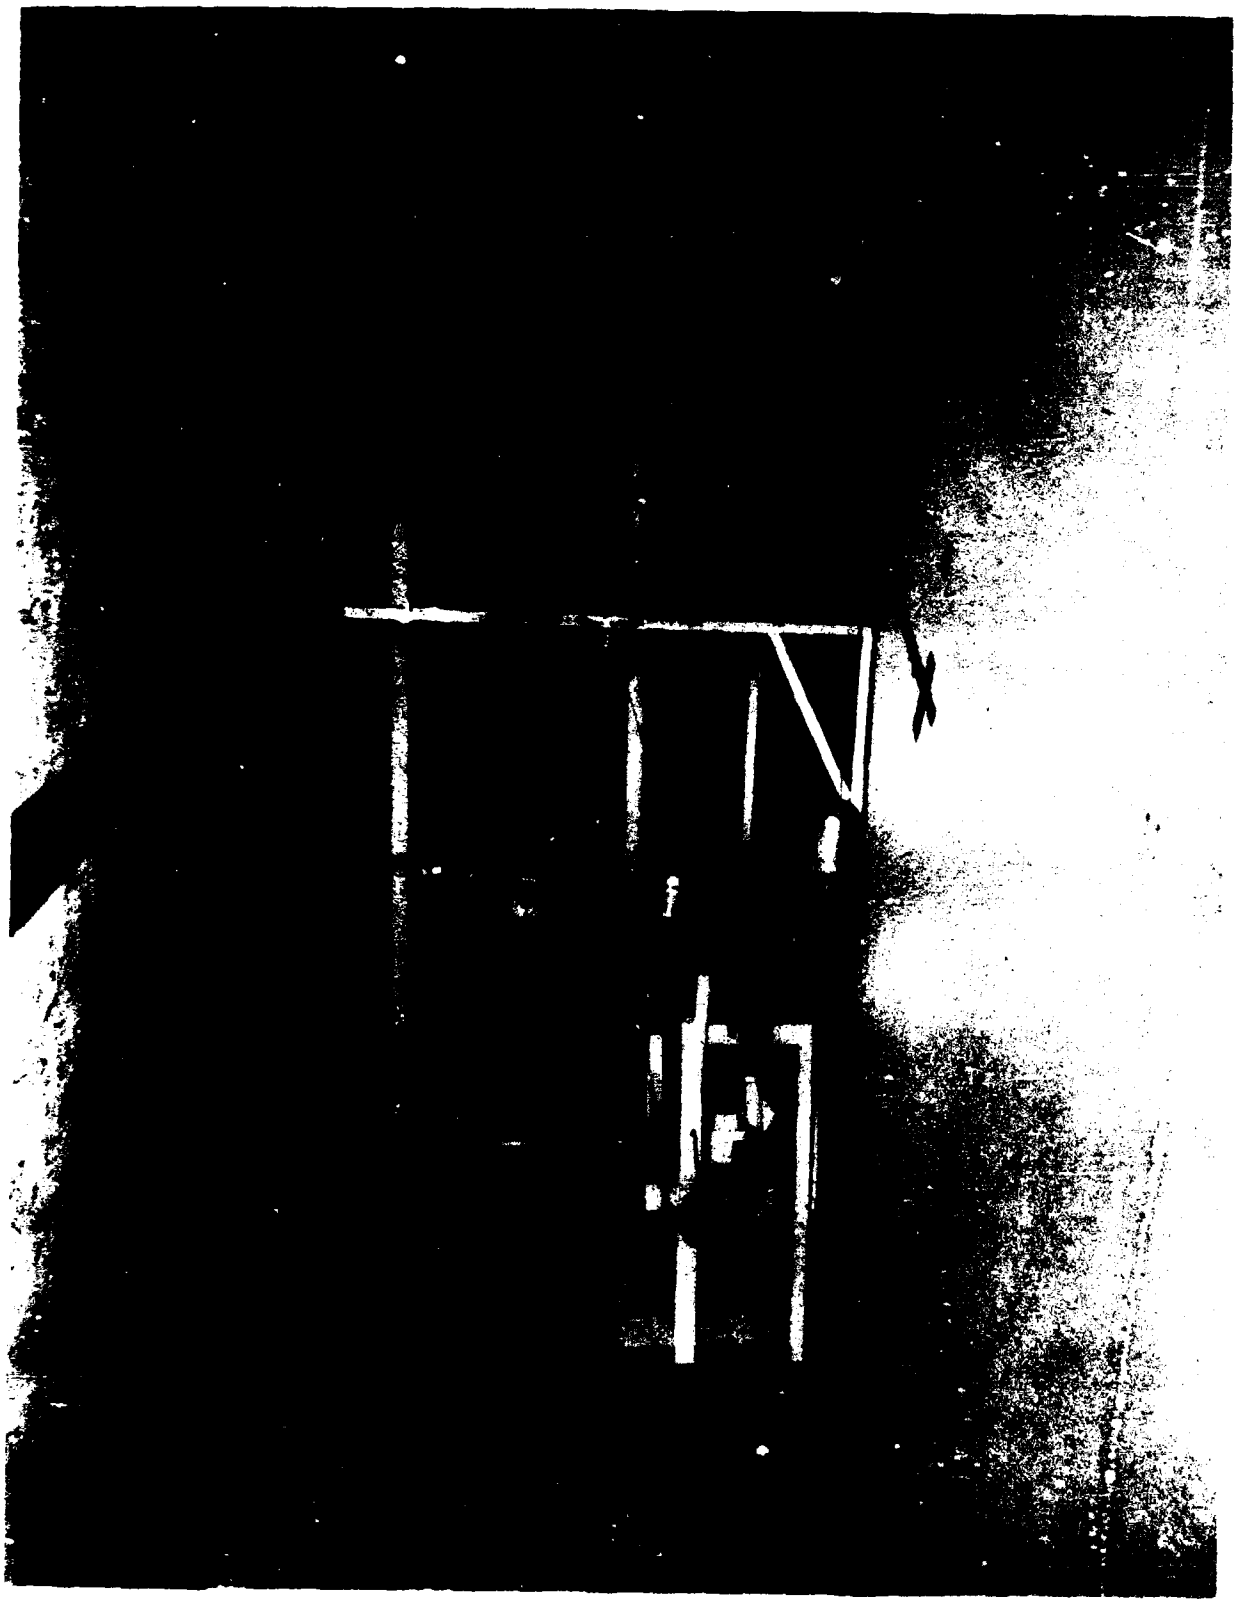

Photograph No. 6. Installation of PVK as Seen From Plenum (Note dc motor drive to PVK)

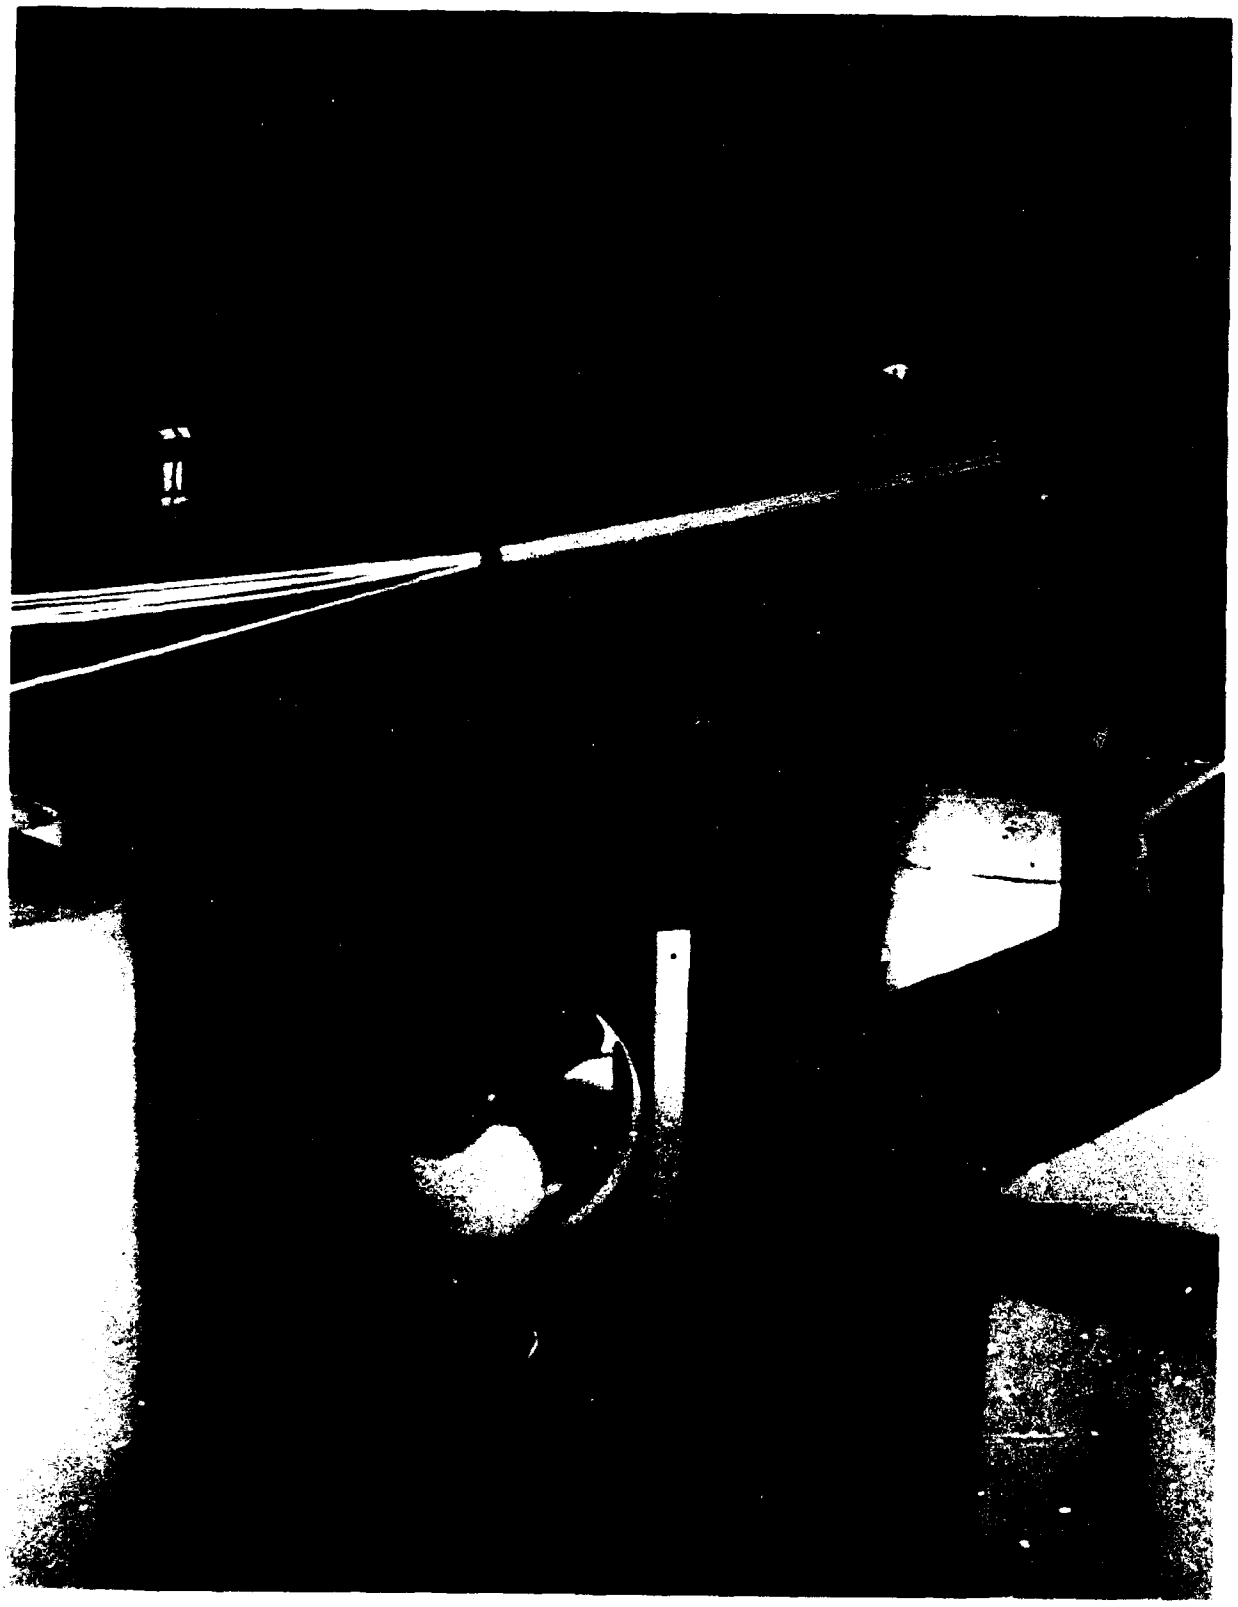

Photograph No. 7 . Adaptation of PVK as Supply Fan - Configuration 1-N (View from Room 2 facing East)

Punkah Pumps were evaluated, as devices to improve the ventilation patterns of the two side rooms, by comparing the environmental conditions which developed without the Punkahs with conditions after these devices had been in operation for several hours. The tests were made with identical shelter supply air rates and temperatures. The Punkah-pump, a recent invention based on an ancient air fanning device, consists of a pendulum-like frame covered with light vanes hinged so that when the frame swings in one direction the vanes open and offer little resistance to the air passing through the frames. During the swing in the opposite direction, or "power" stroke, the vanes swing shut, the frame now offers the resistance of an essentially solid panel to air flow, hence it moves a volume of air ahead of it, while a commensurate volume moves in behind the Punkah to prevent a vacuum from forming. Since the air in motion has inertia, the Punkah on the next "return" stroke with its vanes open, swings through the moving air without appreciably impeding its established flow. Thus uni-directional, albeit pulsing, air flow is established.

When installed in a doorway, the Punkah is capable of moving air between rooms, the effect of which may be to improve environmental conditions in a previously poorly ventilated area. Although additional improvement in ventilation patterns might have been accomplished by installing the Punkah in the bottom half of the doorways, the necessity of frequent access to the side rooms dictated its use in the upper half of the doorways of Rooms 3 and 4. Photograph 8 shows the variable-speed drive mechanism employed to drive the two Punkahs in simulation of the expected manual operation. The "power" and "return" strokes of the device may be seen in Photographs 9 and 10.

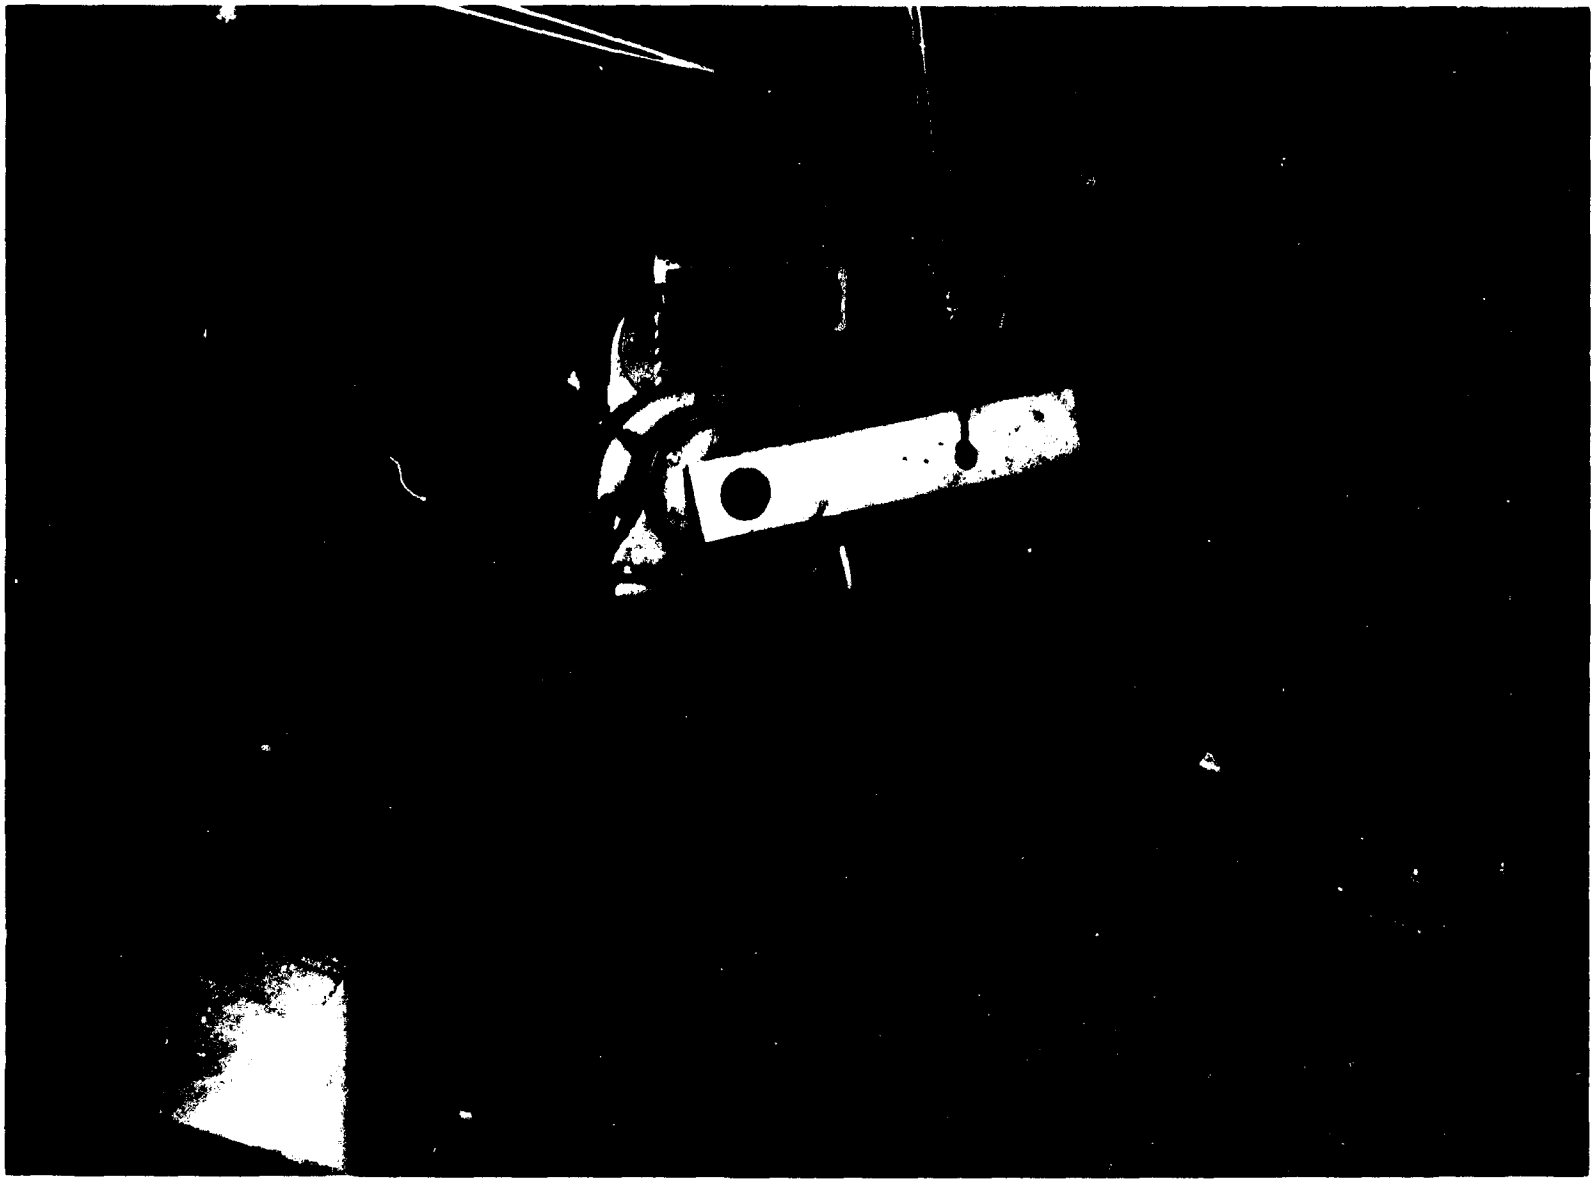

Photograph No. 8 . Variable Speed Drive Unit Used to Actuate Punkah Pumps

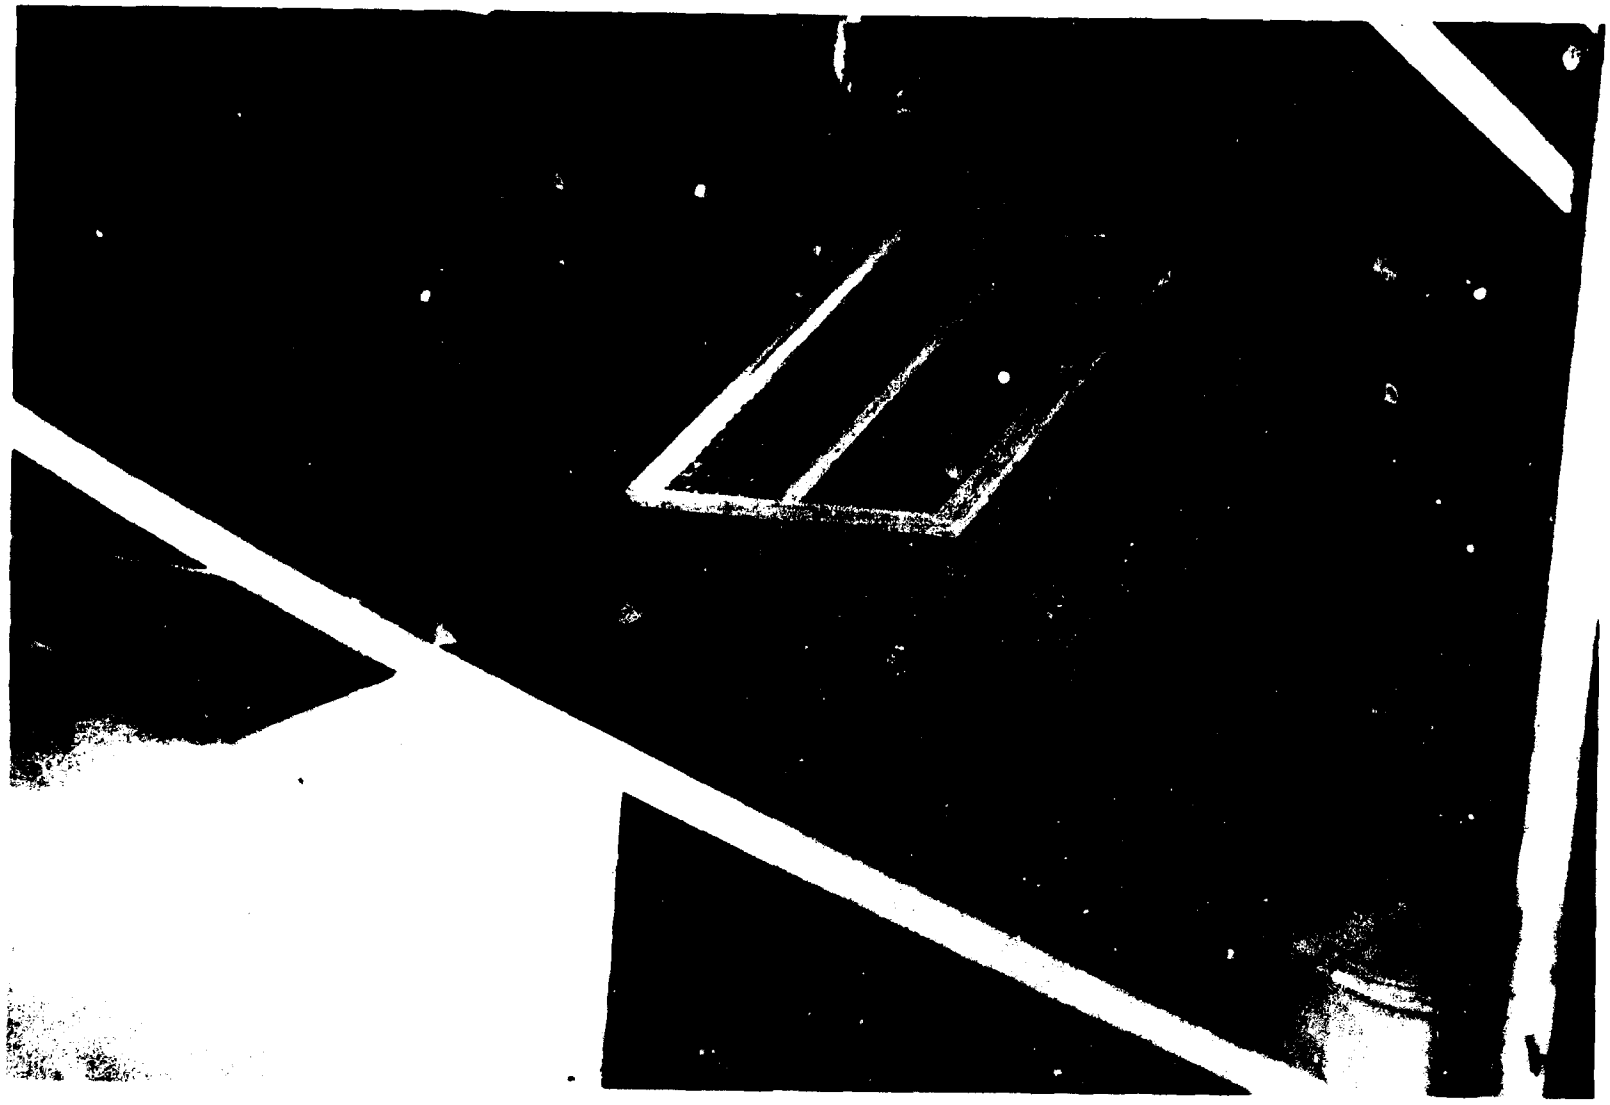

Photograph No. 9 . Operation of Punkah Pump Immediately Prior to "Power" Stroke (Note: punkah flaps are about to close)

Photograph No. 10. Operation of Punkahs Pumps During "Return" Stroke (Note "Opened" Position of Punkah Flaps)

Instrumentation

Conduct of a simulated occupancy test of a shelter area required measurement and control of the mass and energy streams to and from the shelter as well as sufficient determinations of environmental parameters to establish the thermal response of the test area.

The general instrumentation layout is shown schematically on Figure 6; functions and more exact locations of instruments are presented in Tables III and IV. A brief discussion of the variables measured and the equipment used follows.

Temperatures were generally measured with copper-constantan thermocouples, indicated and recorded on multi-point, recording potentiometers. Forty thermocouples were placed at a number of locations in contact with interior and exterior wall surfaces, to measure temperature drops across the walls for use in controlling the environment exterior to the shelter. Within the shelter proper, vertical arrays of thermocouples located as shown on Figure 6 were used to determine the degree of temperature stratification. Wet and dry bulb temperatures of the supply and exhaust air were taken with thermocouples embodied in aspirating psychrometers. Locations of these instruments varied with the ventilation configuration being studied.

Air Flow to the shelter was determined by means of a multi-point velocity traverse of the supply duct using an Alnor, direct displacement, vane-type anemometer.

Humidity of the air at numerous locations within the shelter was measured with "Hygrosensors", humidity sensing devices manufactured by the Hygrodynamics Corp. of Silver Spring, Maryland. These devices also incorporated a resistance thermometer, and in operation the indicated relative humidity and temperature were used as entries to psychrometric charts from which wet bulb temperature was determined. This provided data sheet entries of dry and wet bulb temperatures suitable for an established routine from which effective temperatures could be computed.

At selected times, rather extensive psychrometric "traverses" were made of the entire shelter using Bendix, electrically aspirated, mercurial thermometer, psychrometers. Two operators usually performed this task, taking readings on four foot centers throughout the shelter alternately at 5' above the floor and at 1' above the floor.

Water Flow to the "Simocs" was regulated as described in the section entitled "Simulated Occupants" and was measured by periodic readings of calibrated sight glasses on separate supply tanks for each room.

Power consumed was determined by a three phase, network type watt-hour meter which could measure both 208 volt and 120 volt demands. Except for the direct current motor driving the shelter ventilation fan, and the motor which drove the "Punkahs", when these devices were in use, all power consuming devices were supplied through the watt-hour meter.

FIG. NO. 6 EQUIPMENT DIAGRAM
ADIABATIC SIMULATED PROTECTIVE SHELTER
FORT BELVOIR, VIRGINIA

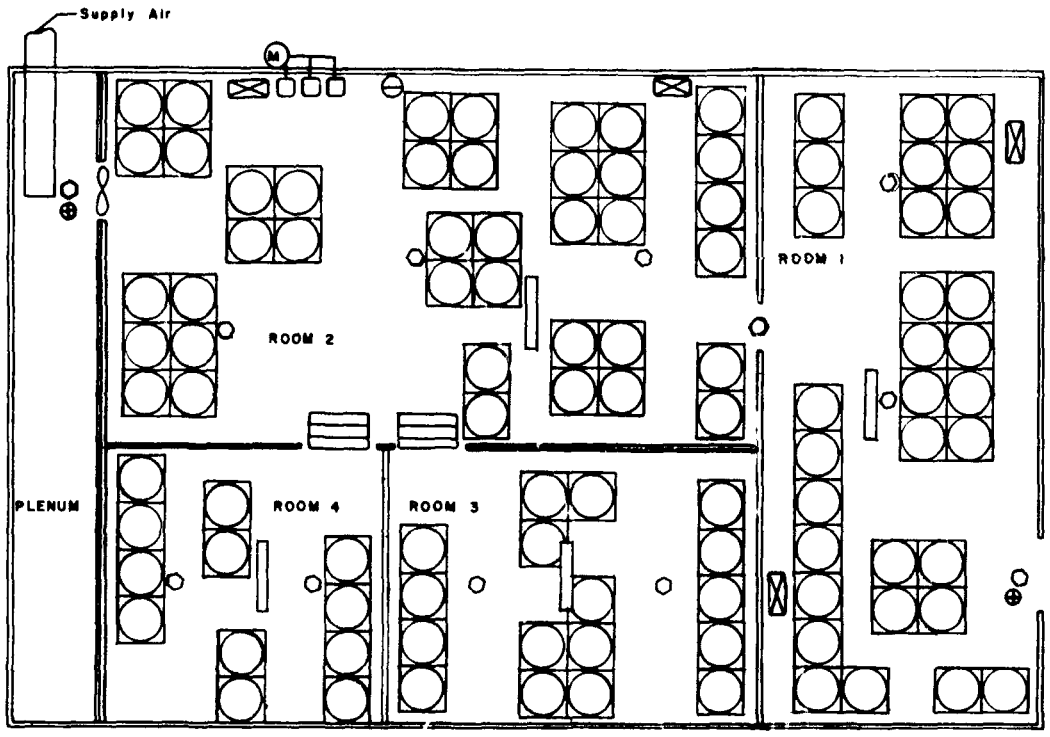

Note 1: For other than Basic Configuration, see Figure 3.

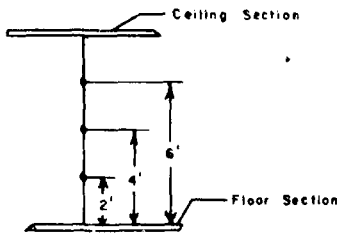

TYPICAL VERTICAL THERMOCOUPLE ARRAY
(Located at Geometric Center of Each Room)

LEGEND

- Simoc
- Water Pump
- Variac
- Hygrosensor
- 40 Watt Flourescent
- KWH Meter
- Punkah Motor
- Fan (PVK)
- Aspirating Psychrometer
- Punkah

ENG-18-020-65-59
JULY, 1965

TABLE III
Hygrosensor Locations
Adiabatic Simulated Protective Shelter
Protective Structures Development Center
Fort Belvoir, Virginia

Data Position Number*	Hygrosensor Head Number	Function**	Location
1	1	Exhaust air, dry bulb	Depends on test configuration number***
2	1	Exhaust air, wet bulb	Depends on test configuration number***
3	2	Air temperature, dry bulb	Geometric Center, Room 1
4	2	Air temperature, wet bulb	Geometric Center, Room 1
5	3	Air temperature, dry bulb	Geometric Center of South third of Room 1
6	3	Air temperature, wet bulb	Geometric Center of South third of Room 1
7	4	Air temperature, dry bulb	Geometric Center of West third of Room 2
8	4	Air temperature, wet bulb	Geometric Center of West third of Room 2
9	5	Air temperature, dry bulb	Geometric Center, Room 2
10	5	Air temperature, wet bulb	Geometric Center, Room 2
11	6	Air temperature, dry bulb	Mid height, North section of East third of Room 2
12	6	Air temperature, wet bulb	Mid height, North section of East third of Room 2
13	7	Supply air, dry bulb	Depends on test configuration number***
14	7	Supply air, wet bulb	Depends on test configuration number***

TABLE III, CONTINUED

Data Position Number*	Hygrosensor Head Number	Function**	Location
15	8	Air temperature, dry bulb	Geometric Center of West half of Room 3
16	8	Air temperature, wet bulb	Geometric Center of West half of Room 3
17	9	Air temperature, dry bulb	Geometric Center of East half of Room 3
18	9	Air temperature, wet bulb	Geometric Center of East half of Room 3
19	10	Air temperature, dry bulb	Geometric Center of East half of Room 4
20	10	Air temperature, wet bulb	Geometric Center of East half of Room 4
21	11	Air temperature, dry bulb	Geometric Center of West half of Room 4
22	11	Air temperature, wet bulb	Geometric Center of West half of Room 4
23	12	Air temperature, dry bulb	Mid height doorway, Room 1 to Room 2
24	12	Air temperature, wet bulb	Mid height doorway, Room 1 to Room 2

* Position number corresponds to tabulated temperature data in APPENDIX B-2

** Wet bulb functions were derived from psychrometric chart using dry bulb temperature and relative humidity values obtained from each Hygrosensor head.

*** See "Results" section of each configuration for exact location of supply and exhaust.

TABLE IV
Thermocouple Locations
Adiabatic Simulated Protective Shelter
Protective Structures Development Center
Fort Belvoir, Virginia

Data Position Number*	Function	Location
25	Supply air, dry bulb	Depends on test configuration number**
26	Supply air, wet bulb	Depends on test configuration number**
27	Exhaust air, dry bulb	Depends on test configuration number**
28	Exhaust air, wet bulb	Depends on test configuration number**
29	Ambient air, dry bulb	Not taken
30	Ambient air, wet bulb	Not taken
31	Air temperature, Room array	Center of Room 1, 2 feet above floor
32	Air temperature, Room array	Center of Room 1, 4 feet above floor
33	Air temperature, Room array	Center of Room 1, 6 feet above floor
34	Air temperature, Room array	Center of Room 2, 2 feet above floor
35	Air temperature, Room array	Center of Room 2, 4 feet above floor
36	Air temperature, Room array	Center of Room 2, 6 feet above floor
37	Air temperature, Room array	Center of Room 3, 2 feet above floor
38	Air temperature, Room array	Center of Room 3, 4 feet above floor
39	Air temperature, Room array	Center of Room 3, 6 feet above floor
40	Air temperature, Room array	Center of Room 4, 2 feet above floor

TABLE IV, CONTINUED

Data Position Number*	Function	Location
41	Air temperature, Room array	Center of Room 4, 4 feet above floor
42	Air temperature, Room array	Center of Room 4, 6 feet above floor
43	Surface temperature	In contact with top surface of floor insulation, Geometric Center of Room 1
44	Below floor level temperature	In contact with bottom surface of insulation, 2 inches below floor level, Geometric Center of Room 1
45	Surface temperature	In contact with top surface of floor insulation, Geometric Center of Room 2
46	Below floor level temperature	In contact with bottom surface of insulation, 2 inches below floor level, Geometric Center of Room 2
47	Exhaust temperature, dry bulb	Center of 20 inch plastic duct prior to exit from shelter
48	Reference, water bath	Environmental Control Trailer, instrumentation cab
49	Reference, water bath***	Environmental Control Trailer, instrumentation cab

* Position numbers correspond to tabulated temperature data in APPENDIX B.

** See "Results" section or Figure Number 3 for exact location of supply and exhaust.

*** Temperature of water bath as indicated on mercurial thermometer. (Same location as position No. 48).

OPERATIONAL PROCEDURES

The conduct of the air distribution studies herein reported comprised two types of shelter response tests each repeated a number of times at different selected values of some important parameter. These were the steady-state, and the diurnal cycle tests. In addition, there were a number of adjunct tests which were made with less regularity. In order that some familiarity be gained with the sequence and frequency of typical measurements, a brief outline of the major operational procedures follows.

The Diurnal Test comprised a period of from 48 to 120 hours during which the shelter was furnished with an air supply whose dry bulb temperature and dew point were varied in simulation of the ambient conditions that would be expected in the shelter vicinity during very warm summer weather. The way in which these supply air conditions were arrived at is discussed in a subsection entitled "Condition of the Ventilation Air". An air flow rate, which calculations indicated should result in an overall shelter effective temperature of either a maximum or an average of 85 F, was selected. The air flow rate was set in the supply duct to the shelter and measured by a 16 point velocity traverse using a vane-type direct displacement anemometer. The air flow was subsequently checked once during each twenty-four hour period, or oftener if there was reason to suspect that it might have been altered.

An initial setting was made of the timing devices of the water measuring and distributing mechanisms, in accordance with the values of Table I and the dry bulb temperature then existing in each room of the shelter. Subsequently, the water level was measured in the tank supplying water to each room, at two hour intervals and compared with the desired rate determined from the values of Table I in accordance with the dry bulb temperature in the space at a time halfway between tank level readings. An appropriate change was made in the timer cycle to increase or decrease the water rate to follow the cycling dry bulb temperatures in the four shelter rooms.

At two hour intervals, the shift operator would read and average a group of temperatures from forty thermocouples located in twenty pairs on inner and outer faces of the shelter structure. From these readings, he would establish an average ΔT from the interior to the exterior of the shelter. Using the controls of the building heating system, supplemented by an auxiliary, oil fired heater in the basement, the operator would adjust the temperature of the space surrounding the shelter to reduce the temperature drop across the shelter walls to a minimum.

At hourly intervals, the operator would read the dry bulb temperature and relative humidity indicated by 11 Hygrosensors located throughout the shelter as shown on Figure 6. Using a psychrometric chart, he would read the wet bulb temperatures determined by these values of temperature and relative humidity and record this data, which is presented in Table II, Appendix B. Additional data were automatically recorded each hour for temperatures measured at the locations shown on Figure 6.

The shift operator, assisted by supervisory personnel, maintained running plots of the environmental conditions as they developed within the shelter. These plots were valuable in detecting anomalies of shelter response which were usually found to be due to errors in procedure. At the end of about thirty-six hours, it was usually possible to begin comparisons of the then existing shelter conditions with those twenty-four hours earlier. When such comparisons indicated that a twenty-four hour cycle had been duplicated, it was assumed that the shelter had attained a stable equilibrium, and the diurnal test was terminated after the shelter had reached and passed the next afternoon peak effective temperatures. In general, the overall duration of such a test depended on the previous history of the shelter, being longer when a major change in ventilation rate or configuration was made.

It was customary during the conduct of a diurnal cycle test to make two detailed traverses of the shelter and determine wet and dry bulb temperatures on four foot centers throughout the entire structure. Usually two Bendix, aspirating psychrometers were employed with two operators making readings at alternate "low" (12 inches above the floor) and "high" points (60 inches above the floor). The locations at which "low" readings could be taken were usually dictated by the placement of Simocs, ductwork, or other equipment with the "high" locations being governed by the remaining points. The traverses were customarily made at the time when the shelter was experiencing maximum effective temperatures (usually about 1400 to 1500 hours) and again during the early morning hours when minimum conditions were prevalent.

The Steady-State Tests were conducted in much the same manner as the diurnal cycle, except that as its name implies, the properties of the ventilation air were held constant until the shelter reached a stable equilibrium. This usually occurred in from eight to sixteen hours of operation.

Air Change and Air Exchange Measurements were considered of importance in evaluating the thermal response of the compartmented simulated shelter as a whole, and as individual rooms. Similarly, the air exchange across the doorways of Rooms 3 and 4, where bi-directional air flow existed, was considered of significance. For this reason, attempts were made to determine the various flows by the three independent methods; direct velocity measurement, heat balance, and tracer gas to be described. It must be emphasized at the outset, that only at the shelter air inlet and shelter exhaust could air flows be measured without ambiguity; at any interior location, determinations were complicated by streams of recirculating air whose presence could be demonstrated, but whose penetration into the particular volume under study could only be estimated. Even for the rooms where the air entered or exited, the term "air change per unit time" must be interpreted with caution. As an example, for Ventilation Configuration Number I, and for a shelter ventilation rate of 18 cfm per occupant, the air changes per hour were 33.8 for Room 2 and 45.0 for Room 1, yet for this configuration and air flow, the effective temperature in Room 1 was always higher than for Room 2, this of course because the air moved through Room 2 first in this configuration.

Direct velocity measurements were attempted in the doorways between Room 2 and Rooms 3, 4, and 1, utilizing both hot wire anemometers developed by the Flow Corporation, and a vane-type, direct displacement meter of

the Alnor, Corporation. Neither instrument was found to be entirely satisfactory in application. When used on a scale low enough to give definite indications, the random air currents were sufficient to drive meter needles off scale in both directions. Only extended periods of observation permitted the operator to mentally integrate the readings. Nevertheless, it was usually possible to establish that bi-directional flow existed in the doorways to Rooms 3 and 4, and uni-directional flow was present in the doorway between Rooms 1 and 2.

Velocity measurements were also made throughout the shelter, together with simultaneous emission of smoke puffs as shown in Photograph 11.

An attempt was made to make similar traverse of the shelter using a narrow-range humidity sensing instrument, but the response time of the instrument, when moved from a higher to a lower relative humidity region, was prohibitively long.

Heat balances were also attempted as a means of estimating the flow of air to the two interior rooms. In this method of measurement, advantage was taken of the fact that heat transmission losses from these rooms were greatly reduced by the insulation employed on the floor and ceiling, as well as on the exterior walls. A correction for the losses actually present could be made based on the known temperature drop across the room boundaries. The heat release within the room was known from watt-hour meter readings made at intervals throughout the test period. A measurement of relative humidity and temperature by a Hygrosensor (see section on Instrumentation) located near the center of the space in question permitted on estimate to be made of the enthalpy of the air within the room. Psychrometric measurements made in the doorway gave data from which the enthalpy of the entering (or leaving) air could be determined. From the known heat release and the enthalpy increase of the ventilation stream, the mass flow rate of the stream could be determined. In the determination of the "average" inlet or exhaust enthalpy, measurements indicated that properties of the air varied over the area of the doorway in much the same manner as had been found for the velocity determinations.

Photograph No. 11. The Application of "Smoke" Generation to Determine Air Currents

Tracer gas techniques were also employed to gain some insight as to air change phenomena. In this method of measurement, a room to be tested was first charged with CO_2 gas (added by means of a tube discharging in the center of the room), until a CO_2 analyzer indicated that a desired concentration of gas had been built up. The supply of CO_2 gas was shut off and continuous measurements made of the decreasing concentration of tracer gas in the test area. Assuming complete mixing of the ventilation air and that present in the room, the concentration of the tracer gas during the decay period is given by:

$$-V \frac{dC}{dt} = QC$$

Where:

C = Concentration of tracer at time t

Q = Ventilation rate to room

V = Volume of room

For initial conditions, $C = C_o$ and t = o, the solution is:

$$C = C_o e^{\frac{-Qt}{V}} = C_o e^{-nt}$$

From which:

$$LnC = LnC_o - nt$$

From a plot of the logarithm of percent concentration versus time, the slope of the decay curve could be determined as a measure of the number of air changes per unit time. A typical decay curve on semi-log coordinates is shown on Figure 7 which follows, for a test of Room 3. From this curve, an air change rate, "n" of 0.13 per minute is obtained. Considering the free volume of Room 3, 1413 cubic feet, it can be seen that an air flow through the door, of $(n)(V_3)$, or 184 cubic feet per minute, occurred. Since the number of occupants in Room 3 is 19, a per capita ventilation rate of 9.8 cfm is inferred.

A complication exists however. The differential equation whose solution is graphically represented by the plot of log concentration versus time, was derived on the assumption that the space under test, having once been charged with the tracer gas, is subsequently ventilated with air which is free of the tracer gas. Such is not the case in the simulated shelter, especially at the lower shelter supply air flow rates where mixing of the inlet and outlet ventilation air streams may occur near the doors to the side rooms. For this reason, it was deemed necessary to determine factors with which to correct the tracer gas air exchange measurements.

Lacking a second carbon dioxide gas analyzer, tests were conducted in which timed samples were taken of the ventilation air supply <u>to</u> the room under test at the same time that the CO_2 analyzer was continuously monitoring the gas concentration <u>in</u> the room. This latter was assumed, and later shown, to represent also the CO_2 concentration in the room exhaust air stream. At the end of the determination, the samples of supply air to the

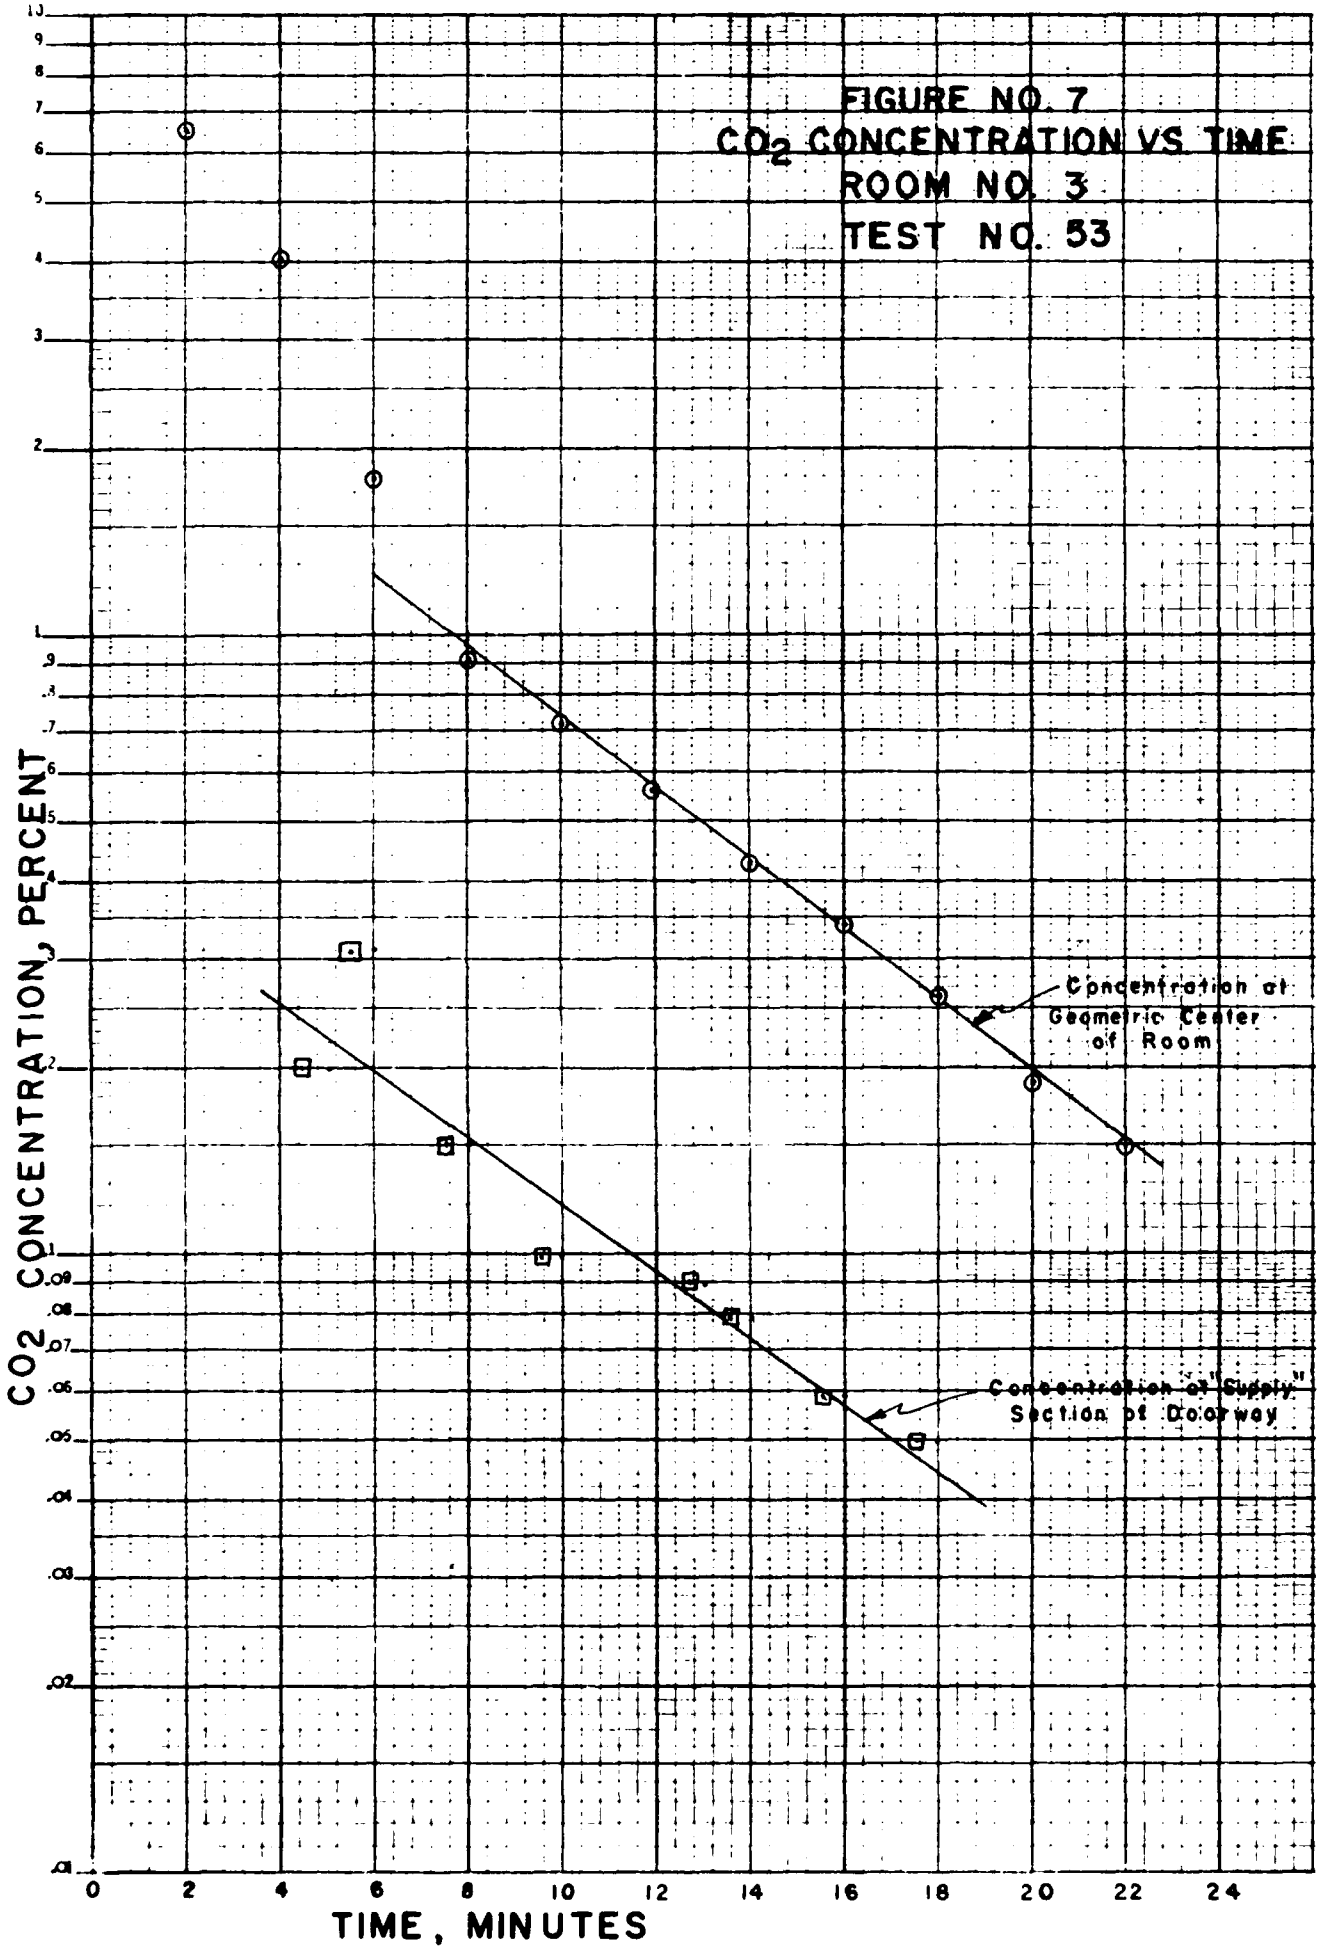
FIGURE NO. 7
CO_2 CONCENTRATION VS. TIME
ROOM NO. 3
TEST NO. 53
Concentration at Geometric Center of Room
Concentration at "Supply" Section of Doorway
CO_2 CONCENTRATION, PERCENT
TIME, MINUTES
0
2
4
6
8
10
12
14
16
18
20
22
24

room were successively analyzed to determine their carbon dioxide gas content. A separate determination had been made to ascertain the sampling lag and the time constant of the CO_2 analyzer and with this information, the concentration of CO_2 gas in the supply air stream could be placed in the correct time relationship with that of the exhaust stream. A typical set of measurements is shown in corrected time relationship as the lower curve of Figure 7.

Mathematically, the contamination of the supply air stream with the tracer gas can be taken into account by dividing the number of air changes per unit time by unity less the ratio of CO_2 concentration in supply air, to CO_2 concentration in room (exhaust) air or $(1 - C_{inlet}/C_{exhaust})$. This operates to increase the apparent ventilation rate by a factor which was found to vary from 1.4 for low shelter supply air flow rates to 1.17 for the highest rate of 25 cfm per occupant. In other words, the uncorrected value of air changes per unit time is in reality a measure of the "pure air" exchange with the room, "pure" in the sense that it had never been contaminated with the tracer gas. The corrected value of air changes takes into account the fact that other than "pure air" was also entering the side room, i.e., air that already contained some CO_2 and hence by inference, already contained some of the heat and moisture released by the occupants of the side rooms. For the example shown on Figure 7, the ratio $C_{inlet}/C_{exhaust}$ is 0.16, the corrected value of ventilation is 184/0.84 or 219 cubic feet per minute.

Still another complicating factor needed to be taken into account. There was no assurance that all of the air (CO_2 contaminated and CO_2 free) which entered the doorway of the side room as an inlet air current, actually penetrated into this room and took some part in its ventilation. The possibility existed that some of this stream exited almost immediately, having entered the room only a short distance. This possibility was tested in experiments in which timed samples were taken at both the lower (inlet) and upper (outlet) areas of the doors to Rooms 3 and 4. Subsequent analysis of these samples and comparison with continuous data from the center of the room indicated that during periods of natural ventilation, (i.e., Punkahs not in operation) the exhaust air had essentially the same gas concentration as that of the air in the center of the room indicating that all of the supply air stream had penetrated well into the room and taken some part in its ventilation. Had there been significant short circuiting of this air stream, the exhaust samples would have been measureably diluted as compared to the room air CO_2 concentration. A line, indicating the concentrations of the exhaust samples is shown on Figure 8, and can be seen to be almost coincident with the room decay curve.

When Punkahs were employed, there was apparent short circuiting of the inlet air to the outlet stream. There was a strong velocity component down and along the Punkah on the power stroke which mixed air from the upper portion of the doorway with the flow into the room near the floor. For this reason, the tracer gas technique is not regarded as reliable when attempted at times when the Punkahs were in operation. Further, there was extensive mixing of inlet and exhaust air just outside the doorways of Rooms 3 and 4 leading to correction values for air changes of the order of 0.6 to 0.2; i.e., the observed ventilation rates should have been multiplied by 1.7 to 5 respectively. Under such conditions, the accuracy of the tracer gas technique is open to serious question.

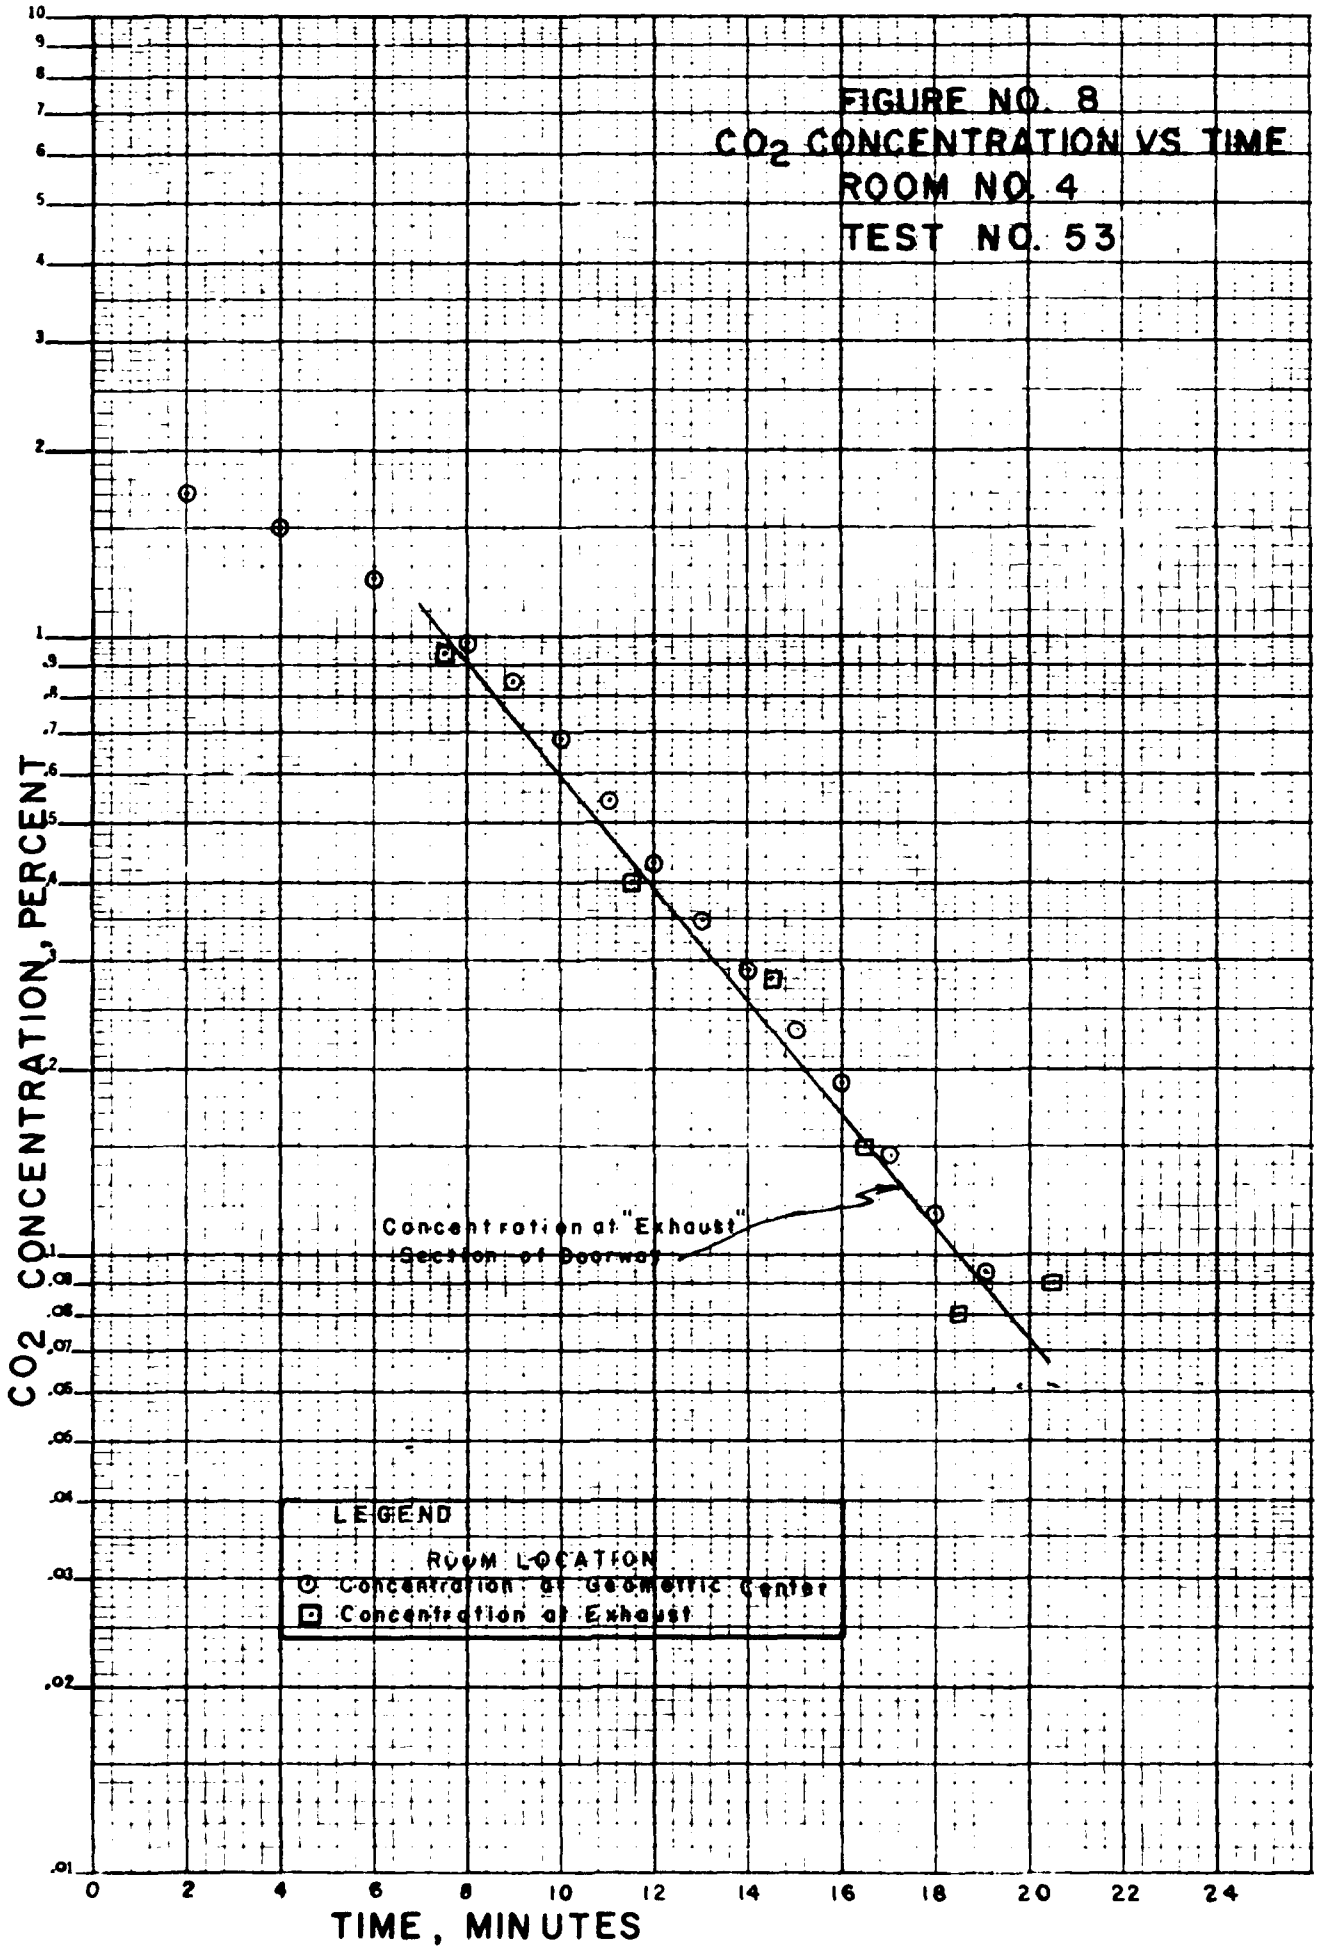
FIGURE NO. 8
CO_2 CONCENTRATION VS TIME
ROOM NO. 4
TEST NO. 53
CO_2 CONCENTRATION, PERCENT
TIME, MINUTES
Concentration at "Exhaust" Section of Doorway
LEGEND
ROOM LOCATION
Concentration at Geometric Center
Concentration at Exhaust

DISCUSSION AND RESULTS

The results obtained during the ventilation studies of the adiabatic simulated compartmented shelter are presented in the figures and tables which follow, together with some comments as to their significance. The overall arrangement of this material is as follows: Environmental Responses to Steady-State and Diurnal Tests, Steady-State Responses of Side Rooms, Air Flow Patterns, Shelter Micro-Environmental Patterns, Tracer Gas Measurements, and the Package Ventilation Kit. Detailed data on which the following curves and plots are based are contained in Appendix B. An Index to Shelter Configurations and Test Numbers is given by Table V.

Environmental Responses to Steady-State and Diurnal Tests are presented chronologically on the six sections of Figure 9, together with the supply conditions which brought about these responses. The response of the shelter during each of the 65 tests depicted has been broken down to show the average environmental conditions existing in each shelter room, as determined from measurements of temperature-humidity sensing instruments. The number of instruments in each room and their location are shown on Figure 6, schematics of the Ventilation Configurations and their modifications are shown on Figure 3. An average shelter effective temperature may be obtained at any time by weighting the individual room average effective temperatures as follows, Room 1 - 35/112; Room 2 - 45/112; Room 3 - 19/112; Room 4 - 13/112.

In general, interpretation of Figure 9 should be based on examination of the last day of a diurnal and the last two to three hours of a steady-state test. If inspection of the plots of supply air conditions reveals a period when temperature control was faulty, this fact should be considered.

Evaluation of responses to Ventilation Configurations 1-N, and 1-P were conducted during the period April 22 - May 8 and also from June 12 through 15. The latter period should be referred to for a presentation of diurnal tests, the diurnal test first conducted (April 22-24) was plagued with start-up difficulties, and in addition, as explained in the section on EQUIPMENT, was conducted with a metabolic water evaporation rate based on the shelter average effective temperature, rather than with individual water rates to each room based on the temperature in that room. Control problems are evident from the supply air plots, and there was a shelter fan power failure on April 24.

The responses to the various steady-state tests may be interpreted more readily by noting that steady-state tests were conducted at maximum (93 F - Dry Bulb), average (84.6 F - Dry Bulb) and minimum (76 F - Dry Bulb) supply air conditions, with a constant dew point of 72 F. The nearly horizontal lines depicting these temperatures are apparent. Examination of the curves indicates that for maximum temperature supply air conditions, no air flow was adequate to make all shelter rooms habitable. At average supply air conditions, the highest air flow (22.5 cfm) was not adequate when natural ventilation was employed (Test 9) but was adequate when Punkahs were used (Test 21). With Punkahs, a flow rate of 18 cfm of air at average conditions was also adequate (Test 18). For supply air furnished at the minimum conditions, 18 cfm was adequate without Punkahs (Test 7) and 10.5 cfm with Punkahs (Test 22).

TABLE V
Index to Shelter Configuration and Test Numbers
Adiabatic Simulated Protective Shelter
P.S.D.C., Fort Belvoir, Virginia

Test Number	Configuration Number *	Shelter Ventilation Rate (CFM/Occupant)	Shelter Supply Condition **
1	1-N	13.5	Diurnal Cycle
2	1-N	13.5	Minimum
3	1-N	13.5	Average
4	1-N	13.5	Maximum
5	1-N	18.0	Maximum
6	1-N	18.0	Average
7	1-N	18.0	Minimum
8	1-N	22.5	Maximum
9	1-N	22.5	Average
10	1-N	23.0	Average
11	1-N	8.0	Minimum
12	1-N	10.5	Average
13	1-N	10.5	Minimum
14	1-P	10.5	Average
15	1-P	15.0	Average
16	1-P	13.5	Minimum
17	1-P	13.5	Maximum
18	1-P	18.0	Average
19	1-P	19.0	Minimum
20	1-P	22.5	Maximum
21	1-P	22.5	Average
22	1-P	10.5	Minimum
23	1-P	18.0	Maximum
24	2-N	13.5	Diurnal
25	2-N	13.5	Average

TABLE V, CONTINUED

Test Number	Configuration Number *	Shelter Ventilation Rate (CFM/Occupant)	Shelter Supply Condition **
26	2-N	13.5	Minimum
27	2-P	13.5	Minimum
28	2-P	13.5	Average
29	2-P	13.5	Maximum
30	2-N	13.5	Maximum
31	2-N	18.0	Maximum
32	2-P	18.0	Maximum
33	2-P	18.0	Average
34	2-N	18.0	Average
35	2-N	18.0	Minimum
36	2-P	18.0	Minimum
37	2-P	18.0	Average
38	2-P	10.5	Minimum
39	2-N	10.5	Minimum
40	2-N	10.5	Average
41	2-P	10.5	Average
42	2-P	8.0	Minimum
43	2-N	8.0	Minimum
44	2-N	22.1	Maximum
45	2-P	22.1	Maximum
46	2-N	25.0	Diurnal
47	2-B	25.0	Diurnal
48	2-PB	25.0	Diurnal
49	2-P	25.0	Diurnal
50	2-P	13.5	Diurnal

TABLE V, CONTINUED

Test Number	Configuration Number *	Shelter Ventilation Rate (CFM/Occupant)	Shelter Supply Condition **
51	2-N	22.5	Average
52	2-P	22.5	Average
53	1-N	25.0	Diurnal
54	1-N	8.0	Minimum
55	3-N	25.0	Diurnal
56	3-N	18.0	Average
57	3-N	18.0	Average
58	3-N	18.0	Minimum
59	3-N	10.5	Minimum
60	3-N	10.5	Average
61	3-N	13.5	Maximum
62	3-N	13.5	Average
63	3-N	13.5	Minimum
64	3-N	8.0	Minimum
65	3-N	13.5	Diurnal

* Configuration numbers correspond to shelter configurations as shown on Figure 3.

** For "Diurnal" entries the supply air conditions correspond to "high design" day temperatures as shown on Figure No. 1; for other entries the following conditions were supplied constantly: 1. Maximum - 93 F (Dry Bulb) and 72 F (Dew Point), 2. Average - 84.6 F (Dry Bulb) and 72 F (Dew Point), 3. Minimum - 76 F (Dry Bulb) and 72 F (Dew Point).

For succeeding portions of Figure 9, only the diurnal-cycle responses will be considered. For the steady-state data depicted, Figure 9 serves mainly as a chronological plot from which the location and validity of data used in the construction of other Figures may be determined.

During the evaluation of Ventilation Configuration 2, six diurnal-cycle tests were made, two at a shelter ventilation rate of 13.5 cfm per occupant which was estimated to produce an average shelter effective temperature of 85 F, and four at a ventilation rate of 25 cfm per occupant which was predicted to produce a maximum shelter effective temperature of 85 F. In the predictions of shelter response, it should be noted that only the overall shelter response could be estimated, the responses of the individual rooms which were to make up the shelter could be determined only by experiment.

When the shelter was ventilated at 13.5 cfm (Test 24) the average temperatures of the individual rooms were Room 1 - 85.7 F; Room 2 - 83.2 F; Room 3 - 86.6 F, and Room 4 - 85.0 F. For a criterion of 85.0 F average effective temperature, Rooms 1 and 3 would have been unuseable. The shelter average effective temperature was 84.7 F, close to the 85.0 F predicted. At 25 cfm per occupant (Test 46), Rooms 1, 3, and 4 show peak effective temperatures above 85 F. The employment of an air directing baffle (Test 47) actually made conditions worse in Rooms 3 and 4 for reasons to be discussed later. The employment of Punkahs and/or baffles in Tests 48 and 49 greatly improved environmental conditions in Rooms 3 and 4 without material change in Rooms 1 and 2. During these tests, Room 2 (which was the air inlet in this Configuration) was the only space which never exceeded an 85.0 F effective temperature, but the excess over 85.0 F for the other rooms was slight and for only a few hours at a time. However, a strict adherence to a maximum of 85.0 F effective temperature as a criterion would rule out all but Room 2 for extended occupancy. The increase in ventilation air which would be necessary to further reduce the shelter response cannot readily be estimated.

The diurnal response of the shelter to a ventilation test at 13.5 cfm per occupant while Punkahs were employed was investigated in Test 50. The average shelter effective temperature for a twenty-four hour period was 84.1 F, somewhat lower than the predicted value of 85.0. The 24 hour averages for the individual rooms were: Room 1 - 85.3; Room 2 - 82.6; Room 3 - 85.0; and Room 4 - 84.4. Thus, it is seen that almost the entire shelter is habitable if the criterion of 85.0 F average effective temperature is employed.

A diurnal test with Ventilation Configuration 1-N (without Punkahs) was conducted at 25 cfm per occupant as Test 53. For a criterion of maximum effective temperature of 85.0 F, Rooms 1, 3, 4 were all unuseable.

Two diurnal tests were conducted with Ventilation Configuration 3, one at 13.5 cfm per occupant to limit average response to 85 F, one at 25 cfm per occupant to limit maximum response to 85 F. In Test 55 (25 cfm), only Room 2 exceeded 85.0 F effective temperature, and this for seven of the 24 hours. In the 13.5 cfm Test No. 65 (13.5 cfm), the overall shelter average effective temperature was 83.9 F, while the individual rooms averaged as follows: Room 1 - 83.7; Room 2 - 85.7; Room 3 - 81.9; and Room 4 - 80.5. Only Room 2 exceeds the criterion of 85 F average effective temperature.

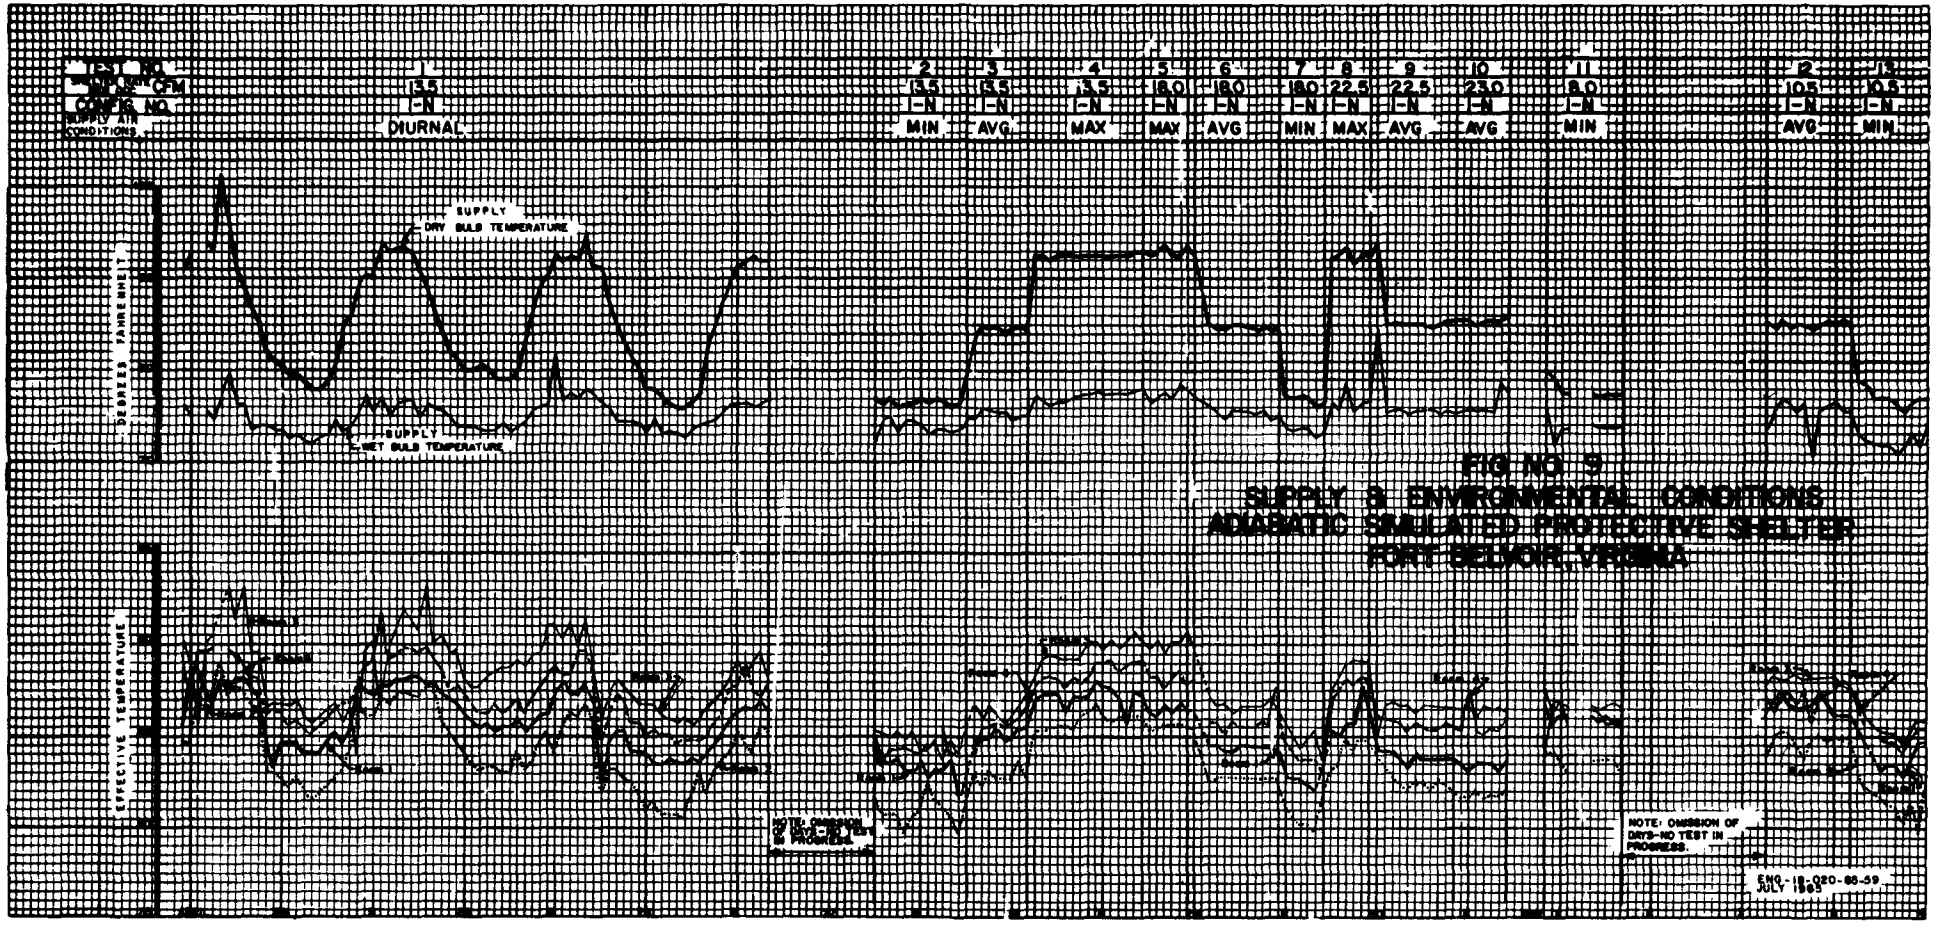

FIG NO. 9
SUPPLY & ENVIRONMENTAL CONDITIONS
ADIABATIC SIMULATED PROTECTIVE SHELTER
FORT BELVOIR, VIRGINIA

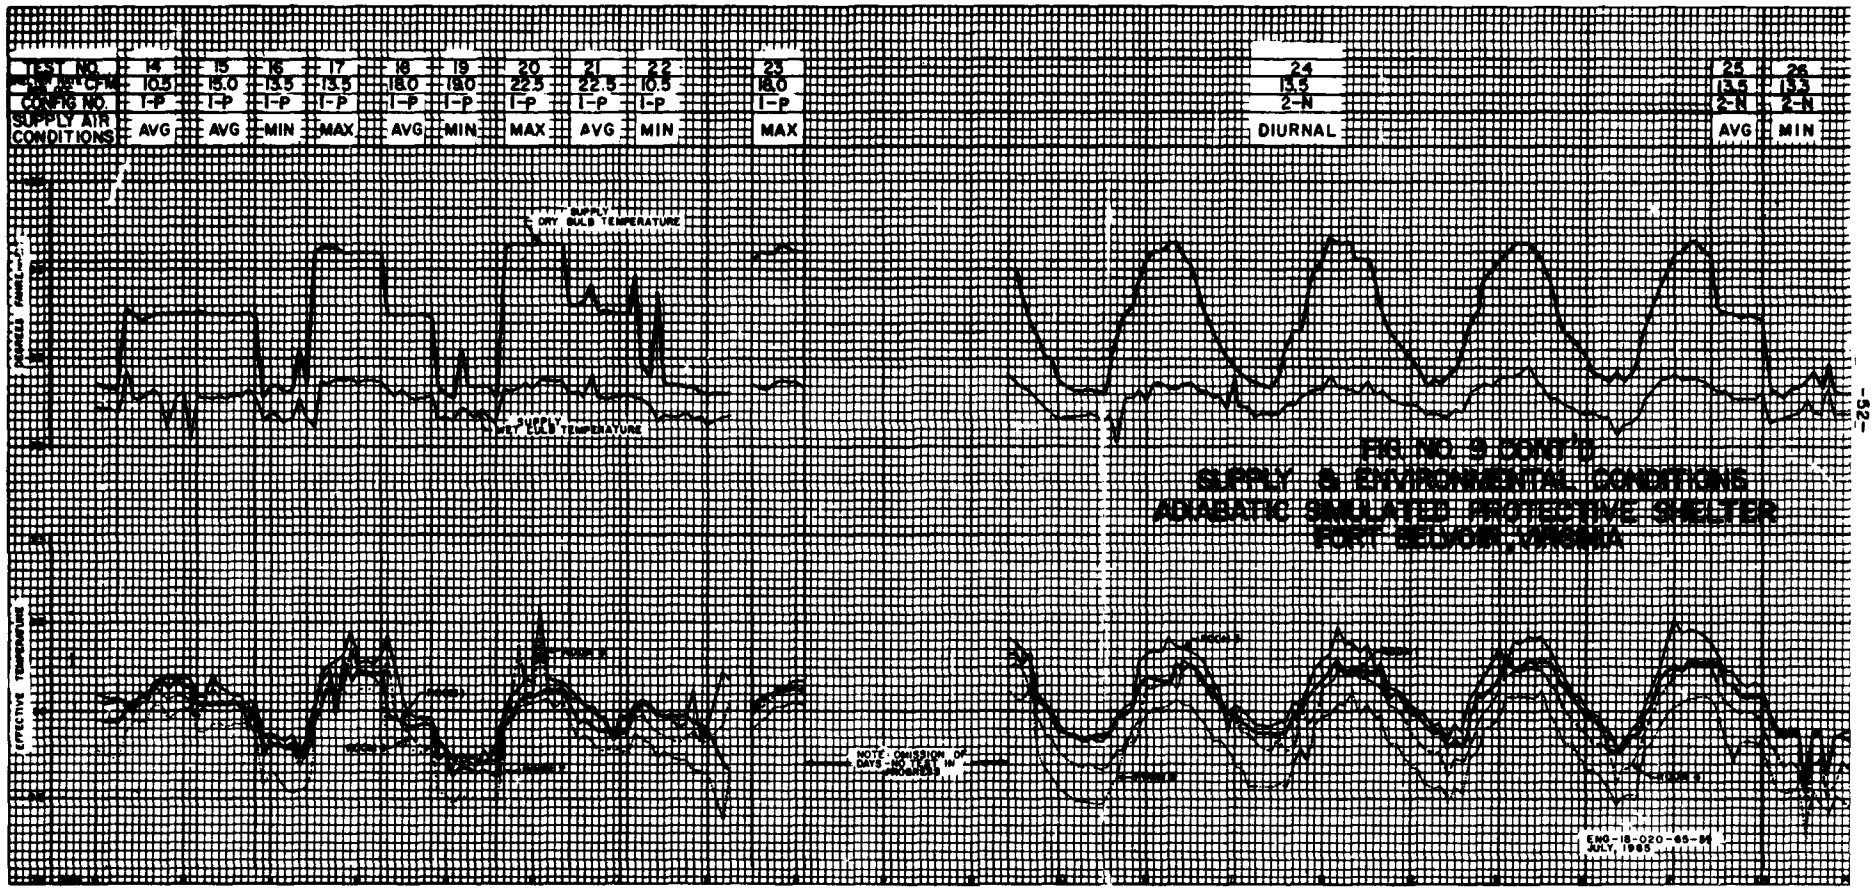

FIG. NO. 9 CONT'D.
SUPPLY & ENVIRONMENTAL CONDITIONS
ADIABATIC SIMULATED PROTECTIVE SHELTER
FORT BELVOIR, VIRGINIA

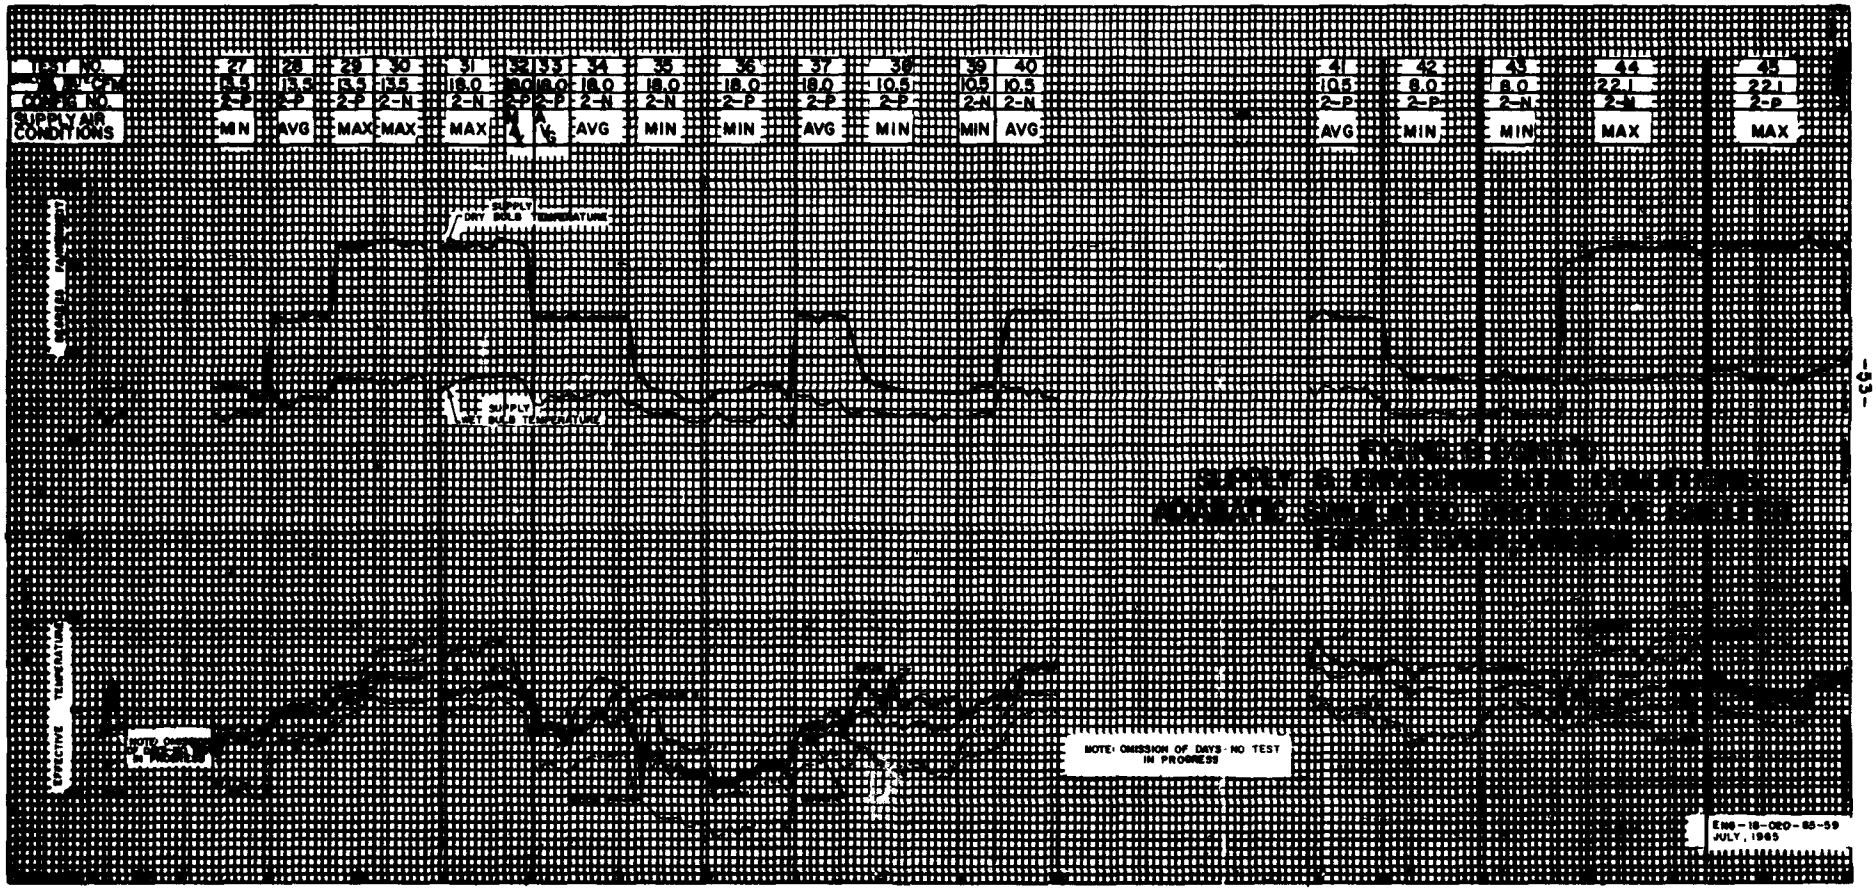
TEST NO.
27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45
13.5 13.5 13.5 13.5 18.0 18.0 18.0 18.0 18.0 18.0 18.0 10.5 10.5 10.5 10.5 8.0 8.0 22.1 22.1
2-P 2-P 2-P 2-N 2-N 2-P 2-P 2-N 2-N 2-P 2-P 2-P 2-N 2-N 2-P 2-P 2-N 2-N 2-P
SUPPLY AIR CONDITIONS
MIN AVG MAX MAX MAX AVG MIN MIN AVG MIN MIN AVG AVG MIN MIN MAX MAX
SUPPLY DRY BULB TEMPERATURE
SUPPLY WET BULB TEMPERATURE
EFFECTIVE TEMPERATURE
NOTE: OMISSION OF DAYS - NO TEST IN PROGRESS
EMB-18-020-65-59
JULY, 1965

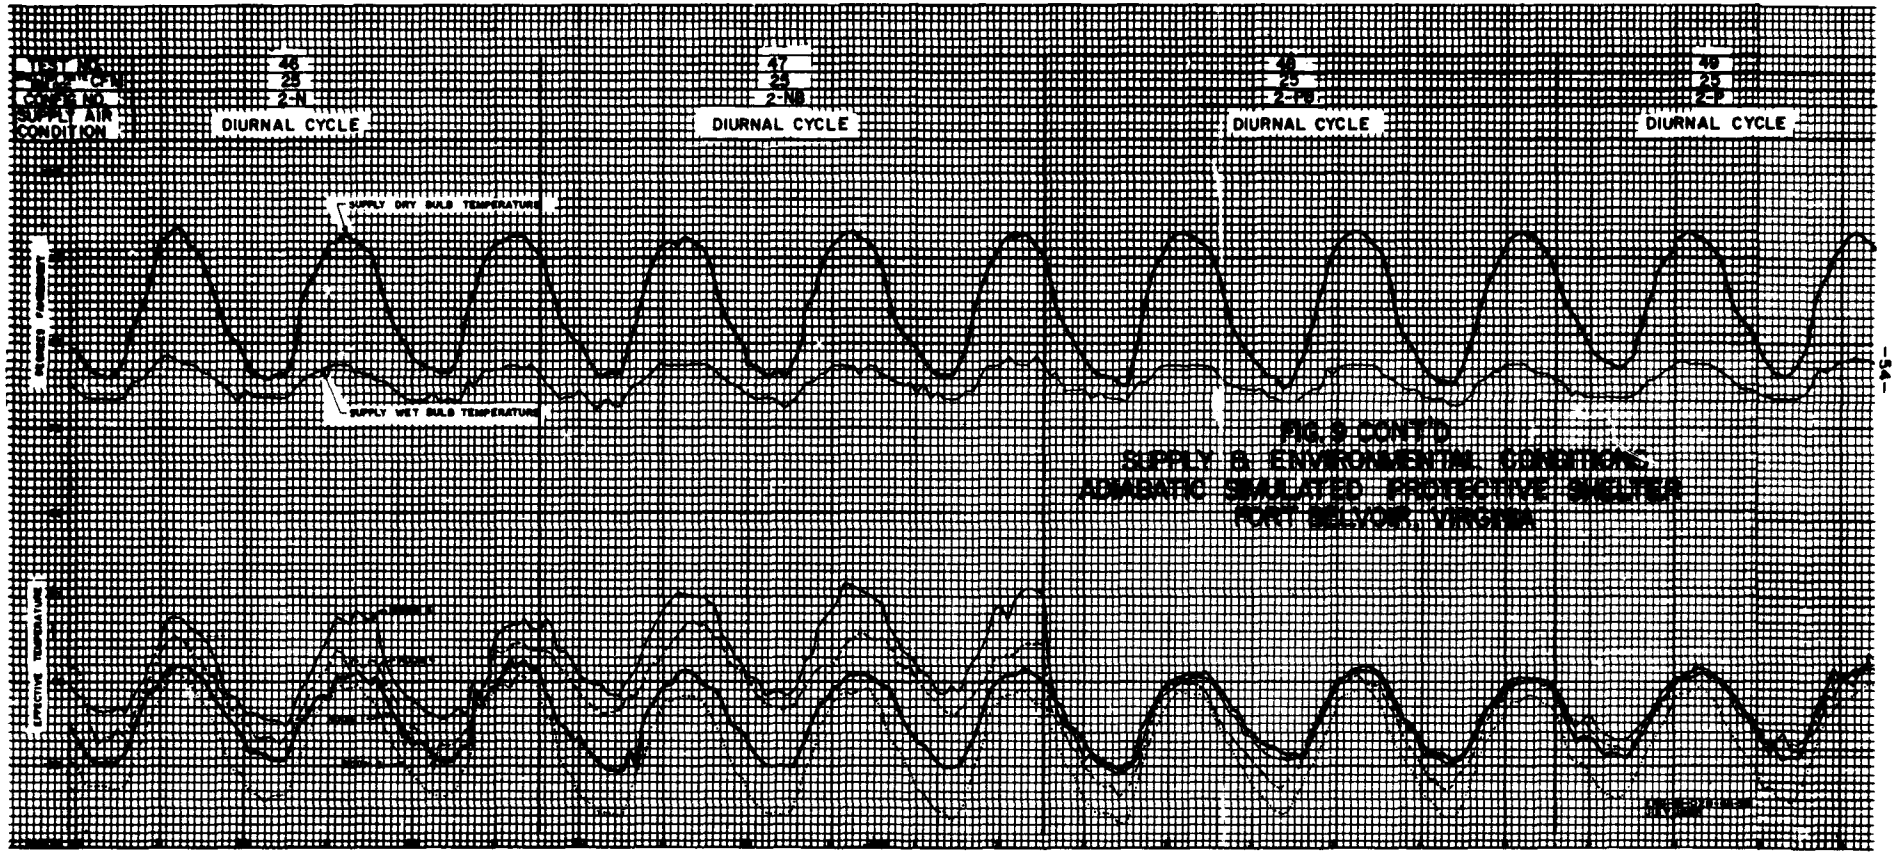

FIG. 9 CONT'D
SUPPLY & ENVIRONMENTAL CONDITIONS
ADIABATIC SIMULATED PROTECTIVE SHELTER
FORT BELVOIR, VIRGINIA

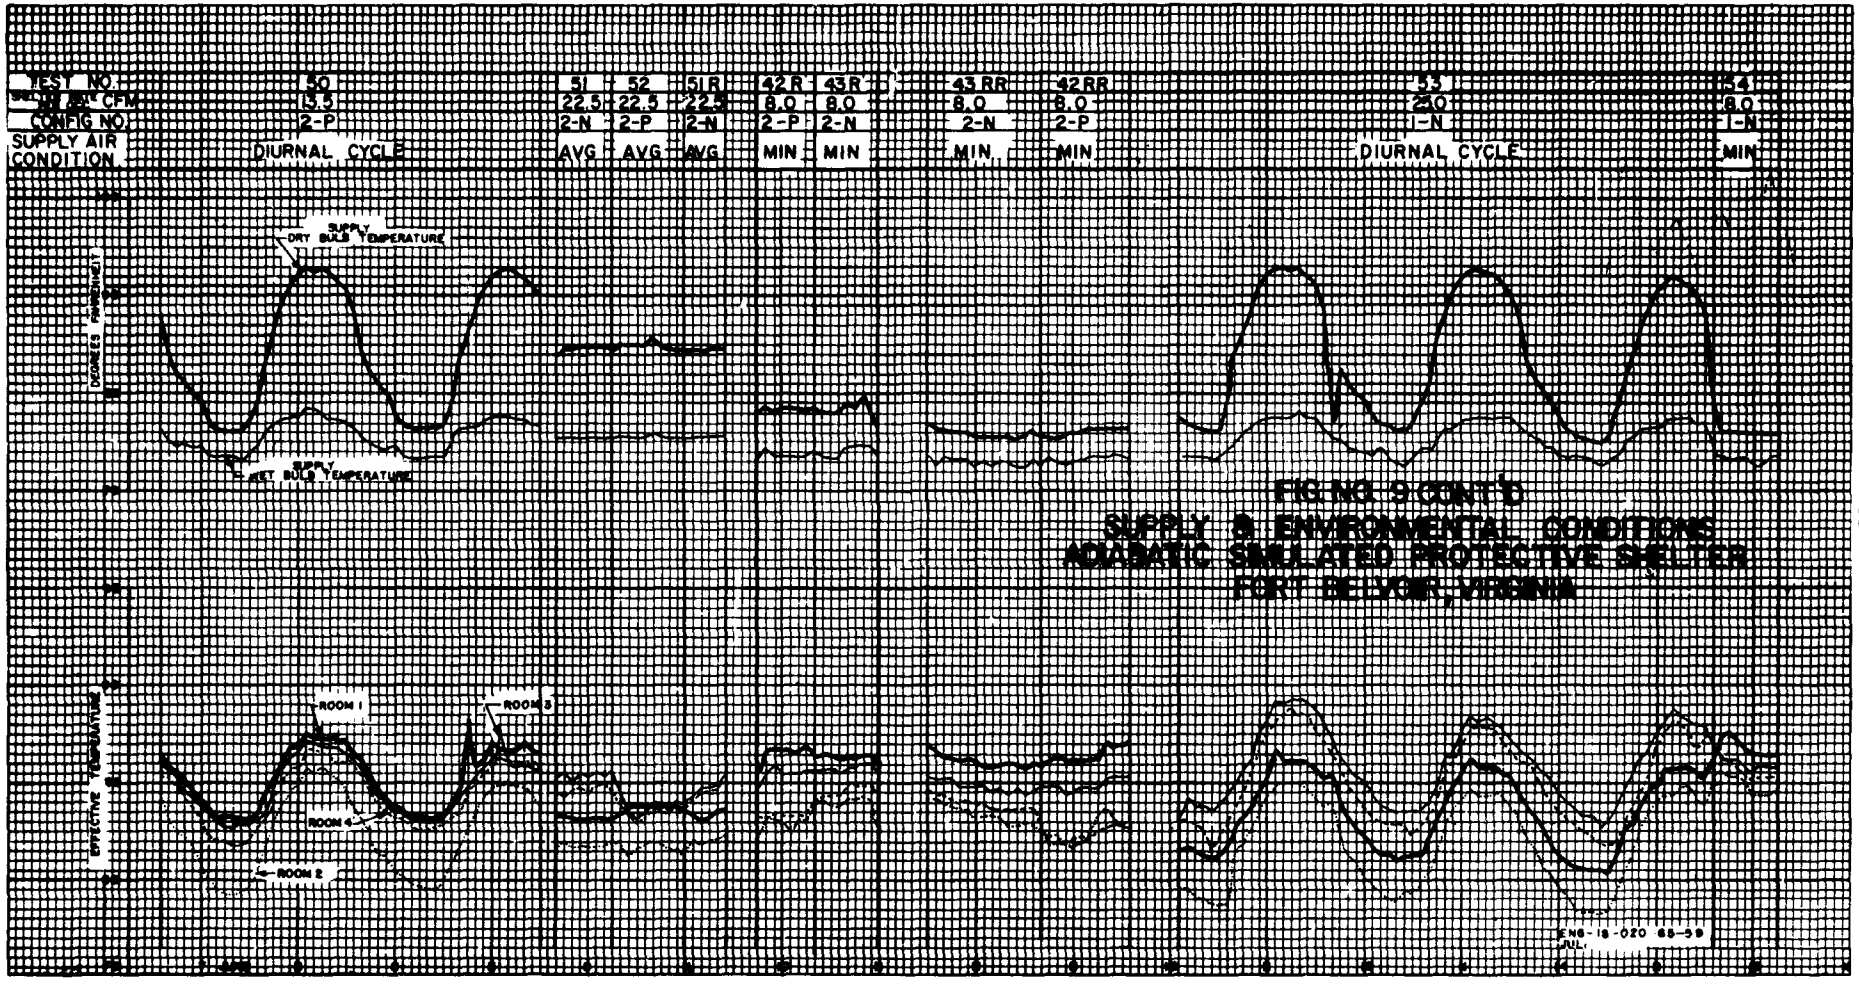

FIG NO 9 CONT'D
SUPPLY & ENVIRONMENTAL CONDITIONS
ADIABATIC SIMULATED PROTECTIVE SHELTER
FORT BELVOIR, VIRGINIA

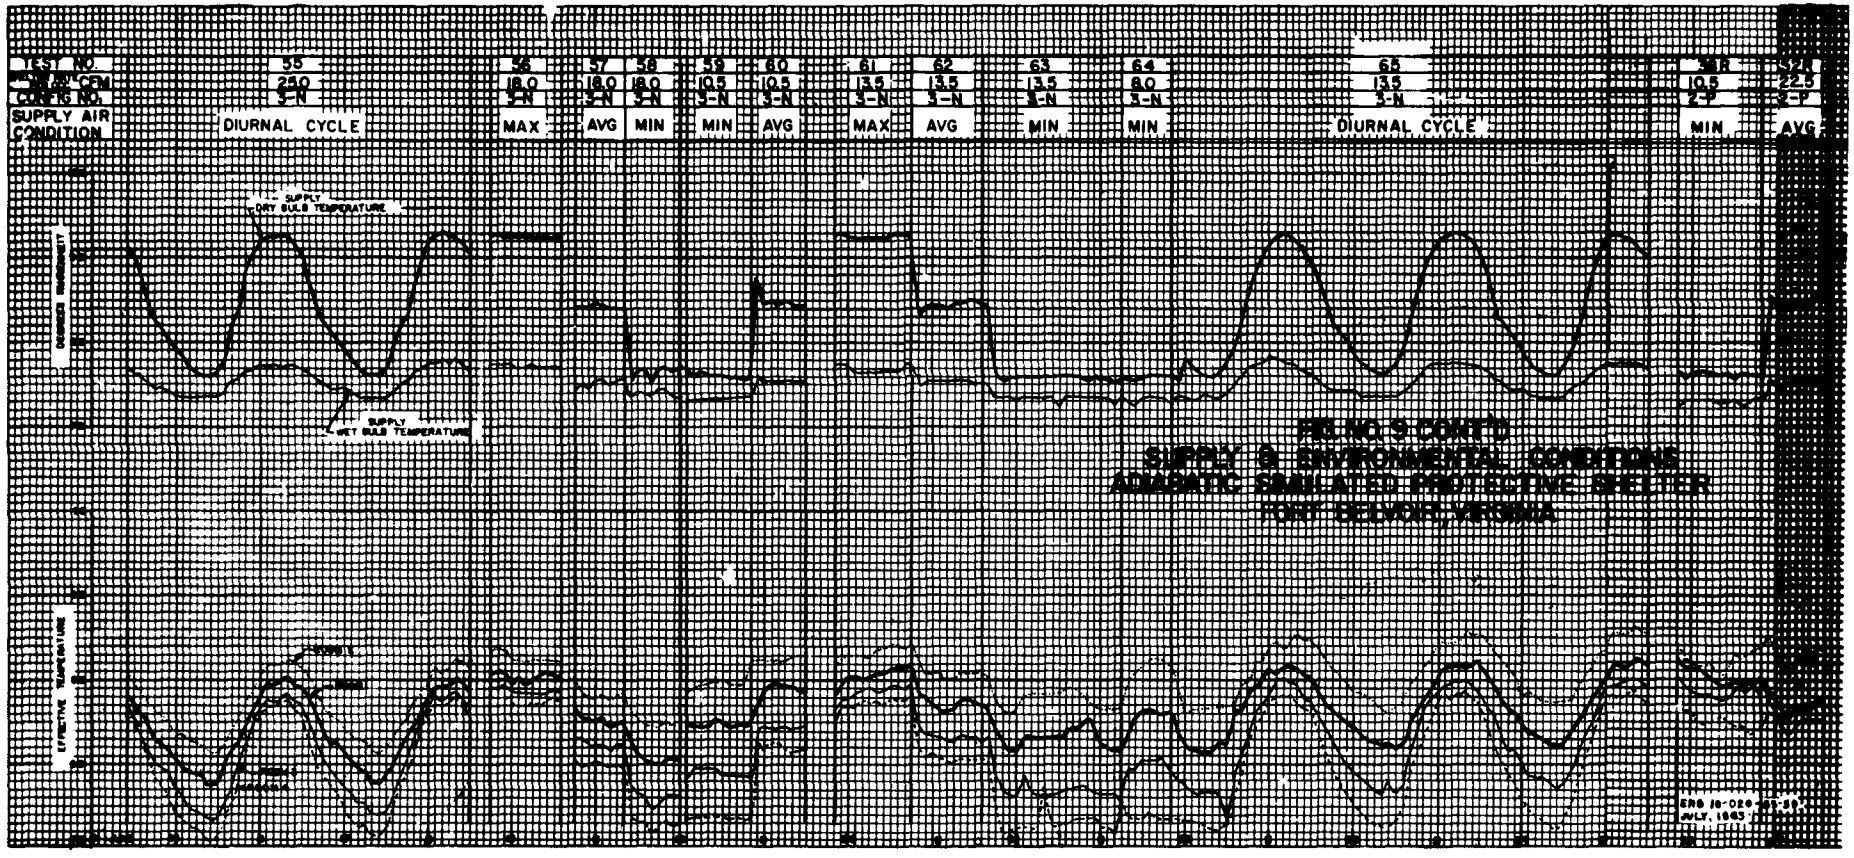
TEST NO.
CFM
CONFIG NO.
SUPPLY AIR CONDITION
55
250
3-N
DIURNAL CYCLE
56
18.0
3-N
MAX
57
18.0
3-N
AVG
58
18.0
3-N
MIN
59
10.5
3-N
MIN
60
10.5
3-N
AVG
61
13.5
3-N
MAX
62
13.5
3-N
AVG
63
13.5
3-N
MIN
64
8.0
3-N
MIN
65
13.5
3-N
DIURNAL CYCLE
10.5
2-P
MIN
22.5
2-P
AVG
SUPPLY DRY BULB TEMPERATURE
SUPPLY WET BULB TEMPERATURE
DRY BULB TEMPERATURE
EFFECTIVE TEMPERATURE
FIG. NO. 9 CONT'D
SUPPLY & ENVIRONMENTAL CONDITIONS
ADIABATIC SIMULATED PROTECTIVE SHELTER
FORT BELVOIR, VIRGINIA

The Steady-State Responses of the Side Rooms which are shown chronologically on Figure 9, are collected and presented as a function of shelter ventilation rate on Figures 10 through 14. Only the tests depicting responses to shelter ventilation at the "average" design day condition of 84.6 F dry bulb temperature and 72.0 F dew point temperature are shown; responses to steady-state ventilation tests employing air at the maximum and minimum conditions of the diurnal cycle produced curves of similar shape.

The response of the four rooms to different air flows, for the configuration in which the PVK was employed as a supply fan is shown on Figure 10. The salient feature to be noted is the non-linear response of the side rooms to changes in the shelter ventilation rate. In the range of ventilation rates from 10 to 15 cfm per occupant, the reduction in effective temperature in the side Rooms 3 and 4 is as great or greater than for any other shelter area, being about 2 degrees drop in effective temperature for a 5 cfm increase in ventilation rate. At shelter ventilation rates of from 14 to 16 cfm, the response curves for Rooms 3 and 4 become quickly asymptotic to the ventilation-rate axis, i.e., no further improvement in effective temperature is accomplished by increases in ventilation rate. For a criterion of 85 F average effective temperature, neither room provides a useable environment at any ventilation rate tested.

It is postulated that the ventilation of the side rooms is almost entirely accomplished by thermal currents (stack effects) and that the air supply to the vicinity of the doorways merely promotes these effects by maintaining a suitable environment at that point, but cannot measurably increase the velocity of the thermal currents within the room. Further, it appears that the volume of ventilation air to these side rooms is affected by doorway size, thus Room 3 with the same size doorway as Room 4, always exhibits higher effective temperatures, because it contains more people (Simocs). This supposition is supported by air exchange measurements to be discussed later.

The behavior of Room 1 is of interest, as it appears to follow the postulated adiabatic response curve quite well. This might be expected, since it is the "exhaust" of the shelter. Room 2, on the contrary, is the "inlet", and since it receives all of the shelter ventilation air, and receives it first, is in effect being provided with much better ventilation than any other area of the shelter. However, its performance curve, even were it shifted to higher ventilation rates, cannot be made to fit the adiabatic curve. This is doubtless due to the influence of the side rooms at the lower air flow rates. At the higher rates, the side rooms are no longer responding to changes in ventilation rate and the curve for Room 2 approximates the behavior of an adiabatic shelter at very high air flow rates.

When Punkahs were operated in conjunction with Ventilation Configuration 1, the results, as shown on Figure 11, were favorable. Using as a criterion, an average effective temperature of 85 F, Room 4 became habitable at a ventilation rate of 12.5 cfm and Room 3 at 16 cfm. Further, the "spread" in effective temperatures which had been four degrees without the Punkahs was reduced to two degrees when these devices were employed. If a ventilation rate of 16 cfm per occupant is selected as adequate, since it makes all the rooms habitable when Punkahs are em-

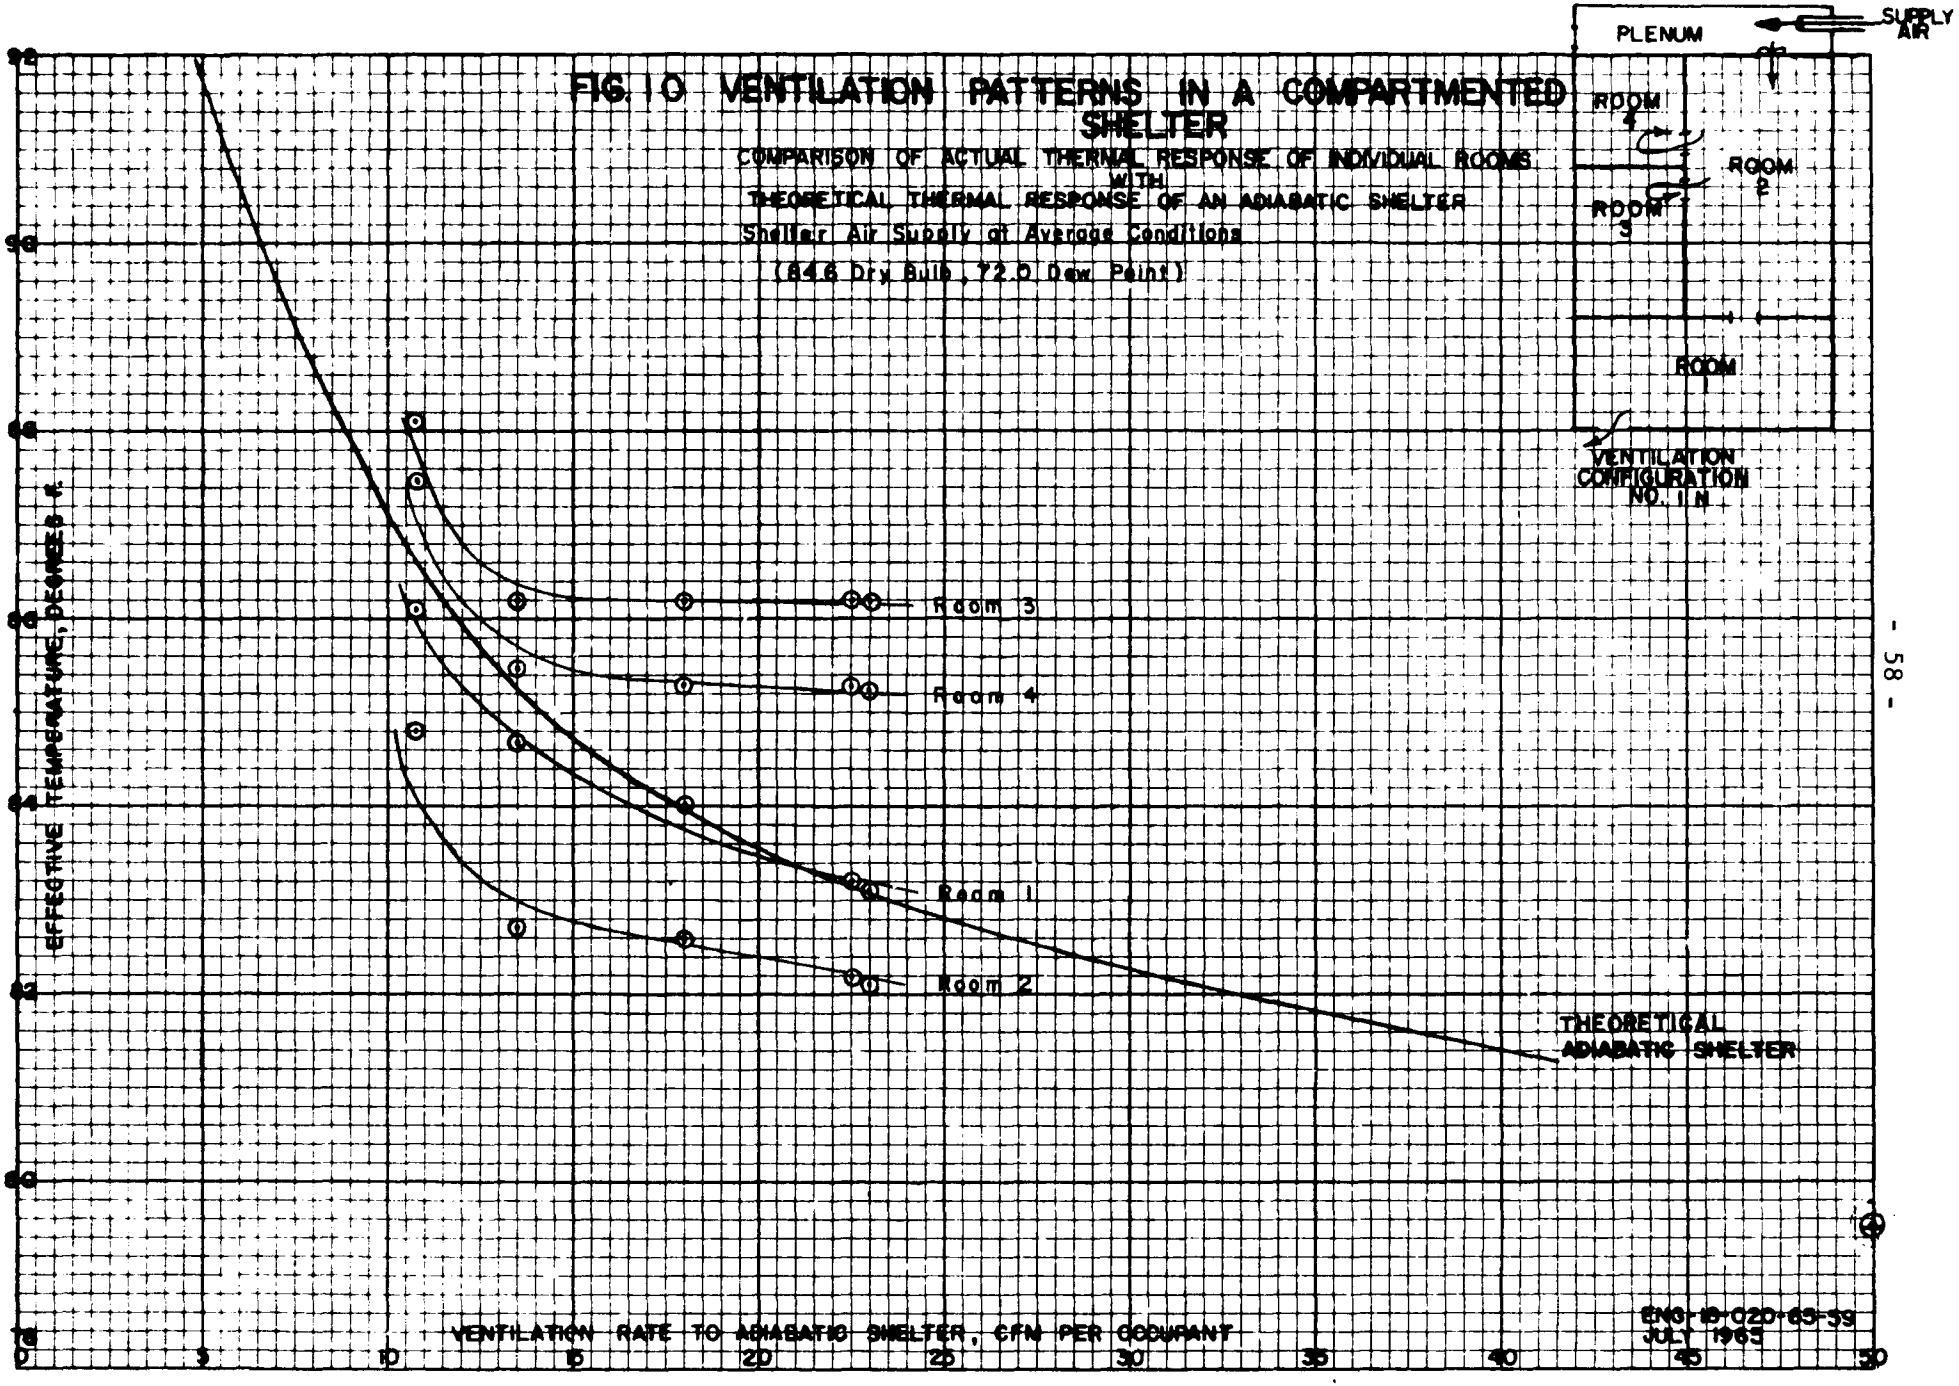

FIG. 10 VENTILATION PATTERNS IN A COMPARTMENTED SHELTER

COMPARISON OF ACTUAL THERMAL RESPONSE OF INDIVIDUAL ROOMS WITH THEORETICAL THERMAL RESPONSE OF AN ADIABATIC SHELTER

Shelter Air Supply at Average Conditions

(84.6 Dry Bulb, 72.0 Dew Point)

ENG-18-020-65-59
JULY 1965

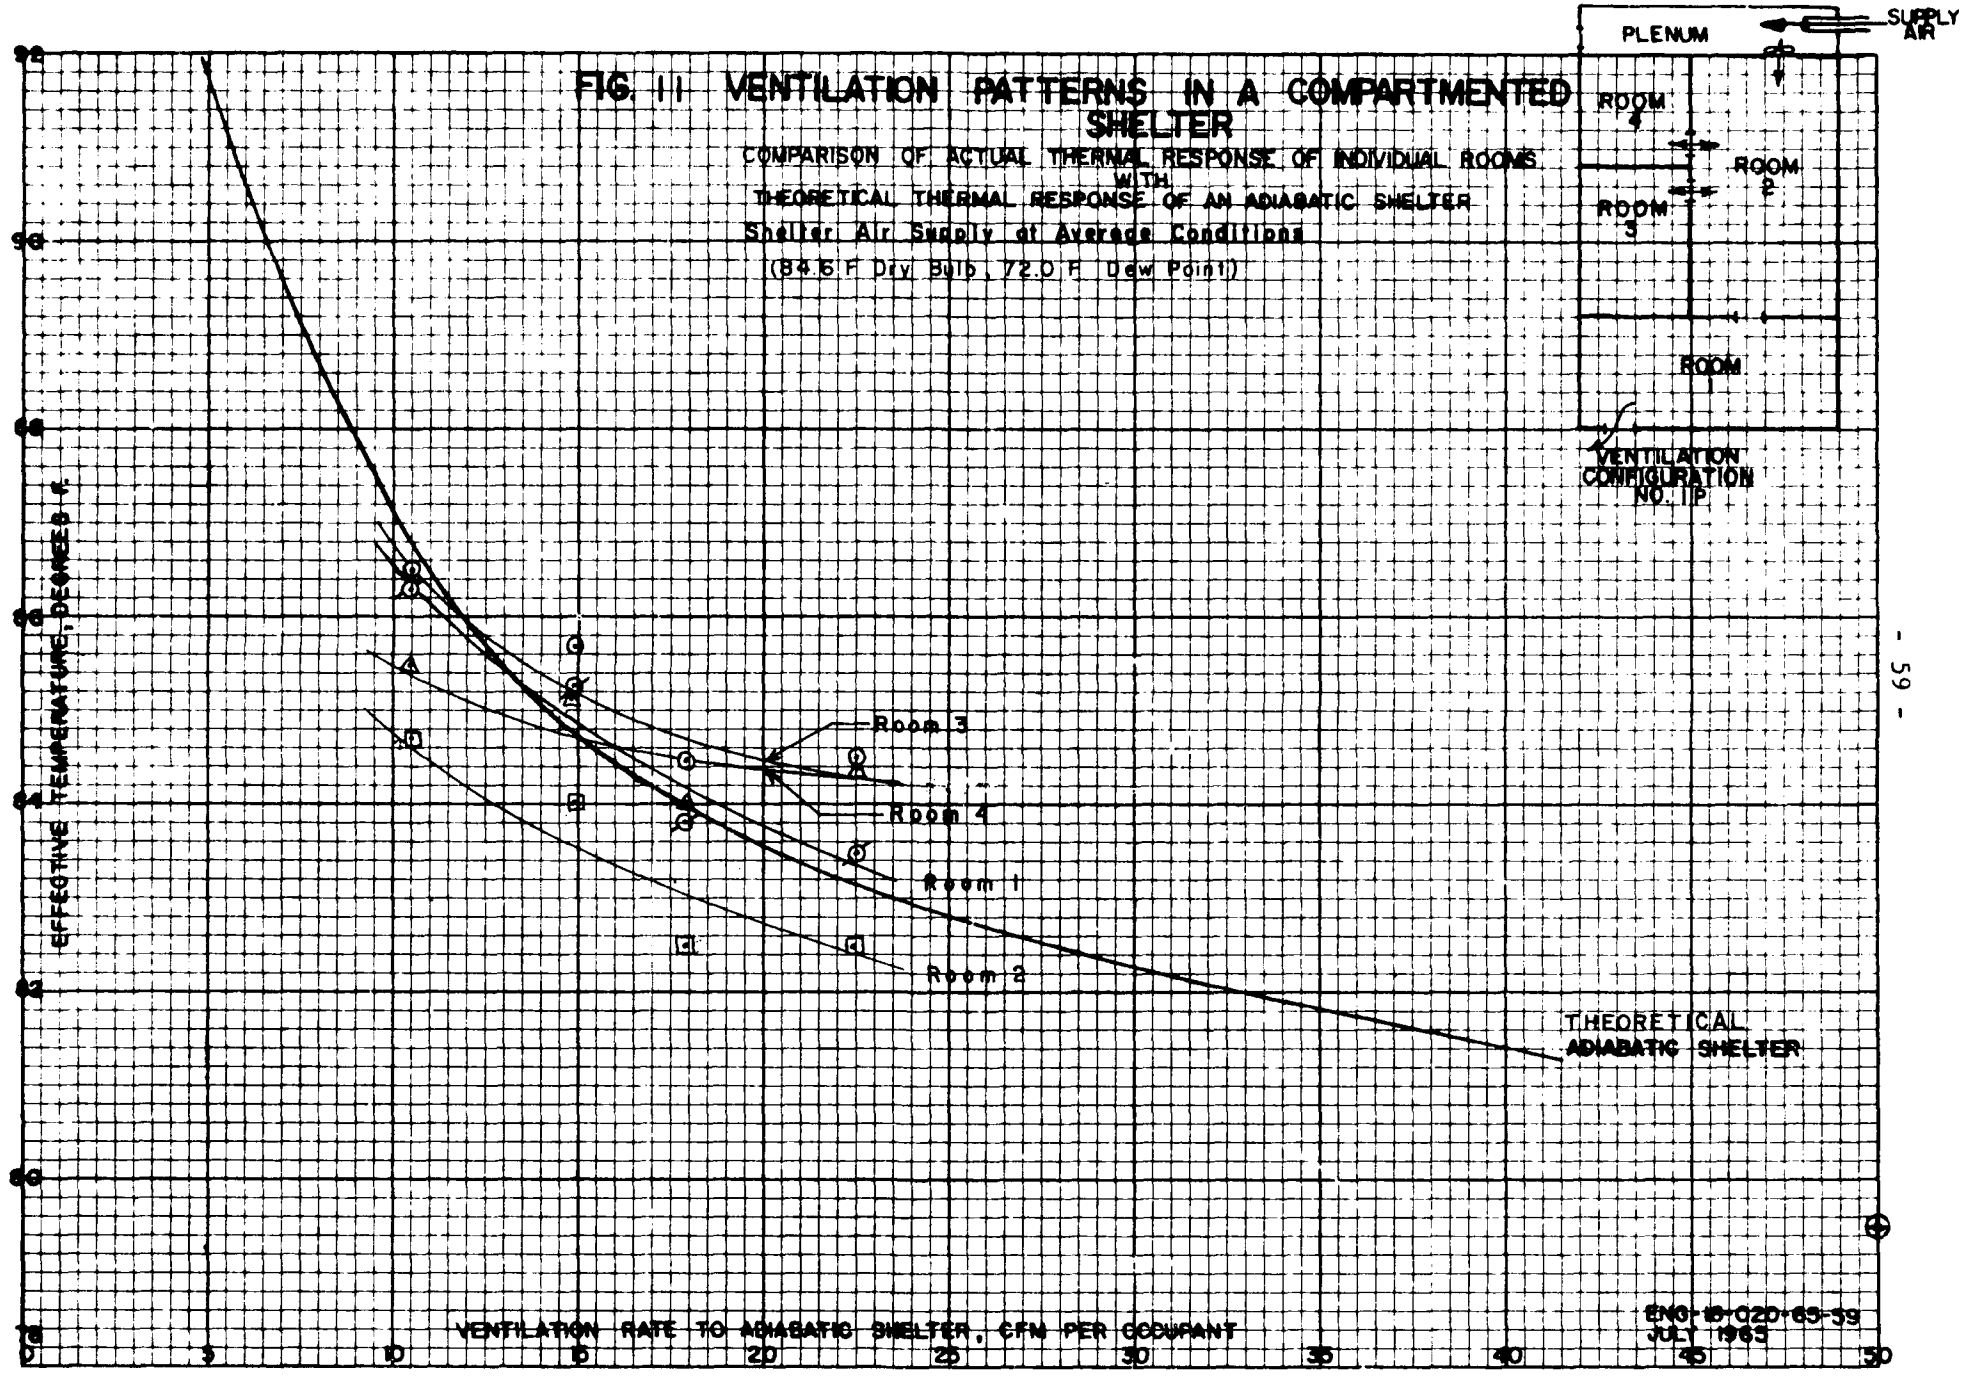
FIG. 11 VENTILATION PATTERNS IN A COMPARTMENTED SHELTER
COMPARISON OF ACTUAL THERMAL RESPONSE OF INDIVIDUAL ROOMS
WITH
THEORETICAL THERMAL RESPONSE OF AN ADIABATIC SHELTER
Shelter Air Supply at Average Conditions
(84.6 F Dry Bulb, 72.0 F Dew Point)
PLENUM
SUPPLY AIR
ROOM 4
ROOM 2
ROOM 3
ROOM 1
VENTILATION CONFIGURATION NO. 1P
Room 3
Room 4
Room 1
Room 2
THEORETICAL ADIABATIC SHELTER
EFFECTIVE TEMPERATURE, DEGREES F.
VENTILATION RATE TO ADIABATIC SHELTER, CFM PER OCCUPANT
0
5
10
15
20
25
30
35
40
45
50
ENG-18-020-65-59
JULY 1965

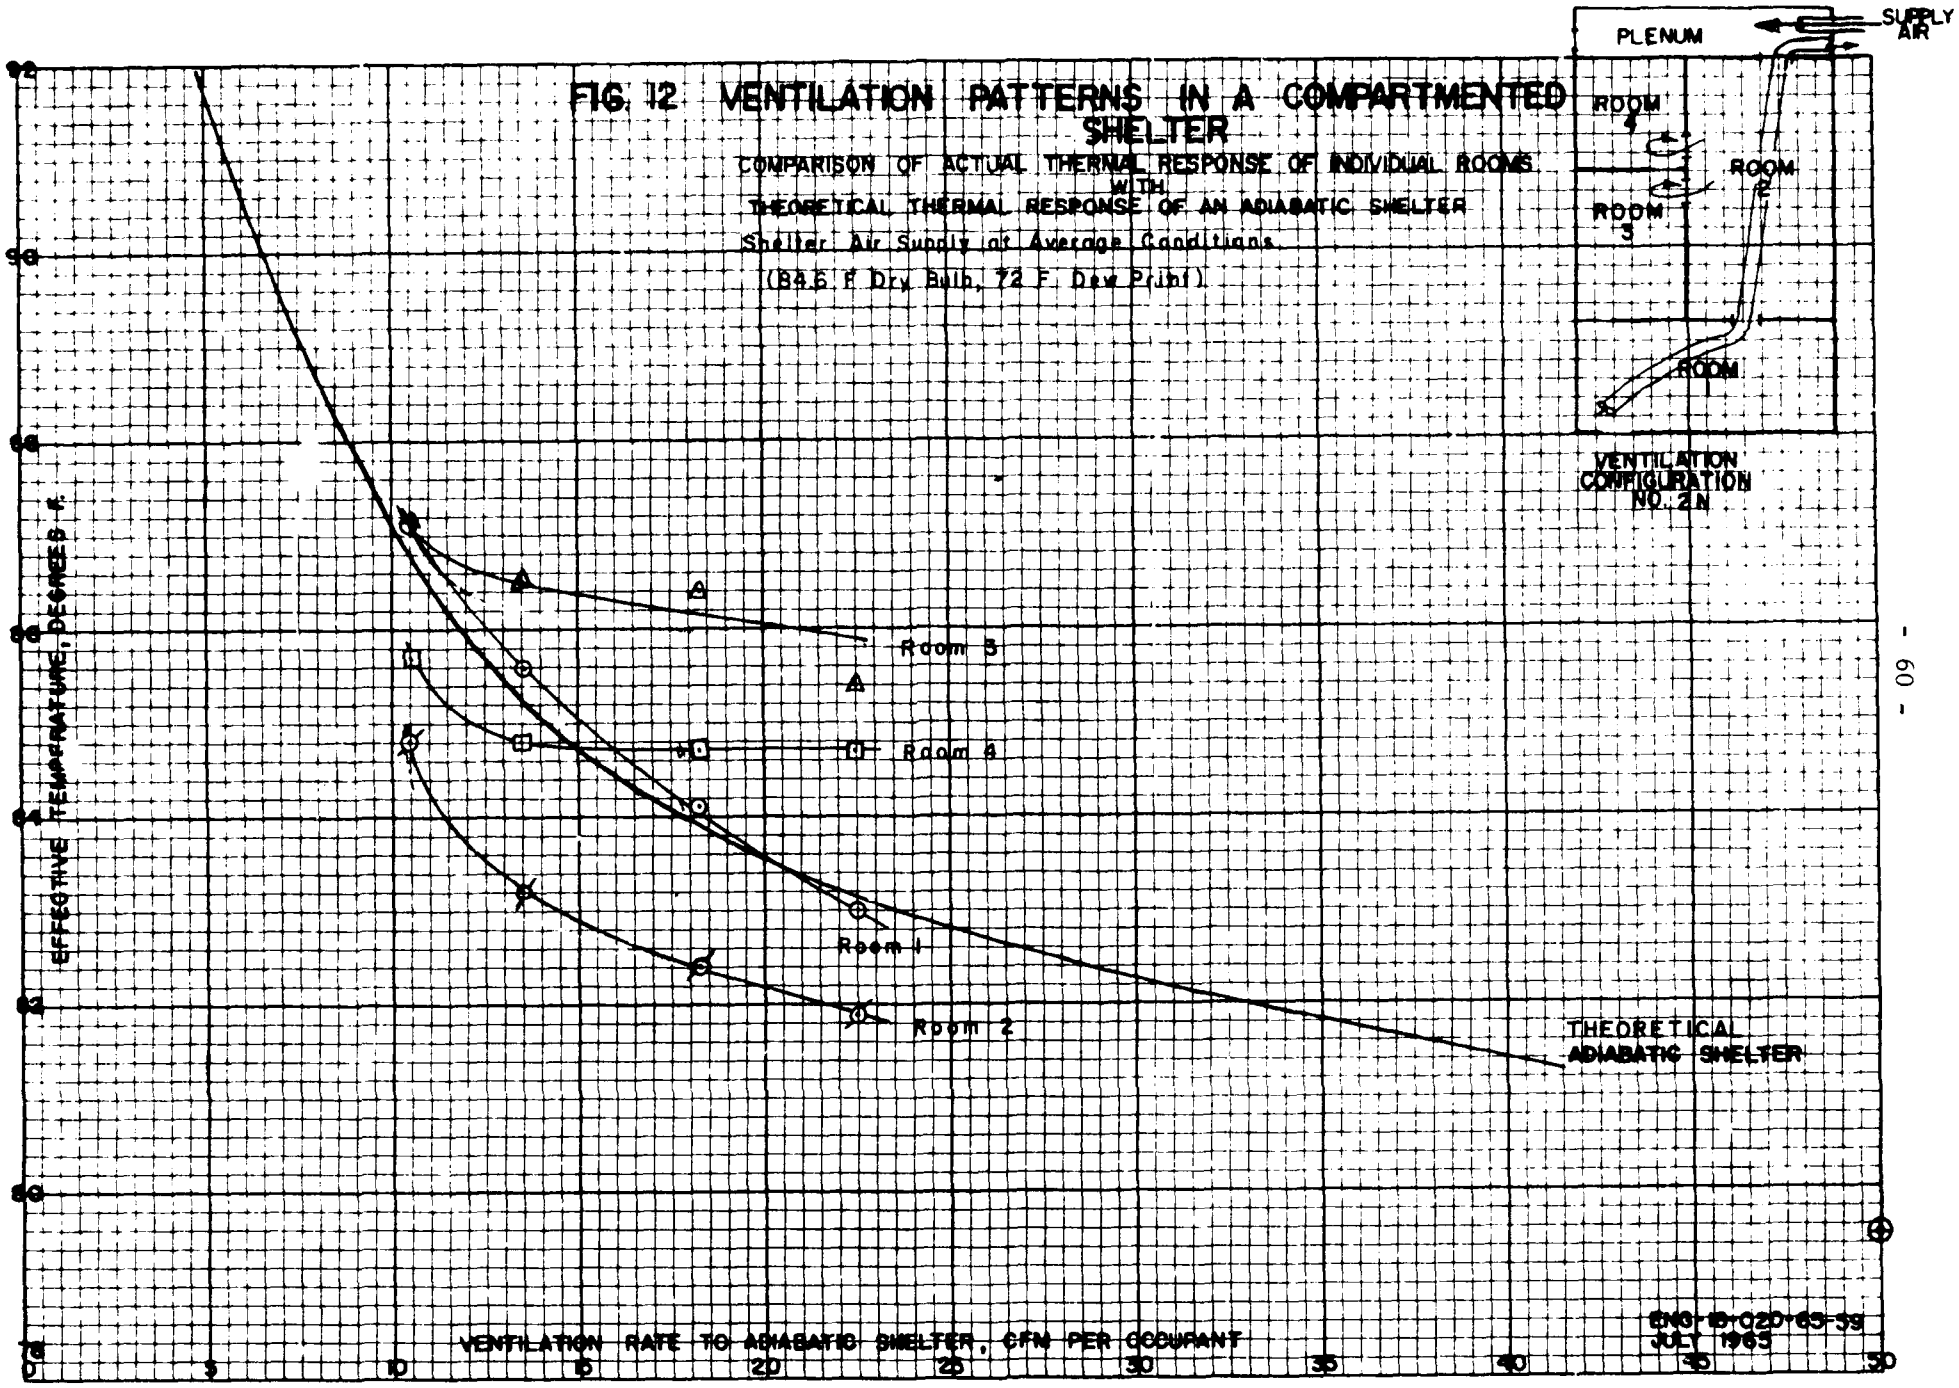

FIG. 12 VENTILATION PATTERNS IN A COMPARTMENTED SHELTER

COMPARISON OF ACTUAL THERMAL RESPONSE OF INDIVIDUAL ROOMS WITH THEORETICAL THERMAL RESPONSE OF AN ADIABATIC SHELTER

Shelter Air Supply at Average Conditions

(84.5 F Dry Bulb, 72 F Dew Point)

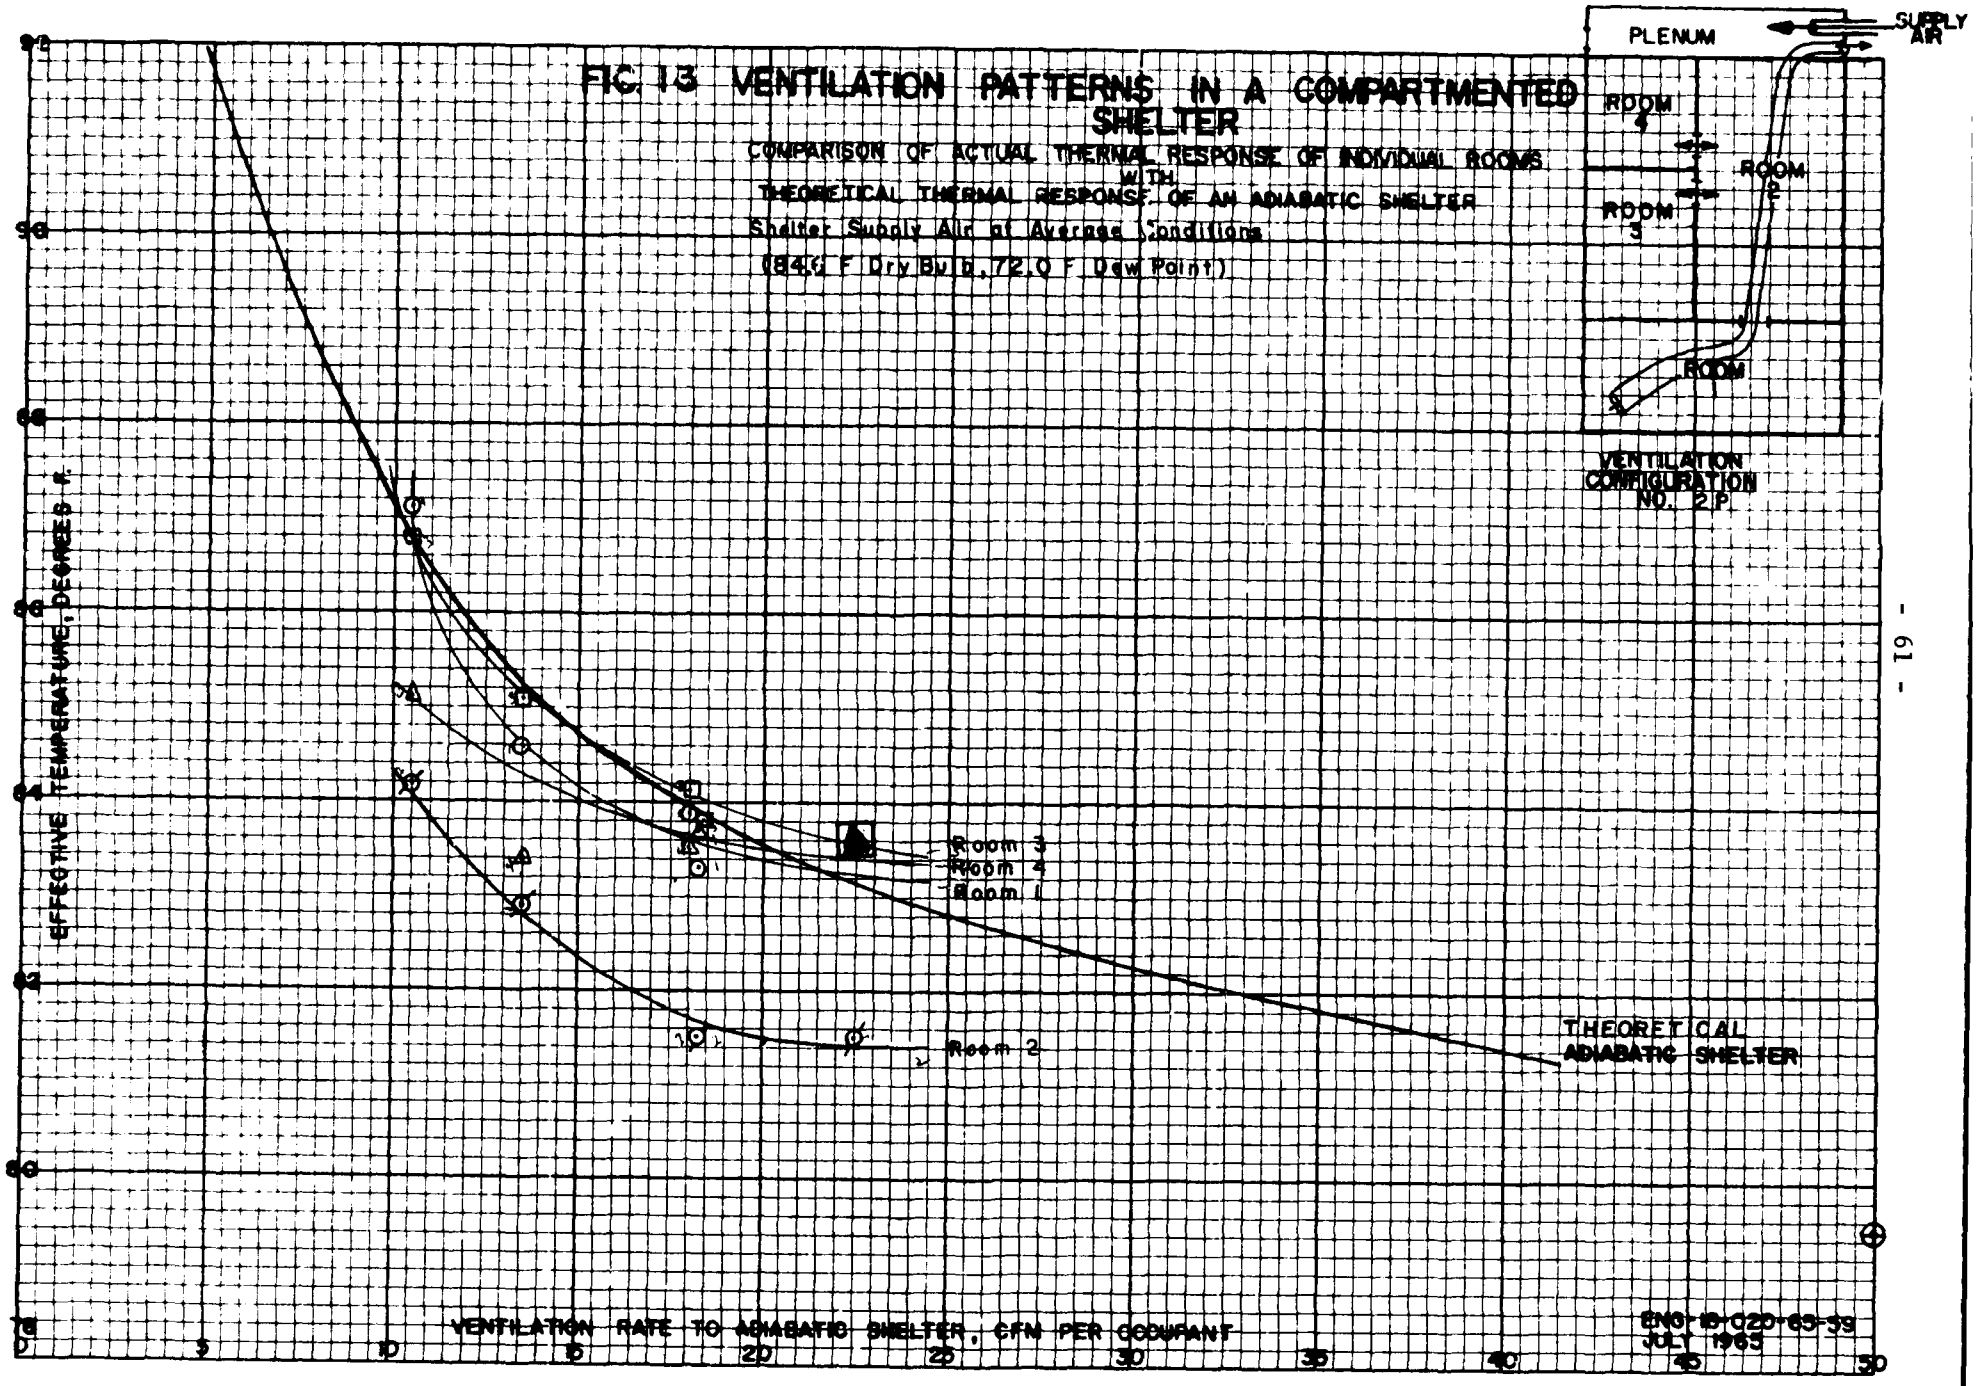

FIG. 13 VENTILATION PATTERNS IN A COMPARTMENTED SHELTER

COMPARISON OF ACTUAL THERMAL RESPONSE OF INDIVIDUAL ROOMS WITH THEORETICAL THERMAL RESPONSE OF AN ADIABATIC SHELTER

Shelter Supply Air at Average Conditions

(84.0 F Dry Bulb, 72.0 F Dew Point)

ENG-19-020-65-39
JULY 1965

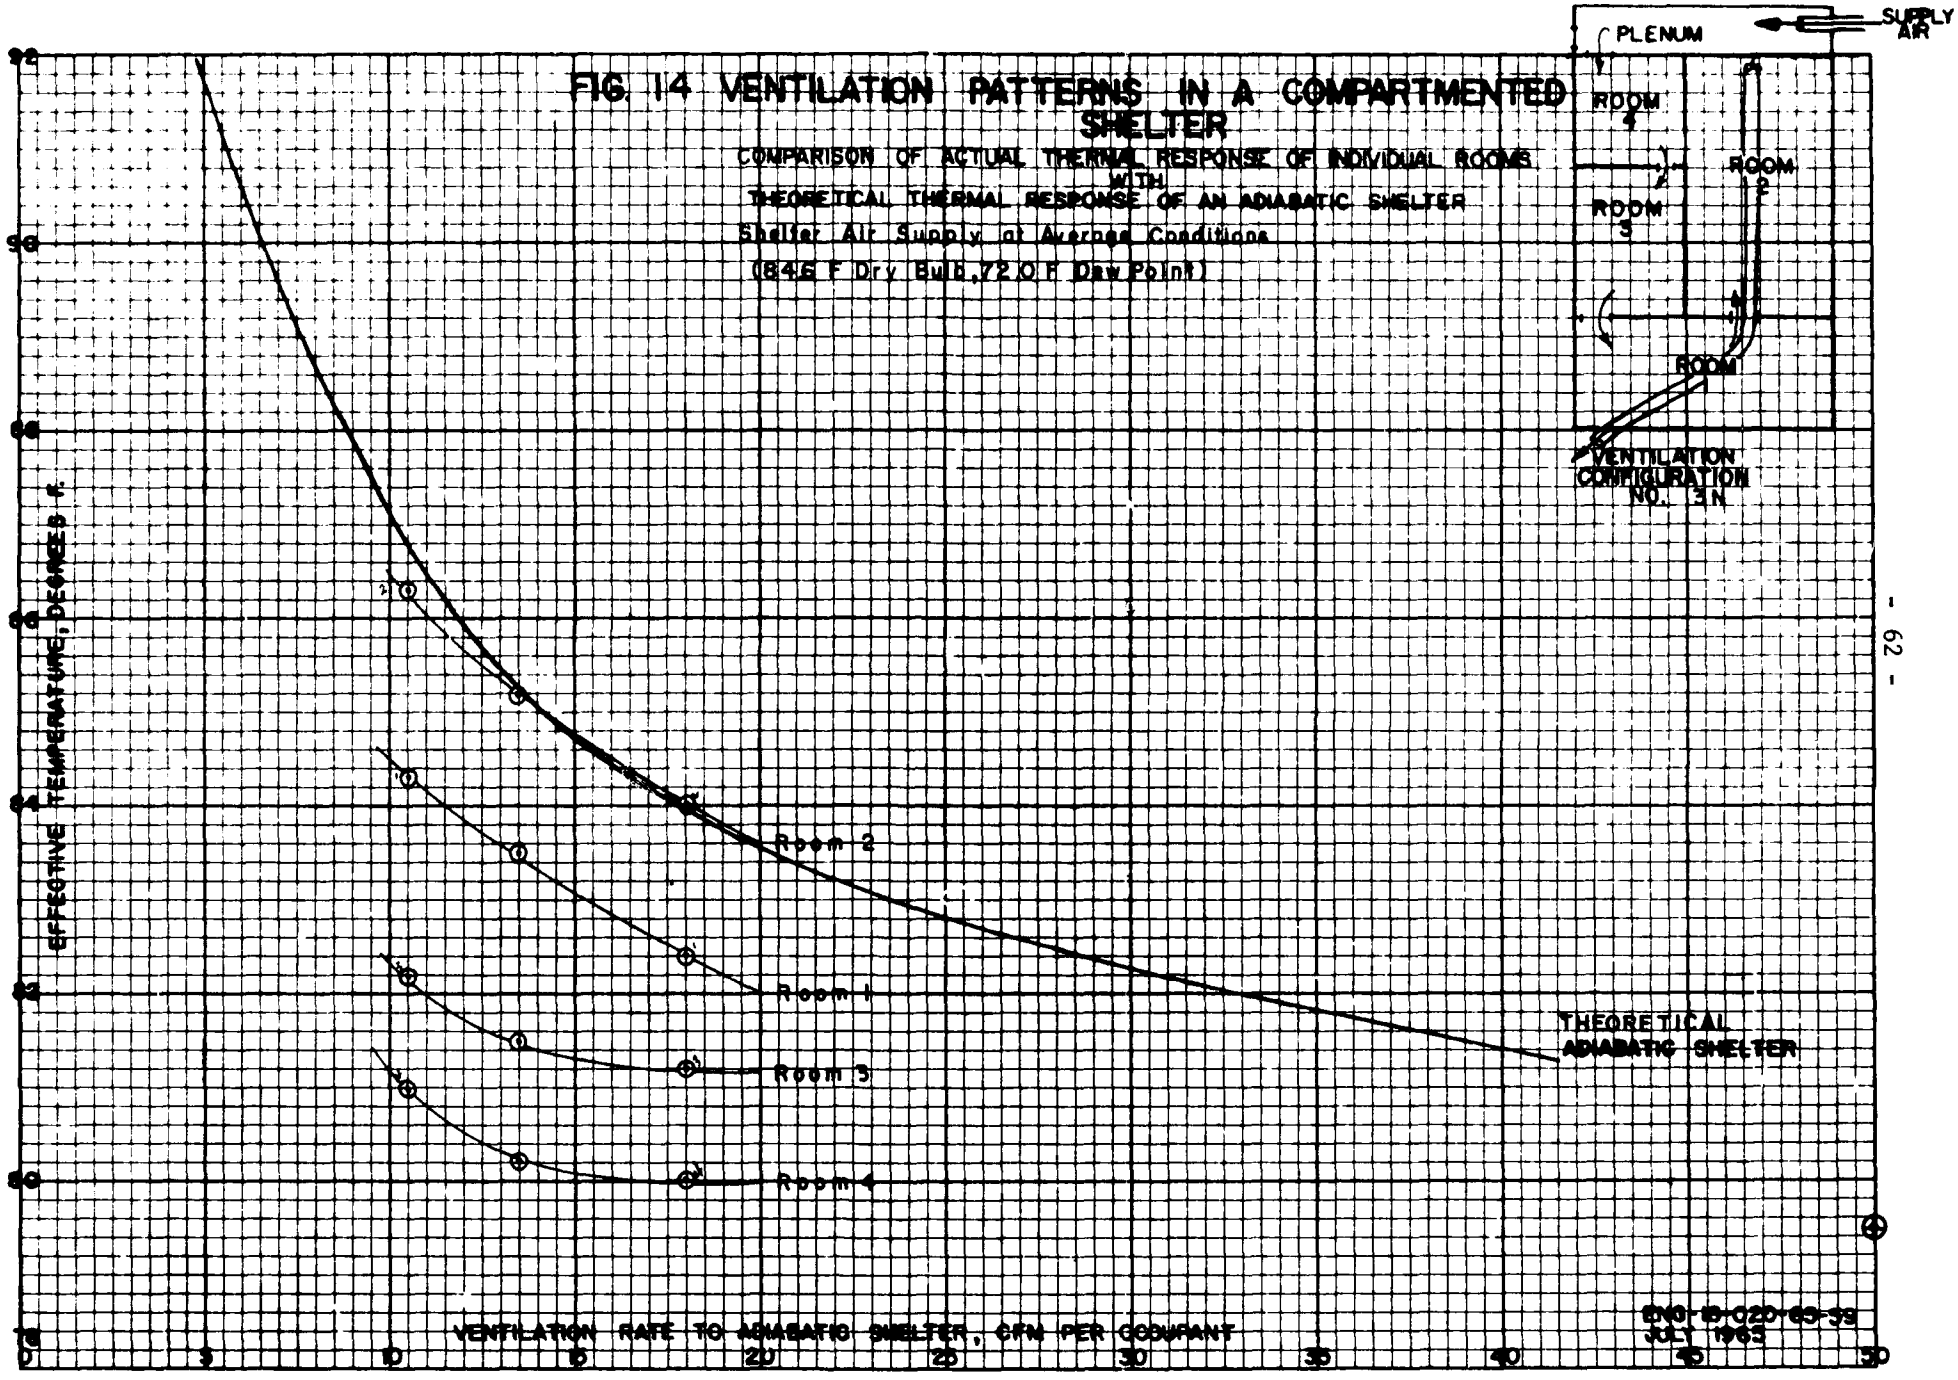

FIG. 14 VENTILATION PATTERNS IN A COMPARTMENTED SHELTER

COMPARISON OF ACTUAL THERMAL RESPONSE OF INDIVIDUAL ROOMS WITH THEORETICAL THERMAL RESPONSE OF AN ADIABATIC SHELTER

Shelter Air Supply at Average Conditions

(84.6 F Dry Bulb, 72.0 F Dew Point)

ENG-B-020-65-39
JULY 1965

ployed, then the performance with and without Punkahs may be compared at this ventilation rate. The effective temperature in Room 3 dropped 1.2 degrees, in Room 4 it dropped 0.8 degrees, while in Room 1 it increased 0.3 degrees and in Room 2 went up by 0.7 degrees when the switch was made to Punkahs. The overall shelter weighted average effective temperature remained constant at 84.1 F, so that the net result of using the Punkahs was to make useable, two rooms, or shelter space for 32 people which had been unuseable before.

When the individual room performance with and without Punkahs is compared for Ventilation Configuration 2 in which the PVK was used as an exhaust, the same effects are noted as for Configuration 1. The results are shown on Figures 12 and 13. Room 3 is not habitable at any ventilation rate investigated, while Room 4 is marginally habitable (average effective temperature of 84.7 F) at flow rates in excess of about 13.5 cfm per occupant. As in the tests of Configuration 1, the shape of the response curves for Rooms 3 and 4 does not indicate that much change in effective temperature can be achieved after the shelter ventilation rate has reached 14 to 16 cfm per occupant. The employment of Punkahs makes the entire shelter habitable at a ventilation rate of 14 cfm per occupant which is a slight improvement over the 16 cfm per occupant required for Configuration 1.

The room response curves for Ventilation Configuration 3 are shown on Figure 14. As indicated on the Figure, Ventilation Configuration 3 is a ventilation scheme in which each room is supplied in series with the entire ventilation supply for the shelter. As predicted in an earlier publication, this method of ventilation produced the best results for the entire shelter. The "worst" room, in this configuration, Room 2, was adequately ventilated by 14 cfm per occupant as predicted by the adiabatic shelter response curve. All other rooms were "better" in the sense that they achieved lower effective temperatures. The overall shelter average effective temperature for this configuration was 83.2 F as compared to 84.1 for Configuration 1.

The improved environmental conditions resulting from Configuration 3 prompted some theoretical calculations involving ventilation schemes. In the first of these, a shelter in which five persons each receives in succession the entire ventilation air supply, is compared with a shelter in which elaborate air distribution ductwork supplies and removes air for each occupant. It is supposed that each man is in a separate cubicle. The results are tabulated below:

EXAMPLE I

	Ventilation Rate		Effective Temperature Leaving Cubicle	
	Series Flow	Parallel Flow	Series Flow	Parallel Flow
Occupant 1	50 cfm	10 cfm	81.2	87.1
Occupant 2	50 cfm	10 cfm	83.0	87.1
Occupant 3	50 cfm	10 cfm	84.5	87.1
Occupant 4	50 cfm	10 cfm	85.8	87.1
Occupant 5	50 cfm	10 cfm	87.2	87.1

Thus it can be seen that only the last man in the series flow scheme suffers as severe environmental conditions as every man in the parallel flow mode.

In the second calculation, the preferred direction in which to ventilate a shelter is investigated. The arrangement of rooms and the occupancy level of the P.S.D.C. adiabatic simulated shelter are used as a model. A ventilation rate of 18 cfm is selected, since actual data was taken at this ventilation rate. Two series ventilation paths, one beginning in Room 4, the other in Room 2 are investigated.

EXAMPLE II

		Path 4-3-1-2-Exhaust		Path 2-1-3-4-Exhaust
		Effective Temperatures		
Room	Number Occupants	Actual	Calculated	Calculated
4	13	80.0	80.4	84.1
3	19	81.2	81.2	83.6
1	35	82.4	82.5	83.0
2	45	84.0	84.1	81.6
	Weighted Average	82.5	82.6	82.6

From this table, it can be noted that the calculated responses were very close to those actually measured, lending support to the contention that the shelter was truly adiabatic in operation. If it can be surmised

that in the hypothetical shelter, the mixing in each room is good so that no area of a room differs significantly from the room average, then the ventilation Path 4-3-1-2-Exhaust is superior to the Path 2-1-3-4-Exhaust. The first path provides 67 persons with conditions below the average, while the latter only has 45 people below the average conditions. Had the ventilation rate been reduced, so that the average shelter effective temperature had reached 85 F, then any rooms which exceeded this value would have been considered uninhabitable according to the criterion used in this report.

It would not be advisable to generalize on the optimum ventilation path from this one example however. In another theoretical study, a different set of room sizes was considered. For a four room shelter, in which room sizes differed by factors of two, the following effective temperatures were calculated. (The ventilation rate is assumed to be 14.1 cfm per occupant - 1% High Design Day - Washington, D.C.; 84.6 Dry Bulb - 72.0 Dew Point.)

EXAMPLE III

Room	Number Occupants	Path 1-2-3-4-Exhaust Effective Temperatures Calculated	Path 4-3-2-1-Exhaust Effective Temperatures Calculated
1	10	80.2	85.6
2	20	81.1	84.9
3	40	82.6	84.2
4	80	85.4	83.1

Path 4-3-2-1-Exhaust, i.e., from largest to smallest rooms, results in 140 persons with environmental conditions below 85.0 effective temperature; Path 1-2-3-4-Exhaust, i.e., from smallest to largest rooms only provides useable conditions for 60 persons.

It is believed that other relative room sizes might alter the selection of the optimum ventilation path; thus, in the preceeding example, if Room 4 is split into two rooms, and the air from Room 3 passed successively through them, then Room 4A will develop an effective temperature of 84.3 F while Room 4B will go to 85.6 F. In effect, forty more persons have been placed in a habitable environment by the provision of a partition.

Air Flow Patterns shown on Figures No. 15 and 16 illustrate the main shelter supply stream as it leaves the plenum and enters Room 2. The main stream as seen in Figure 15 leaves the plenum with a velocity component which carries it down along the south side of Room 2. This ventilation pattern then, directs the "fresh" air away from the doorways of the side rooms. In contrast, the main stream as seen in Figure 16 is baffled (note installation of baffle at the doorway from Room 2 to plenum) toward the north side and impinges directly on the doorways of the side rooms. Tests 46, 47, 48, and 49 were conducted to evaluate the effect of these different ventilation patterns.

A comparison of the responses of the side rooms for the diurnal Tests 46, 47, 48, and 49 is worthy of discussion. These tests were all conducted at a supply ventilation rate of 25 cfm/occ. but exhibit differing environmental shelter responses because of the application of ventilation adjuncts operating individually (Punkahs) or in combination (Punkahs and baffles). Test 46 was conducted without any ventilation aids and as can be seen in Figure 15 the main shelter supply air stream was directed away from the side rooms. The resulting peak effective temperatures in Rooms 3 and 4 were 88.5 F and 87.2 F, respectively. It was then decided to install a baffle at the shelter supply location and direct the "fresh" air at the doorways of the side rooms. The resulting ventilation pattern for Test 47 can be seen in Figure 16. Despite the fact that relatively high velocity air was impinging directly on the doorways of Rooms 3 and 4, very little "fresh" air was actually penetrating into the rooms. The resulting effect was an increase (rather than the postulated decrease) in environmental conditions which developed during Test 46. For example, Room 3 increased from 88.5 F to 90.5 F effective temperature. The increase in effective temperature can be attributed to the disturbance of the natural ventilation currents (stack effects) which had previously been ventilating the side rooms.

It was then postulated that with the addition of Punkah Pumps the air which was being baffled toward the side rooms (but not entering) could be "forced" to ventilate these isolated areas, and hence improve the severe conditions which had developed during Test 47. Test 48 was then conducted, employing both Punkahs and baffles. The effective temperatures in Rooms 3 and 4 dropped from a peak value of 90.5 F and 87.2 F to 85.5 F and 85.2 F, respectively.

The results of Tests 46, 47, and 48 indicate that baffling alone was not sufficient to provide adequate ventilation of the side rooms, but that the combination of baffles and Punkahs does provide uniform distribution of ventilation air to the side rooms.

In order to obtain a complete evaluation of Configuration 2 (in terms of peak effective temperature in Rooms 3 and 4 at 25 cfm) the baffle was removed (and Test 49 conducted) thereby leaving only the Punkahs as adjuncts. In this manner, it could be ascertained whether or not baffling is advantageous when Punkahs are in operation to insure optimum ventilation distribution to the side room. The resulting peak effective temperatures of Rooms 3 and 4 were essentially unchanged from those of Test 48 and were recorded at 85.9 F and 85.6 F, respectively.

FIG. NO. 15
MAJOR AIR FLOW PATTERNS IN ROOM 2
TEST NO. 46
CONFIGURATION 2-N

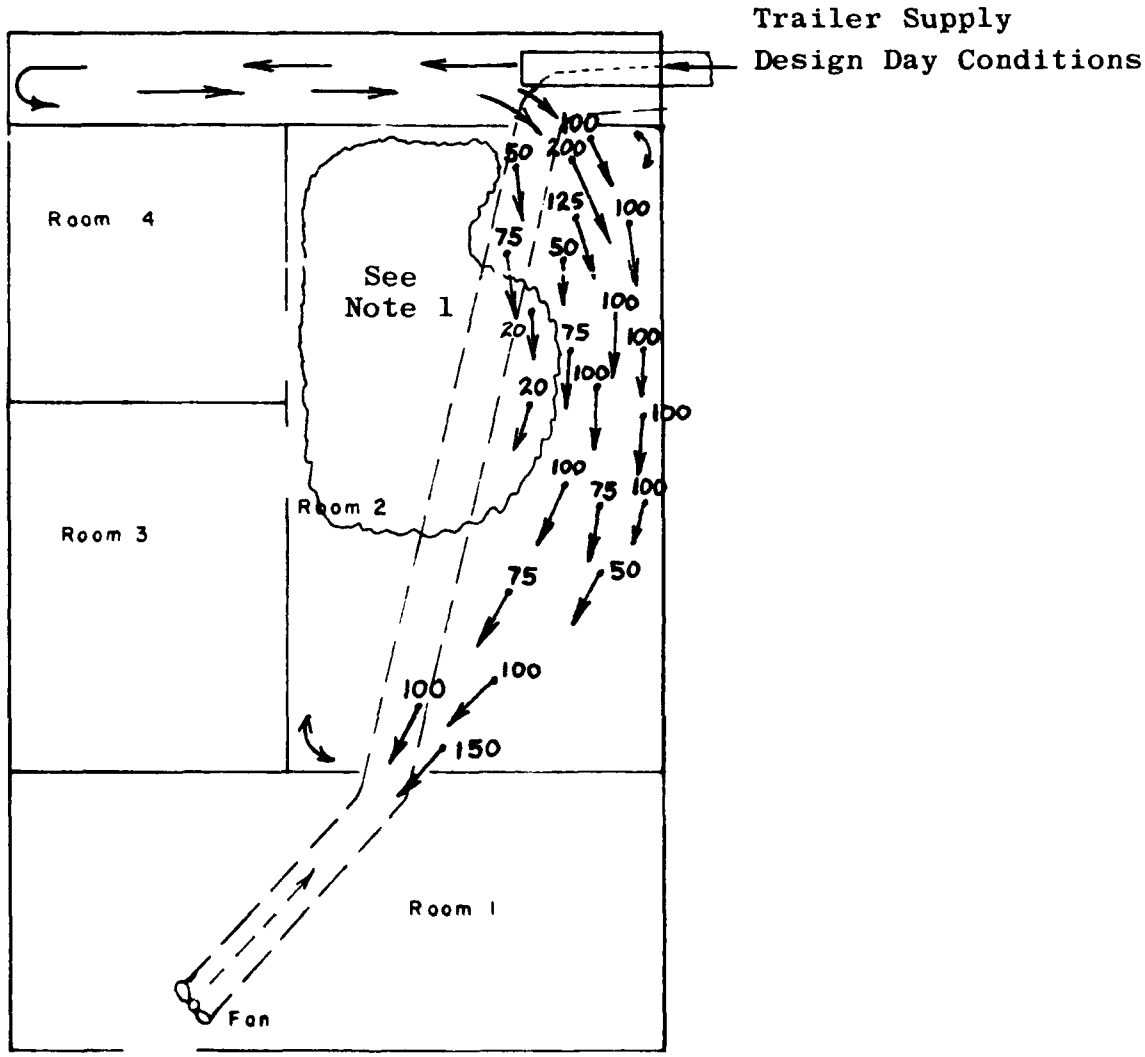

NOTE: 1 Velocities Enclosed Within Area, Were in General Under 20 fpm in Magnitude and Very Unsteady in Direction.

NOTE 2 Direction of Air Flow was Determined by "Smoke" and the Velocity Magnitude Determined by "Hot Wire" Anemometer (5 feet off floor).

FIG. NO. 16
MAJOR AIR FLOW PATTERNS IN ROOM 2
TEST NO. 47
CONFIGURATION 2-B

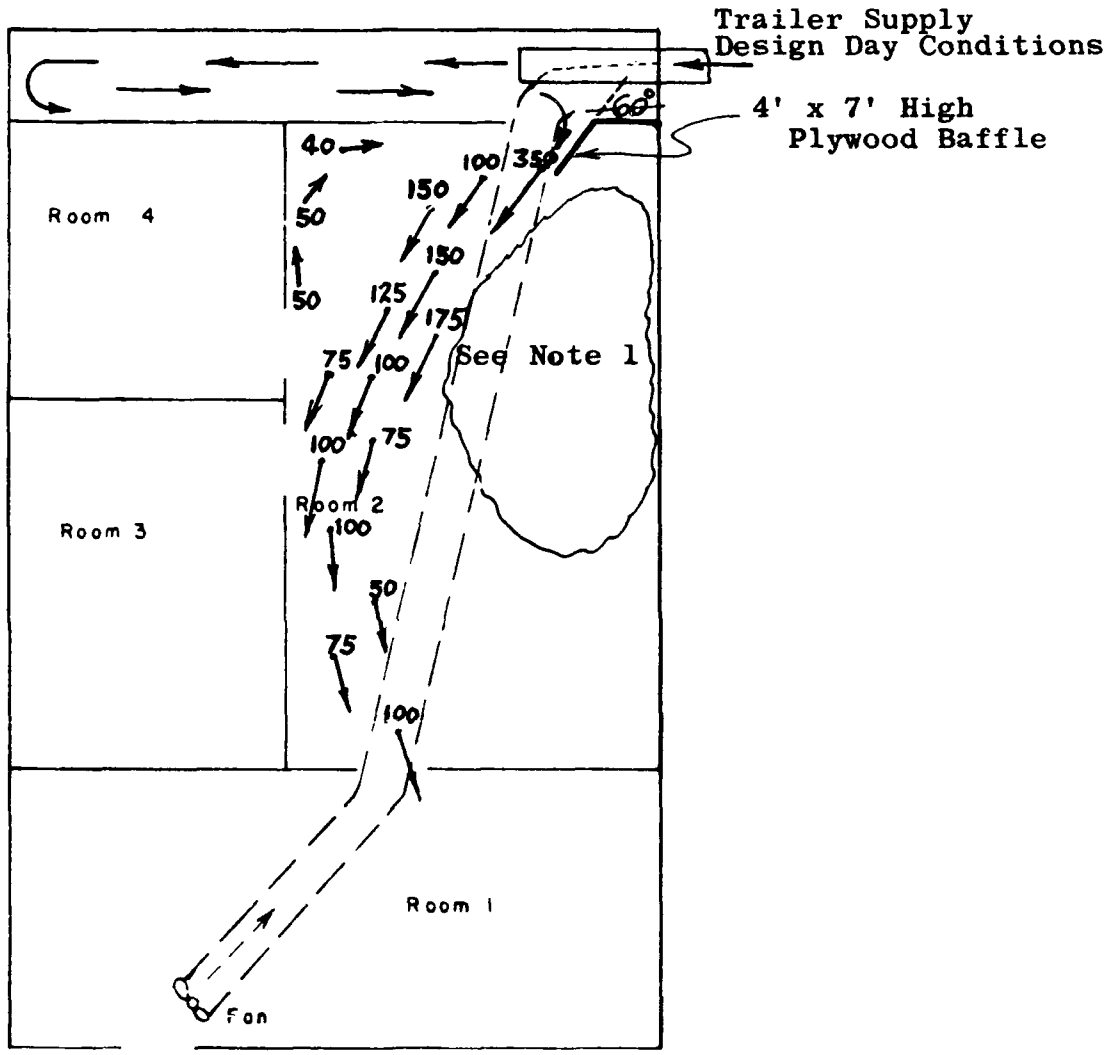

NOTE: 1 Velocities Enclosed Within Area, Were in General Under 20 fpm in Magnitude and Very Unsteady in Direction.

NOTE: 2 Direction of Air Flow was Determined by "Smoke" and the Velocity Magnitude Determined by "Hot Wire" Anemometer (5 feet off floor).

Shelter Micro-Environmental Patterns were investigated and are presented in Figures No. 17, 18, 19, and in Table VI. These include the determination of ventilation rates for Rooms 3 and 4 (based on a heat balance method) and effective temperature variations throughout the shelter for the Configurations tested.

The effectiveness or efficacy of the different Configurations tested can be evaluated in terms of the distribution of the ventilation air. One index to the distribution of this air is the effective temperature variation throughout the test structure. Figures No. 17 and 18 are the results of temperature traverses taken with a battery operated aspirating psychrometer. The average environmental conditions of each room are shown at the top of the figure as well as the average shelter effective temperature. The values shown within the room areas are variations from the average temperature for each individual room. The degree of variation or deviation from the room average for any particular location throughout the room is an indication of a "hot spot" or "cool spot". Additional traverses of the same type as Figures No. 17 and 18 are included in Appendix C for consideration.

From Figure No. 17, it can be seen that "hot spots" and "cool spots" exist within Rooms 3 and 4. For example, plus "+" values (which are indicative of severe locations) are outstanding in all but the doorway corner of Room 4 and minus "-" values (which indicate "cool spots") are present about the supply area.

The maximum variation in effective temperatures for Room 4, is 2.1 degrees for Test 47, but with the addition of Punkah Pumps (all other variables being held constant) the maximum variation was only 1 degree as can be seen from Figure 18. Therefore it is inferred that poor distribution exists within the side rooms during periods of "natural" ventilation.

Room 1 shows little change in response when Punkah Pumps are installed. The maximum variation is 1.3 degrees for Test 47 as compared to 1.6 degrees for Test 48.

CONFIGURATION NO. 2-B

TEST NO. 47 (Maximum Shelter Response)

VENTILATION RATE 25 cfm/occ

AVG. SHELTER E.T. 87.0°

Fig. No. 17

AVG. E.T. OF ROOM 1 86.2
2 85.4
3 92.0
4 88.7

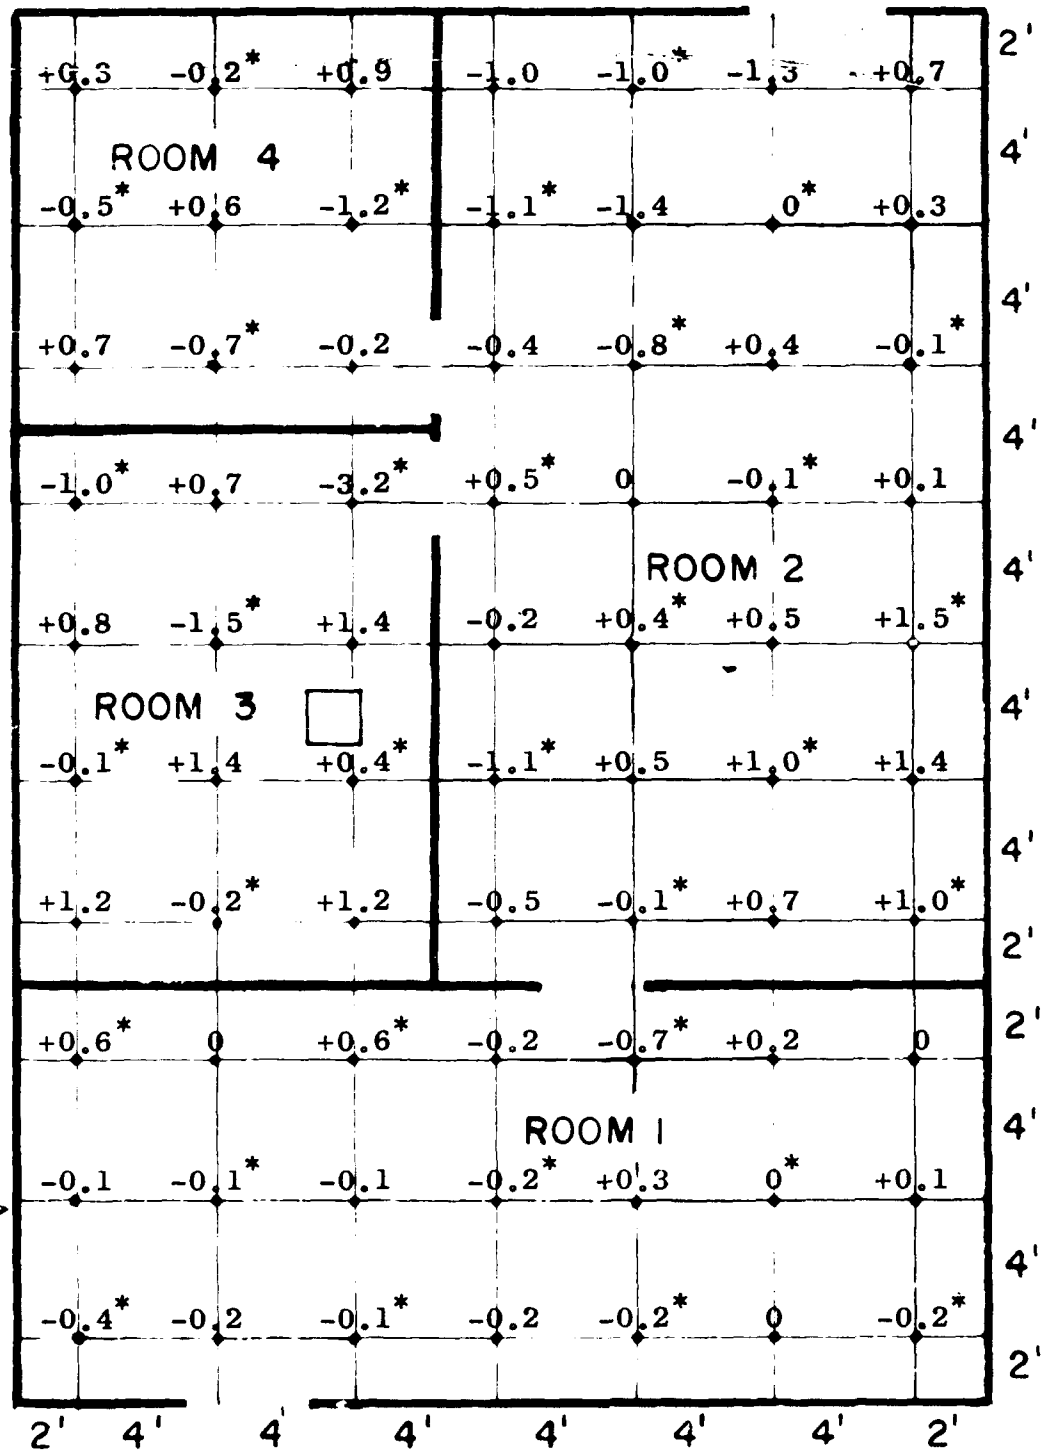

* TEMPERATURES TAKEN AT 1 FT. LEVEL - ALL OTHERS TAKEN AT 5 FT

Configuration Key

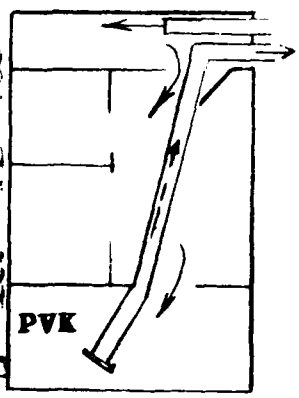

THE PLUS OR MINUS VALUES SHOWN ARE RELATIVE TO ABSOLUTE MAGNITUDE OF THE AVG. E.T. FOR EACH ROOM.

CONFIGURATION NO. 2-BP

TEST NO. 48 (Maximum Shelter Response)

VENTILATION RATE 24.5 cfm/occ

AVG. SHELTER E.T. 85.6°

Fig. No. 18

AVG. E.T. OF ROOM 1 86.0
2 85.2
3 86.1
4 85.7

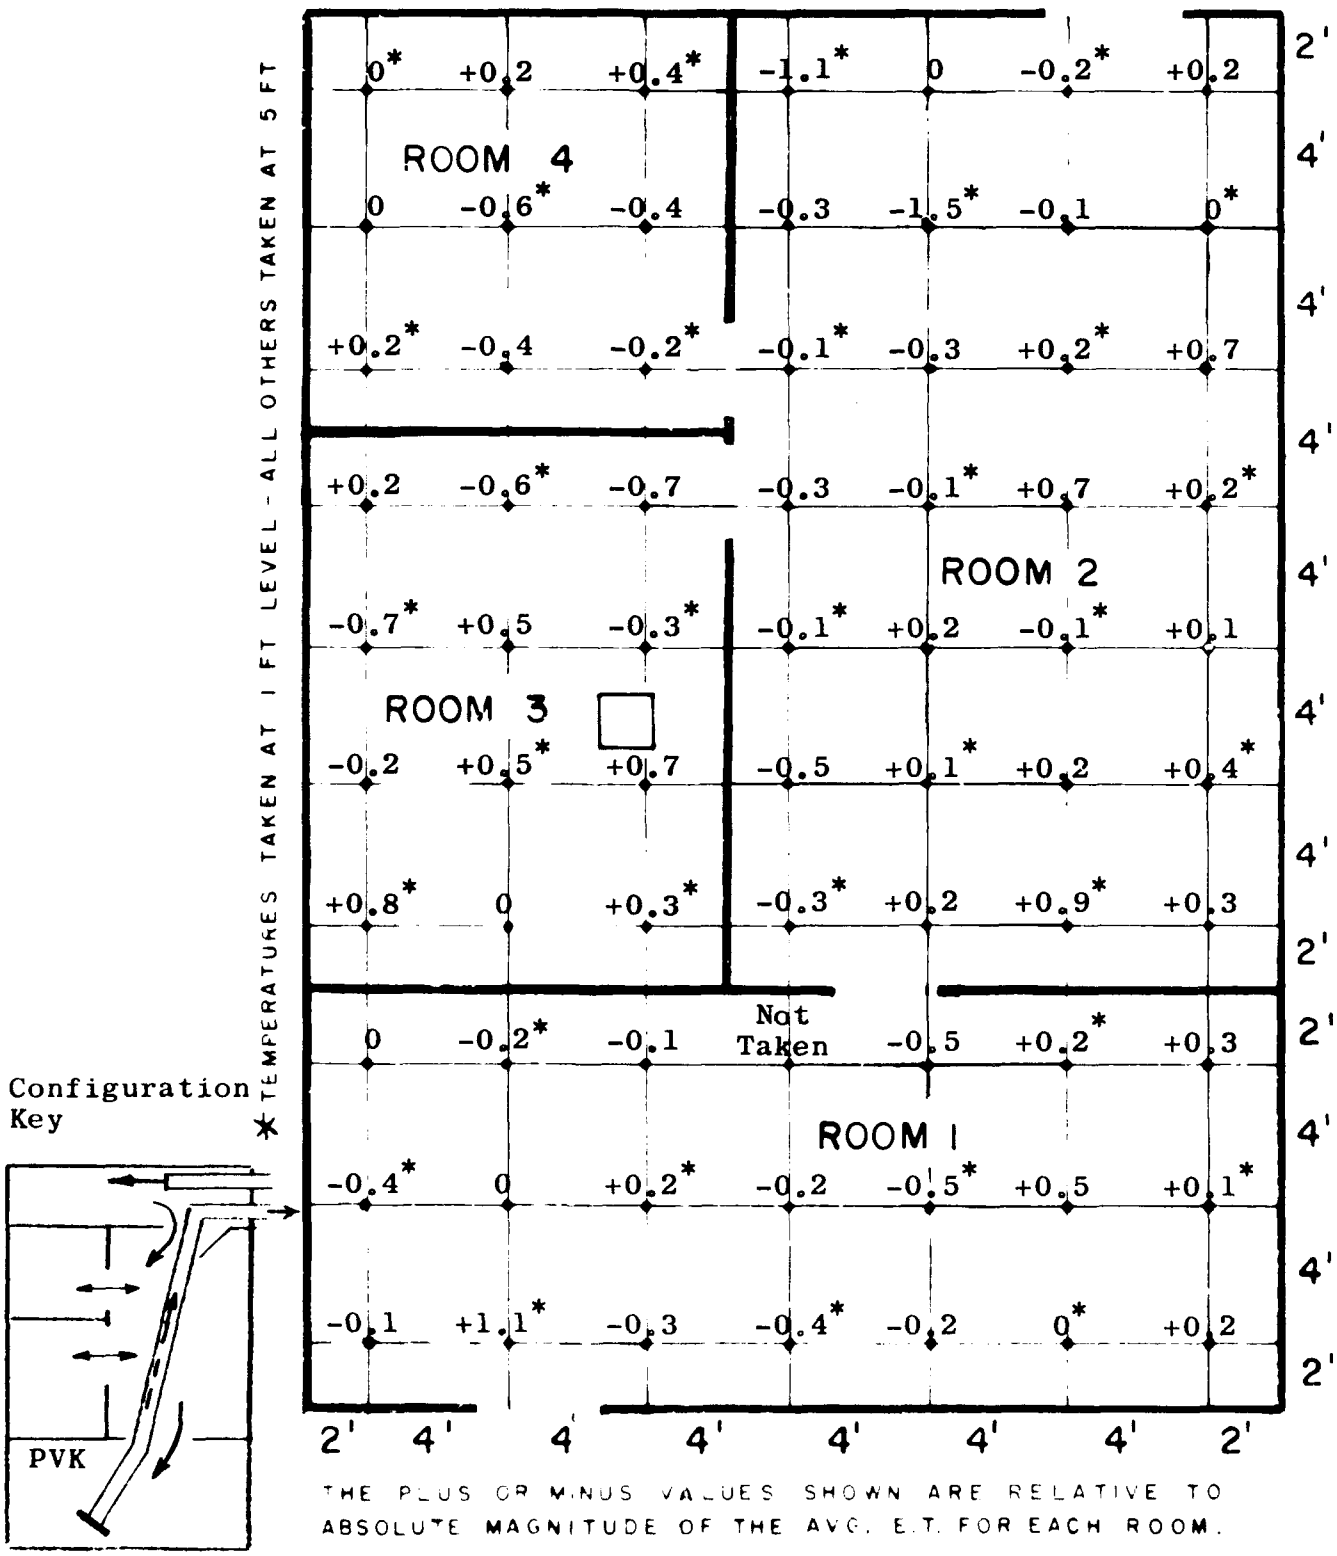

Configuration Key

* TEMPERATURES TAKEN AT 1 FT LEVEL - ALL OTHERS TAKEN AT 5 FT

THE PLUS OR MINUS VALUES SHOWN ARE RELATIVE TO ABSOLUTE MAGNITUDE OF THE AVG. E.T. FOR EACH ROOM.

Figure No. 19 which follows, illustrates the air flow pattern at the doorways of Rooms 3 and 4 during tests conducted under Configuration 2-N. The "supply" air enters the side rooms via the bottom section of the doorway; the "exhaust" air exits through the top portion. The areas of the doorway ascribed to "supply" and "exhaust" air depend largely on the thermal currents developed within the side rooms, the relative thermal condition of the two air masses (specific weight) and air currents which might be present at or near the doorways. The latter of these factors was not significant except during Tests 47 and 48, during which time the shelter supply air was baffled toward the doorways of the side rooms (See section of this report entitled "Air Flow Patterns" for the response of the side rooms during such tests.)

The volume of air which passes through these doorways (i.e., the ventilation rate of the side rooms) depends on the aforementioned factors; also the flow rate is limited by the size of the doorway. Air flow rates into the side rooms were determined by a heat balance method which utilized the difference between the heat content of the "supply" and "exhaust" air. A sample calculation using this method of air flow determination is included in this report as Appendix A-3. The thermal conditions of "inlet" and "exhaust" air were determined by a 12 point traverse at the doorway. (The area associated with each flow direction had previously been determined by the generation of smoke patterns within the doorway.)

The lower portion of Figure 19 shows the areas in the center of which measurements were made during Test 30; the temperatures for the areas shown are listed. The height of the boundary line separating inlet and exhaust areas of the doorway did not vary appreciably from test to test and was in general located approximately 43 inches above the floor.

Table VI is a summary of 17 ventilation rates which were determined by the heat balance method. Comparing the ventilation rates of Rooms 3 and 4 for any test, it can be seen that these rates differ only slightly, lending support to the supposition that the flow generated by the thermal output of the simocs is not a linear function of the number of simocs, but is controlled by the door geometry.

A maximum ventilation rate of 375 cfm was recorded during Test 39 for both Rooms 3 and 4. This rate corresponds the per capita rates of 19.7 and 28.8 cubic feet per minute, respectively. The effective temperatures of Rooms 3 and 4 during this same period were 85.5 F and 83.5 F, respectively.

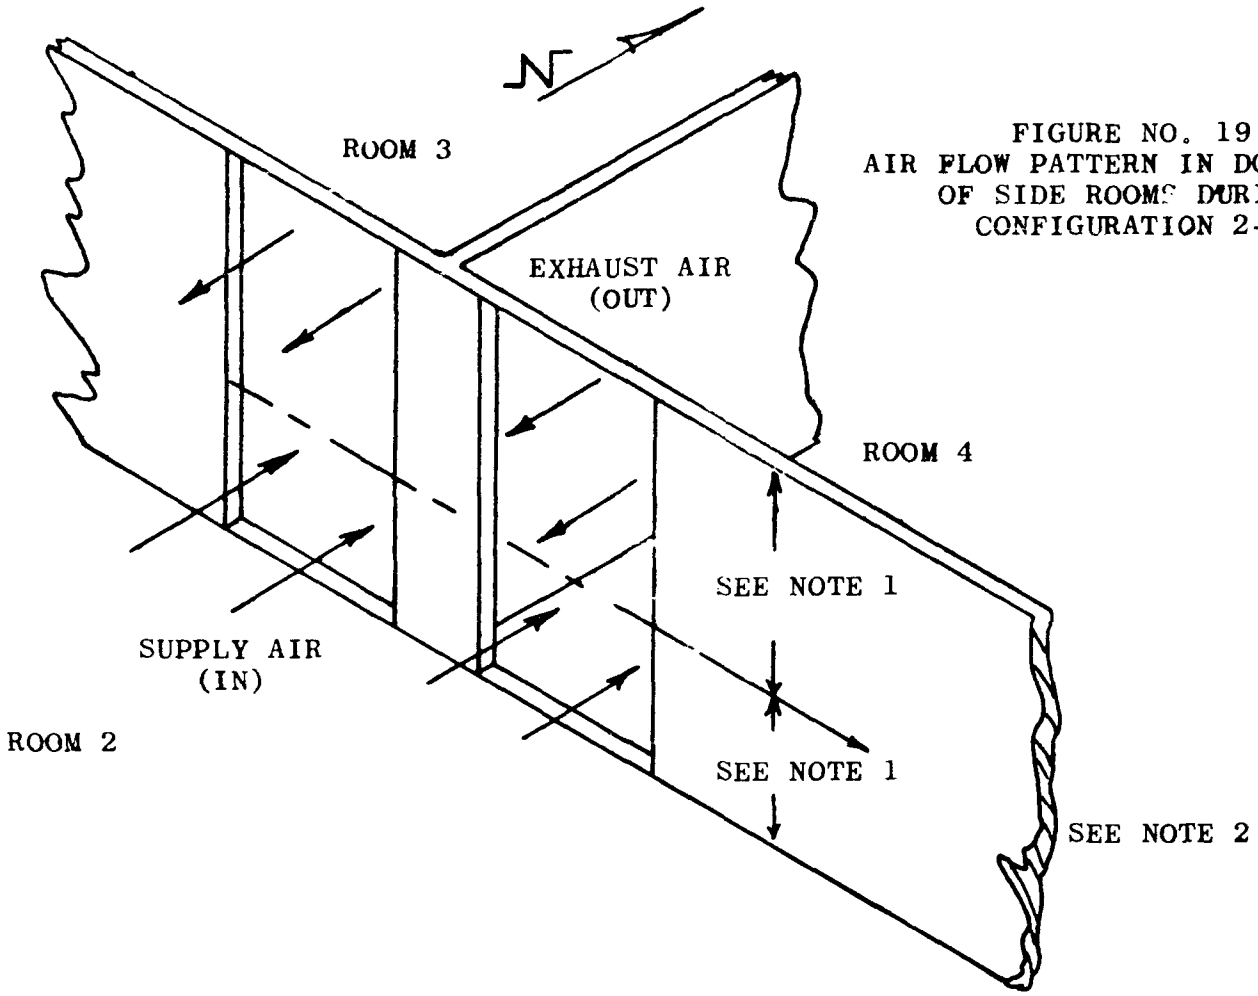

FIGURE NO. 19
AIR FLOW PATTERN IN DOORWAYS
OF SIDE ROOMS DURING
CONFIGURATION 2-N

TYPICAL TRAVERSE AREA LAYOUT
(Actual values given in Table at Left)

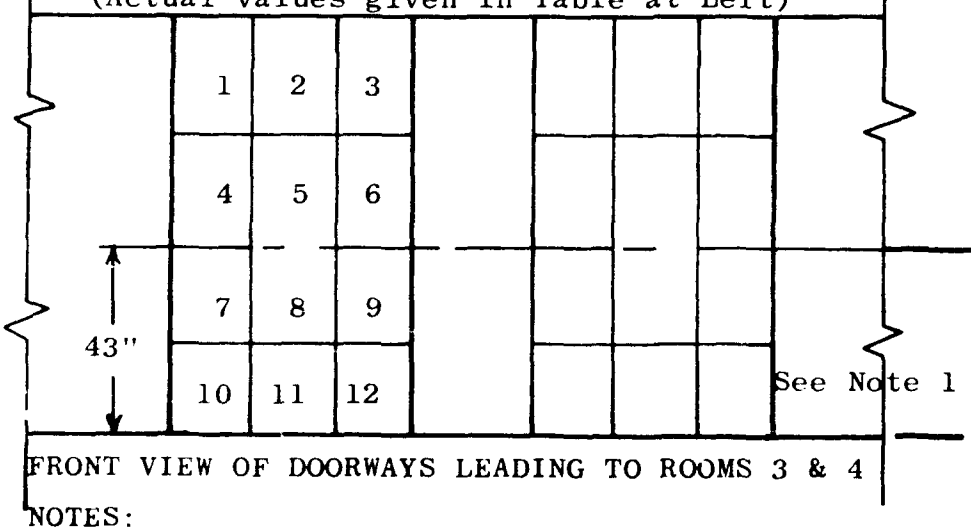

FRONT VIEW OF DOORWAYS LEADING TO ROOMS 3 & 4

VALUES FOR TEMPERATURES
WITHIN TRAVERSED AREA
(Test 30, Room 3)

		db db	wb
Exhaust	1	96.3	87.3
	2	96.8	86.7
	3	96.3	87.2
	4	95.7	87.8
	5	96.0	87.5
	6	96.3	87.5
Supply	7	94.0	81.3
	8	94.0	81.7
	9	93.8	81.3
	10	93.8	80.9
	11	94.0	81.5
	12	94.0	80.7

NOTES:

1) The height at which the boundary was established between Inlet and Exhaust air was determined by the generation of "smoke" patterns within the doorway for each temperature traverse.

2) Boundary lines were well defined within a range of 3 to 6 inches for all tests conducted.

TABLE VI

Summary of Ventilation Rates as Determined by Heat Balance Method

Test No.	Config. No.	Average Inlet Temp.*** Room 3 db. wb	Average Inlet Temp.*** Room 4 db, wb	Average Exhaust Temp.*** Room 3 db, wb	Average Exhaust Temp.*** Room 4 db, wb	Ventilation Rate (CFM) Room 3	Ventilation Rate (CFM) Room 4
24*	2-N	88.3, 78.9	88.0, 78.6	92.1, 84.2	90.2, 82.5	302	289
24**	2-N	94.7, 82.3	94.5, 81.4	96.1, 86.9	94.5, 85.2	329	278
26	2-N	Not Taken	81.0, 76.0	Not Taken	85.9, 79.9	Not Taken	300
30	2-N	94.0, 81.4	94.2, 80.9	96.4, 87.5	95.6, 85.5	251	224
31	2-N	93.3, 80.9	93.5, 80.9	95.1, 86.8	95.0, 84.9	251	266
34	2-N	87.7, 79.0	87.5, 78.7	91.9, 84.2	90.9, 82.3	307	317
39	2-N	83.6, 78.6	83.5, 78.2	88.8, 83.0	88.2, 81.3	375	374
40	2-N	89.0, 79.9	88.7, 79.5	92.6, 85.6	91.7, 83.2	275	304
44	2-N	93.6, 81.5	93.9, 81.5	94.6, 86.8	94.8, 84.8	288	325

* Inlet and Exhaust entry temperatures correspond to shelter response at 0100.

** Inlet and Exhaust entry temperatures correspond to shelter response at 1400.

*** The Inlet and Exhaust conditions of the air were determined by a twelve point traverse using a battery operated aspirating psychrometer.

Tracer Gas Measurements were made during a number of tests to estimate air exchange rates. As described in the Section, "Operational Procedures", a shelter room to be tested was "dosed" with carbon dioxide, then depletion of the tracer gas with time was determined and by a mathematical operation, made to indicate the number of air changes per minute. A correction was made to allow for the fact that some of the tracer gas was recirculating to the area under test. The results of a number of such tests are shown in Table VII. When average values for the air flow through the doorways are determined, it is found that for Room 3, the average of all tests made under the 2-N (no Punkahs) Configuration, is 307 cfm, while for Room 4 under this same Configuration, the average ventilation is 333 cfm. The individual corrected ventilation rates do not differ significantly from these averages, indicating that the ventilation rates through the doorways are independent of shelter ventilation rates and supply air temperatures. The same is generally true for the configurations where Punkahs were employed, here the ventilation rates are 1300 cfm for Room 3 and 1100 for Room 4, and while individual test results differ from these values by up to 50%, there does not seem to be any regular dependence on shelter ventilation rate or supply air temperatures. Considering the uncertainty in the correction factors when Punkahs were employed, the variations are not significant.

As noted in the discussion accompanying the section on ventilation rates determined by heat balances, it appears that ventilation through a doorway is largely independent of the conditions existing outside the doorway. Since the air supply for the side rooms comes from and returns to the same area (Room 2), the side rooms act simply as heaters and saturators, and raise the air through the same range of temperature and humidity regardless of the initial conditions. The ventilation rate becomes a function of the thermal ("stack") effect of the rise in temperature and humidity and the doorway dimensions.

TABLE VII Summary of Ventilation Rates Determined by Gas Tracer Method

Test No.	Room No.	Shelter Ventilation Rate (Cfm/occ)	Config. No.	Apparent Ventilation Rate (Cfm)*	Correction Value 1-(C inlet/C exhaust)	Corrected Ventilation Rate (Cfm)**
17	4	13.5	1-P	166	0.32	518
17	3	13.5	1-P	262	0.32	820
20	4	22.5	1-P	273	0.55	495
22	4	10.5	1-P	202	0.26	775
24***	3	13.5	1-P	133	0.32	418
26	4	13.5	2-N	260	0.75	347
27	3	13.5	2-P	417	0.32	1300
27	4	13.5	2-P	382	0.32	1190
30	3	13.5	2-N	195	0.75	260
30	4	13.5	2-N	220	0.75	293
31	3	18.2	2-N	184	0.80	230
32	4	18.2	2-P	370	0.44	842
32	3	18.2	2-P	466	0.44	1060
33	3	18.2	2-P	551	0.44	1190
34	4	18.2	2-N	295	0.80	369
34	3	18.2	2-N	292	0.80	365
37	4	18.2	2-P	375	0.44	852
38	3	10.5	2-P	367	0.26	1400
38	4	10.5	2-P	380	0.26	1460
39	4	10.5	2-P	300	0.26	1150
40	4	10.5	2-N	225	0.72	313
40	3	10.5	2-N	169	0.72	235
41	3	10.5	2-P	374	0.26	1440
41	4	10.5	2-P	335	0.26	1290
42	4	8.0	2-P	310	0.20	1550
42	3	8.0	2-P	339	0.20	1685
43	4	8.0	2-N	274	0.70	391
43	3	8.0	2-N	345	0.70	493
44	3	21.0	2-N	208	0.81	257
44	4	21.0	2-N	231	0.81	285
50	4	13.5	2-P	240	0.32	750
52-R	4	22.5	2-P	413	0.55	750
52-R	3	22.5	2-P	546	0.55	994
51-	3	22.5	2-N	366	0.81	452
53***	3	25.0	1-N	187	0.84	223

* Ventilation rate based on assumption that air enters side rooms once, exits, and never returns.

** Ventilation rate considering that some air enters side rooms, exits, and returns again.

*** CO_2 Test was conducted during maximum response of shelter.

The Package Ventilating Kit (PVK) was tested only to the extent that operating points were chosen from the performance curve and by utilizing a D.C. motor, the fan was driven at the speed necessary to provide the required air flow at that point. Occasional checks were made on speed and static pressure at the fan, but this data was not used to determine fan performance.

When using the PVK as an exhaust fan, some difficulty was experienced with the application of the polyethylene duct. The duct may not readily be used when it is required to make a sharp turn of more than about 20 degrees. Such a turn causes a crease or partial collapse of the duct resulting in an increase of static pressure within the duct and a significant reduction in the flow rate. Some peripheral support must be provided along the duct at the point of the bend to prevent this collapse.

When the duct was used with its exhaust end unattached severe whipping and snapping was experienced which resulted in splitting of the plastic. In addition, a spontaneous constriction developed three to four duct diameters upstream from the end. Since the constriction did not present a good venturi shape to the flowing air, permanent pressure drop occurred at this point. Both the whipping and the constriction could be prevented by restraining the duct with a heavy object placed inside the end. It was necessary to obstruct about one-third of the area at the duct end to prevent the constriction from developing upstream.

In one portion of the test, the plastic duct was attached to sheet metal ductwork for its passage through the shelter walls. This effectively eliminated any whipping of the duct end, but did not prevent the constriction from developing. Photograph 12 shows the exterior of the duct, while Photograph 13 was taken looking into the metal duct. The assymetry of the constriction is apparent in this latter view.

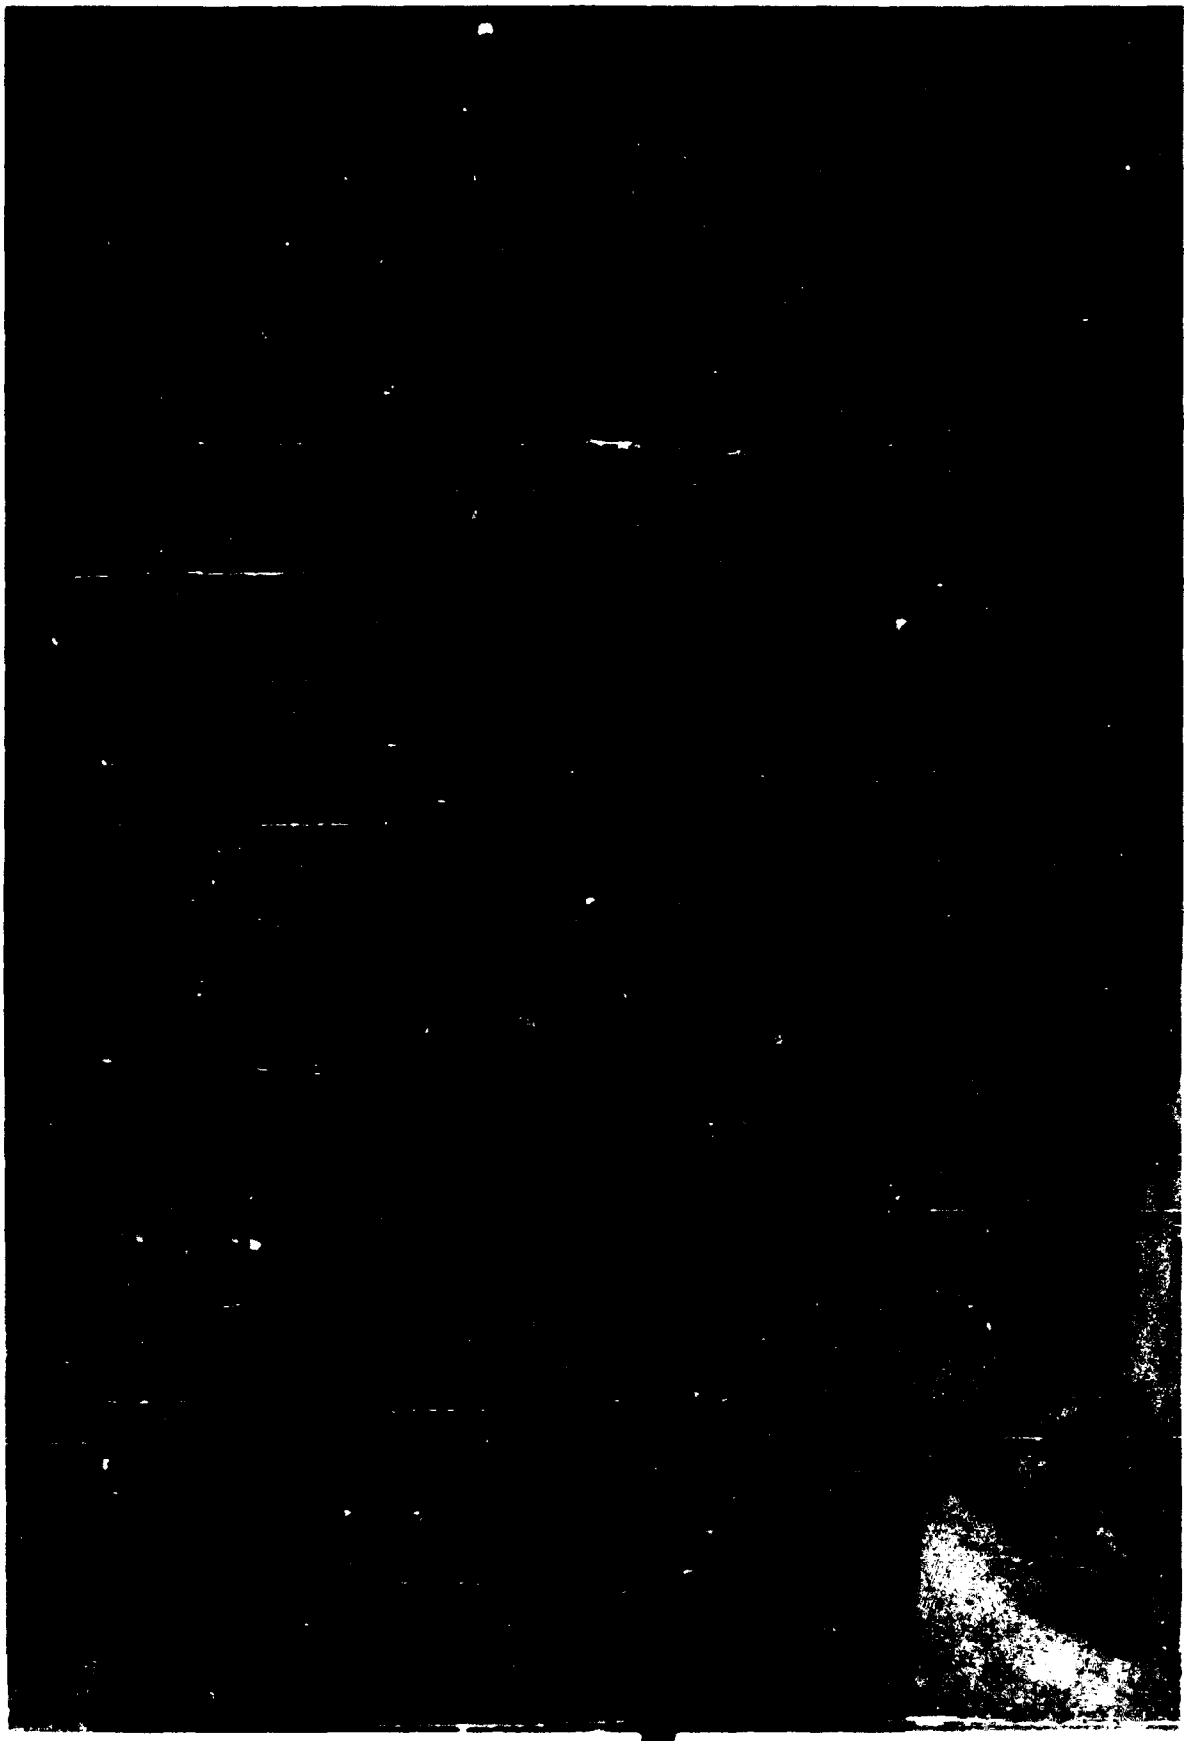

Photograph No. 12. Partial Collapse of Exhaust Duct at Juncture With Metal Ductwork

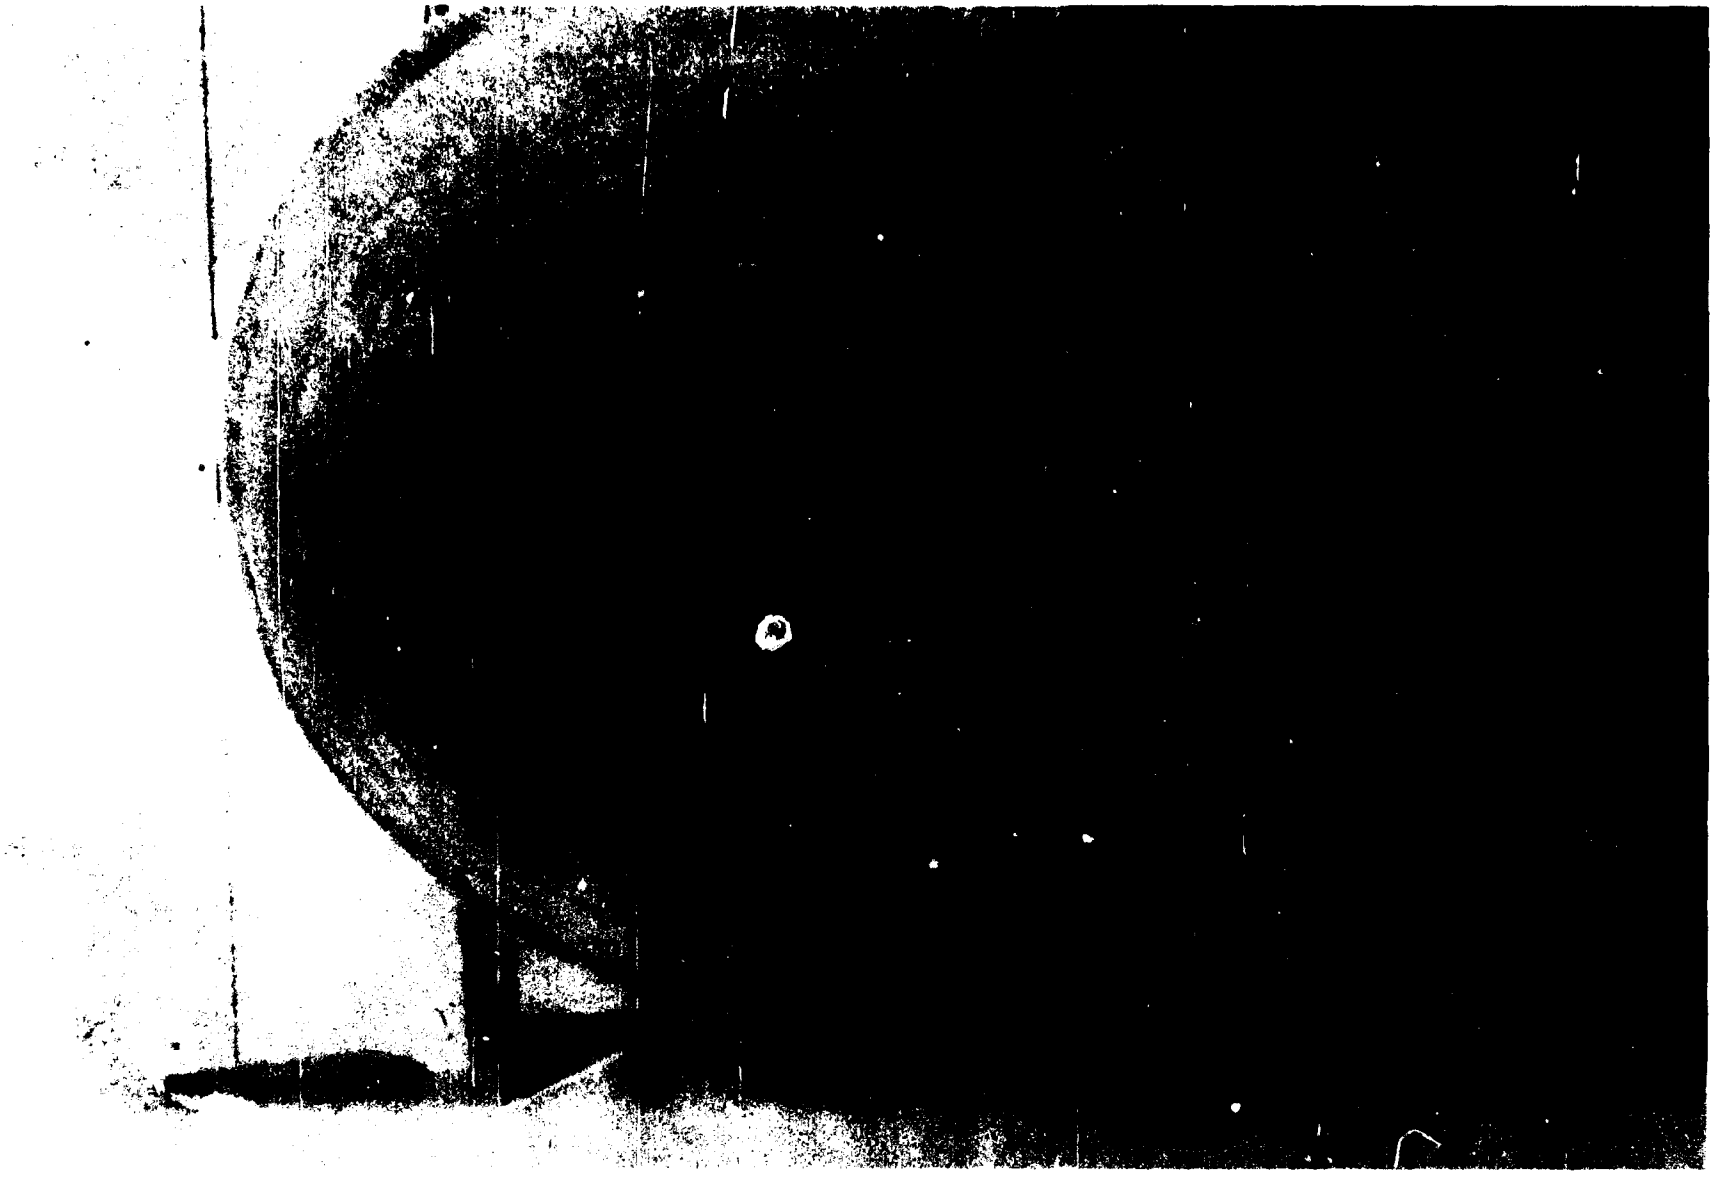

Photograph No. 13. View Into Exhaust Duct Showing Constriction

VII. CONCLUSIONS

A series of thermal response tests were made of a compartmented, adiabatic, simulated protective shelter located in the basement room of the 1000 Persons Protective Shelter at the Protective Structures Development Center, Fort Belvoir, Virginia. The shelter was ventilated at varying rates with air which was conditioned to reproduce the ambient-air conditions expected during a "1% High Design Day", for the rural vicinity of Washington, D.C. (Springfield, Virginia). The thermal response of areas of the shelter was determined when ventilated for extended periods with air which followed a diurnal variation of temperature and humidity. Responses were also determined in a series of steady-state tests in which air at the maximum, average, and minimum conditions occurring during a diurnal cycle was continuously furnished until the shelter environment reached thermal equilibrium. Ventilation of the shelter was accomplished by use of a Package Ventilation Kit utilized in both "supply" and "exhaust" modes and either drawing from, or causing the shelter to draw from a zero pressure plenum which was supplied with the conditioned air. Based on the data taken during the tests, and on observations made by the test personnel, the following conclusions are drawn.

1. The Package Ventilation Kit, because of its flexibility of location, is well suited for ventilation of protective shelters. Ventilation rates of up to 2800 cubic feet per minute were obtainable from the fan of a single PVK, when driven by an electric motor, and with forty-five feet of 20 inch diameter polyethylene duct attached. Evaluation of the fan performance was not within the scope of the contract.

2. A theoretical calculation, supported by actual tests, indicates that the optimum ventilation configuration is one in which air flows in series through shelter rooms or areas. Configurations which permit recirculation of air result in higher average effective temperatures. Proper placement of the shelter ventilating fan, coupled with some capability on the part of the shelter occupants to close some existing openings and create others, can effect a series ventilating path in a compartmented shelter.

3. In the ventilation of a compartmented shelter, flow of air to a "side" room (i.e., a room not in a series air flow path, but connecting to such a "main" room by one or more openings) is largely dependent on thermal currents generated within the room and is little affected by the amount or condition of the air supplied to the "main" room. At the lower ventilation rates, some dependence of the "side" room ventilation on shelter ventilation rates can be shown, due to the sweeping away of the exhaust from the "side" rooms, but in this ventilation rate range, the "side" rooms are uninhabitable from either criterion of effective temperature considered.

4. Employment of Punkah Pumps in doorways exerted a beneficial effect on conditions within otherwise unuseable "side" rooms, with undue adverse effects on the "main" rooms from which they were moving air.

5. An air directing baffle, utilized to cause direct impingement of air on the doorways of "side" rooms, was not a successful approach to improving their ventilation. The directed air stream from a ceiling to floor baffle completely blanketed the doorway and impeded the exit of exhaust air.

6. The flexible polyethylene film tubing furnished to be used as an exhaust duct with the PVK exhibited instability at high air flow rates which could have destroyed it in time. Stable flow could only be obtained by restraining the exit end of the duct and by simultaneously restricting the area of the exit end by about thirty percent. Sharp bends of more than twenty degrees caused a collapse of the sides of the duct which greatly increased its resistance to air flow. A constriction spontaneously developed near the exhaust end of the duct at high air flows which also reduced air handling capability. It is concluded this type of ducting needs further development.

7. Utilization of the PVK in an exhaust configuration was slightly superior, as measured by the conditions noted in the "side" rooms, compared to its employment as a supply fan. A ten percent reduction in the ventilation air supply rate could be made for the exhaust configuration, as compared to the supply configuration, while maintaining the shelter at an average effective temperature of 85.0 F. The effect is believed due to more positive air flow patterns existing in the supply configuration which impeded thermal currents from exiting the "side" room doorways as had been found when an air directing baffle was used.

8. Adiabatic operation of a simulated shelter is realizable in practice by proper insulation of test structures and by maintaining temperature control of the surroundings. When so operated, simulated shelters represent typical areas in the interior cores of multi-story buildings. Deviations of the simulated shelter behavior from that of a "real" shelter result from the fact that tests made of actual shelter areas have not been made under extreme "high design" weather conditions, and therefore have demonstrated heat losses by conduction and radiation that would not be present under the worst conditions, when adiabatic operation will be closely approached. In addition the mass of material (walls, partitions, floor, furnishings, etc.) to be found in a "real" shelter, may be expected to attenuate the amplitude of cyclic temperature variations to a greater degree than that experienced in the simulated shelter which was very lightly constructed.

9. When operated as an "adiabatic" shelter, the response of the structure approached the predicted values very closely. Average shelter effective temperatures did not differ by more than 0.5 degrees from those calculated in advance, and were usually within 0.2 degrees. Effective temperature of any room serving as an exhaust chamber could be predicted with similar accuracy, but temperatures to be expected in "side" rooms could not be predicted with confidence.

10. When subjected to a steady-state test with ventilation air at the average temperature selected from the diurnal cycle, the response of the shelter as a whole very closely approacimated the time-averaged response of the shelter, ventilated at the same rate, with air whose conditions followed a diurnal cycle of temperature and humidity variation. The possibility of substituting several 8-10 hour steady-state tests for a 72 hour diurnal test exists, with savings in time and expense.

11. With respect to the actual thermal responses determined, it is concluded that no diurnal ventilation rate tested was adequate to control

all shelter rooms so that a maximum effective temperature was never exceeded; ventilation rates from 10 to 25 cubic feet per minute per occupant were employed. All diurnal ventilation tests conducted at 22-25 cfm per occupant demonstrated the habitability of the room through which the ventilation air first entered the shelter for a criterion of 85 F maximum effective temperature. No diurnal ventilation test conducted at 13.5 cfm per occupant, the room serving as the inlet for ventilation air, was habitable for a criterion of 85 F average effective temperature. Under these conditions, and for this criterion "side" rooms also became habitable when Punkahs were employed.

12. Estimation of ventilation rates for "side" rooms by heat balance measurements and by tracer-gas techniques indicates that ventilation rates of 300-350 cubic feet per minute may be expected for a doorway 32-1/2 by 78-1/2 inches in size. Velocity measurements indicate that the "inlet" portion of this door extends upward 43 inches from the floor, there is a region of about 6 inches in which flow is indeterminate, the balance of the door serves as an exhaust. It is concluded that natural ventilation through doorways is largely independent of conditions existing in a "main" room, except as directed air flows may impede thermal currents.

VIII. BIBLIOGRAPHY

1. American Society of Heating, Refrigerating, and Air Conditioning Engineers, "A.S.H.R.A.E. Guide and Data Book," Ch. 8, 1963.

2. "ibid".

3. Fluor Products Company, "Evaluated Weather Data for Cooling "Equipment Design," First Edition, 1958.

4. Kearny, C. H., "Manual Shelter-Ventilating Devices for Crowded Shelters Cooled by Outside Air", ORNL-TM-1154, Preliminary Report.

5. Guy B. Panero, Incorporated, "Summer Ventilation Test Above Ground Fallout Shelter, 40 Wall Street Building, New York City", Contract OCD-PS-64-201, Subcontract B-64212-VS, Subtask 1214-B.

6. MRD Division, General American Transportation Corporation, "Analysis of Above-Ground Fallout Shelter Ventilation Requirements", Contract OCD-OS-63-176, Subtask 1215 A.

7. American Society of Heating, Refrigerating, and Air Conditioning Engineers, "A.S.H.R.A.E. Guide and Data Book", Ch. 23, 1963.

8. NBS Report 7369, "Studies of Environmental Factors in a Family-Size Underground Shelter," Washington, D.C., March, 1961.

9. Allen, F. C., Symposium on Survival Shelters, A.S.H.R.A.E., June, 1962.

APPENDICES

APPENDIX A-1

Sample Calculations for the Determination of Overall Heat Transmission Coefficient, "U".

Experimentally Determined "U".

Equation No. 1

$$U = \frac{Q}{A \times \Delta T}$$

Where:

U = Overall Heat Transmission Coefficient (Btu/hr.sq.ft.F)

Q* = Sensible Heat Liberated within Structure (Btu/hr)

A = Area of Walls and Ceiling (Sq.ft.)

ΔT** = Temperature gradient @ Steady State (Deg. F)

$$U = \frac{23,500}{2160 \times 8.8} = 1.23 \text{ Btu/hr.sq.ft.F}$$

Design "U" Determination

Determination of "U" value after addition of Styrofoam Insulation (1 inch thick) to walls and ceiling.

Ceiling Section

	Construction	Resistance (R***)
1.	Outside Surface (Still air)****	0.68
2.	Styrofoam (1 inch thick)	3.85
3.	Vinyl (10 mil)	——
4.	Inside Surface (Still air)	0.68
	Total R_1 =	5.21

$$U_1 = 1/R_1 = 1/5.21 = 0.192$$

---

*Heat to structure was electrical energy and was metered by KWH meter - rate was 6.9 KW or 23,500 Btu/hr.

**Average temperature gradient was determined from twelve thermocouple pairs located across walls and ceiling sections.

***Resistance values from ASHRAE Guide and Data Book, Chapter 23.

****Outside surfaces on the exterior of the shelter, were in "still" air, since located within the basement area of Building 2591, FSDC.

Wall Section (Type A)

Construction	Resistance (R)
1. Outside Surface (Still air)	0.68
2. Styrofoam (1 inch thick)	3.85
3. Air Space (3-5/8 inches)	0.91
4. Plywood (1/4 inch thick)	0.31
5. Inside Surface (Still air)	0.68
Total R_2 =	6.43

$$U_2 = 1/R = 1/6.43 = 0.155$$

Wall Section (Type B)

Construction	Resistance (R)
1. Outside Surface (Still air)	0.68
2. Styrofoam (1 inch thick)	3.85
3. Plywood (1/4 inch thick)	0.31
4. Inside Surface (Still air)	0.68
Total R =	5.52

$$U_3 = 1/R = 1/5.52 = 0.181$$

Composite Shelter "U" Value (i.e., U value based on a weighted average considering areas of individual sections)

$$U_c = U_1 \times \text{Area ratio} + U_2 \times \text{Area ratio} + U_3 \times \text{Area ratio}$$

$$U_c = 0.192 \times 0.518 + 0.181 \times 0.241 + 0.155 \times 0.241$$

$$U_c = \underline{\underline{0.171 \text{ Btu/hr.sq.ft.F}}}$$

APPENDIX A-2

Sample Calculations for Prediction of Shelter Effective Temperatures for "Adiabatic" Conditions.

Definition of Symbols used in Calculations:

h = Enthalpy of moist air - $\frac{\text{Btu}}{\text{lb.dry air}}$

v = Specific volume of moist air - ft^3/lb.dry air

w = Moisture content of air - $\frac{\text{lb. moisture}}{\text{lb.dry air}}$

T_{db} = Dry bulb temperature of air

T_{wb} = Wet bulb temperature of air

$\dot{m}$ = Mass flow rate of air supplied to shelter - $\frac{\text{lb.air}}{\text{min.occ}}$

Q = Volume flow rate of air supplied to shelter - $\frac{ft^3}{\text{min.occ}}$

Problem: Determine the effective temperature resulting from an assumed ventilation rate of 13.5 ft^3/min.occ.

Solution:

Given:

Ventilation air supplied at T_{db} = 84.6 F and

T_{wb} = 75.5 F corresponding to <u>average</u> design day conditions

Let: Subscript 1 denote supply condition

Subscript 2 denote exhaust condition

From Psychrometric Chart at condition 1:

h_1 = 39.07 Btu/lb.dry air

v_1 = 14.17 ft^3/lb.dry air

w_1 = 0.017 lb.moisture/lb.dry air

$$\dot{m} = \frac{Q}{v_1} = \frac{13.5}{14.17} = 0.952 \ \frac{\text{lb.air}}{\text{min. occ}}$$

Δh_{2-1} = heat release in shelter is 400 Btu/hr.occ or

$$\frac{400}{(60)(0.952)} = 7.00 \text{ Btu/lb.dry air}$$

$$h_2 = h_1 + \Delta h_{2-1} = 39.07 + 7.00 = \underline{46.07 \text{ Btu/lb.dry air}}$$

Assume T_{db_2} = 90 F Latent Heat Loss @ 90 F = 0.274 $\frac{\text{lb.water}}{\text{hr.occ.}}$

$$w_2 = \frac{\frac{0.274}{60} + (0.952)(0.017)}{0.952} = 0.0218 \frac{\text{lb.moisture}}{\text{lb.dry air}}$$

From Psychrometric Chart @ 90 F and 0.0218 $\frac{\text{lb.moisture}}{\text{lb.dry air}}$

$$h_2 = \underline{45.70 \text{ Btu/lb.dry air}}$$

Therefore the assumption of T_{db_2} = 90 F was too low

Assume T_{db_2} = 91 F Latent Heat Loss @ 91 F = 0.2830 $\frac{\text{lb.water}}{\text{hr.occ.}}$

$$w_2 = \frac{\frac{0.2830}{60} + 0.0162}{0.952} = 0.02195 \frac{\text{lb.moisture}}{\text{lb.dry air}}$$

$$h_2 = \underline{46.06 \text{ Btu/lb.dry air}}$$

This agrees closely with the required h_2 of 46.07 Btu/lb.dry air

From Psychrometric Chart @ 91 F and 0.02195 $\frac{\text{lb.moisture}}{\text{lb.dry air}}$

$$T_{db_2} = 91.0 \text{ F}$$

$$T_{wb_2} = 82.2 \text{ F}$$

This gives a predicated effective temperature of <u>85.2 F.</u>

From Psychrometric Chart at conditions 2:

$$h_2 = 46.35 \text{ Btu/lb.dry air}$$

$$V_2 = 14.35 \text{ ft}^3\text{/lb.dry air}$$

Equation 1:

$$QxM = M(h_2 - h_1) \times 60$$

Therefore:

$$M = \frac{Q \times n}{(h_2 - h_1) \times 60} = \frac{400 \times 13}{(46.35 - 42.30) \times 60}$$

$$M = 21.2 \frac{\text{lb.dry air}}{\text{min}}$$

Equation 2:

$$V = M\bar{v}$$

Where: $\bar{v}$ = Average specific volume of conditions 1 and 2

$$V = 21.2 \times 14.27$$

$$V = \underline{303 \text{ ft}^3\text{/min.}}$$

---

* It is assumed that the side rooms are adiabatic and that all of the heat generated by the Simocs (400 Btu/hr.occ) is carried out in the ventilation air stream.

** The inlet and exhaust conditions of air were previously determined by a twelve point traverse using a battery operated aspirating psychrometer. The areas assigned to inlet and exhaust air stream were determined by a "smoke" pattern traverse taken prior to temperature traverse.

APPENDIX A-3

Sample Calculations of Air Flow Rate Determination Using Heat Balance Method.

Definition of Symbols used in Calculations:

h = Enthalpy of moist air - $\frac{Btu}{lb.dry\ air}$

v = Specific volume of moist air - ft^3/lb.dry air

T_{db} = Dry bulb temperature of air

T_{wb} = Wet bulb temperature of air

M = Mass flow rate of air - $\frac{lb.air}{min.}$

n = Number of occupants simulated (Room 4)

Q^* = Metabolic heat released by Simoc - Btu/hr.occ

V = Flow rate of air - ft^3/min

Given:**

1) Inlet air conditions in lower portion of doorway @ T_{db} = 87.2 F and T_{wb} = 78.7 F.

2) Exhaust air conditions in upper portion of doorway @ T_{db} = 90.2 F and T_{wb} = 82.3 F.

Let:

Subscript 1 denote inlet conditions.

Subscript 2 denote exhaust conditions.

From Psychrometric Chart at condition 1:

$$h_1 = 42.30 \text{ Btu/lb.dry air}$$

$$V_1 = 14.2 \text{ ft}^3\text{/lb.dry air}$$

From Psychrometric Chart at conditions 2:

$$h_2 = 46.35 \text{ Btu/lb.dry air}$$

$$V_2 = 14.35 \text{ ft}^3\text{/lb.dry air}$$

Equation 1:

$$Q = M(h_2 - h_1)$$

Therefore:

$$M = \frac{Q \times n}{(h_2 - h_1)} = \frac{400 \times 13}{4.35 - 42.30}$$

$$M = 1273 \frac{\text{lb.dry air}}{\text{hr}} \quad \text{or} \quad 21.2 \frac{\text{lb.dry air}}{\text{min}}$$

Equation 2:

$$V = M\,\bar{v}$$

Where: $\bar{v}$ = Average specific volume of conditions 1 and 2

$$V = 21.2 \times 14.57$$

$$V = \underline{312 \text{ ft}^3\text{/min}}$$

---

* It is assumed that the side rooms are adiabatic and that all of the heat generated by the Simocs (400 Btu/hr.occ) is carried out in the ventilation air stream.

** The inlet and exhaust conditions of air were previously determined by a twelve point traverse using a battery operated aspirating psychrometer. The areas assigned to inlet and exhaust air streams were determined by a "smoke" pattern traverse taken prior to temperature traverse.

APPENDIX B

TEMPERATURE DATA TABULATION

TABLE I-B

Index to Temperature Data

The data contained in Table I-B is listed in chronological order. In order that this data can be made readily accessible, the following index relates the test number, with the period during which the test was conducted. The significance of data points 1-49 in Table II-B may be determined by reference to Tables III and IV in the body of the report.

TEST NO.	TEST PERIOD (Date & Time)				
1	1200	4/20/65	through	1600	4/24/65
2	0600	4/27/65	through	1800	4/27/65
3	1900	4/27/65	through	0200	4/28/65
4	0300	4/28/65	through	1700	4/28/65
5	1800	4/28/65	through	2300	4/28/65
6	2400	4/28/65	through	1100	4/29/65
7	1200	4/29/65	through	1700	4/29/65
8	1800	4/29/65	through	2300	4/29/65
9	2400	4/29/65	through	1000	4/30/65
10	1100	4/30/65	through	1700	4/30/65
11	2200	4/30/65	through	0800	5/1/65
12	0300	5/3/65	through	1400	5/3/65
13	1500	5/3/65	through	0300	5/4/65
14	0400	5/4/65	through	1400	5/4/65
15	1500	5/4/65	through	2200	5/4/65
16	2300	5/4/65	through	0500	5/5/65
17	0600	5/5/65	through	1500	5/5/65
18	1600	5/5/65	through	2200	5/5/65
19	2300	5/5/65	through	0700	5/6/65
20	0800	5/6/65	through	1700	5/6/65
21	1800	5/6/65	through	0100	5/7/65
22	0200	5/7/65	through	1200	5/7/65

TABLE I-B, CONTINUED

TEST NO.	TEST PERIOD (Date & Time)				
23	1800	5/7/65	through	0100	5/8/65
24	1700	5/9/65	through	1700	5/13/65
25	1800	5/13/65	through	2400	5/13/65
26	0100	5/14/65	through	1600	5/14/65
27	0400	5/17/65	through	1100	5/14/65
28	1200	5/17/65	through	2000	5/17/65
29	2100	5/17/65	through	0200	5/18/65
30	0300	5/18/65	through	0900	5/18/65
31	1200	5/18/65	through	2000	5/18/65
32	2100	5/18/65	through	2400	5/18/65
33	0100	5/19/65	through	0500	5/19/65
34	0600	5/19/65	through	1300	5/19/65
35	1400	5/19/65	through	2300	5/19/65
36	2400	5/19/65	through	1200	5/20/65
37	1300	5/20/65	through	1900	5/20/65
38	2100	5/20/65	through	1000	5/21/65
39	1100	5/21/65	through	1500	5/21/65
40	1600	5/21/65	through	2400	5/21/65
41	1000	5/23/65	through	2000	5/23/65
42	2100	5/23/65	through	0900	5/24/65
43	1000	5/24/65	through	2000	5/24/65
44	2100	5/24/65	through	1600	5/25/65
45	1700	5/25/65	through	1100	5/26/65
46	2300	5/26/65	through	1800	5/29/65
47	1900	5/29/65	through	1800	6/1/65
48	1900	6/1/65	through	1900	6/4/65

TABLE I-B, CONTINUED

TEST NO.	TEST PERIOD (Date & Time)				
49	2000	6/4/65	through	1800	6/6/65
50	1900	6/6/65	through	1800	6/8/65
51	2000	6/8/65	through	0300	6/9/65
52	0400	6/9/65	through	1200	6/9/65
51-R*	1300	6/9/65	through	1700	6/9/65
42-R*	2100	6/9/65	through	0300	6/10/65
43-R*	0400	6/10/65	through	1200	6/10/65
43-RR**	1800	6/10/65	through	0700	6/11/65
42-RR**	0800	6/11/65	through	1900	6/11/65
53	0100	6/12/65	through	1800	6/14/65
54	1900	6/14/65	through	0300	6/15/65
55	1700	6/15/65	through	1800	6/17/65
56	2100	6/17/65	through	0700	6/18/65
57	0900	6/18/65	through	1600	6/18/65
58	1700	6/18/65	through	2400	6/18/65
59	0100	6/19/65	through	1000	6/19/65
60	1100	6/19/65	through	1800	6/19/65
61	2200	6/19/65	through	0900	6/20/65
62	1000	6/20/65	through	1900	6/20/65
63	2000	6/20/65	through	1500	6/21/65
64	1600	6/21/65	through	2200	6/21/65
65	2300	6/21/65	through	1800	6/24/65
38-R*	2200	6/24/65	through	1000	6/25/65
52-R	1100	6/25/65	through	1800	6/25/65

* Repeat of Numbered Test

** Second Repeat of Numbered Test

TABLE II-B
TEMPERATURE DATA

NOTE: Refer to TABLES III and IV in the Body of the Report for physical location and function of points, and to TABLE II-B, APPENDIX B for the times and [illegible]rations of individual tests.

TIME 1100 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	C.	3	C.	4	C.	5	93.0	6	81.5	7	0.
8	0.	9	92.0	10	86.5	11	92.0	12	80.6	13	91.0	14	76.3
15	93.0	16	88.9	17	98.0	18	88.0	19	95.5	20	84.7	21	99.0
22	88.0	23	C.	24	C.	25	90.5	26	76.5	27	93.5	28	82.5
29	73.5	30	62.0	31	94.0	32	94.0	33	94.0	34	99.0	35	94.0
36	94.5	37	76.5	38	96.5	39	96.5	40	92.6	41	92.0	42	92.0
43	92.5	44	95.5	45	91.0	46	82.5	47	72.5	48	60.0	49	0.

TIME 1200 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	C.	3	C.	4	0.	5	97.1	6	84.5	7	0.
8	0.	9	92.1	10	80.0	11	92.8	12	80.6	13	93.0	14	74.5
15	93.5	16	88.0	17	93.0	18	85.1	19	97.5	20	83.2	21	94.0
22	82.1	23	C.	24	C.	25	91.5	26	76.5	27	93.5	28	82.0
29	67.5	30	51.0	31	94.5	32	94.5	33	94.5	34	94.5	35	94.5
36	94.5	37	76.5	38	97.0	39	97.0	40	93.5	41	93.5	42	93.5
43	93.5	44	86.5	45	93.0	46	83.0	47	69.0	48	60.0	49	0.

TIME 1300 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	C.	3	0.	4	0.	5	97.8	6	85.0	7	0.
8	0.	9	96.0	10	81.7	11	96.6	12	82.7	13	0.	14	0.
15	0.	16	C.	17	96.1	18	80.3	19	0.	20	0.	21	100.0
22	85.4	23	C.	24	0.	25	92.5	26	76.5	27	94.0	28	81.5
29	68.5	30	53.5	31	94.5	32	94.5	33	94.5	34	94.5	35	94.5
36	94.5	37	77.5	38	98.0	39	98.0	40	94.0	41	93.5	42	93.5
43	93.5	44	86.0	45	93.5	46	83.5	47	70.5	48	60.5	49	0.

TIME 1400 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	0.	3	95.0	4	83.0	5	97.0	6	84.7	7	94.0
8	81.2	9	96.0	10	81.6	11	97.0	12	82.9	13	94.0	14	75.7
15	93.5	16	86.2	17	97.0	18	88.0	19	99.0	20	83.8	21	102.0
22	86.6	23	0.	24	C.	25	93.5	26	77.5	27	94.5	28	82.0
29	57.0	30	50.0	31	95.0	32	95.0	33	95.0	34	95.0	35	95.0
36	95.0	37	99.0	38	95.5	39	99.5	40	95.5	41	94.5	42	94.5
43	94.5	44	87.0	45	94.5	46	84.0	47	60.0	48	60.0	49	0.

TIME 1500 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	80.7	3	95.0	4	81.6	5	97.0	6	83.2	7	95.5
8	80.5	9	97.0	10	81.2	11	98.0	12	83.0	13	93.0	14	74.5
15	94.0	16	99.3	17	97.0	18	88.0	19	100.0	20	84.8	21	102.0
22	84.0	23	C.	24	C.	25	93.0	26	76.5	27	94.5	28	81.5
29	66.0	30	48.0	31	95.5	32	95.5	33	95.0	34	95.0	35	95.0
36	95.0	37	99.5	38	100.5	39	100.5	40	96.0	41	95.5	42	95.5
43	94.0	44	86.5	45	95.5	46	84.0	47	68.0	48	60.0	49	0.

TIME 1600 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	C.	3	0.	4	0.	5	98.0	6	83.8	7	98.0
8	82.5	9	99.5	10	84.0	11	98.0	12	88.8	13	101.5	14	86.0
15	0.	16	C.	17	C.	18	0.	19	0.	20	0.	21	0.
22	0.	23	0.	24	0.	25	91.5	26	76.5	27	95.2	28	82.2
29	67.8	30	52.0	31	96.5	32	96.4	33	96.0	34	95.8	35	95.6
36	95.8	37	100.0	38	100.0	39	100.2	40	97.4	41	96.3	42	96.8
43	95.5	44	87.4	45	96.0	46	84.5	47	73.0	48	60.9	49	0.

TIME 1700 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	81.4	3	96.5	4	82.2	5	98.0	6	83.8	7	97.0
8	80.7	9	98.0	10	83.0	11	98.0	12	83.8	13	95.5	14	79.7
15	99.0	16	94.1	17	98.0	18	89.5	19	98.5	20	84.8	21	101.0
22	86.7	23	C.	24	C.	25	90.2	26	76.2	27	95.0	28	82.8
29	72.0	30	60.0	31	95.8	32	95.7	33	95.5	34	95.0	35	95.2
36	95.5	37	99.0	38	99.2	39	99.2	40	96.0	41	95.5	42	95.5
43	94.8	44	87.0	45	94.6	46	84.2	47	75.8	48	61.5	49	0.

TIME 1800 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	82.5	3	[illegible]	4	[illegible]	5	98.6	6	84.3	7	96.5
8	81.5	9	98.0	10	84.0	11	98.0	12	84.0	13	91.0	14	76.3
15	94.0	16	90.0	17	97.0	18	89.0	19	99.0	20	84.8	21	100.0
22	86.2	23	0.	24	C.	25	90.0	26	77.2	27	94.0	28	83.0
29	64.0	30	46.0	31	95.5	32	95.5	33	95.3	34	95.0	35	95.0
36	95.3	37	98.1	38	98.5	39	98.5	40	96.3	41	95.5	42	95.6
43	94.5	44	87.0	45	94.5	46	84.0	47	70.0	48	62.0	49	0.

TIME 1900 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.5	3	95.0	4	83.5	5	98.5	6	85.2	7	95.0
8	80.5	9	98.0	10	84.3	11	98.0	12	84.3	13	89.0	14	76.0
15	99.0	16	93.0	17	98.5	18	90.0	19	97.5	20	84.0	21	99.5
22	85.5	23	C.	24	C.	25	87.0	26	77.0	27	94.2	28	83.2
29	74.0	30	64.9	31	94.6	32	94.8	33	94.9	34	94.0	35	94.5
36	95.0	37	77.0	38	97.5	39	97.5	40	95.5	41	94.0	42	94.5
43	93.4	44	86.5	45	92.8	46	83.5	47	73.0	48	62.6	49	0.

TIME 2000 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.5	3	94.0	4	82.5	5	98.0	6	85.0	7	94.0
8	79.5	9	97.0	10	83.2	11	97.0	12	84.1	13	86.5	14	73.4
15	92.5	16	96.0	17	97.5	18	88.6	19	95.5	20	83.0	21	99.0
22	86.0	23	C.	24	C.	25	84.5	26	75.0	27	92.5	28	82.0
29	67.8	30	52.5	31	92.6	32	93.0	33	93.3	34	92.2	35	93.0
36	93.5	37	75.0	38	95.6	39	95.6	40	92.2	41	92.0	42	92.8
43	91.5	44	85.0	45	90.5	46	82.5	47	68.5	48	63.0	49	0.

TIME 2100 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.6	3	93.0	4	82.3	5	97.5	6	84.5	7	93.0
8	79.5	9	96.0	10	83.4	11	96.0	12	84.3	13	85.0	14	74.0
15	91.5	16	96.0	17	97.5	18	89.0	19	94.5	20	82.5	21	98.5
22	86.4	23	C.	24	C.	25	83.4	26	75.0	27	91.5	28	81.5
29	68.5	30	54.0	31	91.5	32	92.0	33	92.3	34	91.0	35	92.0
36	92.5	37	73.5	38	94.3	39	94.5	40	90.2	41	90.0	42	91.5
43	90.0	44	84.0	45	89.0	46	82.0	47	68.0	48	63.3	49	0.

TIME 2200 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	80.1	3	91.0	4	82.2	5	92.0	6	81.2	7	90.5
8	79.2	9	89.0	10	78.9	11	88.6	12	79.1	13	82.0	14	74.0
15	90.0	16	84.6	17	92.0	18	84.3	19	92.0	20	81.8	21	94.0
22	84.1	23	0.	24	C.	25	80.0	26	74.5	27	90.0	28	81.4
29	67.5	30	52.8	31	89.8	32	91.4	33	91.5	34	89.5	35	90.5
36	91.0	37	71.5	38	92.5	39	92.5	40	88.0	41	88.0	42	89.3
43	88.0	44	83.0	45	87.0	46	81.0	47	68.3	48	63.5	49	0.

TIME 2300 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	80.3	3	86.0	4	77.8	5	92.0	6	81.0	7	90.0
8	75.0	9	88.2	10	79.[illegible]	11	88.2	12	79.5	13	81.0	14	73.5
15	90.0	16	85.0	17	92.0	18	84.8	19	92.0	20	82.[illegible]	21	94.0
22	84.2	23	0.	24	[illegible]	25	80.0	26	74.0	27	89.8	28	81.4
29	68.5	30	54.0	31	89.5	32	90.5	33	90.5	34	89.2	35	90.4
36	91.0	37	71.5	38	92.3	39	92.4	40	87.5	41	87.5	42	89.0
43	87.7	44	82.0	45	86.3	46	80.3	47	67.8	48	63.5	49	0.

TIME 2400 DATE 4/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	80.7	3	90.5	4	80.6	5	92.0	6	81.7	7	89.5
8	79.0	9	88.0	10	78.5	11	88.2	12	80.4	13	80.5	14	73.4
15	89.5	16	84.8	17	92.0	18	85.2	19	91.5	20	81.9	21	94.0
22	84.5	23	0.	24	0.	25	77.8	26	73.0	27	89.5	28	81.5
29	69.5	30	57.0	31	89.0	32	90.1	33	90.1	34	89.0	35	90.1
36	90.8	37	71.0	38	92.0	39	92.0	40	87.0	41	87.0	42	89.0
43	87.5	44	82.2	45	85.6	46	80.1	47	69.0	48	63.8	49	0.

TIME 100 DATE 4/22/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.2	3	90.0	4	81.8	5	91.0	6	80.5	7	88.5
8	78.2	9	87.0	10	78.2	11	87.0	12	79.5	13	79.0	14	72.5
15	89.0	16	85.2	17	91.5	18	84.8	19	91.0	20	81.4	21	93.0
22	83.1	23	C.	24	C.	25	78.5	26	73.5	27	89.0	28	81.2
29	69.5	30	56.2	31	88.5	32	89.8	33	90.0	34	88.5	35	90.0
36	90.5	37	70.8	38	91.5	39	91.5	40	86.4	41	86.4	42	88.5
43	86.9	44	82.0	45	84.8	46	80.0	47	68.2	48	64.0	49	0.

TIME 200 DATE 4/22/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.8	2	80.7	3	90.5	4	82.5	5	91.0	6	80.6	7	89.0
8	79.4	9	87.5	10	78.8	11	87.5	12	79.7	13	79.5	14	73.0
15	89.5	16	85.7	17	92.0	18	84.7	19	91.5	20	82.0	21	93.0
22	83.3	23	0.	24	0.	25	76.7	26	72.0	27	89.2	28	82.0
29	72.0	30	61.5	31	88.5	32	90.0	33	90.0	34	88.7	35	90.0
36	90.7	37	71.0	38	91.7	39	92.0	40	86.2	41	86.0	42	88.2
43	86.7	44	82.0	45	84.7	46	80.0	47	69.0	48	64.0	49	0.

TIME 300 DATE 4/22/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.8	3	90.0	4	81.4	5	91.0	6	80.5	7	88.0
8	78.5	9	86.5	10	78.2	11	86.5	12	79.0	13	78.7	14	72.2
15	89.0	16	84.7	17	91.0	18	83.5	19	91.5	20	80.0	21	93.0
22	81.8	23	0.	24	C.	25	76.0	26	73.5	27	88.5	28	81.0
29	68.5	30	54.5	31	88.0	32	89.2	33	89.2	34	88.0	35	89.7
36	90.0	37	71.0	38	91.8	39	92.0	40	85.5	41	85.2	42	87.5
43	86.2	44	81.5	45	84.0	46	79.5	47	67.0	48	64.2	49	0.

TIME 400 DATE 4/22/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.4	3	89.5	4	81.0	5	90.0	6	80.2	7	87.5
8	78.4	9	86.0	10	77.7	11	86.0	12	78.7	13	78.0	14	72.0
15	88.5	16	84.3	17	91.0	18	83.6	19	92.0	20	80.0	21	94.0
22	81.5	23	0.	24	0.	25	77.0	26	73.0	27	88.5	28	81.5
29	71.0	30	63.0	31	87.5	32	89.0	33	89.0	34	88.0	35	89.5
36	88.0	37	71.5	38	92.7	39	92.7	40	86.8	41	86.8	42	87.5
43	86.0	44	81.5	45	84.0	46	79.0	47	67.5	48	64.5	49	0.

TIME		DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	87.2
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	77.5
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	95.0
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	81.7
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	84.7
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	87.5
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	0.

TIME		DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME		DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME		DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME		DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	900	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	80.5	5	92.5	6	86.5	7	89.8
8	78.5	9	[illegible]	10	[illegible]	11	96.0	12	79.5	13	85.0	14	73.2
15	[illegible]	16	[illegible]	17	[illegible]	18	81.5	19	95.5	20	91.5	21	97.0
22	[illegible]	23	[illegible]	24	[illegible]	25	94.0	26	75.0	27	97.2	28	82.2
29	[illegible]	30	[illegible]	31	[illegible]	32	90.5	33	90.5	34	90.5	35	91.2
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	58.5	41	85.0	42	84.2
43	[illegible]	44	[illegible]	45	[illegible]	46	81.0	47	80.5	48	85.0	49	83.7

TIME	1000	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.2	2	[illegible]	3	93.0	4	82.3	5	100.0	6	86.1	7	92.0
8	80.0	9	96.0	10	87.0	11	94.0	12	82.0	13	89.5	14	75.2
15	94.0	16	75.6	17	93.0	18	81.0	19	97.0	20	82.5	21	95.0
22	83.0	23	0.	24	0.	25	89.0	26	71.0	27	92.5	28	83.0
29	77.0	30	89.5	31	92.5	32	92.5	33	93.0	34	93.0	35	93.5
36	93.5	37	97.0	38	97.5	39	97.5	40	91.5	41	91.5	42	92.0
43	92.0	44	85.5	45	90.5	46	82.0	47	75.5	48	65.5	49	0.

TIME	1100	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	93.0	3	98.0	4	84.0	5	98.0	6	85.5	7	95.0
8	82.0	9	77.0	10	83.5	11	97.0	12	84.0	13	93.5	14	76.7
15	94.0	16	72.0	17	97.5	18	89.1	19	98.0	20	84.8	21	101.0
22	87.6	23	0.	24	0.	25	93.0	26	78.0	27	95.0	28	85.0
29	74.3	30	92.0	31	95.5	32	95.5	33	95.5	34	94.5	35	95.0
36	95.5	37	97.0	38	98.0	39	8.5	40	94.5	41	94.0	42	94.5
43	94.0	44	86.5	45	0.	46	0.	47	0.	48	0.	49	0.

TIME	1200	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	84.3	5	98.0	6	85.0	7	95.0
8	82.0	9	[illegible]	10	[illegible]	11	97.0	12	82.0	13	89.0	14	76.2
15	[illegible]	16	[illegible]	17	[illegible]	18	89.6	19	98.0	20	86.0	21	99.0
22	87.5	23	0.	24	0.	25	93.0	26	78.0	27	94.5	28	85.5
29	81.5	30	77.6	31	94.4	32	94.5	33	94.5	34	93.5	35	94.5
36	[illegible]	37	95.0	38	97.2	39	97.5	40	92.5	41	92.5	42	92.3
43	92.1	44	85.0	45	91.5	46	83.5	47	79.0	48	64.0	49	0.

TIME	1300	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	94.5	4	83.5	5	97.5	6	85.0	7	94.5
8	82.0	9	[illegible]	10	87.5	11	95.0	12	83.8	13	89.0	14	76.2
15	[illegible]	16	[illegible]	17	97.0	18	89.6	19	98.0	20	86.0	21	99.0
22	87.5	23	0.	24	0.	25	93.0	26	78.0	27	94.5	28	85.5
29	81.5	30	77.6	31	94.4	32	94.5	33	94.5	34	93.5	35	94.5
36	[illegible]	37	95.0	38	97.2	39	97.5	40	92.5	41	92.5	42	92.3
43	92.1	44	85.0	45	91.5	46	83.5	47	79.0	48	64.0	49	0.

TIME	1400	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	1500	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	[illegible]	3	95.0	4	83.5	5	98.0	6	85.5	7	94.5
8	81.0	9	[illegible]	10	83.0	11	97.0	12	84.5	13	93.5	14	76.5
15	74.0	16	[illegible]	17	95.0	18	89.0	19	98.0	20	84.8	21	100.0
22	86.7	23	[illegible]	24	0.	25	93.5	26	78.5	27	94.7	28	84.5
29	70.5	30	95.5	31	95.0	32	95.0	33	95.0	34	95.0	35	95.5
36	95.5	37	97.5	38	98.0	39	98.5	40	94.5	41	94.0	42	94.5
43	94.0	44	87.0	45	93.[illegible]	46	84.0	47	70.5	48	66.5	49	0.

TIME	1600	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.2	2	86.5	3	93.0	4	82.3	5	100.0	6	86.1	7	92.0
8	80.0	9	96.0	10	87.0	11	94.0	12	82.0	13	89.5	14	75.2
15	94.0	16	75.6	17	93.0	18	81.0	19	97.0	20	82.5	21	95.0
22	83.0	23	0.	24	0.	25	89.0	26	71.0	27	92.5	28	83.0
29	77.0	30	89.5	31	92.5	32	92.5	33	93.0	34	93.0	35	93.5
36	93.5	37	97.0	38	97.5	39	97.5	40	91.5	41	91.5	42	92.0
43	92.0	44	85.5	45	90.5	46	82.0	47	75.5	48	65.5	49	0.

TIME	1700	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	84.3	5	98.0	6	85.0	7	94.5
8	82.0	9	[illegible]	10	83.5	11	96.0	12	83.8	13	89.0	14	76.2
15	[illegible]	16	[illegible]	17	97.0	18	89.6	19	98.0	20	86.0	21	99.0
22	87.5	23	0.	24	0.	25	93.0	26	78.0	27	94.5	28	85.5
29	81.5	30	77.6	31	94.4	32	94.5	33	94.5	34	93.5	35	94.5
36	[illegible]	37	95.0	38	97.2	39	97.5	40	92.5	41	92.5	42	92.3
43	92.1	44	85.0	45	91.5	46	83.5	47	79.0	48	64.0	49	0.

TIME	1800	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	1900	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	2000	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	2100	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	2200	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	2300	DATE		4/22/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	300	DATE		4/23/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME	400	DATE		4/23/1965									
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	[illegible]
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	[illegible]	13	[illegible]	14	[illegible]
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	[illegible]	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	[illegible]	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	[illegible]	49	[illegible]

TIME 500 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	81.0	2	80.5	3	86.0	4	81.5	5	88.0	6	80.5	7	86.0
8	78.7	9	91.5	10	77.4	11	83.0	12	77.9	13	76.0	14	72.7
15	93.0	16	94.5	17	85.0	18	84.5	19	89.5	20	82.0	21	90.0
22	82.5	23	0.	24	0.	25	75.5	26	73.0	27	87.7	28	83.2
29	79.5	30	73.5	31	86.7	32	87.8	33	88.0	34	87.0	35	89.0
36	90.0	37	94.0	38	90.0	39	90.0	40	83.2	41	83.5	42	85.5
43	84.5	44	81.0	45	82.5	46	79.5	47	75.2	48	70.0	49	0.

TIME 600 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.5	2	80.4	3	88.0	4	81.5	5	0.	6	0.	7	86.0
8	73.0	9	0.	10	0.	11	0.	12	0.	13	76.5	14	73.4
15	88.5	16	94.0	17	0.	18	0.	19	89.5	20	84.7	21	0.
22	0.	23	0.	24	0.	25	75.2	26	73.5	27	88.2	28	83.0
29	80.0	30	76.0	31	87.0	32	88.0	33	88.2	34	87.0	35	89.0
36	90.0	37	94.0	38	90.0	39	90.0	40	83.2	41	83.7	42	85.5
43	84.5	44	81.0	45	82.5	46	79.5	47	76.0	48	70.0	49	0.

TIME 700 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	81.5	3	88.0	4	81.5	5	88.0	6	80.5	7	86.5
8	79.5	9	76.0	10	80.5	11	0.	12	0.	13	77.5	14	74.0
15	89.0	16	94.4	17	88.5	18	84.0	19	90.0	20	82.5	21	89.5
22	81.7	23	0.	24	0.	25	75.0	26	73.5	27	88.0	28	83.5
29	77.5	30	71.0	31	87.0	32	88.0	33	88.2	34	87.0	35	89.0
36	89.8	37	94.0	38	90.0	39	90.2	40	83.5	41	84.0	42	85.5
43	85.5	44	81.5	45	81.5	46	79.7	47	75.2	48	70.0	49	0.

TIME 800 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	80.4	3	89.0	4	81.4	5	90.0	6	80.8	7	88.0
8	79.2	9	86.0	10	78.0	11	86.0	12	78.0	13	83.0	14	74.1
15	90.0	16	94.9	17	90.0	18	84.9	19	91.0	20	82.5	21	90.0
22	81.2	23	0.	24	0.	25	83.2	26	77.0	27	90.0	28	84.0
29	82.0	30	79.8	31	89.0	32	89.7	33	89.0	34	89.0	35	90.5
36	91.0	37	91.0	38	91.5	39	91.7	40	87.0	41	87.0	42	87.5
43	88.0	44	83.2	45	86.7	46	81.5	47	78.5	48	70.0	49	0.

TIME 900 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.3	3	90.5	4	82.2	5	91.0	6	84.7	7	89.5
8	80.3	9	87.5	10	79.0	11	88.0	12	80.5	13	85.0	14	74.5
15	90.5	16	95.0	17	90.5	18	85.0	19	91.5	20	82.6	21	92.0
22	83.0	23	0.	24	0.	25	85.0	26	75.0	27	90.5	28	84.5
29	77.5	30	70.5	31	90.5	32	90.5	33	90.5	34	90.0	35	91.0
36	91.5	37	91.5	38	92.5	39	92.5	40	88.0	41	88.0	42	88.5
43	86.5	44	84.0	45	83.5	46	87.5	47	70.0	48	70.0	49	0.

TIME 1000 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	82.0	3	91.0	4	81.6	5	92.0	6	81.2	7	90.5
8	80.1	9	89.5	10	79.0	11	90.0	12	80.4	13	87.5	14	75.2
15	91.0	16	85.0	17	92.0	18	86.0	19	92.0	20	82.6	21	92.5
22	83.0	23	0.	24	0.	25	88.7	26	75.0	27	92.0	28	84.5
29	77.0	30	70.5	31	92.0	32	92.0	33	92.0	34	92.0	35	93.0
36	93.0	37	92.0	38	93.5	39	92.5	40	90.5	41	90.0	42	90.5
43	90.7	44	86.5	45	90.0	46	0.	47	0.	48	0.	49	0.

TIME 1100 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	82.4	3	93.0	4	83.0	5	93.0	6	82.2	7	92.0
8	80.4	9	91.0	10	79.0	11	91.0	12	80.7	13	90.0	14	76.1
15	92.5	16	96.5	17	92.5	18	85.0	19	94.5	20	84.5	21	94.0
22	84.7	23	0.	24	0.	25	89.0	26	76.1	27	92.5	28	85.0
29	78.0	30	74.0	31	93.0	32	93.0	33	93.0	34	92.5	35	91.5
36	93.5	37	94.0	38	94.5	39	91.0	40	91.5	41	91.5	42	91.5
43	91.5	44	86.0	45	86.5	46	84.0	47	76.0	48	69.5	49	0.

TIME 1200 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	83.0	3	93.0	4	83.2	5	94.0	6	82.4	7	92.5
8	81.0	9	92.0	10	80.5	11	92.0	12	82.7	13	91.2	14	76.3
15	93.0	16	98.0	17	93.5	18	86.7	19	94.0	20	84.3	21	94.0
22	85.0	23	0.	24	0.	25	91.5	26	76.1	27	93.0	28	85.5
29	77.5	30	80.5	31	93.5	32	91.5	33	93.5	34	93.5	35	94.0
36	94.0	37	94.5	38	95.0	39	94.5	40	92.5	41	92.5	42	92.5
43	92.5	44	86.5	45	92.0	46	84.5	47	78.0	48	69.5	49	0.

TIME 1300 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	84.0	3	93.5	4	83.0	5	94.0	6	83.0	7	93.0
8	80.7	9	92.0	10	79.8	11	92.0	12	81.0	13	92.0	14	76.3
15	93.0	16	99.3	17	93.5	18	87.0	19	94.0	20	89.0	21	94.0
22	85.0	23	0.	24	0.	25	91.7	26	76.3	27	93.5	28	86.0
29	79.0	30	72.5	31	93.0	32	91.5	33	93.5	34	93.5	35	94.0
36	94.5	37	95.0	38	95.0	39	95.0	40	93.0	41	92.5	42	92.5
43	92.5	44	86.5	45	92.5	46	84.5	47	69.5	48	0.	49	0.

TIME 1400 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	82.0	3	93.0	4	83.0	5	94.0	6	83.0	7	93.0
8	77.0	9	92.0	10	80.5	11	92.0	12	80.5	13	92.5	14	76.0
15	93.5	16	97.0	17	94.0	18	87.0	19	94.0	20	84.5	21	94.0
22	84.5	23	0.	24	0.	25	92.0	26	77.0	27	93.5	28	93.5
29	86.0	30	76.0	31	94.0	32	94.0	33	94.0	34	94.0	35	94.5
36	94.5	37	94.5	38	95.0	39	95.0	40	93.5	41	94.0	42	93.0
43	93.0	44	86.5	45	92.5	46	84.5	47	78.0	48	69.5	49	0.

TIME 1500 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	83.0	3	94.5	4	83.8	5	94.0	6	83.0	7	94.0
8	82.0	9	92.0	10	80.1	11	93.0	12	82.0	13	92.0	14	76.2
15	94.0	16	98.8	17	94.0	18	87.0	19	94.0	20	84.5	21	95.0
22	82.5	23	0.	24	0.	25	91.5	26	91.4	27	93.5	28	86.0
29	80.4	30	74.0	31	94.0	32	94.0	33	93.0	34	94.0	35	94.5
36	94.5	37	94.9	38	95.0	39	95.0	40	93.5	41	93.0	42	93.0
43	93.0	44	86.8	45	92.5	46	85.0	47	78.0	48	69.0	49	0.

TIME 1600 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	84.5	3	93.5	4	84.7	5	92.0	6	81.9	7	93.0
8	81.0	9	92.0	10	80.5	11	93.0	12	82.0	13	92.0	14	77.0
15	93.5	16	94.9	17	94.0	18	87.3	19	94.5	20	85.2	21	93.0
22	84.6	23	0.	24	0.	25	92.0	26	77.0	27	93.0	28	85.3
29	0.	30	0.	31	94.0	32	94.0	33	94.0	34	94.0	35	94.5
36	94.7	37	94.7	38	95.0	39	95.0	40	93.7	41	93.2	42	93.0
43	93.0	44	87.0	45	93.0	46	85.0	47	0.	48	70.0	49	0.

TIME 2400 DATE 4/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 2400 DATE 4/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 2400 DATE 4/26/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-	28	-0.
29	-0.	30	-0.	31	-0.	32	0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 600 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.1	2	80.7	3	89.0	4	84.0	5	88.0	6	83.2	7	86.5
8	84.0	9	93.0	10	73.0	11	93.0	12	80.3	13	77.0	14	72.2
15	89.0	16	94.4	17	89.5	18	91.4	19	88.5	20	81.8	21	89.0
22	82.4	23	0.	24	0.	25	76.7	26	73.2	27	87.3	28	83.3
29	76.1	30	69.5	31	88.0	32	89.0	33	89.0	34	87.0	35	88.8
36	84.5	37	91.5	38	89.0	39	88.2	40	82.5	41	82.7	42	84.8
43	85.0	44	81.2	45	81.5	46	79.0	47	68.5	48	63.0	49	0.

TIME 7 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	81.0	3	88.5	4	80.9	5	88.0	6	80.9	7	86.5
8	79.2	9	92.5	10	77.4	11	93.0	12	78.3	13	76.5	14	74.6
15	89.0	16	93.0	17	89.0	18	93.1	19	88.0	20	81.0	21	88.0
22	81.2	23	0.	24	0.	25	75.0	26	72.5	27	87.0	28	83.0
29	73.0	30	91.5	31	87.2	32	88.2	33	88.5	34	86.5	35	88.5
36	89.0	37	87.2	38	89.0	39	88.0	40	82.2	41	82.5	42	84.8
43	85.0	44	81.2	45	82.5	46	79.0	47	67.0	48	63.0	49	0.

TIME 800 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.5	2	80.8	3	88.0	4	80.9	5	88.0	6	80.7	7	86.0
8	78.9	9	92.5	10	77.8	11	93.0	12	78.7	13	77.0	14	75.0
15	88.5	16	93.8	17	89.0	18	93.0	19	88.0	20	82.0	21	88.5
22	82.3	23	0.	24	0.	25	77.0	26	74.0	27	87.0	28	83.0
29	76.2	30	66.7	31	87.2	32	88.0	33	88.5	34	86.8	35	88.5
36	89.2	37	87.5	38	88.0	39	88.0	40	82.5	41	82.8	42	84.8
43	85.0	44	81.2	45	82.0	46	78.8	47	66.7	48	63.2	49	0.

TIME 900 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.8	3	88.0	4	81.5	5	88.0	6	81.2	7	86.0
8	79.5	9	92.0	10	77.6	11	93.0	12	78.0	13	76.0	14	73.4
15	88.5	16	93.2	17	89.0	18	83.6	19	88.0	20	82.2	21	88.5
22	82.0	23	0.	24	0.	25	75.0	26	72.5	27	86.5	28	83.0
29	71.5	30	90.5	31	87.0	32	87.0	33	88.5	34	86.5	35	88.5
36	89.5	37	87.5	38	87.5	39	87.5	40	82.5	41	82.5	42	84.5
43	84.5	44	80.5	45	81.5	46	78.5	47	75.0	48	63.5	49	0.

TIME 1000 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.5	2	81.0	3	87.5	4	81.5	5	87.5	6	80.3	7	86.0
8	79.2	9	92.0	10	77.6	11	83.0	12	70.0	13	76.5	14	74.3
15	88.5	16	93.2	17	88.0	18	82.8	19	88.0	20	82.5	21	88.0
22	82.2	23	0.	24	0.	25	75.0	26	73.0	27	86.5	28	83.0
29	74.0	30	94.5	31	88.0	32	88.0	33	88.0	34	86.5	35	88.5
36	89.0	37	87.0	38	88.0	39	88.0	40	82.5	41	82.5	42	84.5
43	84.5	44	81.0	45	81.5	46	79.0	47	69.0	48	63.5	49	0.

TIME 1100 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.5	3	87.5	4	81.0	5	87.0	6	80.8	7	85.5
8	79.0	9	91.0	10	77.5	11	83.0	12	79.0	13	76.5	14	74.3
15	88.0	16	93.0	17	88.5	18	83.7	19	87.8	20	82.5	21	88.0
22	82.0	23	0.	24	0.	25	75.0	26	72.7	27	86.0	28	83.0
29	75.0	30	89.5	31	88.2	32	87.5	33	87.5	34	86.5	35	88.5
36	89.0	37	87.5	38	88.0	39	88.0	40	82.5	41	82.5	42	84.5
43	84.5	44	81.0	45	82.0	46	79.0	47	71.5	48	64.0	49	0.

TIME 1200 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.0	3	87.0	4	81.7	5	88.5	6	80.1	7	85.5
8	79.2	9	92.0	10	77.8	11	93.0	12	78.2	13	77.0	14	74.0
15	87.0	16	92.4	17	89.0	18	82.8	19	87.5	20	82.0	21	88.0
22	82.5	23	0.	24	0.	25	77.0	26	74.0	27	86.0	28	82.5
29	73.0	30	92.0	31	86.5	32	87.0	33	87.0	34	86.5	35	88.5
36	88.5	37	87.0	38	88.0	39	88.0	40	82.5	41	82.5	42	84.5
43	84.5	44	80.5	45	81.5	46	78.5	47	68.5	48	63.5	49	0.

TIME 1300 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.8	3	87.0	4	80.8	5	88.5	6	80.2	7	85.5
8	80.0	9	92.0	10	82.0	11	93.0	12	83.5	13	76.5	14	73.0
15	87.5	16	92.2	17	89.5	18	83.2	19	87.5	20	82.3	21	88.0
22	83.0	23	0.	24	0.	25	75.0	26	72.5	27	86.0	28	82.5
29	70.0	30	90.5	31	86.0	32	87.	33	87.0	34	86.0	35	88.0
36	88.5	37	87.0	38	87.5	39	87.0	40	82.0	41	82.5	42	84.5
43	84.5	44	80.5	45	81.7	46	79.0	47	65.0	48	64.0	49	0.

TIME 1400 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.0	3	87.0	4	81.0	5	0.	6	0.	7	85.5
8	78.8	9	0.	10	0.	11	0.	12	0.	13	77.0	14	73.5
15	88.0	16	93.0	17	0.	18	0.	19	0.	20	0.	21	0.
22	0.	23	0.	24	0.	25	76.0	26	73.0	27	86.0	28	82.5
29	70.0	30	90.0	31	86.0	32	86.5	33	86.5	34	86.0	35	88.0
36	88.5	37	87.0	38	87.5	39	87.5	40	82.0	41	82.0	42	84.0
43	84.0	44	80.5	45	81.5	46	78.5	47	65.5	48	64.0	49	0.

TIME 1500 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	77.8	3	87.0	4	80.8	5	0.	6	0.	7	85.5
8	76.	9	[illegible]	10	0.	11	0.	12	0.	13	76.5	14	73.5
15	87.5	16	81.4	17	0.	18	0.	19	87.5	20	84.4	21	0.
22	0.	23	0.	24	0.	25	75.0	26	73.0	27	85.5	28	82.0
29	86.	30	73.0	31	87.5	32	86.5	33	86.5	34	86.0	35	88.5
36	88.5	37	87.0	38	87.5	39	87.5	40	82.0	41	82.0	42	84.5
43	84.5	44	86.5	45	81.5	46	78.5	47	64.0	48	63.7	49	0.

TIME 1600 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	[illegible]	3	85.5	4	81.5	5	0.	6	0.	7	85.5
8	77.1	9	0.	10	0.	11	0.	12	0.	13	76.0	14	73.1
15	88.0	16	82.8	17	0.	18	0.	19	87.5	20	82.0	21	0.
22	0.	23	0.	24	0.	25	77.0	26	73.5	27	86.1	28	82.8
29	72.5	30	0.	31	86.	32	87.0	33	87.0	34	86.5	35	88.4
36	88.5	37	87.0	38	87.8	39	87.9	40	82.5	41	82.5	42	84.3
43	84.5	44	86.0	45	81.5	46	79.0	47	73.5	48	64.5	49	0.

TIME 1700 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.5	3	87.0	4	80.2	5	84.1	6	77.5	7	85.0
8	79.1	9	81.7	10	76.2	11	82.0	12	76.3	13	78.5	14	73.3
15	88.1	16	82.0	17	87.5	18	82.0	19	87.5	20	81.6	21	87.5
22	82.5	23	0.	24	0.	25	76.0	26	72.0	27	86.0	28	82.5
29	84.1	30	76.0	31	84.1	32	86.8	33	86.8	34	85.1	35	87.8
36	88.3	37	86.0	38	86.5	39	86.5	40	82.5	41	82.5	42	84.2
43	84.5	44	86.5	45	81.2	46	79.0	47	73.0	48	64.9	49	0.

TIME 1800 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 1900 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.4	3	89.5	4	82.0	5	0.	6	0.	7	88.5
8	79.0	9	0.	10	0.	11	0.	12	0.	13	84.0	14	74.8
15	90.5	16	85.0	17	0.	18	0.	19	89.5	20	83.4	21	86.9
22	81.4	23	86.0	24	84.5	25	0.	26	83.1	27	74.8	28	89.0
29	84.5	30	71.3	31	86.0	32	89.5	33	89.5	34	89.5	35	89.5
36	90.5	37	87.7	38	89.8	39	89.8	40	90.0	41	87.0	42	87.0
43	87.2	44	87.8	45	83.1	46	0.	47	0.	48	0.	49	0.

TIME 2000 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	81.5	3	90.0	4	82.1	5	90.0	6	82.1	7	89.3
8	78.0	9	87.0	10	79.0	11	87.0	12	79.2	13	85.0	14	76.0
15	90.5	16	84.9	17	90.0	18	83.3	19	90.1	20	83.2	21	90.0
22	83.2	23	0.	24	0.	25	84.7	26	76.0	27	89.5	28	85.0
29	72.0	30	90.0	31	90.0	32	90.0	33	90.0	34	90.0	35	91.0
36	91.2	37	90.2	38	90.5	39	89.4	40	86.2	41	87.5	42	88.0
43	88.5	44	81.8	45	87.0	46	81.8	47	71.0	48	65.0	49	0.

TIME 2100 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.6	3	90.5	4	82.[illegible]	5	90.0	6	82.0	7	89.8
8	81.0	9	87.0	10	78.9	11	87.0	12	80.8	13	84.8	14	75.8
15	91.0	16	85.0	17	91.0	18	84.2	19	90.6	20	83.0	21	90.0
22	82.9	23	0.	24	0.	25	83.0	26	75.0	27	89.6	28	84.9
29	77.8	30	73.5	31	90.3	32	90.4	33	90.4	34	90.2	35	91.5
36	91.5	37	90.9	38	91.0	39	91.0	40	88.0	41	87.7	42	88.0
43	88.5	44	83.7	45	87.0	46	81.8	47	67.4	48	64.9	49	0.

TIME 2200 DATE 4/27/1965

P	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.4	3	91.8	4	83.5	5	90.0	6	81.6	7	90.0
8	80.5	9	87.0	10	78.9	11	87.0	12	79.1	13	84.8	14	75.5
15	91.0	16	84.5	17	91.0	18	83.7	19	91.0	20	83.4	21	91.0
22	83.2	23	0.	24	0.	25	84.0	26	76.5	27	90.0	28	85.0
29	72.5	30	59.0	31	90.5	32	90.5	33	90.5	34	90.3	35	91.8
36	91.8	37	91.0	38	91.1	39	91.1	40	87.9	41	87.8	42	88.2
43	88.5	44	83.6	45	87.1	46	81.7	47	68.0	48	65.0	49	0.

TIME 2300 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.0	3	90.5	4	82.2	5	90.0	6	81.2	7	90.0
8	80.8	9	86.5	10	78.5	11	87.0	12	79.1	13	84.2	14	75.5
15	91.2	16	83.0	17	90.5	18	83.2	19	91.0	20	83.0	21	90.5
22	82.9	23	0.	24	0.	25	83.2	26	75.5	27	90.0	28	85.0
29	73.0	30	61.0	31	90.5	32	90.6	33	90.5	34	90.2	35	91.7
36	91.9	37	91.0	38	91.2	39	91.5	40	88.0	41	87.8	42	88.1
43	88.5	44	83.5	45	87.2	46	81.5	47	79.5	48	70.3	49	0.

TIME 2400 DATE 4/27/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.2	3	91.0	4	82.5	5	90.0	6	81.2	7	90.0
8	80.3	9	87.0	10	78.6	11	87.0	12	79.0	13	84.5	14	74.8
15	91.0	16	84.1	17	91.0	18	83.9	19	91.0	20	83.0	21	91.0
22	83.2	23	0.	24	0.	25	84.6	26	76.3	27	91.0	28	85.6
29	80.7	30	75.8	31	91.0	32	91.0	33	91.0	34	91.0	35	92.2
36	92.5	37	91.5	38	91.8	39	92.0	40	88.5	41	88.2	42	89.0
43	89.0	44	84.0	45	87.5	46	82.5	47	74.8	48	65.7	49	0.

TIME 100 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.3	3	91.0	4	82.5	5	0.	6	0.	7	90.0
8	80.5	9	0.	10	0.	11	0.	12	0.	13	85.0	14	75.0
15	91.5	16	84.7	17	0.	18	0.	19	91.0	20	83.5	21	0.
22	0.	23	0.	24	0.	25	84.7	26	76.5	27	91.0	28	85.7
29	78.0	30	69.2	31	90.7	32	91.0	33	91.0	34	91.0	35	92.0
36	92.5	37	91.7	38	92.0	39	92.0	40	88.5	41	88.2	42	89.0
43	89.2	44	84.0	45	87.5	46	82.3	47	75.0	48	65.7	49	0.

TIME 200 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	82.2	3	91.0	4	82.2	5	91.5	6	81.2	7	90.5
8	80.7	9	88.5	10	79.6	11	88.0	12	79.0	13	84.5	14	75.0
15	91.7	16	85.0	17	92.0	18	84.6	19	91.5	20	83.7	21	92.0
22	84.3	23	0.	24	0.	25	84.0	26	76.2	27	91.0	28	86.0
29	76.0	30	65.5	31	90.7	32	91.0	33	91.0	34	91.0	35	92.2
36	92.5	37	91.8	38	92.0	39	92.0	40	88.7	41	88.5	42	87.2
43	89.5	44	84.2	45	87.5	46	82.2	47	72.2	48	65.7	49	0.

TIME 300 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	92.9	3	93.5	4	83.3	5	94.0	6	84.1	7	94.0
8	82.9	9	72.0	10	80.5	11	92.0	12	81.0	13	92.5	14	77.2
15	93.0	16	87.2	17	93.0	18	85.2	19	93.0	20	85.0	21	93.0
22	85.7	23	0.	24	0.	25	92.7	26	80.8	27	93.5	28	87.5
29	80.0	30	71.2	31	92.0	32	92.0	33	92.0	34	92.0	35	92.0
36	92.0	37	92.0	38	91.3	39	91.0	40	91.0	41	90.5	42	90.0
43	90.0	44	90.0	45	90.0	46	90.0	47	90.0	48	85.2	49	0.

TIME 400 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.0	3	94.5	4	83.7	5	95.0	6	84.2	7	94.5
8	81.7	9	73.0	10	80.7	11	93.0	12	80.7	13	92.5	14	76.8
15	94.2	16	88.0	17	95.0	18	86.7	19	94.0	20	86.0	21	94.5
22	85.8	23	0.	24	0.	25	92.0	26	81.7	27	94.7	28	88.8
29	84.7	30	90.0	31	95.3	32	95.2	33	95.0	34	95.0	35	95.5
36	95.3	37	95.0	38	95.0	39	94.8	40	94.2	41	93.7	42	93.7
43	94.0	44	87.5	45	93.2	46	85.0	47	75.5	48	66.0	49	0.

TIME 500 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.0	3	95.0	4	83.2	5	95.5	6	84.0	7	94.5
8	81.7	9	73.0	10	81.1	11	93.0	12	80.8	13	92.0	14	76.4
15	94.5	16	88.5	17	95.0	18	86.5	19	94.0	20	85.3	21	95.0
22	86.0	23	0.	24	0.	25	91.5	26	78.2	27	94.5	28	78.8
29	83.0	30	75.5	31	95.0	32	95.2	33	95.0	34	95.0	35	95.5
36	95.7	37	95.0	38	94.8	39	94.8	40	94.0	41	93.5	42	93.7
43	94.0	44	87.5	45	93.7	46	85.0	47	78.0	48	66.0	49	0.

TIME 600 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	92.8	3	95.0	4	83.5	5	95.0	6	83.5	7	94.5
8	81.7	9	73.0	10	81.0	11	93.0	12	80.8	13	92.5	14	76.8
15	94.0	16	87.5	17	95.0	18	86.4	19	94.0	20	85.2	21	95.0
22	85.5	23	0.	24	0.	25	93.7	26	78.5	27	95.0	28	89.0
29	87.0	30	84.8	31	95.5	32	95.5	33	95.5	34	95.5	35	96.0
36	96.0	37	95.3	38	95.3	39	95.3	40	94.5	41	94.0	42	94.1
43	94.1	44	87.7	45	93.5	46	85.5	47	83.0	48	66.2	49	0.

TIME 700 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	93.2	3	95.0	4	83.2	5	93.0	6	82.0	7	94.5
8	81.7	9	73.0	10	80.7	11	93.0	12	81.5	13	92.5	14	76.8
15	94.5	16	88.0	17	95.0	18	86.2	19	94.5	20	85.4	21	95.0
22	82.8	23	0.	24	0.	25	91.5	26	77.5	27	95.0	28	89.2
29	87.5	30	85.0	31	95.7	32	95.7	33	95.5	34	95.2	35	95.7
36	96.0	37	95.2	38	95.2	39	95.2	40	94.5	41	94.0	42	94.0
43	94.5	44	87.8	45	93.5	46	85.5	47	81.3	48	66.5	49	0.

TIME 800 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	93.7	3	95.0	4	83.0	5	95.0	6	84.6	7	94.0
8	81.7	9	72.5	10	80.5	11	92.5	12	81.0	13	92.5	14	77.1
15	94.5	16	88.2	17	95.0	18	85.5	19	94.5	20	86.0	21	94.5
22	85.6	23	0.	24	0.	25	92.7	26	78.5	27	95.2	28	89.5
29	86.0	30	82.5	31	96.0	32	96.2	33	96.2	34	95.2	35	96.0
36	96.0	37	95.5	38	95.5	39	95.5	40	94.5	41	93.7	42	93.8
43	94.7	44	88.0	45	93.0	46	85.5	47	82.5	48	66.5	49	0.

TIME 900 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.7	2	83.2	3	95.0	4	82.8	5	95.0	6	84.7	7	94.5
8	81.8	9	73.0	10	82.2	11	92.5	12	82.5	13	92.5	14	77.2
15	94.2	16	88.5	17	94.0	18	85.5	19	95.0	20	85.5	21	94.0
22	84.5	23	0.	24	0.	25	91.5	26	78.0	27	95.5	28	89.5
29	86.5	30	81.5	31	95.5	32	95.5	33	95.5	34	95.0	35	95.5
36	96.0	37	95.5	38	95.5	39	96.0	40	95.0	41	94.5	42	94.5
43	95.0	44	88.5	45	94.0	46	86.0	47	85.0	48	66.5	49	0.

TIME 1000 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	83.4	3	95.0	4	83.5	5	95.0	6	84.2	7	94.5
8	82.2	9	73.5	10	81.6	11	93.5	12	83.5	13	92.4	14	77.5
15	94.2	16	89.0	17	94.5	18	88.3	19	95.0	20	85.9	21	94.5
22	85.2	23	0.	24	0.	25	92.5	26	92.5	27	92.5	28	92.5
29	92.8	30	92.8	31	93.0	32	93.0	33	93.0	34	93.0	35	93.0
36	93.0	37	93.0	38	93.0	39	93.0	40	93.0	41	93.0	42	93.0
43	93.0	44	93.0	45	93.2	46	93.2	47	93.2	48	93.2	49	0.

TIME 1100 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.4	2	83.4	3	95.0	4	84.7	5	95.0	6	84.9	7	94.8
8	82.0	9	74.0	10	82.0	11	94.0	12	84.7	13	92.4	14	77.7
15	94.1	16	89.3	17	94.5	18	88.2	19	95.3	20	86.3	21	96.0
22	0.	23	0.	24	0.	25	92.5	26	79.0	27	95.5	28	90.5
29	90.5	30	90.5	31	95.5	32	95.5	33	95.5	34	95.5	35	96.0
36	96.0	37	96.0	38	96.5	39	96.5	40	95.5	41	95.0	42	94.5
43	94.5	44	88.5	45	94.0	46	85.5	47	82.0	48	66.5	49	0.

TIME 1200 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.1	2	83.7	3	94.8	4	84.0	5	95.0	6	84.8	7	94.7
8	82.2	9	73.0	10	81.2	11	94.0	12	84.4	13	92.3	14	77.6
15	94.0	16	86.3	17	95.5	18	89.6	19	95.1	20	86.2	21	95.5
22	86.6	23	0.	24	0.	25	92.5	26	79.0	27	95.5	28	90.5
29	90.5	30	90.5	31	95.5	32	95.5	33	95.5	34	95.5	35	96.0
36	96.0	37	96.0	38	96.5	39	96.5	40	95.5	41	94.5	42	94.5
43	94.5	44	88.5	45	94.0	46	86.5	47	82.0	48	66.5	49	0.

TIME 1300 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	84.9	3	94.5	4	83.7	5	95.0	6	84.9	7	94.5
8	82.3	9	72.5	10	80.7	11	94.0	12	81.2	13	92.5	14	77.6
15	91.4	16	89.3	17	95.0	18	89.0	19	95.0	20	86.2	21	96.0
22	86.7	23	0.	24	0.	25	93.2	26	79.5	27	94.5	28	89.5
29	81.8	30	76.0	31	95.0	32	95.0	33	94.5	34	95.5	35	95.5
36	95.5	37	95.5	38	96.0	39	96.0	40	94.5	41	94.0	42	94.0
43	94.0	44	87.5	45	93.5	46	85.5	47	82.5	48	66.5	49	0.

TIME 1400 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	83.9	3	94.5	4	83.7	5	94.0	6	83.8	7	94.0
8	82.0	9	72.5	10	80.8	11	93.5	12	84.4	13	92.8	14	77.7
15	94.0	16	89.3	17	94.0	18	87.1	19	95.0	20	86.5	21	94.5
22	85.4	23	0.	24	0.	25	93.5	26	80.0	27	95.0	28	90.0
29	88.0	30	86.0	31	95.5	32	95.5	33	95.5	34	95.5	35	96.0
36	96.0	37	96.0	38	96.0	39	96.0	40	95.0	41	94.5	42	94.5
43	94.5	44	88.0	45	93.5	46	86.0	47	84.0	48	66.5	49	0.

TIME 1500 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.8	3	94.4	4	81.2	5	0.	6	0.	7	94.0
8	81.4	9	0.	10	0.	11	0.	12	0.	13	92.5	14	77.6
15	94.0	16	88.4	17	0.	18	0.	19	95.0	20	86.2	21	0.
22	0.	23	0.	24	0.	25	92.5	26	80.0	27	94.5	28	90.0
29	81.5	30	71.5	31	95.0	32	95.0	33	95.0	34	95.0	35	95.5
36	95.5	37	75.5	38	95.5	39	95.5	40	94.0	41	94.0	42	94.0
43	94.0	44	87.5	45	93.0	46	85.5	47	76.0	48	66.5	49	0.

TIME 1600 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	88.7	3	94.5	4	84.1	5	0.	6	0.	7	94.0
8	81.4	9	0.	10	0.	11	0.	12	0.	13	93.0	14	77.9
15	94.2	16	89.4	17	0.	18	0.	19	95.0	20	86.5	21	0.
22	0.	23	0.	24	0.	25	92.4	26	81.5	27	94.3	28	89.6
29	82.0	30	74.0	31	95.0	32	95.0	33	95.0	34	95.0	35	95.8
36	96.0	37	75.5	38	95.7	39	95.9	40	94.4	41	94.0	42	94.0
43	94.0	44	87.5	45	93.5	46	85.7	47	84.5	48	66.5	49	0.

TIME 1700 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	83.6	3	94.5	4	83.6	5	95.0	6	83.8	7	94.0
8	81.7	9	93.0	10	80.7	11	94.0	12	84.6	13	93.0	14	78.0
15	94.2	16	89.5	17	95.0	18	87.5	19	95.0	20	86.9	21	95.0
22	87.1	23	0.	24	0.	25	93.8	26	90.2	27	94.5	28	90.0
29	86.3	30	82.0	31	95.0	32	95.0	33	95.0	34	95.0	35	95.8
36	95.9	37	95.5	38	95.5	39	95.7	40	95.0	41	94.0	42	94.0
43	94.0	44	87.5	45	93.5	46	85.6	47	81.0	48	66.3	49	0.

TIME 1800 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	81.1	3	94.0	4	81.6	5	94.0	6	83.3	7	94.0
8	80.6	9	93.0	10	80.0	11	93.0	12	81.5	13	92.5	14	76.5
15	94.0	16	88.4	17	95.0	18	87.5	19	94.3	20	85.0	21	95.0
22	85.6	23	0.	24	0.	25	94.0	26	91.0	27	94.0	28	88.9
29	85.0	30	80.5	31	94.5	32	94.5	33	94.5	34	94.8	35	95.7
36	95.8	37	95.0	38	95.4	39	95.5	40	94.8	41	94.0	42	94.0
43	94.0	44	87.5	45	93.0	46	85.6	47	81.5	48	66.5	49	0.

TIME 1900 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.2	2	81.7	3	93.5	4	81.1	5	94.0	6	83.0	7	94.0
8	81.0	9	93.0	10	80.0	11	93.0	12	81.7	13	93.0	14	77.2
15	94.0	16	89.6	17	95.0	18	87.5	19	94.0	20	34.9	21	95.0
22	85.9	23	0.	24	0.	25	94.0	26	92.0	27	93.9	28	88.5
29	82.3	30	75.2	31	94.2	32	94.2	33	94.0	34	94.6	35	95.5
36	95.6	37	94.8	38	95.0	39	95.0	40	93.0	41	94.3	42	94.0
43	94.0	44	87.5	45	94.0	46	86.0	47	78.8	48	66.6	49	0.

TIME 2000 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	81.3	3	94.0	4	81.9	5	95.0	6	84.5	7	94.0
8	81.5	9	93.0	10	80.4	11	94.0	12	81.7	13	93.5	14	77.8
15	94.2	16	88.9	17	93.8	18	84.5	19	94.8	20	85.2	21	93.0
22	84.4	23	0.	24	0.	25	92.8	26	91.1	27	94.0	28	88.9
29	82.4	30	75.8	31	94.5	32	94.5	33	94.3	34	95.0	35	95.8
36	96.0	37	95.2	38	95.2	39	95.0	40	95.0	41	94.1	42	94.1
43	94.0	44	87.8	45	93.4	46	85.8	47	80.1	48	66.7	49	0.

TIME 2100 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.9	3	94.0	4	81.9	5	94.0	6	83.0	7	94.0
8	80.5	9	93.0	10	80.2	11	93.8	12	82.8	13	92.5	14	77.0
15	94.5	16	89.2	17	95.5	18	87.5	19	94.0	20	85.0	21	94.5
22	85.2	23	0.	24	0.	25	93.5	26	91.3	27	93.7	28	88.7
29	74.5	30	64.0	31	94.6	32	94.2	33	94.2	34	95.1	35	95.5
36	95.9	37	94.8	38	95.1	39	95.1	40	94.7	41	94.8	42	93.7
43	94.9	44	87.9	45	93.1	46	85.7	47	76.8	48	66.9	49	0.

TIME 2200 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	81.6	3	94.0	4	82.1	5	95.0	6	84.3	7	94.2
8	80.8	9	93.0	10	80.0	11	94.0	12	82.9	13	92.5	14	78.7
15	94.4	16	88.9	17	95.5	18	87.7	19	94.2	20	85.7	21	95.0
22	86.4	23	0.	24	0.	25	92.9	26	91.6	27	94.1	28	88.8
29	82.6	30	75.9	31	94.5	32	94.5	33	94.2	34	95.0	35	95.7
36	95.8	37	95.0	38	95.0	39	95.0	40	95.0	41	94.3	42	94.2
43	94.2	44	87.8	45	93.9	46	85.9	47	80.0	48	66.9	49	0.

TIME 2300 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.1	3	94.0	4	82.6	5	[illegible]	6	82.8	7	94.0
8	80.8	9	93.0	10	80.1	11	94.0	12	82.8	13	93.5	14	78.0
15	95.5	16	90.5	17	96.0	18	87.9	19	94.2	20	85.0	21	94.0
22	84.7	23	0.	24	0.	25	91.9	26	90.9	27	94.0	28	89.0
29	83.6	30	83.6	31	94.6	32	94.7	33	94.3	34	95.0	35	95.9
36	96.0	37	94.9	38	95.0	39	95.0	40	94.9	41	93.9	42	94.0
43	94.0	44	77.9	45	93.7	46	85.8	47	80.6	48	67.0	49	0.

TIME 2400 DATE 4/28/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	82.0	3	94.0	4	82.1	5	94.5	6	83.1	7	94.0
8	80.8	9	93.0	10	80.0	11	93.5	12	82.2	13	92.5	14	77.3
15	94.8	16	88.6	17	95.5	18	86.8	19	94.5	20	85.8	21	94.5
22	85.4	23	0.	24	0.	25	92.2	26	91.4	27	94.0	28	89.2
29	85.0	30	80.5	31	94.5	32	94.5	33	94.5	34	95.5	35	96.0
36	96.0	37	95.0	38	95.0	39	95.0	40	95.0	41	94.0	42	94.0
43	94.0	44	88.0	45	93.5	46	86.0	47	85.0	48	67.0	49	0.

TIME 100 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	0.	3	0.	4	0.	5	0.	6	0.	7	0.
8	0.	9	0.	10	0.	11	0.	12	0.	13	0.	14	0.
15	0.	16	0.	17	0.	18	0.	19	0.	20	0.	21	0.
22	0.	23	0.	24	0.	25	0.	26	0.	27	0.	28	0.
29	0.	30	0.	31	0.	32	0.	33	0.	34	0.	35	0.
36	0.	37	0.	38	0.	39	0.	40	0.	41	0.	42	0.
43	0.	44	0.	45	0.	46	0.	47	0.	48	0.	49	0.

TIME 200 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	80.7	3	90.0	4	80.5	5	91.0	6	81.5	7	89.0
8	79.2	9	87.5	10	78.0	11	89.0	12	80.2	13	85.0	14	76.0
15	93.0	16	83.7	17	94.0	18	84.5	19	91.0	20	82.5	21	92.0
22	83.6	23	0.	24	0.	25	0.	26	0.	27	0.	28	0.
29	0.	30	0.	31	0.	32	0.	33	0.	34	0.	35	0.
36	0.	37	0.	38	0.	39	0.	40	0.	41	0.	42	0.
43	0.	44	0.	45	0.	46	0.	47	0.	48	0.	49	0.

TIME 300 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.7	2	81.0	3	90.0	4	80.7	5	91.0	6	81.3	7	89.0
8	79.5	9	87.0	10	77.9	11	89.0	12	80.2	13	84.5	14	75.2
15	93.0	16	84.0	17	93.0	18	83.4	19	91.0	20	82.8	21	91.0
22	83.1	23	0.	24	0.	25	0.	26	0.	27	0.	28	0.
29	0.	30	0.	31	0.	32	0.	33	0.	34	0.	35	0.
36	0.	37	0.	38	0.	39	0.	40	0.	41	0.	42	0.
43	0.	44	0.	45	0.	46	0.	47	0.	48	0.	49	0.

TIME 400 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	80.7	3	90.0	4	80.8	5	90.0	6	80.5	7	89.0
8	79.6	9	87.0	10	78.0	11	89.0	12	80.7	13	84.5	14	74.7
15	92.5	16	83.8	17	93.0	18	83.4	19	90.7	20	81.2	21	91.0
22	82.6	23	0.	24	0.	25	84.2	26	76.0	27	89.5	28	86.5
29	79.8	30	72.5	31	89.7	32	90.0	33	90.0	34	91.5	35	93.0
36	93.3	37	90.5	38	91.0	39	91.2	40	88.0	41	87.8	42	87.8
43	88.5	44	84.2	45	87.0	46	82.5	47	75.8	48	66.7	49	0.

TIME 500 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	80.0	3	90.0	4	80.7	5	90.5	6	81.0	7	89.0
8	79.6	9	87.0	10	78.0	11	89.0	12	80.5	13	85.0	14	75.7
15	92.0	16	83.5	17	92.5	18	83.0	19	91.0	20	83.1	21	91.0
22	82.8	23	0.	24	0.	25	84.7	26	76.0	27	89.5	28	87.0
29	81.5	30	75.7	31	89.8	32	90.0	33	90.0	34	91.5	35	92.8
36	93.0	37	90.5	38	91.0	39	91.2	40	88.0	41	87.8	42	88.0
43	88.5	44	84.5	45	87.0	46	82.7	47	77.0	48	66.8	49	0.

TIME 600 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.0	3	90.0	4	80.7	5	91.0	6	81.5	7	88.7
8	79.3	9	87.0	10	78.0	11	89.0	12	80.5	13	85.0	14	75.6
15	92.0	16	83.8	17	92.5	18	83.6	19	90.5	20	82.7	21	91.0
22	82.8	23	0.	24	0.	25	84.2	26	76.0	27	89.5	28	80.0
29	87.0	30	75.5	31	89.6	32	90.0	33	90.0	34	91.0	35	92.5
36	93.0	37	90.2	38	91.0	39	91.0	40	87.8	41	87.7	42	87.7
43	88.5	44	84.0	45	86.8	46	82.5	47	75.8	48	66.5	49	0.

TIME 700 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	80.5	3	90.0	4	80.7	5	91.0	6	81.3	7	88.7
8	79.3	9	87.0	10	78.0	11	89.0	12	80.5	13	84.7	14	75.6
15	92.0	16	84.0	17	92.5	18	83.6	19	90.5	20	82.7	21	91.0
22	82.8	23	0.	24	0.	25	83.8	26	75.5	27	89.8	28	80.0
29	83.0	30	76.0	31	89.7	32	90.0	33	90.0	34	91.0	35	92.5
36	93.0	37	90.3	38	91.0	39	91.0	40	87.7	41	87.7	42	87.7
43	88.5	44	84.2	45	87.0	46	82.5	47	76.7	48	66.8	49	0.

TIME 800 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.7	2	80.6	3	90.0	4	80.8	5	91.0	6	81.5	7	88.7
8	79.3	9	87.0	10	78.4	11	89.0	12	80.8	13	84.5	14	75.1
15	91.7	16	84.0	17	92.5	18	84.2	19	90.5	20	82.7	21	91.0
22	82.8	23	0.	24	0.	25	83.5	26	75.7	27	89.5	28	85.5
29	78.2	30	71.0	31	89.7	32	90.0	33	90.0	34	91.0	35	92.2
36	93.0	37	90.5	38	91.0	39	91.0	40	88.0	41	87.7	42	88.0
43	88.5	44	84.2	45	87.0	46	82.5	47	76.0	48	66.7	49	0.

TIME 900 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.0	3	90.0	4	80.7	5	91.0	6	81.3	7	89.0
8	79.9	9	87.0	10	77.7	11	88.5	12	80.5	13	84.9	14	75.6
15	92.0	16	84.4	17	92.0	18	83.5	19	90.7	20	83.0	21	91.0
22	83.1	23	0.	24	0.	25	84.5	26	76.0	27	90.0	28	85.5
29	78.0	30	72.5	31	90.0	32	90.3	33	90.3	34	91.2	35	92.5
36	93.0	37	90.5	38	91.0	39	91.5	40	88.0	41	88.0	42	88.0
43	89.0	44	84.5	45	87.0	46	82.5	47	78.0	48	66.5	49	0.

TIME 1000 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.7	2	80.6	3	90.0	4	80.7	5	91.0	6	81.2	7	88.9
8	79.3	9	87.0	10	77.8	11	88.5	12	80.6	13	84.5	14	74.6
15	92.8	16	85.1	17	92.0	18	83.9	19	90.5	20	82.7	21	91.0
22	82.7	23	0.	24	0.	25	84.0	26	75.5	27	89.8	28	86.5
29	81.8	30	76.3	31	90.0	32	90.0	33	90.0	34	91.0	35	92.5
36	92.8	37	90.5	38	91.0	39	91.2	40	87.8	41	87.8	42	88.0
43	88.5	44	84.5	45	87.0	46	82.5	47	77.6	48	61.0	49	0.

TIME 1100 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.4	3	90.0	4	80.4	5	91.0	6	81.1	7	89.0
8	79.2	9	87.0	10	77.8	11	89.0	12	80.8	13	85.0	14	75.0
15	92.0	16	84.1	17	92.0	18	83.3	19	90.5	20	81.6	21	91.0
22	82.8	23	0.	24	0.	25	84.6	26	75.6	27	89.7	28	85.5
29	82.0	30	77.5	31	90.0	32	90.0	33	90.0	34	91.1	35	92.5
36	93.0	37	90.7	38	91.2	39	91.4	40	88.0	41	88.0	42	88.0
43	88.8	44	84.5	45	87.2	46	82.6	47	78.1	48	66.5	49	0.

TIME 1200 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.3	3	88.0	4	79.0	5	89.0	6	79.6	7	86.5
8	77.8	9	84.0	10	77.4	11	87.0	12	79.5	13	77.3	14	71.9
15	91.0	16	82.8	17	90.0	18	82.8	19	90.0	20	81.7	21	90.0
22	81.9	23	0.	24	0.	25	76.5	26	73.4	27	87.0	28	81.6
29	78.7	30	72.9	31	86.8	32	88.0	33	88.0	34	88.5	35	91.0
36	91.6	37	88.6	38	89.7	39	90.0	40	83.8	41	83.8	42	84.5
43	85.5	44	82.7	45	82.2	46	80.8	47	76.0	48	66.5	49	0.

TIME 1300 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	79.2	3	81.2	4	79.4	5	88.0	6	79.8	7	84.0
8	77.4	9	82.0	10	76.6	11	85.5	12	79.2	13	77.0	14	73.4
15	89.7	16	82.5	17	90.0	18	82.6	19	88.5	20	80.9	21	89.5
22	82.2	23	0.	24	0.	25	76.0	26	73.0	27	86.0	28	92.4
29	75.8	30	68.0	31	86.7	32	86.9	33	86.9	34	87.5	35	89.7
36	90.3	37	87.2	38	88.4	39	88.6	40	88.3	41	88.3	42	81.5
43	84.7	44	81.2	45	81.7	46	80.0	47	72.6	48	66.5	49	0.

TIME 1400 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.2	2	78.8	3	86.8	4	79.4	5	87.5	6	79.9	7	84.0
8	77.4	9	82.0	10	76.5	11	85.0	12	78.6	13	77.4	14	71.6
15	88.2	16	81.3	17	89.5	18	82.3	19	88.0	20	81.1	21	88.0
22	81.2	23	0.	24	0.	25	76.2	26	72.6	27	86.0	28	87.8
29	81.7	30	81.8	31	81.7	32	81.9	33	82.0	34	82.2	35	81.5
36	90.0	37	87.0	38	88.0	39	88.2	40	82.6	41	82.8	42	81.3
43	84.1	44	91.0	45	81.8	46	80.0	47	73.8	48	66.5	49	0.

TIME 1500 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.8	3	86.5	4	79.1	5	87.5	6	79.5	7	84.2
8	77.1	9	92.0	10	76.6	11	94.5	12	78.8	13	77.0	14	73.8
15	94.0	16	91.9	17	89.2	18	92.4	19	88.0	20	81.2	21	88.0
22	84.1	23	C.	24	C.	25	76.0	26	76.0	27	76.0	28	76.0
29	86.5	30	91.7	31	89.5	32	90.4	33	86.5	34	87.0	35	89.2
36	94.9	37	97.0	38	87.8	39	88.0	40	82.5	41	82.5	42	83.2
43	94.2	44	92.8	45	82.2	46	79.8	47	74.5	48	66.5	49	0.

TIME 1600 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	96.1	2	94.0	3	86.5	4	79.0	5	87.0	6	79.3	7	84.0
8	77.4	9	91.5	10	76.4	11	94.0	12	78.3	13	76.0	14	72.8
15	94.0	16	90.0	17	88.5	18	91.6	19	97.5	20	81.0	21	88.0
22	81.5	23	C.	24	C.	25	75.6	26	72.0	27	85.5	28	82.4
29	79.	30	87.5	31	84.9	32	85.9	33	89.0	34	85.5	35	88.5
36	94.1	37	90.5	38	87.3	39	87.5	40	82.0	41	82.0	42	82.4
43	91.5	44	91.5	45	81.0	46	79.8	47	70.0	48	66.5	49	0.

TIME 1700 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.1	2	78.6	3	86.5	4	94.5	5	87.0	6	95.8	7	84.0
8	79.6	9	92.0	10	87.2	11	84.0	12	89.5	13	76.5	14	73.1
15	95.1	16	91.8	17	86.5	18	90.7	19	97.0	20	80.5	21	87.5
22	85.0	23	C.	24	C.	25	78.9	26	72.9	27	85.9	28	79.1
29	75.0	30	92.4	31	85.2	32	88.2	33	89.0	34	87.0	35	89.0
36	97.5	37	97.0	38	87.5	39	91.0	40	82.2	41	82.5	42	83.0
43	91.7	44	91.9	45	82.0	46	80.0	47	78.2	48	67.5	49	0.

TIME 1800 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	79.4	3	95.0	4	90.4	5	91.0	6	81.7	7	90.5
8	79.0	9	91.0	10	78.4	11	90.0	12	78.1	13	92.0	14	76.5
15	91.0	16	90.4	17	92.0	18	84.5	19	90.0	20	85.5	21	91.0
22	85.0	23	C.	24	C.	25	90.0	26	77.5	27	91.5	28	90.0
29	93.2	30	77.0	31	92.1	32	92.1	33	91.4	34	92.9	35	92.9
36	92.5	37	91.0	38	92.0	39	91.5	40	92.0	41	92.0	42	91.5
43	91.4	44	92.0	45	92.0	46	84.5	47	77.5	48	67.9	49	0.

TIME 1900 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	79.0	3	92.5	4	80.0	5	93.0	6	81.4	7	92.0
8	78.5	9	91.0	10	78.2	11	91.0	12	78.6	13	92.5	14	75.9
15	93.0	16	90.5	17	94.0	18	85.1	19	92.0	20	84.8	21	93.0
22	85.3	23	C.	24	C.	25	96.0	26	78.0	27	92.3	28	89.9
29	94.1	30	77.0	31	93.0	32	92.5	33	92.8	34	94.1	35	94.5
36	94.5	37	92.8	38	91.0	39	93.0	40	92.9	41	92.2	42	92.1
43	91.0	44	92.8	45	92.5	46	84.8	47	79.5	48	67.8	49	0.

TIME 2000 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	80.5	3	94.0	4	81.0	5	94.0	6	81.5	7	94.0
8	80.1	9	93.0	10	80.5	11	93.0	12	80.6	13	93.5	14	78.8
15	94.0	16	90.9	17	95.0	18	86.4	19	93.5	20	86.0	21	94.0
22	85.4	23	C.	24	C.	25	91.0	26	78.8	27	94.5	28	91.0
29	95.0	30	93.2	31	95.2	32	95.0	33	94.8	34	95.7	35	95.8
36	96.0	37	95.5	38	94.6	39	94.6	40	94.4	41	93.8	42	93.8
43	94.1	44	93.2	45	93.9	46	98.6	47	82.0	48	68.0	49	0.

TIME 2100 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	80.5	3	93.5	4	80.1	5	95.0	6	81.8	7	92.5
8	76.8	9	92.5	10	79.0	11	93.0	12	80.6	13	91.5	14	76.6
15	94.5	16	97.4	17	96.0	18	85.7	19	94.0	20	85.5	21	94.0
22	84.5	23	C.	24	C.	25	91.2	26	70.0	27	94.8	28	92.0
29	90.2	30	91.0	31	95.4	32	95.1	33	94.9	34	95.8	35	96.0
36	96.2	37	94.8	38	94.8	39	94.8	40	94.5	41	93.8	42	93.8
43	94.3	44	88.0	45	93.8	46	85.7	47	81.4	48	68.0	49	0.

TIME 2200 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.0	3	95.0	4	86.8	5	95.0	6	81.9	7	94.5
8	80.4	9	93.0	10	79.6	11	93.0	12	80.1	13	92.7	14	77.5
15	95.0	16	91.8	17	96.0	18	85.5	19	94.5	20	85.6	21	95.0
22	85.5	23	C.	24	C.	25	91.0	26	90.0	27	94.9	28	91.1
29	86.8	30	81.4	31	95.8	32	95.5	33	95.1	34	95.0	35	96.4
36	96.6	37	96.4	38	96.3	39	96.3	40	94.6	41	93.9	42	94.0
43	94.7	44	88.0	45	93.9	46	85.7	47	80.6	48	67.8	49	0.

TIME 2300 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	81.0	3	95.0	4	81.1	5	96.0	6	82.6	7	94.0
8	79.6	9	93.0	10	79.6	11	93.0	12	80.1	13	92.3	14	77.9
15	95.0	16	87.5	17	96.0	18	85.5	19	94.5	20	85.4	21	95.0
22	85.0	23	C.	24	C.	25	91.5	26	91.2	27	92.0	28	91.7
29	85.8	30	95.0	31	95.9	32	95.8	33	95.2	34	96.0	35	96.6
36	96.8	37	95.5	38	95.5	39	95.5	40	94.8	41	94.0	42	94.0
43	94.4	44	88.2	45	93.8	46	85.8	47	81.2	48	67.9	49	0.

TIME 2400 DATE 4/29/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	79.4	3	92.0	4	79.4	5	92.0	6	79.8	7	91.0
8	79.1	9	88.0	10	85.9	11	85.5	12	75.4	13	94.0	14	84.5
15	90.0	16	79.8	17	94.0	18	81.7	19	93.5	20	83.0	21	94.0
22	82.0	23	0.	24	0.	25	86.2	26	85.2	27	91.3	28	87.0
29	81.0	30	74.7	31	91.8	32	91.8	33	91.5	34	93.0	35	94.5
36	95.0	37	93.0	38	93.5	39	93.7	40	89.5	41	89.1	42	89.5
43	90.8	44	85.8	45	94.0	46	83.5	47	78.8	48	67.8	49	0.

TIME 100 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.4	3	90.5	4	0.	5	91.0	6	0.	7	89.0
8	0.	9	87.5	10	0.	11	89.0	12	0.	13	85.0	14	75.4
15	93.0	16	0.	17	93.0	18	0.	19	92.0	20	0.	21	93.0
22	0.	23	C.	24	C.	25	85.5	26	76.0	27	85.5	28	80.0
29	81.0	30	75.0	31	90.3	32	90.5	33	90.2	34	92.0	35	93.2
36	94.0	37	91.7	38	92.2	39	92.5	40	88.0	41	88.0	42	88.0
43	89.0	44	84.8	45	87.2	46	82.8	47	76.5	48	67.9	49	0.

TIME 200 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	79.5	3	90.0	4	80.0	5	91.0	6	80.7	7	88.[illegible]
8	79.0	9	87.0	10	78.0	11	89.0	12	80.7	13	85.2	14	75.7
15	92.0	16	84.0	17	92.5	18	83.7	19	91.0	20	82.5	21	92.0
22	83.5	23	0.	24	0.	25	84.5	26	76.2	27	89.8	28	81.5
29	76.2	30	70.7	31	89.5	32	89.7	33	89.5	34	91.2	35	92.8
36	93.0	37	91.0	38	91.5	39	91.7	40	88.0	41	87.7	42	87.8
43	88.8	44	84.5	45	87.2	46	82.8	47	77.5	48	67.7	49	0.

TIME 300 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.5	3	89.5	4	80.0	5	90.0	6	80.3	7	88.0
8	78.2	9	87.0	10	78.3	11	88.5	12	80.3	13	85.0	14	75.7
15	92.0	16	84.2	17	92.9	18	84.3	19	91.0	20	82.7	21	92.0
22	83.4	23	C.	24	C.	25	85.0	26	76.3	27	89.7	28	80.0
29	75.2	30	90.0	31	89.3	32	89.3	33	89.3	34	91.0	35	92.5
36	93.0	37	90.	38	91.2	39	91.5	40	87.5	41	87.5	42	87.5
43	88.5	44	84.2	45	87.0	46	82.5	47	76.2	48	67.6	49	0.

TIME 400 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.4	3	89.0	4	79.2	5	90.0	6	80.2	7	88.0
8	78.3	9	87.0	10	77.5	11	86.5	12	79.5	13	85.0	14	75.4
15	92.0	16	84.2	17	92.0	18	83.7	19	91.0	20	82.5	21	91.0
22	82.7	23	C.	24	C.	25	84.0	26	75.5	27	89.0	28	80.5
29	76.2	30	72.0	31	84.0	32	89.0	33	89.0	34	91.0	35	92.2
36	92.5	37	90.0	38	91.0	39	91.0	40	87.5	41	87.2	42	87.5
43	88.3	44	84.0	45	87.0	46	82.5	47	76.7	48	67.5	49	0.

TIME 500 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.2	3	89.0	4	79.7	5	91.0	6	81.3	7	88.0
8	78.6	9	87.0	10	77.8	11	89.0	12	80.5	13	85.0	14	75.7
15	92.0	16	84.3	17	92.0	18	84.0	19	91.0	20	82.8	21	91.0
22	83.1	23	C.	24	C.	25	84.5	26	76.3	27	89.0	28	80.5
29	76.0	30	71.0	31	89.0	32	89.0	33	89.0	34	91.0	35	92.2
36	92.7	37	90.5	38	91.0	39	91.0	40	87.7	41	87.5	42	87.5
43	88.5	44	84.2	45	87.2	46	82.5	47	77.7	48	67.5	49	0.

TIME 600 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.5	3	89.0	4	79.8	5	90.0	6	80.5	7	88.0
8	79.0	9	87.0	10	78.0	11	88.5	12	80.0	13	85.0	14	75.7
15	91.9	16	84.0	17	92.0	18	83.5	19	90.5	20	82.5	21	91.0
22	83.0	23	0.	24	0.	25	84.5	26	76.5	27	88.5	28	79.5
29	74.5	30	66.2	31	88.7	32	88.8	33	88.8	34	90.5	35	92.0
36	92.5	37	90.2	38	90.8	39	91.0	40	87.5	41	87.0	42	87.2
43	88.2	44	84.0	45	86.8	46	82.2	47	76.5	48	67.5	49	0.

TIME 700 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.7	2	79.3	3	89.0	4	79.8	5	90.0	6	80.5	7	88.0
8	78.5	9	86.0	10	77.5	11	88.0	12	79.7	13	84.7	14	75.8
15	91.5	16	84.0	17	92.0	18	84.0	19	90.5	20	82.5	21	91.0
22	82.5	23	C.	24	C.	25	84.0	26	76.0	27	89.0	28	80.0
29	76.5	30	72.5	31	88.8	32	89.0	33	88.7	34	90.5	35	92.0
36	92.5	37	90.0	38	90.7	39	91.0	40	87.5	41	87.0	42	87.0
43	88.0	44	84.0	45	86.8	46	82.2	47	77.0	48	67.2	49	0.

TIME 800 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.2	3	89.0	4	79.5	5	90.0	6	80.5	7	88.0
8	78.6	9	87.0	10	78.0	11	89.0	12	80.7	13	85.0	14	75.1
15	91.5	16	84.0	17	92.0	18	84.0	19	90.5	20	82.6	21	91.0
22	82.5	23	0.	24	C.	25	85.2	26	76.0	27	89.0	28	80.2
29	74.0	30	67.8	31	89.2	32	89.2	33	89.1	34	90.8	35	92.0
36	92.5	37	90.3	38	91.0	39	91.0	40	87.6	41	87.2	42	87.3
43	88.4	44	84.2	45	86.8	46	87.4	47	86.0	48	67.2	49	0.

TIME 900 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.4	2	81.0	3	89.5	4	80.0	5	90.0	6	80.5	7	88.4
8	79.0	9	86.5	10	77.6	11	88.0	12	79.6	13	85.5	14	75.6
15	91.8	16	84.3	17	92.0	18	83.6	19	90.6	20	82.8	21	91.0
22	82.7	23	C.	24	C.	25	86.2	26	76.2	27	89.2	28	80.5
29	74.0	30	66.8	31	89.5	32	89.5	33	89.4	34	91.0	35	92.1
36	92.7	37	90.7	38	91.0	39	91.2	40	87.9	41	87.4	42	87.5
43	88.6	44	84.5	45	87.0	46	82.7	47	76.0	48	67.0	49	0.

TIME 1000 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.0	3	89.2	4	79.8	5	90.0	6	80.2	7	88.2
8	78.8	9	86.0	10	76.8	11	88.0	12	79.3	13	85.5	14	75.5
15	91.5	16	84.2	17	92.0	18	84.0	19	90.7	20	82.8	21	91.0
22	82.5	23	C.	24	C.	25	85.2	26	76.1	27	89.0	28	80.0
29	74.0	30	67.7	31	89.1	32	89.1	33	89.1	34	91.0	35	92.2
36	92.5	37	90.7	38	91.1	39	91.2	40	87.8	41	87.4	42	87.5
43	88.6	44	84.4	45	86.9	46	82.5	47	76.2	48	66.8	49	0.

TIME 1100 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.9	2	78.9	3	89.0	4	79.3	5	90.0	6	80.2	7	88.0
8	78.5	9	86.5	10	77.1	11	87.5	12	78.9	13	85.5	14	75.6
15	91.7	16	84.0	17	92.0	18	83.6	19	90.7	20	82.4	21	91.0
22	82.4	23	C.	24	C.	25	84.9	26	76.0	27	88.6	28	79.8
29	72.9	30	63.5	31	88.8	32	88.8	33	88.8	34	90.8	35	92.0
36	92.4	37	90.5	38	91.0	39	91.1	40	87.6	41	87.2	42	87.2
43	88.2	44	84.0	45	87.0	46	82.2	47	72.6	48	66.7	49	0.

TIME 1200 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.8	2	79.0	3	88.0	4	78.7	5	90.0	6	80.0	7	88.0
8	78.6	9	86.5	10	77.2	11	87.5	12	78.5	13	85.2	14	75.8
15	91.5	16	84.1	17	92.0	18	84.0	19	90.7	20	88.5	21	91.5
22	82.8	23	C.	24	C.	25	84.2	26	76.1	27	89.0	28	79.2
29	63.2	30	45.3	31	88.5	32	88.5	33	88.3	34	90.6	35	91.8
36	92.3	37	90.3	38	90.9	39	91.0	40	87.3	41	87.0	42	87.0
43	88.6	44	83.7	45	86.7	46	81.8	47	70.5	48	66.8	49	0.

TIME 1300 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.5	3	89.0	4	79.6	5	90.0	6	80.0	7	88.0
8	78.5	9	86.0	10	77.0	11	88.0	12	79.4	13	85.0	14	75.6
15	91.4	16	82.3	17	92.0	18	83.8	19	90.5	20	82.3	21	91.0
22	82.2	23	C.	24	C.	25	83.5	26	76.0	27	88.5	28	79.7
29	68.6	30	56.8	31	88.6	32	88.7	33	88.5	34	90.7	35	91.9
36	92.2	37	90.4	38	91.0	39	91.0	40	87.2	41	87.0	42	87.0
43	88.5	44	83.5	45	87.0	46	81.5	47	70.1	48	67.0	49	0.

TIME 1400 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.2	3	89.0	4	79.7	5	90.0	6	80.3	7	88.0
8	78.5	9	86.0	10	77.0	11	87.0	12	77.8	13	85.5	14	75.8
15	91.5	16	84.3	17	92.0	18	83.8	19	90.0	20	81.7	21	91.0
22	82.7	23	0.	24	C.	25	85.1	26	76.5	27	88.6	28	79.6
29	0.	30	0.	31	88.5	32	88.5	33	88.5	34	90.6	35	91.8
36	92.1	37	90.0	38	90.0	39	90.3	40	87.0	41	86.4	42	86.7
43	87.9	44	83.5	45	86.5	46	81.6	47	67.8	48	67.0	49	0.

TIME 1500 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.7	2	74.0	3	89.0	4	79.4	5	90.0	6	80.3	7	88.0
8	78.5	9	86.0	10	77.0	11	88.0	12	78.8	13	85.5	14	75.5
15	91.5	16	84.1	17	92.0	18	83.8	19	90.5	20	82.7	21	91.0
22	82.5	23	0.	24	0.	25	85.0	26	76.5	27	88.5	28	79.1
29	0.	30	0.	31	88.6	32	88.6	33	88.5	34	90.5	35	91.8
36	92.0	37	90.2	38	90.6	39	90.8	40	87.3	41	87.0	42	87.0
43	88.0	44	83.8	45	86.8	46	82.0	47	67.6	48	67.1	49	0.

TIME 1600 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.4	2	76.7	3	85.0	4	78.6	5	90.0	6	80.0	7	88.0
8	78.5	9	86.0	10	76.7	11	88.0	12	79.0	13	85.5	14	78.7
15	91.5	16	84.2	17	92.0	18	84.0	19	90.5	20	82.7	21	91.0
22	82.4	23	0.	24	0.	25	84.3	26	76.5	27	88.2	28	79.0
29	64.0	30	47.3	31	88.5	32	88.5	33	88.3	34	90.4	35	91.5
36	92.0	37	90.0	38	90.7	39	90.8	40	87.4	41	86.8	42	87.0
43	88.0	44	83.5	45	86.5	46	81.8	47	67.5	48	67.5	49	0.

TIME 1700 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	78.7	3	89.0	4	79.9	5	90.0	6	80.5	7	88.0
8	79.1	9	87.5	10	77.4	11	88.0	12	79.3	13	86.0	14	77.5
15	91.0	16	83.9	17	91.8	18	84.0	19	91.0	20	82.8	21	91.0
22	83.9	23	0.	24	0.	25	84.6	26	77.1	27	88.8	28	80.0
29	70.5	30	60.0	31	88.8	32	89.0	33	88.5	34	90.8	35	91.8
36	92.2	37	90.3	38	90.8	39	91.0	40	87.3	41	87.0	42	87.0
43	88.3	44	83.5	45	86.8	46	81.8	47	72.0	48	68.0	49	0.

TIME 2200 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.4	3	92.0	4	84.4	5	92.0	6	84.2	7	89.0
8	81.6	9	87.0	10	80.7	11	89.0	12	82.8	13	80.0	14	76.5
15	92.5	16	85.3	17	93.0	18	85.4	19	88.0	20	75.2	21	89.0
22	86.1	23	0.	24	0.	25	79.0	26	76.3	27	90.4	28	83.2
29	74.0	30	63.6	31	92.8	32	92.4	33	92.2	34	91.7	35	93.4
36	93.8	37	88.7	38	88.8	39	89.0	40	87.0	41	87.2	42	89.9
43	88.4	44	84.1	45	86.2	46	86.8	47	73.2	48	69.4	49	0.

TIME 2300 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	81.1	3	91.0	4	81.9	5	91.0	6	83.5	7	89.0
8	80.4	9	87.0	10	80.8	11	89.0	12	83.1	13	79.0	14	71.9
15	92.0	16	82.5	17	92.0	18	84.5	19	89.0	20	84.5	21	91.0
22	85.8	23	0.	24	0.	25	77.3	26	71.3	27	90.0	28	81.5
29	73.8	30	65.0	31	90.6	32	91.3	33	91.3	34	90.3	35	92.5
36	93.0	37	88.6	38	89.4	39	89.6	40	85.5	41	86.1	42	88.3
43	87.5	44	83.6	45	84.5	46	82.2	47	74.1	48	69.5	49	0.

TIME 2400 DATE 4/30/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.5	3	90.5	4	83.5	5	91.0	6	83.5	7	88.5
8	81.2	9	86.0	10	79.5	11	88.5	12	82.2	13	77.5	14	73.5
15	91.2	16	83.7	17	92.0	18	85.0	19	90.0	20	84.8	21	90.5
22	85.0	23	0.	24	0.	25	74.5	26	72.8	27	89.5	28	88.2
29	74.2	30	65.0	31	90.0	32	91.0	33	91.0	34	89.5	35	91.5
36	92.0	37	89.2	38	90.0	39	90.0	40	88.0	41	85.7	42	89.0
43	87.0	44	83.2	45	84.5	46	81.0	47	73.0	48	70.0	49	0.

TIME 100 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.7	3	90.5	4	83.5	5	91.0	6	80.3	7	86.0
8	81.0	9	86.0	10	79.8	11	88.0	12	82.0	13	77.5	14	73.7
15	91.0	16	84.0	17	91.5	18	84.5	19	90.0	20	84.0	21	90.5
22	82.5	23	0.	24	0.	25	76.5	26	73.0	27	89.5	28	83.2
29	74.8	30	65.5	31	90.0	32	91.0	33	91.0	34	89.0	35	91.2
36	91.8	37	89.2	38	90.0	39	90.0	40	85.0	41	85.5	42	88.8
43	87.0	44	83.0	45	84.5	46	80.8	47	72.2	48	69.9	49	0.

TIME 200 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.0	3	90.5	4	83.7	5	91.0	6	80.5	7	88.0
8	81.4	9	86.0	10	80.2	11	88.0	12	82.5	13	77.5	14	74.0
15	91.0	16	84.2	17	91.0	18	84.5	19	89.5	20	84.5	21	90.5
22	85.0	23	0.	24	0.	25	76.5	26	73.0	27	89.2	28	83.5
29	75.7	30	67.0	31	89.8	32	91.0	33	91.0	34	89.0	35	91.0
36	91.8	37	89.2	38	90.0	39	90.0	40	85.0	41	85.5	42	89.0
43	87.0	44	83.0	45	84.0	46	80.8	47	73.2	48	70.0	49	0.

TIME 300 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.0	3	90.5	4	83.7	5	91.0	6	80.5	7	88.0
8	81.4	9	86.0	10	80.2	11	88.0	12	82.5	13	77.5	14	74.0
15	91.0	16	84.2	17	91.0	18	84.5	19	89.5	20	84.5	21	90.5
22	85.0	23	0.	24	0.	25	76.5	26	73.0	27	89.2	28	83.5
29	75.7	30	67.0	31	89.8	32	91.0	33	91.0	34	89.0	35	91.0
36	91.8	37	89.2	38	90.0	39	90.0	40	85.0	41	85.5	42	89.0
43	87.0	44	83.0	45	84.0	46	80.8	47	73.2	48	70.0	49	0.

TIME 400 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.0	3	90.5	4	83.7	5	91.0	6	80.5	7	88.0
8	81.4	9	86.0	10	80.2	11	88.0	12	82.5	13	77.5	14	74.0
15	91.0	16	84.2	17	91.0	18	84.5	19	89.5	20	84.5	21	90.5
22	85.0	23	0.	24	0.	25	76.5	26	73.0	27	89.2	28	83.5
29	75.7	30	67.0	31	89.8	32	91.0	33	91.0	34	89.0	35	91.0
36	91.8	37	89.2	38	90.0	39	90.0	40	85.0	41	85.5	42	89.0
43	87.0	44	83.0	45	84.0	46	80.8	47	73.2	48	70.0	49	0.

TIME 500 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.2	3	90.0	4	83.5	5	90.5	6	80.5	7	88.0
8	81.4	9	86.0	10	80.2	11	88.0	12	82.6	13	77.0	14	73.7
15	90.5	16	84.0	17	91.0	18	84.8	19	89.5	20	84.5	21	90.5
22	84.8	23	0.	24	0.	25	76.3	26	73.0	27	89.3	28	83.7
29	76.5	30	69.0	31	89.5	32	90.8	33	90.8	34	88.5	35	91.0
36	91.5	37	89.0	38	90.0	39	90.0	40	84.5	41	85.2	42	88.7
43	86.8	44	83.0	45	84.0	46	80.5	47	73.0	48	70.0	49	0.

TIME 600 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.8	2	83.0	3	90.0	4	83.7	5	91.0	6	80.0	7	88.0
8	81.4	9	86.0	10	80.5	11	88.0	12	82.7	13	77.0	14	73.7
15	90.5	16	84.2	17	91.0	18	84.8	19	89.5	20	84.5	21	90.5
22	82.5	23	0.	24	0.	25	76.3	26	73.0	27	89.0	28	83.0
29	76.0	30	67.5	31	89.2	32	90.7	33	90.7	34	88.5	35	91.0
36	91.5	37	89.2	38	90.0	39	90.0	40	84.5	41	85.2	42	88.5
43	86.5	44	83.0	45	84.0	46	80.5	47	73.5	48	70.0	49	0.

TIME 700 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	83.0	3	90.0	4	83.7	5	90.5	6	83.5	7	88.0
8	81.6	9	86.0	10	80.5	11	88.0	12	82.7	13	77.5	14	73.6
15	90.5	16	84.5	17	91.0	18	85.3	19	89.5	20	84.5	21	90.5
22	82.5	23	0.	24	0.	25	77.0	26	73.0	27	89.2	28	83.0
29	81.0	30	74.2	31	89.2	32	90.5	33	90.5	34	88.5	35	91.0
36	91.5	37	89.0	38	90.0	39	90.0	40	84.8	41	85.2	42	88.5
43	86.5	44	83.0	45	84.0	46	80.8	47	74.0	48	70.0	49	0.

TIME 800 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	83.0	3	90.0	4	83.8	5	90.0	6	83.0	7	87.5
8	81.2	9	85.5	10	79.5	11	87.5	12	82.5	13	77.5	14	76.0
15	90.0	16	84.0	17	91.0	18	85.2	19	89.5	20	84.5	21	90.5
22	82.5	23	0.	24	0.	25	77.0	26	73.7	27	89.0	28	82.8
29	75.2	30	67.2	31	89.0	32	90.2	33	90.2	34	88.2	35	90.5
36	91.2	37	89.8	38	89.8	39	90.0	40	84.5	41	85.0	42	88.0
43	86.2	44	82.5	45	84.0	46	80.5	47	72.0	48	70.0	49	0.

TIME 2400 DATE 5/ 1/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 2400 DATE 5/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 300 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	83.5	3	95.5	4	84.6	5	94.0	6	82.5	7	91.4
8	78.8	9	90.5	10	78.9	11	92.0	12	80.2	13	85.4	14	73.5
15	95.0	16	85.1	17	97.0	18	84.2	19	94.0	20	80.7	21	95.0
22	82.7	23	0.	24	0.	25	84.0	26	75.0	27	93.2	28	82.5
29	0.	30	0.	31	93.8	32	94.1	33	94.1	34	96.6	35	96.9
36	97.3	37	95.8	38	95.6	39	95.5	40	92.4	41	91.0	42	92.6
43	91.6	44	86.0	45	90.3	46	83.8	47	70.0	48	75.7	49	0.

TIME 400 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	82.1	3	92.5	4	82.5	5	94.0	6	83.3	7	91.5
8	81.0	9	91.0	10	80.6	11	92.5	12	81.8	13	84.5	14	76.0
15	95.0	16	84.0	17	97.0	18	85.2	19	94.0	20	82.7	21	99.0
22	84.2	23	0.	24	0.	25	84.6	26	77.4	27	93.8	28	84.0
29	0.	30	0.	31	94.0	32	94.3	33	94.7	34	96.8	35	96.8
36	97.5	37	95.6	38	95.5	39	95.5	40	91.6	41	91.4	42	92.9
43	92.0	44	87.5	45	90.3	46	84.0	47	76.5	48	76.0	49	0.

TIME 500 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.7	2	82.9	3	93.5	4	83.9	5	94.0	6	83.5	7	92.0
8	81.9	9	91.0	10	80.6	11	92.0	12	82.0	13	85.4	14	77.0
15	95.0	16	84.6	17	96.0	18	84.7	19	94.0	20	83.8	21	99.0
22	84.3	23	0.	24	0.	25	84.5	26	77.2	27	93.4	28	84.0
29	0.	30	0.	31	93.7	32	94.0	33	94.0	34	96.0	35	96.8
36	97.0	37	95.1	38	95.2	39	95.3	40	91.0	41	91.0	42	92.9
43	91.6	44	86.2	45	90.1	46	83.8	47	70.3	48	75.0	49	0.

TIME 600 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	82.2	3	92.5	4	83.9	5	94.0	6	83.4	7	91.5
8	81.4	9	91.0	10	80.6	11	92.0	12	82.0	13	84.5	14	76.4
15	94.5	16	84.4	17	96.0	18	84.4	19	94.0	20	83.5	21	99.5
22	82.6	23	0.	24	0.	25	84.4	26	77.1	27	93.2	28	84.1
29	0.	30	0.	31	93.5	32	94.0	33	94.0	34	95.6	35	96.4
36	96.7	37	95.3	38	95.5	39	95.6	40	91.0	41	91.0	42	92.3
43	91.5	44	86.2	45	90.0	46	88.8	47	71.8	48	75.5	49	0.

TIME 700 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	82.2	3	92.5	4	83.4	5	93.5	6	83.3	7	91.0
8	81.4	9	90.0	10	80.0	11	92.0	12	82.2	13	85.0	14	75.4
15	94.5	16	84.1	17	96.0	18	85.6	19	93.5	20	83.4	21	95.0
22	84.5	23	0.	24	0.	25	85.5	26	77.9	27	93.5	28	84.8
29	0.	30	0.	31	93.5	32	94.0	33	94.0	34	95.2	35	96.0
36	96.8	37	95.0	38	95.5	39	95.2	40	91.0	41	91.0	42	92.1
43	91.5	44	86.2	45	90.0	46	83.8	47	76.4	48	75.8	49	0.

TIME 800 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.6	2	82.4	3	92.0	4	83.1	5	93.5	6	83.9	7	85.0
8	81.7	9	90.0	10	78.5	11	91.5	12	82.1	13	85.0	14	76.8
15	94.0	16	83.0	17	95.5	18	85.5	19	93.5	20	84.2	21	94.5
22	85.3	23	0.	24	0.	25	85.5	26	77.2	27	92.4	28	94.1
29	74.4	30	65.0	31	92.4	32	93.2	33	93.2	34	94.5	35	95.7
36	97.0	37	94.6	38	95.0	39	95.0	40	90.7	41	90.7	42	97.0
43	91.2	44	86.8	45	90.0	46	83.8	47	79.0	48	75.4	49	0.

TIME 900 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	82.5	3	91.8	4	83.6	5	93.0	6	84.2	7	90.5
8	81.5	9	90.0	10	80.8	11	91.5	12	82.6	13	84.5	14	70.5
15	93.5	16	85.1	17	95.0	18	85.8	19	83.0	20	84.0	21	94.1
22	85.0	23	0.	24	0.	25	84.8	26	77.3	27	92.2	28	84.5
29	76.5	30	62.2	31	92.0	32	92.8	33	92.9	34	94.1	35	95.2
36	95.5	37	94.2	38	94.8	39	94.8	40	90.4	41	90.5	42	91.9
43	91.8	44	91.8	45	89.6	46	83.6	47	75.8	48	75.0	49	0.

TIME 1000 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	82.9	3	91.5	4	86.6	5	92.5	6	84.2	7	90.5
8	81.7	9	90.0	10	81.0	11	91.5	12	82.8	13	85.0	14	75.6
15	93.4	16	86.1	17	94.5	18	85.5	19	93.0	20	84.6	21	94.0
22	85.0	23	0.	24	0.	25	85.5	26	77.8	27	91.9	28	84.5
29	76.0	30	67.3	31	92.0	32	92.5	33	92.5	34	93.9	35	95.0
36	95.2	37	94.0	38	94.6	39	94.7	40	90.0	41	90.2	42	91.6
43	90.8	44	85.5	45	89.1	46	83.5	47	73.9	48	74.9	49	0.

TIME 1100 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.1	3	91.5	4	83.8	5	92.4	6	84.2	7	90.5
8	81.7	9	90.0	10	80.6	11	91.0	12	82.8	13	85.5	14	76.1
15	93.0	16	85.8	17	94.0	18	85.6	19	93.0	20	84.7	21	94.0
22	85.5	23	0.	24	0.	25	84.5	26	77.2	27	91.9	28	84.2
29	73.2	30	61.0	31	92.0	32	92.2	33	92.2	34	93.3	35	94.7
36	94.9	37	93.8	38	94.3	39	94.3	40	90.1	41	90.2	42	91.5
43	90.6	44	85.5	45	89.0	46	83.3	47	71.8	48	74.9	49	0.

TIME 1200 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.8	2	82.9	3	91.0	4	83.5	5	92.0	6	83.9	7	90.0
8	81.6	9	90.0	10	81.6	11	91.0	12	83.0	13	85.0	14	76.9
15	93.0	16	86.2	17	94.0	18	86.1	19	92.5	20	84.0	21	94.0
22	85.7	23	0.	24	0.	25	85.7	26	77.6	27	91.4	28	84.3
29	68.0	30	53.3	31	91.8	32	91.9	33	91.9	34	93.0	35	94.4
36	94.5	37	93.4	38	94.0	39	94.0	40	90.0	41	90.2	42	91.3
43	90.4	44	85.0	45	89.3	46	83.0	47	71.2	48	75.0	49	0.

TIME 1300 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	8 .1	3	91.0	4	83.6	5	92.0	6	84.0	7	90.0
8	81.4	9	36.1	10	81.2	11	91.0	12	82.8	13	85.5	14	75.5
15	92.0	16	85.4	17	0.	18	0.	19	92.5	20	85.2	21	94.0
22	86.7	23	0.	24	0.	25	84.6	26	77.2	27	92.0	28	83.6
29	71.5	30	58.3	31	91.4	32	91.6	33	91.5	34	91.6	35	91.7
36	90.1	37	93.0	38	93.8	39	93.9	40	90.0	41	90.0	42	90.6
43	90.1	44	85.1	45	58.3	46	83.1	47	71.3	48	75.1	49	0.

TIME 1400 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.6	3	90.5	4	83.5	5	92.0	6	84.4	7	90.0
8	81.7	9	90.0	10	81.5	11	91.0	12	83.4	13	85.0	14	75.4
15	92.0	16	86.5	17	94.0	18	87.1	19	92.0	20	84.6	21	94.0
22	88.4	23	0.	24	0.	25	84.5	26	77.5	27	91.0	28	84.4
29	71.0	30	60.5	31	91.3	32	91.4	33	91.4	34	92.5	35	93.8
36	94.0	37	92.9	38	93.5	39	93.5	40	89.5	41	89.8	42	90.6
43	90.4	44	85.0	45	89.4	46	82.9	47	73.7	48	75.7	49	0.

TIME 1500 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	81.7	3	85.5	4	82.4	5	91.0	6	83.0	7	88.0
8	80.3	9	87.0	10	78.9	11	86.0	12	81.0	13	79.0	14	73.0
15	91.0	16	84.0	17	93.0	18	85.2	19	91.0	20	83.1	21	93.0
22	84.1	23	0.	24	0.	25	78.9	26	74.0	27	88.8	28	86.0
29	78.4	30	71.0	31	84.0	32	90.0	33	90.0	34	90.1	35	92.0
36	91.4	37	90.5	38	91.8	39	91.9	40	86.0	41	86.4	42	86.5
43	87.0	44	83.0	45	85.5	46	80.6	47	70.8	48	76.0	49	0.

TIME 1600 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	81.0	3	84.0	4	82.2	5	90.0	6	82.6	7	87.0
8	79.5	9	86.0	10	78.5	11	88.0	12	80.3	13	78.5	14	72.2
15	90.0	16	83.4	17	91.0	18	84.0	19	90.0	20	82.5	21	92.0
22	83.8	23	0.	24	0.	25	77.4	26	72.6	27	87.7	28	85.1
29	75.5	30	64.2	31	87.9	32	89.0	33	89.1	34	89.0	35	89.0
36	92.5	37	89.8	38	90.8	39	90.9	40	85.2	41	85.2	42	87.9
43	86.7	44	82.5	45	84.4	46	80.5	47	70.3	48	77.0	49	0.

TIME 1800 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	80.0	3	87.0	4	79.2	5	89.0	6	81.0	7	85.5
8	78.2	9	85.0	10	78.1	11	87.0	12	80.2	13	77.0	14	71.7
15	89.0	16	82.1	17	90.0	18	83.4	19	89.0	20	82.0	21	90.0
22	82.9	23	0.	24	0.	25	77.0	26	72.5	27	87.0	28	85.0
29	77.5	30	66.5	31	87.0	32	88.2	33	88.2	34	88.2	35	90.0
36	90.9	37	88.8	38	89.9	39	90.0	40	84.6	41	84.7	42	87.0
43	85.4	44	82.2	45	83.8	46	80.9	47	72.8	48	77.5	49	0.

TIME 1900 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	80.7	3	87.0	4	81.0	5	88.0	6	81.2	7	85.5
8	78.6	9	84.0	10	77.1	11	86.5	12	80.1	13	77.0	14	71.8
15	89.0	16	82.9	17	90.0	18	82.9	19	88.5	20	82.0	21	90.0
22	82.9	23	0.	24	0.	25	77.5	26	72.4	27	87.3	28	85.6
29	78.5	30	71.0	31	87.5	32	88.3	33	88.3	34	88.3	35	90.0
36	90.8	37	88.8	38	89.9	39	90.0	40	84.5	41	84.5	42	87.0
43	85.4	44	82.1	45	83.5	46	80.8	47	73.6	48	77.3	49	0.

TIME 2000 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	79.8	3	85.0	4	81.1	5	88.0	6	81.1	7	85.0
8	78.0	9	84.0	10	77.1	11	86.0	12	79.6	13	76.2	14	71.0
15	88.5	16	82.3	17	90.0	18	82.7	19	88.0	20	81.4	21	90.0
22	82.7	23	0.	24	0.	25	76.1	26	71.5	27	86.8	28	85.2
29	80.4	30	75.2	31	86.7	32	88.0	33	88.0	34	88.0	35	89.9
36	90.5	37	88.5	38	89.5	39	89.8	40	84.0	41	84.2	42	86.9
43	85.0	44	82.0	45	83.0	46	80.5	47	79.5	48	77.2	49	0.

TIME 2100 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.0	3	86.4	4	80.5	5	87.0	6	80.1	7	84.5
8	77.6	9	83.0	10	77.0	11	83.5	12	77.6	13	75.5	14	71.4
15	88.0	16	81.8	17	85.0	18	82.7	19	88.0	20	81.4	21	89.0
22	81.9	23	0.	24	0.	25	75.5	26	71.4	27	86.3	28	84.9
29	79.2	30	73.3	31	85.6	32	87.3	33	87.3	34	87.4	35	89.4
36	90.0	37	88.0	38	89.0	39	89.2	40	83.3	41	83.6	42	86.2
43	84.5	44	81.5	45	83.0	46	80.0	47	74.5	48	76.0	49	0.

TIME 2200 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	80.7	3	87.0	4	82.2	5	88.0	6	81.8	7	85.0
8	78.8	9	84.0	10	78.3	11	86.0	12	80.2	13	76.5	14	73.0
15	88.0	16	82.8	17	89.5	18	83.6	19	88.0	20	82.2	21	90.0
22	83.5	23	0.	24	0.	25	76.8	26	73.0	27	87.0	28	85.3
29	80.5	30	75.1	31	86.5	32	88.0	33	88.0	34	88.0	35	89.9
36	90.1	37	88.7	38	89.5	39	89.5	40	84.2	41	84.5	42	86.7
43	85.4	44	82.1	45	83.8	46	80.5	47	76.9	48	76.1	49	0.

TIME 2300 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	81.5	3	87.5	4	82.8	5	89.0	6	83.0	7	77.5
8	72.0	9	84.0	10	78.6	11	87.0	12	81.5	13	77.0	14	71.8
15	89.0	16	83.8	17	90.0	18	84.4	19	88.5	20	83.0	21	90.0
22	83.9	23	0.	24	0.	25	77.4	26	74.0	27	81.6	28	86.0
29	80.5	30	74.3	31	87.2	32	88.5	33	88.5	34	88.6	35	90.4
36	90.8	37	89.4	38	90.0	39	90.0	40	85.0	41	85.0	42	87.0
43	86.0	44	82.5	45	84.0	46	80.8	47	75.6	48	75.8	49	0.

TIME 2400 DATE 5/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	81.5	3	87.5	4	82.4	5	89.5	6	83.4	7	86.0
8	79.8	9	84.5	10	75.2	11	87.0	12	81.7	13	77.0	14	73.7
15	89.0	16	83.7	17	90.0	18	84.2	19	89.0	20	83.2	21	90.0
22	83.5	23	0.	24	0.	25	77.2	26	74.0	27	81.6	28	86.2
29	0.	30	0.	31	87.5	32	88.9	33	89.0	34	89.0	35	90.3
36	91.2	37	89.6	38	90.2	39	90.2	40	85.4	41	85.4	42	87.7
43	86.0	44	82.8	45	83.9	46	81.2	47	75.9	48	76.0	49	0.

TIME 100 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	81.6	3	87.7	4	82.5	5	88.5	6	82.2	7	86.0
8	79.8	9	85.0	10	75.5	11	87.0	12	81.4	13	77.0	14	74.2
15	89.0	16	83.5	17	90.0	18	84.0	19	89.0	20	83.1	21	90.0
22	83.4	23	0.	24	0.	25	77.2	26	74.2	27	81.6	28	86.3
29	0.	30	0.	31	87.4	32	88.9	33	88.9	34	89.0	35	90.5
36	91.1	37	89.6	38	90.2	39	90.2	40	85.2	41	85.1	42	87.7
43	86.0	44	82.7	45	84.0	46	81.0	47	76.2	48	75.7	49	0.

TIME 200 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	81.4	3	87.6	4	82.3	5	88.5	6	82.0	7	86.0
8	79.5	9	84.5	10	79.2	11	87.0	12	81.5	13	76.8	14	74.2
15	89.0	16	83.2	17	90.0	18	84.0	19	89.0	20	83.0	21	90.0
22	83.4	23	0.	24	0.	25	76.8	26	74.1	27	87.8	28	86.2
29	0.	30	0.	31	87.5	32	88.9	33	88.9	34	89.0	35	90.6
36	91.2	37	89.6	38	90.2	39	90.2	40	85.0	41	85.0	42	87.7
43	86.0	44	82.6	45	83.8	46	81.0	47	77.0	48	75.1	49	0.

TIME 300 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	81.6	3	87.5	4	82.3	5	88.5	6	82.0	7	85.8
8	80.5	9	84.0	10	78.6	11	86.5	12	81.0	13	76.5	14	73.8
15	89.0	16	83.4	17	90.0	18	84.0	19	89.0	20	83.2	21	90.0
22	83.4	23	0.	24	0.	25	76.2	26	73.4	27	87.5	28	86.0
29	0.	30	0.	31	87.2	32	88.6	33	88.8	34	88.9	35	90.3
36	91.0	37	89.3	38	90.0	39	90.0	40	84.8	41	85.0	42	87.6
43	85.8	44	82.5	45	83.7	46	80.7	47	75.5	48	74.6	49	0.

TIME 400 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	82.2	3	88.0	4	82.0	5	90.0	6	83.6	7	87.0
8	79.8	9	89.0	10	82.0	11	88.0	12	80.9	13	85.5	14	78.6
15	89.3	16	83.4	17	90.0	18	83.2	19	89.0	20	82.8	21	90.0
22	82.8	23	0.	24	0.	25	88.2	26	77.2	27	89.8	28	88.0
29	0.	30	0.	31	89.5	32	89.7	33	89.7	34	90.4	35	90.5
36	90.9	37	90.1	38	90.0	39	90.0	40	89.6	41	89.6	42	89.6
43	89.1	44	84.4	45	89.1	46	83.2	47	78.2	48	74.4	49	0.

TIME 500 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	84.4	3	90.0	4	82.2	5	91.0	6	83.1	7	89.5
8	81.3	9	90.0	10	82.0	11	89.5	12	80.9	13	85.0	14	75.5
15	90.5	16	86.7	17	90.0	18	82.6	19	89.8	20	82.7	21	90.0
22	82.3	23	0.	24	0.	25	84.8	26	76.0	27	91.0	28	89.1
29	0.	30	0.	31	91.0	32	91.0	33	91.0	34	91.2	35	91.3
36	91.6	37	91.0	38	91.0	39	90.8	40	90.2	41	90.3	42	90.7
43	90.0	44	85.4	45	89.1	46	83.4	47	77.2	48	74.1	49	0.

TIME 600 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.2	3	90.5	4	82.4	5	92.0	6	83.5	7	90.0
8	81.2	9	90.0	10	81.1	11	90.0	12	80.7	13	84.4	14	75.1
15	91.0	16	83.8	17	91.0	18	83.1	19	90.7	20	82.2	21	91.0
22	82.2	23	0.	24	0.	25	84.1	26	75.5	27	91.0	28	89.2
29	0.	30	0.	31	90.0	32	90.2	33	91.3	34	91.3	35	91.5
36	91.7	37	91.8	38	91.8	39	91.5	40	90.5	41	90.5	42	90.9
43	90.0	44	85.2	45	89.5	46	83.3	47	75.8	48	73.9	49	0.

TIME 700 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.3	2	82.4	3	90.7	4	82.4	5	92.0	6	83.2	7	90.4
8	81.1	9	90.0	10	81.0	11	90.0	12	80.3	13	84.5	14	75.6
15	91.0	16	83.2	17	91.5	18	83.0	19	91.5	20	82.0	21	92.0
22	82.1	23	0.	24	0.	25	84.2	26	75.7	27	91.2	28	89.5
29	0.	30	0.	31	91.5	32	91.5	33	91.5	34	91.9	35	91.9
36	92.0	37	92.3	38	92.3	39	92.1	40	91.0	41	91.0	42	91.1
43	90.4	44	85.3	45	89.5	46	83.5	47	71.6	48	73.8	49	0.

TIME 800 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	84.0	3	92.5	4	83.9	5	92.5	6	83.6	7	91.8
8	82.6	9	91.5	10	82.5	11	90.5	12	81.1	13	85.0	14	76.5
15	91.5	16	86.0	17	92.0	18	83.5	19	94.0	20	84.5	21	92.0
22	82.1	23	0.	24	0.	25	84.5	26	76.2	27	92.0	28	83.2
29	0.	30	0.	31	92.3	32	92.0	33	92.0	34	92.5	35	92.5
36	92.5	37	93.0	38	93.0	39	93.0	40	91.2	41	91.5	42	91.8
43	91.0	44	86.0	45	89.8	46	83.2	47	66.8	48	73.0	49	0.

TIME 900 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	82.9	3	92.0	4	83.1	5	93.5	6	84.6	7	91.0
8	81.8	9	91.5	10	82.6	11	91.0	12	81.5	13	85.0	14	75.7
15	92.0	16	83.7	17	93.0	18	84.0	19	92.0	20	82.5	21	92.5
22	82.8	23	0.	24	0.	25	85.0	26	76.3	27	92.8	28	83.7
29	0.	30	0.	31	93.0	32	93.0	33	93.0	34	93.5	35	93.7
36	93.7	37	93.2	38	93.2	39	93.0	40	92.0	41	92.0	42	91.8
43	91.8	44	86.5	45	90.0	46	84.0	47	76.2	48	73.2	49	0.

TIME 1000 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	82.8	3	91.5	4	82.5	5	93.0	6	83.8	7	90.5
8	81.1	9	91.0	10	81.6	11	90.0	12	80.2	13	85.0	14	71.5
15	93.0	16	83.6	17	93.8	18	83.8	19	92.0	20	82.0	21	92.0
22	81.9	23	0.	24	0.	25	85.5	26	76.9	27	92.5	28	83.0
29	74.0	30	64.4	31	93.0	32	92.8	33	92.8	34	94.0	35	94.1
36	94.1	37	93.1	38	93.0	39	92.9	40	91.8	41	91.7	42	91.6
43	91.4	44	86.0	45	90.0	46	83.7	47	72.6	48	72.9	49	0.

TIME 1100 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	83.5	3	92.5	4	83.5	5	93.5	6	84.3	7	90.8
8	81.6	9	91.5	10	82.4	11	90.0	12	80.1	13	85.0	14	75.5
15	93.0	16	83.4	17	93.5	18	83.6	19	92.0	20	82.5	21	92.0
22	82.4	23	0.	24	0.	25	84.5	26	76.0	27	92.2	28	83.5
29	71.1	30	57.7	31	92.5	32	92.5	33	92.5	34	93.8	35	93.8
36	94.0	37	92.8	38	92.8	39	92.7	40	91.4	41	91.4	42	91.3
43	91.2	44	86.0	45	89.8	46	83.5	47	70.2	48	73.0	49	0.

TIME 1200 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	82.8	3	91.2	4	82.8	5	93.0	6	84.2	7	90.5
8	81.7	9	91.0	10	82.6	11	90.0	12	81.5	13	85.0	14	76.0
15	92.4	16	83.5	17	92.5	18	84.3	19	91.5	20	82.6	21	92.0
22	82.5	23	0.	24	0.	25	84.6	26	76.0	27	91.4	28	83.4
29	73.0	30	61.8	31	91.9	32	91.9	33	92.0	34	93.0	35	93.1
36	93.2	37	92.2	38	92.1	39	92.1	40	91.0	41	91.1	42	91.1
43	91.1	44	85.9	45	90.0	46	83.0	47	71.0	48	73.2	49	0.

TIME 1300 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	82.1	3	91.0	4	82.6	5	93.0	6	84.5	7	90.5
8	81.7	9	91.0	10	82.6	11	90.0	12	81.5	13	85.0	14	76.5
15	92.0	16	83.7	17	93.0	18	84.1	19	91.0	20	82.2	21	91.5
22	82.5	23	0.	24	0.	25	84.8	26	76.0	27	91.2	28	83.8
29	71.4	30	58.8	31	91.5	32	91.6	33	91.7	34	92.8	35	92.8
36	93.0	37	90.0	38	92.0	39	91.8	40	91.0	41	90.9	42	90.0
43	90.5	44	85.5	45	89.8	46	83.2	47	71.0	48	73.6	49	0.

TIME 1400 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.3	3	90.2	4	81.2	5	92.0	6	82.9	7	89.9
8	80.5	9	90.0	10	80.4	11	89.6	12	80.0	13	85.3	14	75.5
15	92.0	16	82.5	17	92.5	18	81.9	19	91.3	20	81.0	21	91.5
22	79.4	23	0.	24	0.	25	84.2	26	75.5	27	90.0	28	82.0
29	70.0	30	90.5	31	90.1	32	90.3	33	90.4	34	92.2	35	92.3
36	92.5	37	92.2	38	92.2	39	92.0	40	90.0	41	90.0	42	90.0
43	89.5	44	85.0	45	85.1	46	83.0	47	71.7	48	73.9	49	0.

TIME 1500 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.1	3	90.0	4	81.1	5	92.0	6	83.2	7	89.5
8	80.2	9	90.0	10	80.0	11	90.0	12	79.7	13	85.0	14	75.5
15	93.0	16	81.5	17	94.0	18	81.9	19	93.0	20	80.9	21	94.0
22	81.5	23	0.	24	0.	25	84.4	26	75.4	27	90.0	28	81.0
29	71.5	30	90.5	31	90.5	32	90.5	33	90.2	34	93.8	35	94.0
36	94.1	37	94.5	38	94.2	39	93.8	40	90.0	41	90.0	42	90.0
43	89.0	44	89.7	45	89.0	46	82.8	47	71.9	48	74.2	49	0.

TIME 1600 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.4	3	90.0	4	81.2	5	92.0	6	83.5	7	90.0
8	80.7	9	91.0	10	81.0	11	91.0	12	80.6	13	85.0	14	75.4
15	95.0	16	82.5	17	95.5	18	83.3	19	94.5	20	81.7	21	95.0
22	82.0	23	0.	24	0.	25	85.0	26	76.2	27	90.5	28	81.5
29	71.0	30	90.2	31	91.2	32	91.0	33	90.9	34	94.8	35	94.9
36	95.0	37	95.2	38	95.0	39	94.5	40	90.5	41	90.8	42	90.8
43	90.0	44	85.0	45	90.0	46	83.0	47	71.7	48	74.7	49	0.

TIME 1700 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	91.0	3	90.5	4	81.3	5	92.0	6	83.0	7	90.0
8	80.5	9	91.0	10	81.1	11	90.5	12	80.3	13	85.0	14	75.6
15	93.5	16	82.4	17	94.0	18	83.0	19	93.0	20	81.4	21	93.0
22	81.7	23	0.	24	0.	25	84.1	26	75.2	27	90.4	28	81.4
29	69.0	30	90.5	31	91.0	32	90.8	33	90.5	34	93.3	35	93.3
36	93.4	37	93.5	38	93.5	39	93.0	40	90.2	41	90.1	42	90.1
43	89.7	44	84.8	45	85.0	46	82.8	47	70.0	48	75.0	49	0.

TIME 1800 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.5	3	90.0	4	81.3	5	92.0	6	83.2	7	90.0
8	80.7	9	90.0	10	80.4	11	90.0	12	80.1	13	85.0	14	75.5
15	92.5	16	82.5	17	93.0	18	82.7	19	92.0	20	81.1	21	92.5
22	82.0	23	0.	24	0.	25	85.0	26	76.3	27	90.0	28	81.5
29	71.0	30	90.5	31	90.8	32	90.6	33	90.9	34	92.7	35	92.7
36	92.7	37	92.7	38	92.6	39	92.5	40	90.0	41	90.0	42	90.0
43	89.7	44	84.8	45	85.9	46	82.9	47	71.7	48	75.1	49	0.

TIME 1900 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.6	3	90.0	4	81.3	5	92.0	6	83.3	7	90.0
8	80.0	9	90.0	10	80.8	11	90.0	12	80.5	13	85.0	14	75.9
15	92.3	16	82.7	17	92.0	18	82.5	19	91.5	20	82.0	21	92.0
22	82.4	23	0.	24	0.	25	84.0	26	75.6	27	90.0	28	81.5
29	69.0	30	90.9	31	90.4	32	90.3	33	90.2	34	91.8	35	91.8
36	92.0	37	91.9	38	91.8	39	91.5	40	89.8	41	89.8	42	89.8
43	89.3	44	84.5	45	88.4	46	82.6	47	70.2	48	75.5	49	0.

TIME 2000 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.6	3	90.0	4	81.6	5	92.0	6	83.3	7	89.5
8	80.0	9	90.0	10	81.0	11	90.0	12	80.3	13	85.0	14	75.7
15	91.5	16	82.6	17	92.0	18	82.8	19	91.0	20	81.6	21	91.0
22	0.	23	0.	24	0.	25	84.1	26	74..	27	90.0	28	81.8
29	72.5	30	91.9	31	90.4	32	90.2	33	90.2	34	91.8	35	91.8
36	92.1	37	91.9	38	91.9	39	91.7	40	90.0	41	90.0	42	90.0
43	89.5	44	84.9	45	88.5	46	83.0	47	70.0	48	76.4	49	0.

TIME 2100 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.7	3	90.0	4	81.0	5	93.2	6	83.2	7	89.5
8	80.7	9	90.0	10	81.3	11	90.0	12	80.7	13	85.0	14	76.3
15	86.5	16	78.4	17	92.0	18	83.0	19	91.0	20	81.9	21	91.0
22	81.9	23	0.	24	0.	25	84.0	26	75.0	27	90.0	28	82.3
29	75.5	30	87.0	31	90.0	32	90.0	33	90.0	34	91.8	35	91.8
36	92.0	37	91.5	38	91.5	39	91.4	40	89.0	41	89.6	42	89.7
43	89.5	44	84.9	45	89.0	46	83.2	47	75.5	48	76.5	49	0.

TIME 2200 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.4	3	90.0	4	81.3	5	92.0	6	83.0	7	89.0
8	80.0	9	90.0	10	80.7	11	89.0	12	79.4	13	84.5	14	75.6
15	91.0	16	82.2	17	92.0	18	82.5	19	91.0	20	81.4	21	91.0
22	81.4	23	0.	24	0.	25	84.0	26	76.0	27	90.0	28	82.2
29	74.1	30	87.0	31	90.4	32	90.3	33	90.4	34	91.9	35	91.8
36	92.2	37	92.0	38	91.8	39	91.5	40	90.0	41	89.5	42	89.5
43	89.2	44	84.9	45	88.5	46	83.0	47	73.1	48	76.8	49	0.

TIME 2300 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	79.0	3	86.0	4	78.6	5	88.0	6	80.0	7	85.0
8	77.7	9	85.0	10	77.8	11	85.0	12	77.2	13	75.5	14	72.6
15	89.0	16	80.2	17	89.0	18	80.3	19	88.5	20	79.5	21	88.0
22	79.2	23	0.	24	0.	25	76.0	26	72.0	27	86.7	28	80.4
29	71.2	30	81.0	31	86.5	32	87.0	33	87.0	34	88.5	35	88.7
36	89.4	37	88.9	38	88.8	39	88.5	40	85.2	41	85.0	42	85.3
43	85.1	44	82.0	45	83.5	46	80.8	47	72.2	48	77.0	49	0.

TIME 2400 DATE 5/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	78.6	3	86.5	4	80.0	5	88.2	6	81.0	7	85.4
8	78.0	9	85.7	10	75.4	11	85.7	12	78.7	13	77.0	14	73.9
15	88.5	16	81.0	17	88.2	18	80.7	19	88.4	20	80.7	21	88.0
22	80.6	23	0.	24	0.	25	76.8	26	73.5	27	87.1	28	81.1
29	0.	30	0.	31	87.0	32	87.0	33	87.4	34	88.4	35	88.7
36	89.0	37	88.6	38	88.6	39	88.4	40	85.3	41	85.5	42	85.8
43	85.8	44	87.5	45	84.3	46	80.9	47	71.8	48	76.6	49	0.

TIME 100 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	80.5	3	86.5	4	79.8	5	88.0	6	80.7	7	85.0
8	78.3	9	85.0	10	78.5	11	85.0	12	78.1	13	77.0	14	73.5
15	88.5	16	80.9	17	88.0	18	80.5	19	88.0	20	80.5	21	88.0
22	80.3	23	0.	24	0.	25	76.4	26	73..	27	87.3	28	81.2
29	0.	30	0.	31	87.0	32	87.0	33	87.3	34	88.2	35	88.6
36	89.0	37	88.4	38	88.4	39	88.2	40	85.0	41	85.1	42	85.5
43	85.5	44	82.5	45	83.5	46	80.5	47	72.1	48	76.5	49	0.

TIME 200 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	77.6	3	86.0	4	79.4	5	88.0	6	80.9	7	85.0
8	78.3	9	84.0	10	77.8	11	84.0	12	77.5	13	76.0	14	72.8
15	88.0	16	80.5	17	88.0	18	80.4	19	87.5	20	80.0	21	87.5
22	80.0	23	0.	24	0.	25	76.4	26	72.0	27	86.8	28	80.5
29	0.	30	0.	31	86.6	32	86.6	33	87.0	34	87.5	35	88.0
36	88.3	37	87.6	38	87.4	39	87.5	40	84.0	41	84.6	42	84.9
43	85.0	44	82.0	45	83.2	46	80.3	47	74.2	48	76.3	49	0.

TIME 300 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	80.0	3	86.0	4	79.7	5	88.0	6	81.2	7	84.0
8	77.6	9	84.0	10	77.8	11	84.0	12	77.6	13	76.5	14	73.4
15	88.0	16	81.0	17	88.0	18	80.8	19	87.0	20	80.0	21	87.0
22	80.0	23	0.	24	0.	25	76.0	26	73.0	27	86.9	28	80.8
29	0.	30	0.	31	86.6	32	86.7	33	87.0	34	87.5	35	88.0
36	88.0	37	87.5	38	87.5	39	87.5	40	84.2	41	84.6	42	85.0
43	85.0	44	82.0	45	83.0	46	80.0	47	72.2	48	76.2	49	0.

TIME 400 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	77.2	3	85.2	4	78.7	5	87.0	6	80.2	7	84.0
8	77.5	9	84.5	10	76.1	11	84.0	12	77.4	13	81.0	14	75.4
15	86.5	16	80.0	17	86.5	18	79.5	19	86.0	20	79.2	21	86.0
22	79.2	23	0.	24	0.	25	80.5	26	74.8	27	86.8	28	82.5
29	0.	30	0.	31	86.5	32	86.5	33	86.5	34	87.0	35	87.0
36	87.2	37	86.8	38	86.8	39	86.5	40	85.0	41	85.0	42	85.0
43	85.2	44	82.2	45	84.4	46	81.0	47	71.8	48	76.3	49	0.

TIME 500 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	79.8	3	86.0	4	79.5	5	88.0	6	81.9	7	84.8
8	78.6	9	84.0	10	77.4	11	84.5	12	78.2	13	77.2	14	78.2
15	87.7	16	80.8	17	87.0	18	80.7	19	87.0	20	80.0	21	87.0
22	80.1	23	0.	24	0.	25	76.9	26	76.2	27	86.8	28	84.5
29	0.	30	0.	31	86.7	32	86.7	33	87.0	34	87.5	35	87.8
36	88.2	37	87.3	38	87.3	39	87.3	40	84.0	41	84.8	42	85.0
43	85.1	44	82.0	45	83.7	46	80.5	47	71.5	48	76.3	49	0.

TIME 600 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.2	2	92.1	3	90.0	4	81.9	5	91.0	6	83.7	7	90.0
8	81.4	9	90.5	10	81.1	11	90.0	12	80.7	13	92.0	14	77.1
15	90.5	16	80.4	17	90.5	18	83.0	19	89.3	20	82.1	21	90.0
22	82.0	23	0.	24	0.	25	84.0	26	79.1	27	91.6	28	89.0
29	0.	30	0.	31	91.8	32	91.6	33	91.3	34	92.0	35	91.8
36	91.3	37	91.4	38	91.3	39	91.1	40	92.0	41	91.7	42	91.5
43	91.3	44	86.2	45	92.0	46	95.0	47	78.0	48	76.6	49	0.

TIME 700 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	92.0	3	92.0	4	82.4	5	94.0	6	85.1	7	92.5
8	91.9	9	93.0	10	87.0	11	92.0	12	80.7	13	92.5	14	77.5
15	92.0	16	84.3	17	94.0	18	84.2	19	92.0	20	82.8	21	92.5
22	82.4	23	0.	24	0.	25	91.0	26	79.0	27	93.2	28	91.0
29	0.	30	0.	31	94.0	32	93.8	33	93.4	34	94.4	35	94.0
36	94.0	37	94.0	38	93.8	39	93.6	40	94.0	41	93.5	42	93.5
43	93.0	44	87.4	45	93.0	46	85.5	47	74.0	48	76.2	49	0.

TIME 800 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	93.0	3	93.4	4	83.0	5	94.0	6	84.7	7	94.5
8	83.0	9	94.0	10	82.3	11	93.5	12	81.5	13	92.5	14	77.2
15	93.5	16	85.0	17	94.5	18	84.2	19	93.8	20	83.4	21	94.0
22	83.0	23	0.	24	0.	25	93.2	26	79.8	27	94.2	28	91.8
29	82.6	30	72.5	31	94.8	32	94.5	33	94.2	34	95.2	35	95.0
36	95.0	37	95.0	38	95.0	39	94.8	40	94.8	41	94.2	42	94.2
43	94.0	44	88.0	45	94.0	46	87.0	47	79.2	48	78.7	49	0.

TIME 900 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	93.0	3	94.0	4	73.0	5	95.0	6	85.0	7	94.0
8	82.0	9	94.0	10	82.2	11	94.0	12	81.7	13	92.5	14	77.6
15	94.0	16	85.0	17	95.0	18	84.3	19	94.5	20	83.6	21	94.4
22	83.0	23	0.	24	0.	25	93.4	26	79.4	27	95.0	28	83.0
29	85.0	30	76.2	31	95.5	32	95.5	33	95.0	34	96.2	35	96.0
36	96.0	37	96.0	38	96.0	39	95.8	40	95.8	41	95.2	42	95.2
43	94.8	44	88.4	45	94.6	46	86.4	47	79.0	48	78.3	49	0.

TIME 1000 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.3	3	94.2	4	83.4	5	95.8	6	85.4	7	94.3
8	82.3	9	94.0	10	82.1	11	94.0	12	81.6	13	92.0	14	77.5
15	94.5	16	85.2	17	96.0	18	84.7	19	95.0	20	80.0	21	95.5
22	83.6	23	0.	24	0.	25	92.2	26	79.4	27	95.0	28	93.4
29	85.0	30	77.9	31	95.8	32	95.7	33	95.2	34	96.8	35	96.2
36	96.2	37	96.5	38	96.4	39	96.2	40	95.9	41	95.4	42	95.3
43	95.0	44	90.0	45	94.9	46	86.6	47	87.8	48	76.0	49	0.

TIME 1100 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.2	3	94.0	4	82.9	5	94.0	6	82.9	7	94.0
8	81.5	9	93.5	10	82.6	11	94.0	12	82.7	13	92.0	14	77.8
15	95.2	16	85.4	17	97.0	18	88.2	19	96.0	20	84.9	21	96.0
22	85.5	23	0.	24	0.	25	92.2	26	79.4	27	95.0	28	93.2
29	84.1	30	74.8	31	95.9	32	95.5	33	95.0	34	99.0	35	98.8
36	98.8	37	98.2	38	98.2	39	98.2	40	95.2	41	94.8	42	95.0
43	96.8	44	88.8	45	94.8	46	86.4	47	77.2	48	75.5	49	0.

TIME 1200 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.0	3	94.0	4	83.0	5	94.5	6	84.5	7	94.0
8	82.2	9	93.8	10	82.0	11	94.0	12	81.7	13	92.0	14	77.2
15	94.0	16	85.2	17	94.0	18	83.6	19	95.0	20	83.7	21	94.6
22	82.9	23	0.	24	0.	25	93.3	26	80.0	27	95.0	28	93.2
29	85.0	30	76.0	31	95.7	32	95.5	33	95.2	34	95.8	35	95.7
36	95.7	37	95.8	38	96.0	39	96.0	40	95.0	41	95.0	42	95.0
43	94.5	44	88.2	45	94.0	46	86.0	47	77.3	48	75.5	49	0.

TIME 1300 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.5	3	94.2	4	83.5	5	94.2	6	84.0	7	94.0
8	82.6	9	94.0	10	82.4	11	93.8	12	81.8	13	92.0	14	77.5
15	94.0	16	85.4	17	94.5	18	84.0	19	94.5	20	84.0	21	94.0
22	82.8	23	0.	24	0.	25	91.2	26	79.0	27	94.8	28	84.2
29	75.8	30	67.8	31	95.5	32	95.4	33	95.1	34	95.7	35	95.5
36	95.5	37	95.5	38	95.5	39	95.5	40	95.0	41	94.7	42	94.7
43	94.4	44	88.2	45	94.0	46	86.0	47	77.2	48	75.4	49	0.

TIME 1400 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	91.3	3	94.0	4	83.3	5	94.0	6	84.2	7	94.0
8	82.4	9	93.5	10	82.0	11	93.5	12	81.6	13	92.0	14	77.5
15	94.0	16	95.2	17	94.0	18	83.7	19	94.0	20	83.5	21	94.0
22	83.3	23	0.	24	0.	25	93.8	26	79.8	27	95.6	28	84.2
29	74.8	30	95.2	31	95.2	32	95.1	33	95.0	34	95.5	35	95.5
36	95.5	37	93.5	38	92.8	39	91.9	40	93.9	41	94.0	42	94.0
43	94.0	44	87.8	45	92.5	46	85.6	47	76.7	48	75.5	49	0.

TIME 1500 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	93.2	3	93.7	4	82.9	5	94.0	6	84.5	7	93.5
8	81.9	9	93.0	10	81.5	11	93.0	12	81.4	13	92.0	14	77.5
15	93.5	16	94.7	17	95.0	18	83.7	19	93.0	20	83.7	21	92.5
22	82.5	23	0.	24	0.	25	92.0	26	78.8	27	94.1	28	84.0
29	73.4	30	92.0	31	94.8	32	99.8	33	94.4	34	95.0	35	95.0
36	95.0	37	94.6	38	94.5	39	94.4	40	94.4	41	94.3	42	94.2
43	93.9	44	87.5	45	94.0	46	85.8	47	75.0	48	75.3	49	0.

TIME 1600 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.1	3	90.0	4	81.0	5	91.5	6	81.4	7	89.5
8	80.3	9	88.5	10	79.1	11	90.0	12	81.0	13	85.0	14	76.6
15	94.0	16	97.5	17	95.0	18	86.6	19	94.0	20	84.0	21	95.0
22	85.4	23	0.	24	0.	25	84.2	26	76.3	27	90.0	28	82.0
29	70.3	30	88.9	31	90.4	32	94.5	33	90.4	34	95.5	35	95.8
36	96.2	37	95.0	38	95.0	39	95.0	40	89.0	41	89.0	42	89.1
43	89.2	44	85.0	45	88.5	46	83.5	47	74.0	48	75.8	49	0.

TIME 1700 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	80.9	3	89.5	4	81.2	5	90.5	6	81.6	7	88.5
8	79.6	9	88.0	10	79.0	11	90.0	12	81.6	13	85.0	14	75.6
15	89.0	16	92.9	17	95.0	18	86.8	19	88.8	20	80.4	21	95.0
22	85.2	23	0.	24	0.	25	84.5	26	76.2	27	90.0	28	82.0
29	74.0	30	88.0	31	90.0	32	90.0	33	90.0	34	95.1	35	95.8
36	96.0	37	94.5	38	95.0	39	95.0	40	88.8	41	88.5	42	89.0
43	89.0	44	84.9	45	88.0	46	83.4	47	7[illegible]	48	75.5	49	0.

TIME 1800 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	81.0	3	89.0	4	81.0	5	90.0	6	81.9	7	88.5
8	80.2	9	88.0	10	79.7	11	89.0	12	80.2	13	85.0	14	76.4
15	91.5	16	93.2	17	91.0	18	82.0	19	91.0	20	82.0	21	91.0
22	81.9	23	0.	24	0.	25	84.5	26	77.0	27	89.8	28	82.3
29	74.5	30	86.0	31	89.8	32	89.9	33	89.8	34	91.2	35	91.2
36	92.0	37	91.5	38	91.6	39	91.7	40	89.0	41	89.0	42	89.0
43	88.6	44	84.7	45	87.5	46	83.1	47	74.8	48	0.	49	0.

TIME 1900 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.3	3	88.5	4	80.6	5	89.5	6	81.7	7	88.0
8	80.0	9	88.0	10	79.7	11	88.0	12	79.5	13	85.0	14	75.6
15	90.0	16	92.5	17	90.0	18	81.7	19	90.0	20	82.0	21	89.5
22	81.2	23	0.	24	0.	25	83.5	26	75.5	27	89.2	28	82.0
29	74.0	30	85.5	31	89.2	32	89.3	33	89.1	34	90.4	35	90.4
36	90.4	37	90.9	38	90.9	39	90.9	40	88.5	41	88.5	42	88.6
43	88.5	44	84.5	45	87.5	46	83.0	47	75.0	48	74.9	49	0.

TIME 2000 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.0	3	88.5	4	80.2	5	90.0	6	81.6	7	87.0
8	78.6	9	88.0	10	79.3	11	88.0	12	79.1	13	85.0	14	75.3
15	90.0	16	92.4	17	89.5	18	80.9	19	90.0	20	81.9	21	89.0
22	80.4	23	0.	24	0.	25	84.5	26	76.0	27	89.5	28	81.4
29	73.1	30	84.1	31	89.2	32	89.2	33	89.0	34	90.0	35	90.2
36	90.5	37	90.5	38	90.5	39	90.5	40	88.3	41	88.2	42	88.5
43	88.2	44	84.2	45	87.4	46	83.0	47	74.6	48	74.6	49	0.

TIME 2100 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.2	3	89.0	4	80.6	5	90.0	6	81.7	7	88.0
8	79.5	9	88.0	10	79.4	11	88.0	12	79.0	13	85.0	14	75.5
15	90.0	16	92.5	17	89.5	18	80.7	19	90.0	20	81.6	21	88.0
22	79.9	23	0.	24	0.	25	85.0	26	77.0	27	89.5	28	81.5
29	72.0	30	67.0	31	89.5	32	89.5	33	89.3	34	90.5	35	90.5
36	90.0	37	90.4	38	90.8	39	90.8	40	88.6	41	88.6	42	88.5
43	88.5	44	84.5	45	87.5	46	83.1	47	74.0	48	74.5	49	0.

TIME 2200 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	80.3	3	89.0	4	80.3	5	90.0	6	81.7	7	88.5
8	79.6	9	88.0	10	79.3	11	88.5	12	79.4	13	84.6	14	75.6
15	90.0	16	92.5	17	89.5	18	80.7	19	90.0	20	81.3	21	90.0
22	81.0	23	0.	24	0.	25	84.5	26	76.0	27	89.5	28	87.5
29	79.9	30	71.3	31	89.5	32	89.5	33	89.4	34	90.5	35	90.7
36	90.8	37	90.9	38	90.9	39	90.9	40	88.5	41	88.5	42	88.7
43	88.5	44	84.5	45	87.8	46	83.0	47	75.5	48	74.5	49	0.

TIME 2300 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	78.8	3	86.5	4	78.0	5	88.0	6	79.5	7	85.0
8	77.5	9	84.0	10	76.8	11	85.0	12	77.0	13	77.0	14	73.0
15	89.0	16	91.1	17	88.0	18	79.5	19	89.0	20	80.5	21	88.0
22	79.0	23	0.	24	0.	25	76.6	26	73.1	27	86.8	28	86.0
29	78.8	30	71.0	31	86.5	32	86.7	33	86.6	34	88.5	35	89.0
36	89.1	37	89.2	38	89.2	39	89.1	40	85.0	41	85.2	42	85.5
43	85.4	44	[illegible]	45	83.0	46	80.8	47	73.5	48	74.5	49	0.

TIME 2400 DATE 5/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.5	2	78.2	3	85.0	4	78.3	5	88.2	6	81.2	7	84.0
8	77.2	9	83.5	10	77.4	11	84.0	12	77.3	13	76.0	14	73.4
15	88.0	16	91.8	17	86.5	18	78.9	19	87.8	20	80.0	21	86.5
22	78.8	23	0.	24	0.	25	75.8	26	72.5	27	85.8	28	85.0
29	0.	30	0.	31	85.1	32	85.6	33	85.6	34	87.2	35	87.5
36	88.0	37	88.0	38	88.0	39	87.8	40	83.6	41	83.7	42	84.1
43	84.2	44	81.5	45	81.6	46	80.1	47	70.8	48	74.8	49	0.

TIME 100 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.5	2	78.2	3	84.0	4	77.9	5	86.0	6	79.2	7	83.0
8	77.0	9	82.0	10	76.8	11	83.0	12	77.1	13	75.5	14	73.0
15	87.0	16	90.2	17	86.0	18	78.9	19	87.0	20	79.8	21	86.0
22	78.7	23	0.	24	0.	25	75.0	26	72.7	27	84.8	28	84.2
29	0.	30	0.	31	84.0	32	84.5	33	84.5	34	86.5	35	86.5
36	87.0	37	87.0	38	87.0	39	87.0	40	82.8	41	82.8	42	83.2
43	83.2	44	80.0	45	81.0	46	79.9	47	69.8	48	74.9	49	0.

TIME 200 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.8	3	84.5	4	79.0	5	86.0	6	79.6	7	84.0
8	77.8	9	84.0	10	77.8	11	84.0	12	77.5	13	81.0	14	74.3
15	86.5	16	80.5	17	86.0	18	79.2	19	86.5	20	79.5	21	86.0
22	79.0	23	0.	24	0.	25	80.5	26	75.5	27	86.9	28	86.5
29	0.	30	0.	31	85.4	32	85.5	33	85.5	34	87.0	35	87.0
36	87.1	37	87.1	38	87.1	39	87.0	40	84.9	41	84.7	42	84.8
43	84.8	44	81.8	45	83.2	46	81.1	47	71.0	48	73.7	49	0.

TIME 300 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.5	3	85.0	4	78.6	5	86.0	6	79.3	7	84.0
8	77.7	9	82.5	10	76.8	11	84.0	12	77.6	13	77.0	14	74.0
15	87.0	16	80.2	17	86.0	18	78.8	19	87.0	20	79.8	21	86.0
22	78.7	23	0.	24	0.	25	76.0	26	72.8	27	85.0	28	84.9
29	0.	30	0.	31	84.5	32	85.0	33	85.0	34	86.9	35	86.9
36	87.1	37	87.1	38	87.1	39	87.0	40	83.4	41	83.6	42	83.9
43	83.8	44	81.2	45	82.0	46	80.3	47	69.3	48	73.3	49	0.

TIME 400 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.5	3	84.5	4	78.3	5	86.0	6	79.3	7	83.5
8	77.1	9	83.0	10	77.2	11	84.0	12	77.7	13	77.0	14	73.3
15	87.0	16	80.1	17	86.0	18	78.9	19	87.0	20	79.0	21	86.0
22	78.6	23	0.	24	0.	25	75.4	26	72.0	27	85.0	28	84.8
29	0.	30	0.	31	84.2	32	84.8	33	84.8	34	86.5	35	86.7
36	87.1	37	87.1	38	87.1	39	87.0	40	83.2	41	83.6	42	83.9
43	83.9	44	81.2	45	81.8	46	80.1	47	73.1	48	72.7	49	0.

TIME 500 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.4	3	84.7	4	78.3	5	86.0	6	78.3	7	83.5
8	77.0	9	82.5	10	76.6	11	84.5	12	78.0	13	77.0	14	74.0
15	87.0	16	80.0	17	85.5	18	78.8	19	87.0	20	79.5	21	88.0
22	80.3	23	0.	24	0.	25	77.5	26	73.4	27	85.0	28	85.0
29	0.	30	0.	31	84.4	32	84.8	33	84.8	34	86.5	35	86.5
36	86.8	37	87.0	38	87.0	39	87.2	40	83.0	41	83.2	42	83.6
43	83.5	44	81.5	45	81.6	46	80.0	47	71.6	48	72.5	49	0.

TIME 600 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.4	3	84.8	4	78.3	5	86.0	6	79.1	7	84.0
8	76.9	9	83.0	10	77.0	11	84.0	12	77.3	13	77.0	14	73.4
15	87.0	16	79.8	17	86.0	18	78.5	19	87.0	20	79.5	21	86.0
22	78.3	23	0.	24	0.	25	76.2	26	72.8	27	85.2	28	85.0
29	0.	30	0.	31	84.8	32	85.0	33	85.0	34	87.0	35	87.0
36	87.2	37	87.2	38	87.5	39	87.2	40	83.7	41	83.7	42	84.0
43	84.0	44	81.2	45	82.1	46	80.4	47	72.0	48	72.5	49	0.

TIME 700 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.2	2	77.6	3	84.0	4	77.6	5	86.0	6	79.7	7	83.0
8	75.5	9	83.0	10	76.0	11	84.0	12	78.5	13	75.5	14	72.9
15	87.0	16	79.6	17	88.0	18	81.2	19	87.0	20	79.4	21	86.0
22	79.0	23	0.	24	0.	25	74.4	26	72.0	27	84.5	28	84.2
29	0.	30	0.	31	83.8	32	84.0	33	84.1	34	86.0	35	86.4
36	86.8	37	87.0	38	87.0	39	86.4	40	81.2	41	83.7	42	83.9
43	83.9	44	81.2	45	85.5	46	80.2	47	69.5	48	72.0	49	0.

TIME 800 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.4	2	79.5	3	90.8	4	80.1	5	90.3	6	81.0	7	91.3
8	80.0	9	91.5	10	79.6	11	91.0	12	79.6	13	92.5	14	76.9
15	90.5	16	82.5	17	91.0	18	80.9	19	91.0	20	81.2	21	91.0
22	80.5	23	0.	24	0.	25	93.9	26	79.3	27	92.2	28	80.9
29	86.1	30	79.8	31	93.0	32	92.2	33	92.1	34	93.0	35	92.8
36	92.8	37	93.0	38	92.8	39	92.9	40	92.8	41	92.5	42	92.4
43	92.2	44	86.6	45	92.9	46	85.2	47	77.8	48	72.0	49	0.

TIME 900 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.2	3	92.5	4	80.3	5	92.0	6	81.2	7	93.0
8	80.0	9	92.5	10	79.8	11	92.5	12	79.7	13	93.0	14	76.1
15	92.5	16	83.2	17	93.0	18	81.2	19	93.5	20	81.7	21	93.0
22	80.2	23	0.	24	0.	25	91.0	26	87.5	27	94.2	28	92.0
29	88.9	30	75.0	31	94.8	32	94.2	33	94.0	34	95.2	35	95.0
36	95.0	37	95.2	38	95.2	39	95.0	40	95.0	41	94.5	42	94.5
43	94.2	44	88.0	45	95.0	46	86.3	47	78.4	48	72.0	49	0.

TIME 1000 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.0	3	93.5	4	80.9	5	93.0	6	81.5	7	94.0
8	80.5	9	93.5	10	80.3	11	93.5	12	80.3	13	93.0	14	76.6
15	93.5	16	83.4	17	94.0	18	81.5	19	94.2	20	92.0	21	94.0
22	81.3	23	0.	24	0.	25	93.0	26	79.1	27	94.2	28	92.5
29	86.0	30	76.2	31	95.0	32	94.5	33	94.2	34	95.8	35	95.4
36	95.5	37	95.8	38	95.8	39	95.6	40	95.0	41	94.8	42	94.8
43	94.3	44	88.0	45	94.5	46	86.2	47	86.1	48	76.9	49	0.

TIME 1100 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	80.3	3	94.0	4	81.0	5	94.0	6	82.3	7	94.0
8	80.2	9	94.0	10	81.0	11	94.0	12	80.6	13	93.0	14	77.4
15	94.0	16	83.4	17	94.0	18	81.5	19	94.5	20	81.4	21	94.0
22	81.4	23	0.	24	0.	25	94.0	26	79.4	27	94.5	28	93.0
29	85.2	30	77.0	31	95.1	32	94.4	33	94.6	34	96.0	35	95.8
36	95.8	37	95.5	38	93.9	39	94.0	40	95.0	41	94.6	42	94.6
43	94.5	44	88.3	45	94.5	46	86.2	47	79.0	48	72.0	49	0.

TIME 1200 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	80.4	3	93.5	4	81.1	5	94.0	6	82.4	7	94.0
8	80.5	9	94.0	10	80.6	11	94.0	12	81.0	13	93.0	14	76.8
15	94.0	16	83.9	17	94.0	18	81.6	19	94.2	20	82.0	21	94.0
22	81.7	23	0.	24	0.	25	94.2	26	80.2	27	95.0	28	93.6
29	86.7	30	79.6	31	95.4	32	95.0	33	49.8	34	96.2	35	96.0
36	96.0	37	96.0	38	96.0	39	95.9	40	95.9	41	95.0	42	95.0
43	95.0	44	88.5	45	94.8	46	86.6	47	79.8	48	71.9	49	0.

TIME 1300 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	80.9	3	94.0	4	81.5	5	94.0	6	82.3	7	94.0
8	80.5	9	94.0	10	81.0	11	94.0	12	81.1	13	93.0	14	77.6
15	94.0	16	84.0	17	94.5	18	97.5	19	94.0	20	91.9	21	94.5
22	82.1	23	0.	24	0.	25	93.2	26	79.0	27	94.6	28	93.0
29	85.0	30	76.0	31	95.2	32	95.1	33	94.9	34	96.0	35	96.0
36	96.0	37	96.0	38	96.0	39	96.0	40	95.2	41	95.0	42	95.0
43	94.8	44	88.2	45	94.4	46	86.5	47	78.5	48	72.0	49	0.

TIME 1400 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.0	3	94.0	4	81.5	5	94.0	6	82.6	7	94.0
8	80.9	9	94.0	10	81.0	11	94.0	12	81.0	13	93.0	14	77.7
15	94.0	16	94.2	17	94.5	18	82.5	19	95.0	20	81.0	21	95.0
22	82.5	23	0.	24	0.	25	95.0	26	80.0	27	96.0	28	94.0
29	90.0	30	95.4	31	95.5	32	95.4	33	95.2	34	96.3	35	96.1
36	96.1	37	96.4	38	96.4	39	96.2	40	95.2	41	95.1	42	75.2
43	95.0	44	95.9	45	100.0	46	87.0	47	89.9	48	75.8	49	0.

TIME 1500 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.9	3	94.0	4	81.2	5	94.0	6	82.4	7	94.0
8	80.0	9	93.0	10	80.0	11	93.0	12	80.2	13	93.0	14	77.5
15	94.0	16	93.8	17	94.0	18	82.2	19	94.0	20	82.5	21	93.0
22	81.3	23	0.	24	0.	25	95.0	26	80.5	27	95.0	28	94.8
29	97.2	30	80.0	31	95.5	32	95.3	33	95.0	34	95.8	35	95.7
36	95.7	37	95.6	38	95.6	39	95.5	40	95.0	41	94.8	42	94.8
43	94.9	44	88.2	45	94.2	46	86.5	47	81.3	48	72.6	49	0.

TIME 1600 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	81.4	3	94.0	4	81.5	5	94.0	6	82.6	7	94.0
8	81.0	9	94.0	10	81.1	11	93.5	12	80.6	13	93.0	14	77.6
15	94.0	16	93.4	17	94.0	18	82.4	19	94.0	20	82.4	21	94.0
22	82.4	23	0.	24	0.	25	94.9	26	84.8	27	94.8	28	94.2
29	90.2	30	81.6	31	95.2	32	95.1	33	94.9	34	95.8	35	95.8
36	95.8	37	95.8	38	95.8	39	95.4	40	94.9	41	94.8	42	94.7
43	94.0	44	88.5	45	95.0	46	86.5	47	78.8	48	72.8	49	0.

TIME 1700 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.9	2	80.3	3	92.0	4	80.5	5	93.0	6	81.7	7	92.0
8	80.2	9	91.0	10	79.8	11	92.0	12	80.0	13	86.0	14	76.0
15	93.5	16	83.1	17	93.5	18	81.9	19	94.0	20	82.8	21	92.0
22	80.9	23	0.	24	0.	25	86.5	26	77.4	27	91.5	28	91.0
29	93.5	30	75.4	31	92.0	32	92.0	33	92.0	34	93.4	35	93.5
36	93.8	37	93.9	38	94.0	39	94.0	40	90.8	41	90.8	42	90.9
43	90.9	44	86.2	45	89.5	46	84.0	47	77.3	48	73.0	49	0.

TIME 1800 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	80.0	3	90.0	4	80.3	5	91.0	6	81.4	7	89.5
8	80.0	9	89.0	10	79.4	11	90.0	12	79.5	13	86.0	14	76.1
15	92.0	16	83.0	17	92.0	18	81.5	19	92.0	20	82.3	21	92.0
22	82.3	23	0.	24	0.	25	85.9	26	76.0	27	90.0	28	82.0
29	64.4	30	47.0	31	90.0	32	90.0	33	90.0	34	91.8	35	92.0
36	92.2	37	92.1	38	92.0	39	92.2	40	89.4	41	90.0	42	89.5
43	89.3	44	84.1	45	88.9	46	83.2	47	75.8	48	70.0	49	0.

TIME 1900 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	80.2	3	90.0	4	80.7	5	90.5	6	81.6	7	89.5
8	80.0	9	89.0	10	80.0	11	89.5	12	80.0	13	86.5	14	75.8
15	91.5	16	82.6	17	91.0	18	81.5	19	91.4	20	82.3	21	91.0
22	81.2	23	0.	24	0.	25	85.4	26	76.5	27	90.0	28	88.8
29	77.1	30	64.8	31	90.0	32	90.0	33	90.0	34	91.5	35	91.5
36	92.0	37	91.5	38	91.7	39	91.8	40	89.5	41	89.5	42	89.5
43	89.3	44	85.0	45	88.8	46	83.5	47	71.8	48	73.0	49	0.

TIME 2000 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	79.6	3	84.0	4	80.2	5	90.0	6	81.3	7	88.5
8	79.4	9	88.5	10	79.9	11	89.0	12	80.4	13	88.5	14	78.1
15	91.0	16	82.3	17	91.0	18	81.6	19	91.0	20	82.0	21	90.5
22	81.5	23	0.	24	0.	25	84.4	26	75.9	27	89.5	28	88.4
29	72.7	30	86.0	31	89.2	32	89.3	33	89.0	34	90.8	35	91.0
36	91.3	37	90.5	38	90.9	39	90.9	40	88.5	41	88.5	42	88.5
43	88.4	44	84.2	45	87.5	46	83.0	47	67.7	48	73.2	49	0.

TIME 2100 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	80.0	2	79.9	3	85.0	4	80.0	5	90.0	6	81.0	7	88.5
8	79.4	9	88.0	10	78.6	11	88.5	12	78.9	13	85.5	14	75.6
15	90.5	16	81.0	17	90.0	18	80.5	19	90.5	20	81.3	21	90.0
22	81.3	23	0.	24	0.	25	84.3	26	76.0	27	89.2	28	80.4
29	66.0	30	0.0	31	89.0	32	89.0	33	89.0	34	90.4	35	90.5
36	90.7	37	90.3	38	90.5	39	90.5	40	88.2	41	88.2	42	88.2
43	88.0	44	84.0	45	87.5	46	82.8	47	66.9	48	73.3	49	0.

TIME 2200 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.8	2	79.4	3	84.5	4	79.9	5	90.0	6	81.0	7	88.5
8	79.2	9	88.0	10	78.6	11	89.0	12	79.1	13	85.4	14	75.4
15	90.4	16	82.0	17	90.0	18	80.6	19	90.0	20	81.0	21	90.0
22	80.6	23	0.	24	0.	25	84.0	26	75.8	27	89.0	28	80.0
29	65.4	30	90.0	31	89.2	32	89.0	33	89.0	34	90.5	35	90.5
36	90.7	37	90.5	38	90.5	39	90.5	40	88.5	41	88.5	42	88.5
43	88.1	44	84.0	45	88.0	46	83.0	47	68.0	48	73.6	49	0.

TIME 2300 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.6	3	85.0	4	80.0	5	90.0	6	81.0	7	88.8
8	79.7	9	88.0	10	78.8	11	88.5	12	79.1	13	85.0	14	75.6
15	81.5	16	82.9	17	90.0	18	80.7	19	81.5	20	82.4	21	90.0
22	80.8	23	0.	24	0.	25	84.0	26	76.4	27	89.3	28	80.3
29	63.0	30	43.5	31	89.2	32	89.2	33	89.0	34	90.3	35	90.5
36	90.8	37	90.7	38	90.7	39	90.7	40	88.3	41	88.4	42	88.3
43	88.2	44	84.0	45	87.3	46	82.9	47	65.0	48	73.3	49	0.

TIME 2400 DATE 5/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.4	3	89.0	4	79.8	5	90.0	6	80.8	7	88.5
8	79.2	9	88.0	10	78.7	11	89.0	12	79.0	13	85.0	14	75.7
15	90.5	16	82.0	17	90.0	18	80.7	19	90.5	20	81.1	21	90.0
22	80.7	23	0.	24	0.	25	84.8	26	77.0	27	90.0	28	81.1
29	0.	30	0.	31	90.0	32	90.0	33	89.7	34	91.2	35	91.2
36	91.8	37	91.7	38	91.6	39	91.5	40	89.3	41	89.1	42	89.2
43	89.0	44	85.2	45	88.4	46	83.8	47	77.0	48	74.2	49	0.

TIME 100 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.5	3	84.0	4	79.6	5	90.0	6	80.7	7	88.5
8	79.1	9	88.0	10	78.7	11	88.5	12	78.8	13	85.0	14	76.0
15	90.5	16	82.0	17	90.0	18	80.5	19	91.0	20	81.3	21	90.5
22	80.8	23	0.	24	0.	25	84.6	26	76.7	27	90.0	28	81.0
29	0.	30	0.	31	90.0	32	90.0	33	89.8	34	91.2	35	91.0
36	91.7	37	91.7	38	91.8	39	91.5	40	89.4	41	89.0	42	89.2
43	89.0	44	85.0	45	88.2	46	83.7	47	77.0	48	74.0	49	0.

TIME 200 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.3	3	90.0	4	80.3	5	90.0	6	82.3	7	89.0
8	81.2	9	89.0	10	81.1	11	88.0	12	79.7	13	85.4	14	84.4
15	90.9	16	83.4	17	91.0	18	81.5	19	90.0	20	81.5	21	90.0
22	81.2	23	0.	24	0.	25	78.4	26	74.4	27	91.2	28	83.9
29	0.	30	0.	31	91.0	32	91.2	33	91.5	34	91.6	35	91.6
36	92.0	37	91.5	38	91.5	39	91.0	40	89.4	41	89.8	42	89.5
43	89.5	44	85.5	45	88.0	46	83.2	47	76.5	48	73.8	49	0.

TIME 300 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.4	3	90.0	4	82.3	5	91.0	6	83.0	7	88.8
8	81.2	9	89.0	10	80.3	11	87.5	12	80.0	13	79.0	14	75.4
15	91.4	16	83.3	17	90.0	18	81.9	19	90.0	20	81.9	21	90.0
22	81.5	23	0.	24	0.	25	78.2	26	75.0	27	91.4	28	83.8
29	0.	30	0.	31	91.0	32	91.3	33	91.8	34	91.5	35	91.6
36	92.0	37	91.1	38	91.0	39	90.8	40	89.8	41	89.5	42	89.4
43	89.3	44	85.3	45	87.9	46	83.2	47	77.0	48	73.4	49	0.

TIME 400 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.5	3	90.0	4	82.2	5	90.5	6	82.4	7	88.4
8	80.7	9	80.0	10	81.0	11	86.5	12	78.9	13	78.2	14	74.8
15	90.6	16	83.1	17	90.0	18	82.0	19	89.8	20	81.7	21	89.0
22	80.9	23	0.	24	0.	25	77.3	26	74.2	27	90.9	28	83.2
29	0.	30	0.	31	90.4	32	91.0	33	91.4	34	91.0	35	91.0
36	91.6	37	90.8	38	90.7	39	90.2	40	89.2	41	89.0	42	89.0
43	89.0	44	85.0	45	87.5	46	83.1	47	75.9	48	73.1	49	0.

TIME 500 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	82.3	3	89.0	4	82.1	5	90.0	6	81.7	7	88.0
8	80.5	9	86.5	10	79.1	11	86.0	12	78.5	13	87.5	14	83.0
15	90.2	16	82.5	17	89.5	18	81.3	19	89.0	20	81.1	21	89.5
22	80.2	23	0.	24	0.	25	77.0	26	73.8	27	90.4	28	83.0
29	0.	30	0.	31	90.0	32	90.8	33	91.0	34	90.8	35	90.8
36	91.1	37	90.2	38	90.2	39	90.0	40	88.7	41	88.5	42	88.4
43	88.4	44	85.0	45	86.9	46	83.0	47	75.3	48	73.0	49	0.

TIME 600 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.2	2	81.8	3	89.2	4	81.5	5	90.0	6	81.9	7	87.5
8	80.0	9	87.5	10	80.3	11	86.0	12	78.8	13	77.2	14	73.5
15	90.0	16	82.3	17	89.5	18	81.5	19	88.8	20	80.9	21	88.0
22	80.0	23	0.	24	0.	25	76.4	26	73.0	27	90.0	28	83.0
29	0.	30	0.	31	89.4	32	90.4	33	90.8	34	91.5	35	90.5
36	91.0	37	90.5	38	90.0	39	89.5	40	88.3	41	88.1	42	88.1
43	88.0	44	84.6	45	86.5	46	82.8	47	76.0	48	72.9	49	0.

TIME 700 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	82.0	3	89.0	4	81.7	5	90.0	6	82.1	7	87.0
8	79.5	9	86.5	10	79.5	11	86.0	12	78.4	13	77.0	14	73.3
15	89.5	16	82.3	17	89.0	18	81.2	19	88.5	20	80.7	21	88.0
22	80.0	23	0.	24	0.	25	76.6	26	73.2	27	90.0	28	83.0
29	0.	30	0.	31	89.4	32	90.2	33	90.6	34	90.2	35	90.2
36	90.6	37	89.6	38	89.6	39	89.3	40	88.0	41	88.0	42	88.0
43	88.0	44	84.5	45	86.5	46	82.7	47	76.0	48	72.5	49	0.

TIME 800 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	82.1	3	89.0	4	81.7	5	89.5	6	82.0	7	87.0
8	79.9	9	86.0	10	79.9	11	85.5	12	78.5	13	77.0	14	73.3
15	89.5	16	82.1	17	88.0	18	80.4	19	88.0	20	80.5	21	87.5
22	79.9	23	0.	24	0.	25	76.5	26	73.8	27	89.8	28	83.0
29	79.9	30	73.5	31	89.9	32	90.2	33	90.6	34	90.0	35	90.1
36	90.4	37	89.4	38	89.4	39	89.0	40	87.8	41	87.8	42	87.8
43	87.8	44	84.2	45	86.1	46	82.5	47	77.6	48	72.0	49	0.

TIME 900 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	82.0	3	89.0	4	81.7	5	90.0	6	81.9	7	87.0
8	79.9	9	86.0	10	79.5	11	85.5	12	78.7	13	77.0	14	73.9
15	89.5	16	82.1	17	88.5	18	81.2	19	88.5	20	80.6	21	88.0
22	80.4	23	0.	24	0.	25	76.0	26	73.0	27	89.9	28	83.0
29	78.0	30	77.2	31	88.9	32	90.4	33	90.9	34	90.1	35	90.1
36	90.3	37	89.4	38	89.4	39	89.2	40	87.5	41	87.6	42	87.6
43	87.8	44	84.3	45	86.0	46	82.5	47	78.2	48	72.0	49	0.

TIME 1000 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	81.8	3	89.0	4	81.9	5	89.0	6	81.5	7	86.0
8	79.2	9	86.0	10	78.5	11	85.0	12	77.2	13	77.0	14	73.0
15	89.5	16	82.7	17	89.0	18	81.4	19	88.0	20	82.4	21	88.0
22	80.3	23	0.	24	0.	25	78.0	26	73.0	27	89.9	28	83.0
29	76.0	30	67.8	31	89.5	32	90.0	33	90.2	34	90.3	35	90.0
36	90.4	37	89.9	38	89.7	39	89.4	40	87.2	41	87.3	42	87.6
43	87.0	44	84.0	45	86.0	46	83.2	47	75.0	48	72.0	49	0.

TIME 1100 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	81.4	3	88.5	4	81.4	5	89.0	6	81.5	7	86.0
8	79.0	9	86.0	10	79.5	11	84.5	12	78.0	13	76.0	14	73.2
15	88.2	16	81.5	17	87.5	18	80.3	19	87.5	20	80.5	21	87.5
22	79.5	23	0.	24	0.	25	75.5	26	72.8	27	87.6	28	82.6
29	74.0	30	65.0	31	88.8	32	89.6	33	90.0	34	88.5	35	88.6
36	89.0	37	88.0	38	88.3	39	88.0	40	86.8	41	89.0	42	87.0
43	87.3	44	84.4	45	85.5	46	82.2	47	75.0	48	72.0	49	0.

TIME 1200 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	81.5	3	88.0	4	81.5	5	88.0	6	80.8	7	86.0
8	79.4	9	85.5	10	79.4	11	84.0	12	77.6	13	76.0	14	72.3
15	88.5	16	81.8	17	88.0	18	81.3	19	87.0	20	84.0	21	86.0
22	79.1	23	0.	24	0.	25	75.8	26	73.0	27	89.2	28	88.0
29	74.0	30	64.5	31	88.5	32	89.4	33	90.0	34	88.8	35	89.1
36	89.5	37	88.4	38	88.3	39	88.3	40	87.0	41	86.9	42	86.8
43	87.0	44	83.8	45	85.2	46	82.0	47	74.5	48	71.8	49	0.

TIME 1300 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	0.	3	0.	4	0.	5	0.	6	0.	7	0.
8	0.	9	0.	10	0.	11	0.	12	0.	13	0.	14	0.
15	0.	16	0.	17	0.	18	0.	19	0.	20	0.	21	0.
22	0.	23	0.	24	0.	25	0.	26	0.	27	0.	28	0.
29	0.	30	0.	31	0.	32	0.	33	0.	34	0.	35	0.
36	0.	37	0.	38	0.	39	0.	40	0.	41	0.	42	0.
43	0.	44	0.	45	0.	46	0.	47	0.	48	0.	49	0.

TIME 1400 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	79.3	3	86.0	4	79.4	5	86.0	6	79.5	7	83.0
8	76.6	9	81.0	10	79.4	11	82.0	12	76.1	13	76.0	14	73.2
15	89.0	16	86.5	17	89.0	18	86.0	19	87.0	20	84.2	21	88.0
22	80.0	23	0.	24	C.	25	83.0	26	73.5	27	86.0	28	80.4
29	72.0	30	62.2	31	89.4	32	87.0	33	87.2	34	90.0	35	90.0
36	90.6	37	88.0	38	88.1	39	88.3	40	81.9	41	82.0	42	82.8
43	83.7	44	81.5	45	80.5	46	80.3	47	71.3	48	72.0	49	0.

TIME 1500 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	78.6	3	86.0	4	79.5	5	85.0	6	78.0	7	83.0
8	76.6	9	80.0	10	94.5	11	82.0	12	76.1	13	76.0	14	73.2
15	88.0	16	85.9	17	89.0	18	86.2	19	86.0	20	83.5	21	88.5
22	85.8	23	0.	24	C.	25	75.8	26	73.2	27	86.2	28	80.2
29	77.2	30	69.9	31	85.2	32	86.8	33	87.0	34	89.1	35	89.8
36	90.2	37	88.1	38	83.6	39	81.2	40	79.0	41	76.4	42	74.5
43	74.2	44	73.5	45	73.2	46	73.0	47	72.0	48	71.5	49	0.

TIME 1800 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	80.9	3	91.0	4	81.2	5	91.0	6	81.4	7	90.5
8	80.8	9	90.0	10	75.9	11	90.0	12	80.0	13	91.0	14	77.0
15	89.5	16	83.6	17	90.0	18	82.5	19	89.0	20	83.0	21	89.0
22	82.0	23	0.	24	C.	25	91.7	26	79.0	27	92.0	28	82.0
29	74.3	30	66.0	31	92.3	32	92.1	33	91.5	34	91.0	35	90.9
36	91.2	37	90.0	38	90.0	39	90.0	40	91.4	41	90.8	42	90.8
43	91.5	44	86.5	45	91.2	46	85.0	47	77.0	48	72.0	49	0.

TIME 1900 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.9	3	92.0	4	81.0	5	92.0	6	82.8	7	91.5
8	80.7	9	91.0	10	80.0	11	91.0	12	79.9	13	92.0	14	76.9
15	91.0	16	83.2	17	91.0	18	82.0	19	91.0	20	81.4	21	91.0
22	81.8	23	C.	24	C.	25	92.9	26	79.0	27	93.0	28	81.9
29	75.9	30	69.0	31	93.5	32	93.0	33	92.7	34	92.2	35	92.0
36	92.3	37	92.0	38	92.0	39	92.0	40	92.4	41	92.0	42	92.0
43	92.5	44	87.0	45	92.5	46	85.5	47	79.0	48	71.5	49	0.

TIME 2000 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	80.6	3	93.0	4	81.0	5	93.0	6	83.5	7	92.0
8	80.5	9	92.0	10	80.5	11	92.0	12	80.5	13	92.0	14	76.8
15	91.5	16	83.0	17	92.0	18	82.6	19	92.0	20	82.2	21	92.0
22	81.6	23	0.	24	0.	25	92.0	26	79.2	27	94.0	28	82.3
29	77.0	30	61.0	31	94.8	32	94.1	33	93.6	34	93.3	35	93.0
36	93.1	37	93.2	38	93.4	39	93.3	40	93.4	41	93.0	42	93.0
43	93.5	44	88.0	45	93.0	46	85.9	47	80.0	48	71.5	49	0.

TIME 2100 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.7	3	93.5	4	81.3	5	93.5	6	83.0	7	93.0
8	80.9	9	92.5	10	80.5	11	93.0	12	80.9	13	92.0	14	77.2
15	92.5	16	83.5	17	92.5	18	82.0	19	93.0	20	82.6	21	93.0
22	82.1	23	C.	24	C.	25	92.1	26	79.5	27	94.3	28	82.3
29	78.0	30	60.5	31	95.0	32	94.6	33	94.2	34	92.6	35	93.9
36	99.0	37	99.3	38	99.5	39	94.5	40	94.0	41	93.8	42	92.0
43	91.5	44	90.0	45	93.7	46	85.5	47	72.0	48	71.7	49	0.

TIME 2200 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.4	2	81.0	3	93.7	4	81.5	5	94.0	6	83.5	7	93.0
8	80.6	9	93.0	10	80.6	11	93.0	12	80.5	13	93.0	14	77.6
15	92.8	16	83.5	17	93.0	18	82.4	19	93.5	20	82.5	21	93.5
22	82.1	23	0.	24	0.	25	93.5	26	80.0	27	95.0	28	82.5
29	75.5	30	67.8	31	95.5	32	95.0	33	94.5	34	94.8	35	94.4
36	94.8	37	94.9	38	94.9	39	94.9	40	94.9	41	94.3	42	94.1
43	94.3	44	88.1	45	94.1	46	86.5	47	79.5	48	71.9	49	0.

TIME 2300 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	80.7	3	94.0	4	81.2	5	94.0	6	83.0	7	93.5
8	80.9	9	93.0	10	80.6	11	93.8	12	81.3	13	92.5	14	77.2
15	93.0	16	83.2	17	94.0	18	82.8	19	94.0	20	82.6	21	94.0
22	82.2	23	0.	24	0.	25	93.5	26	80.0	27	95.0	28	82.6
29	74.3	30	65.0	31	95.5	32	95.3	33	94.8	34	95.0	35	94.8
36	95.0	37	95.0	38	95.0	39	95.0	40	95.0	41	94.3	42	94.3
43	94.3	44	89.0	45	94.0	46	86.6	47	77.5	48	72.0	49	0.

TIME 2400 DATE 5/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.2	3	94.0	4	81.5	5	94.0	6	82.7	7	93.6
8	80.8	9	93.5	10	80.8	11	93.5	12	80.8	13	92.0	14	77.2
15	93.5	16	83.4	17	94.0	18	82.5	19	94.0	20	82.5	21	94.0
22	82.0	23	0.	24	0.	25	93.0	26	80.0	27	94.8	28	82.6
29	0.	30	C.	31	95.5	32	95.0	33	94.6	34	95.2	35	94.9
36	95.1	37	95.0	38	95.0	39	95.0	40	95.0	41	94.2	42	94.2
43	94.2	44	88.5	45	93.9	46	86.6	47	78.0	48	72.0	49	0.

TIME 100 DATE 5/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.3	2	81.0	3	93.5	4	81.4	5	93.5	6	82.8	7	93.5
8	80.8	9	93.5	10	80.7	11	93.5	12	80.7	13	92.0	14	76.8
15	93.8	16	83.4	17	94.0	18	82.4	19	94.0	20	82.5	21	94.0
22	81.9	23	C.	24	0.	25	93.2	26	80.0	27	94.6	28	82.6
29	0.	30	0.	31	95.1	32	95.0	33	94.6	34	95.5	35	95.0
36	95.5	37	95.2	38	95.3	39	95.5	40	95.0	41	94.5	42	94.5
43	94.2	44	88.7	45	94.0	46	86.8	47	79.8	48	71.8	49	0.

TIME 200 DATE 5/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-C.	31	-C.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 1700 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	96.5	2	84.2	3	96.0	4	84.7	5	96.0	6	85.0	7	95.0
8	82.8	9	94.0	10	81.8	11	93.5	12	81.1	13	90.0	14	78.4
15	96.5	16	86.5	17	97.0	18	85.0	19	96.0	20	83.4	21	97.0
22	83.1	23	C.	24	0.	25	92.0	26	80.3	27	86.5	28	76.1
29	64.5	30	51.8	31	96.5	32	96.9	33	96.7	34	97.5	35	98.0
36	98.0	37	98.0	38	97.5	39	97.4	40	94.5	41	94.5	42	95.6
43	95.4	44	89.8	45	93.0	46	86.0	47	73.3	48	71.9	49	0.

TIME 1800 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	96.0	2	84.3	3	95.5	4	84.5	5	96.0	6	85.0	7	94.0
8	82.2	9	94.0	10	81.5	11	93.0	12	80.7	13	90.0	14	77.5
15	96.0	16	85.9	17	97.0	18	85.4	19	95.5	20	83.3	21	97.0
22	83.9	23	0.	24	C.	25	89.0	26	78.0	27	86.5	28	76.5
29	66.5	30	55.2	31	95.5	32	96.0	33	96.0	34	96.2	35	97.2
36	97.3	37	97.1	38	96.8	39	96.5	40	93.4	41	93.9	42	95.0
43	94.6	44	89.0	45	92.0	46	85.7	47	75.7	48	72.2	49	0.

TIME 1900 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	83.4	3	94.5	4	84.1	5	94.8	6	84.2	7	95.0
8	83.9	9	92.0	10	80.7	11	92.0	12	80.3	13	87.0	14	76.7
15	95.0	16	84.9	17	96.0	18	85.8	19	94.0	20	82.4	21	95.7
22	83.2	23	0.	24	C.	25	87.4	26	78.8	27	86.5	28	76.5
29	65.0	30	51.8	31	94.0	32	95.0	33	95.0	34	94.9	35	96.0
36	96.0	37	95.5	38	95.5	39	95.3	40	91.8	41	92.3	42	93.7
43	93.1	44	88.0	45	90.4	46	84.9	47	72.4	48	72.5	49	0.

TIME 2000 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	83.6	3	93.5	4	83.3	5	96.5	6	86.6	7	91.0
8	81.3	9	95.0	10	84.1	11	95.0	12	83.8	13	84.5	14	76.4
15	93.8	16	84.5	17	94.5	18	84.8	19	93.0	20	82.7	21	93.8
22	82.4	23	0.	24	C.	25	84.5	26	77.0	27	0.	28	0.
29	0.	30	C.	31	92.5	32	94.0	33	94.0	34	92.8	35	94.5
36	95.0	37	93.8	38	94.0	39	93.8	40	90.0	41	90.3	42	92.1
43	91.8	44	71.9	45	0.	46	0.	47	0.	48	0.	49	0.

TIME 2100 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	81.4	3	92.5	4	81.6	5	92.0	6	83.0	7	89.8
8	80.5	9	88.0	10	78.5	11	88.0	12	78.3	13	82.5	14	75.4
15	92.0	16	81.6	17	93.0	18	83.8	19	91.0	20	81.7	21	91.0
22	80.7	23	0.	24	C.	25	83.0	26	76.0	27	0.	28	0.
29	0.	30	0.	31	91.2	32	93.3	33	93.8	34	91.0	35	93.0
36	93.5	37	91.0	38	91.5	39	91.5	40	88.0	41	88.6	42	90.5
43	90.5	44	86.5	45	86.6	46	83.0	47	74.3	48	73.0	49	0.

TIME 2200 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.0	3	91.0	4	81.1	5	91.0	6	82.6	7	88.0
8	79.5	9	87.0	10	78.0	11	86.0	12	77.3	13	80.0	14	74.2
15	90.5	16	82.4	17	91.0	18	82.6	19	89.0	20	80.8	21	89.0
22	80.0	23	0.	24	C.	25	80.0	26	76.6	27	90.5	28	82.0
29	0.	30	C.	31	89.3	32	91.8	33	92.3	34	88.8	35	91.0
36	91.7	37	89.3	38	90.0	39	90.0	40	86.1	41	86.8	42	88.8
43	88.5	44	85.5	45	85.3	46	82.5	47	75.0	48	73.0	49	0.

TIME 2300 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	80.8	3	90.5	4	81.4	5	90.0	6	82.0	7	87.0
8	79.5	9	85.5	10	77.6	11	85.0	12	77.1	13	80.0	14	73.9
15	90.0	16	82.5	17	90.0	18	82.0	19	88.0	20	80.5	21	88.5
22	80.2	23	0.	24	C.	25	80.1	26	75.0	27	90.0	28	82.4
29	0.	30	C.	31	88.5	32	90.7	33	91.2	34	88.0	35	90.3
36	91.2	37	88.3	38	85.0	39	89.0	40	85.4	41	86.0	42	87.9
43	88.0	44	84.9	45	84.6	46	82.0	47	75.8	48	73.0	49	0.

TIME 2400 DATE 5/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	80.2	3	89.2	4	80.7	5	88.5	6	81.0	7	86.0
8	78.5	9	84.0	10	76.8	11	84.0	12	76.8	13	77.8	14	73.0
15	88.8	16	81.8	17	89.0	18	81.4	19	87.1	20	79.9	21	87.0
22	79.2	23	0.	24	0.	25	78.0	26	73.9	27	88.6	28	81.5
29	0.	30	0.	31	87.1	32	89.7	33	90.0	34	86.8	35	89.3
36	90.0	37	87.2	38	87.9	39	88.0	40	84.1	41	84.8	42	86.9
43	84.9	44	84.0	45	83.5	46	81.3	47	73.0	48	73.0	49	0.

TIME 100 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.4	2	79.9	3	88.7	4	80.5	5	88.0	6	80.9	7	85.4
8	78.3	9	83.5	10	76.7	11	83.5	12	76.7	13	77.0	14	73.3
15	88.0	16	81.4	17	88.0	18	80.8	19	86.6	20	79.8	21	86.0
22	78.8	23	0.	24	0.	25	69.5	26	73.0	27	88.0	28	81.3
29	0.	30	0.	31	86.6	32	89.1	33	89.8	34	86.0	35	88.8
36	89.6	37	86.8	38	87.2	39	87.2	40	83.6	41	84.1	42	86.4
43	86.4	44	83.8	45	82.8	46	81.2	47	78.5	48	71.9	49	0.

TIME 200 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	79.5	3	88.2	4	80.3	5	88.0	6	80.9	7	85.0
8	78.0	9	83.0	10	76.6	11	83.0	12	76.5	13	76.8	14	73.2
15	87.8	16	81.2	17	88.0	18	81.1	19	86.0	20	79.5	21	86.0
22	79.0	23	0.	24	C.	25	77.0	26	73.2	27	87.8	28	81.0
29	0.	30	C.	31	86.3	32	88.8	33	89.0	34	85.9	35	88.0
36	89.0	37	86.0	38	86.8	39	86.8	40	83.5	41	83.7	42	85.8
43	85.5	44	83.2	45	82.2	46	81.0	47	73.3	48	73.0	49	0.

TIME 300 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.2	2	79.8	3	88.0	4	80.5	5	87.5	6	80.6	7	85.0
8	78.1	9	83.0	10	76.6	11	82.5	12	76.2	13	76.8	14	73.0
15	87.5	16	81.1	17	87.5	18	80.7	19	85.8	20	79.5	21	85.5
22	78.8	23	0.	24	0.	25	77.0	26	73.1	27	87.7	28	81.0
29	0.	30	C.	31	86.2	32	88.5	33	88.9	34	85.5	35	87.9
36	88.6	37	85.9	38	86.5	39	86.7	40	83.2	41	83.7	42	85.8
43	85.9	44	83.5	45	82.3	46	80.9	47	73.5	48	72.5	49	0.

TIME 400 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	79.5	3	88.0	4	80.4	5	88.0	6	80.9	7	85.0
8	78.1	9	82.5	10	76.1	11	82.5	12	76.1	13	76.8	14	73.7
15	87.5	16	81.1	17	87.5	18	80.9	19	85.8	20	79.5	21	86.0
22	79.4	23	0.	24	0.	25	77.0	26	73.5	27	87.8	28	80.9
29	0.	30	C.	31	86.3	32	88.6	33	88.9	34	85.5	35	87.9
36	88.7	37	86.0	38	86.6	39	86.7	40	83.1	41	83.7	42	85.8
43	85.8	44	83.3	45	82.3	46	80.9	47	72.8	48	72.2	49	0.

TIME 500 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.2	2	79.4	3	88.5	4	80.3	5	88.0	6	80.8	7	85.0
8	78.1	9	82.5	10	76.5	11	82.0	12	75.8	13	76.4	14	73.1
15	87.4	16	81.0	17	87.0	18	80.6	19	85.5	20	79.2	21	85.5
22	78.7	23	0.	24	0.	25	76.5	26	72.9	27	87.8	28	80.7
29	0.	30	0.	31	86.5	32	88.9	33	89.2	34	85.4	35	87.8
36	88.5	37	86.0	38	86.5	39	86.4	40	83.0	41	83.4	42	85.9
43	86.1	44	83.3	45	82.2	46	80.9	47	72.6	48	72.4	49	0.

TIME 600 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.8	2	79.7	3	85.5	4	80.4	5	88.0	6	80.6	7	85.0
8	78.1	9	83.0	10	76.7	11	82.7	12	76.2	13	76.0	14	72.8
15	87.3	16	80.9	17	87.5	18	80.6	19	85.5	20	79.0	21	85.5
22	78.1	23	0.	24	0.	25	76.8	26	73.0	27	88.0	28	80.8
29	0.	30	0.	31	86.7	32	93.0	33	89.5	34	85.5	35	87.9
36	88.9	37	85.9	38	86.4	39	86.5	40	82.2	41	83.7	42	85.7
43	86.0	44	81.2	45	82.2	46	80.8	47	72.0	48	72.0	49	0.

TIME 700 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.8	3	85.0	4	80.6	5	88.5	6	81.0	7	85.8
8	80.5	9	84.0	10	77.2	11	84.0	12	77.3	13	80.0	14	73.7
15	87.0	16	81.7	17	87.5	18	81.4	19	86.0	20	75.8	21	86.0
22	79.1	23	0.	24	0.	25	80.0	26	74.2	27	88.5	28	81.1
29	0.	30	0.	31	87.5	32	89.6	33	90.0	34	86.8	35	84.4
36	87.2	37	82.7	38	87.0	39	87.0	40	84.7	41	85.0	42	86.5
43	79.5	44	79.5	45	84.5	46	81.8	47	73.5	48	72.0	49	0.

TIME 800 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	81.7	3	90.0	4	81.1	5	90.0	6	81.0	7	87.0
8	74.2	9	81.0	10	78.1	11	85.0	12	77.3	13	82.5	14	70.4
15	88.7	16	80.0	17	88.5	18	82.0	19	87.0	20	80.0	21	87.0
22	79.7	23	0.	24	0.	25	81.6	26	75.5	27	90.3	28	82.1
29	76.7	30	0.	31	89.5	32	90.2	33	91.0	34	88.8	35	90.0
36	90.9	37	86.5	38	88.5	39	88.8	40	87.0	41	84.1	42	88.5
43	79.4	44	79.9	45	81.5	46	83.0	47	70.1	48	71.9	49	0.

TIME 900 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.7	3	91.0	4	81.7	5	91.0	6	82.0	7	91.5
8	74.2	9	81.0	10	80.5	11	85.0	12	77.5	13	85.0	14	75.2
15	90.0	16	80.9	17	90.5	18	81.4	19	88.5	20	81.7	21	88.5
22	80.0	23	0.	24	0.	25	84.8	26	76.0	27	91.8	28	82.5
29	74.7	30	0.	31	91.5	32	92.0	33	92.0	34	90.0	35	91.0
36	90.0	37	86.5	38	89.5	39	90.0	40	88.5	41	88.5	42	89.5
43	85.5	44	84.5	45	86.0	46	83.5	47	70.1	48	72.0	49	0.

TIME 1000 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.7	3	91.5	4	81.7	5	91.5	6	81.0	7	89.5
8	75.6	9	81.0	10	80.5	11	88.0	12	78.2	13	86.0	14	75.6
15	91.0	16	81.7	17	90.5	18	81.4	19	89.5	20	82.0	21	89.5
22	80.6	23	0.	24	0.	25	80.0	26	74.0	27	89.0	28	78.8
29	75.0	30	0.	31	92.5	32	92.0	33	93.2	34	91.0	35	92.0
36	91.5	37	88.5	38	89.0	39	89.0	40	89.0	41	89.9	42	87.4
43	81.5	44	81.2	45	84.0	46	84.0	47	76.5	48	71.8	49	0.

TIME 1100 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	81.7	3	91.5	4	81.7	5	91.5	6	81.0	7	89.5
8	75.6	9	81.0	10	80.5	11	88.0	12	78.2	13	86.0	14	75.6
15	91.0	16	81.7	17	90.5	18	81.4	19	89.5	20	82.0	21	89.5
22	80.6	23	0.	24	0.	25	80.0	26	74.0	27	89.0	28	78.8
29	75.0	30	0.	31	92.5	32	92.0	33	93.2	34	91.0	35	92.0
36	91.5	37	88.5	38	89.0	39	89.0	40	89.0	41	89.9	42	87.4
43	81.5	44	81.2	45	84.0	46	84.0	47	76.5	48	71.8	49	0.

TIME 1200 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	82.6	3	94.0	4	83.5	5	94.0	6	83.2	7	92.0
8	80.8	9	82.0	10	80.7	11	92.0	12	80.2	13	91.0	14	75.0
15	93.0	16	86.5	17	93.0	18	84.9	19	92.0	20	83.8	21	93.0
22	82.9	23	92.0	24	80.8	25	91.0	26	78.7	27	94.5	28	93.8
29	73.2	30	82.2	31	94.5	32	94.4	33	94.5	34	93.8	35	94.4
36	94.6	37	93.6	38	93.8	39	93.8	40	93.0	41	93.0	42	93.0
43	94.2	44	86.5	45	92.5	46	85.0	47	75.0	48	71.8	49	0.

TIME 1300 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.9	3	94.0	4	83.0	5	94.0	6	82.8	7	93.0
8	80.3	9	81.0	10	80.6	11	93.0	12	80.6	13	92.0	14	77.2
15	93.5	16	86.0	17	94.0	18	85.6	19	94.0	20	84.8	21	94.0
22	82.7	23	0.	24	0.	25	92.5	26	78.1	27	95.6	28	84.0
29	72.0	30	0.	31	95.2	32	95.0	33	95.0	34	94.5	35	95.0
36	95.5	37	94.8	38	95.0	39	95.0	40	94.0	41	94.0	42	94.2
43	94.0	44	85.0	45	93.6	46	85.6	47	96.1	48	77.5	49	0.

TIME 1400 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.9	3	94.0	4	83.0	5	94.0	6	82.8	7	93.0
8	80.3	9	81.0	10	80.6	11	93.0	12	80.6	13	92.0	14	77.2
15	93.5	16	86.0	17	94.0	18	85.6	19	94.0	20	84.8	21	94.0
22	82.7	23	0.	24	0.	25	92.5	26	78.1	27	95.6	28	84.0
29	72.0	30	0.	31	95.2	32	95.0	33	95.0	34	94.5	35	95.0
36	95.5	37	94.8	38	95.0	39	95.0	40	94.0	41	94.0	42	94.2
43	94.0	44	85.0	45	93.6	46	85.6	47	96.1	48	77.5	49	0.

TIME 1500 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	82.3	3	94.5	4	82.6	5	94.5	6	82.5	7	94.0
8	80.2	9	84.0	10	80.5	11	94.0	12	81.0	13	93.0	14	76.4
15	94.0	16	86.0	17	94.5	18	85.8	19	93.0	20	83.3	21	94.0
22	84.0	23	93.0	24	79.8	25	93.7	26	88.7	27	95.5	28	83.0
29	69.0	30	0.	31	95.5	32	95.2	33	95.1	34	95.2	35	95.8
36	96.0	37	96.4	38	94.2	39	94.9	40	95.8	41	94.6	42	94.8
43	95.0	44	86.0	45	94.2	46	85.6	47	96.4	48	73.0	49	0.

TIME 1600 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	82.9	3	95.0	4	84.0	5	95.5	6	84.1	7	94.0
8	81.2	9	84.5	10	81.1	11	94.0	12	80.5	13	93.0	14	76.7
15	95.5	16	86.0	17	95.5	18	86.1	19	94.0	20	84.7	21	95.0
22	84.6	23	95.0	24	83.2	25	93.3	26	78.3	27	95.8	28	84.0
29	70.0	30	95.0	31	95.5	32	95.4	33	95.1	34	95.0	35	95.6
36	95.9	37	94.8	38	95.0	39	95.0	40	94.5	41	94.3	42	94.5
43	94.5	44	95.0	45	93.8	46	85.9	47	95.9	48	73.3	49	0.

TIME 1700 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.6	3	94.5	4	83.4	5	95.0	6	83.8	7	93.5
8	81.1	9	94.0	10	81.2	11	93.0	12	80.1	13	91.5	14	77.1
15	94.0	16	86.5	17	95.0	18	85.9	19	94.0	20	84.1	21	95.0
22	84.4	23	94.0	24	82.1	25	90.8	26	77.7	27	95.0	28	83.9
29	71.0	30	57.0	31	94.9	32	95.0	33	95.0	34	94.5	35	95.1
36	95.5	37	94.5	38	94.5	39	94.5	40	93.5	41	93.4	42	93.9
43	94.0	44	88.5	45	92.9	46	85.3	47	95.0	48	74.0	49	0.

TIME 1800 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	81.4	3	93.0	4	82.2	5	93.0	6	82.0	7	91.0
8	80.5	9	87.0	10	75.0	11	87.0	12	78.6	13	80.0	14	74.1
15	85.0	16	79.5	17	91.0	18	83.6	19	89.5	20	83.2	21	89.5
22	81.3	23	86.0	24	81.4	25	80.4	26	75.0	27	90.5	28	83.3
29	80.0	30	72.8	31	89.4	32	91.1	33	91.2	34	89.3	35	91.4
36	92.3	37	90.0	38	90.0	39	90.0	40	86.7	41	87.2	42	88.6
43	88.6	44	79.3	45	85.5	46	82.5	47	90.1	48	74.0	49	0.

TIME 1900 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	83.1	3	94.5	4	83.7	5	94.0	6	84.0	7	92.0
8	81.3	9	91.0	10	80.5	11	91.0	12	79.4	13	88.0	14	76.5
15	93.5	16	85.7	17	94.5	18	85.4	19	93.0	20	83.7	21	93.5
22	82.6	23	93.0	24	83.3	25	88.2	26	77.9	27	94.7	28	84.6
29	75.5	30	85.5	31	94.0	32	94.3	33	94.8	34	94.0	35	94.9
36	95.5	37	93.1	38	93.9	39	93.9	40	92.0	41	92.0	42	93.0
43	91.0	44	82.0	45	90.5	46	85.0	47	94.3	48	74.8	49	0.

TIME 2000 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	83.3	3	92.8	4	82.8	5	93.0	6	83.4	7	91.0
8	80.4	9	90.5	10	79.4	11	90.0	12	79.5	13	89.0	14	74.2
15	92.5	16	84.8	17	93.5	18	85.0	19	93.0	20	83.4	21	93.0
22	82.5	23	92.0	24	79.7	25	84.6	26	77.0	27	93.2	28	84.2
29	74.7	30	79.5	31	92.4	32	93.4	33	93.7	34	92.5	35	94.0
36	94.5	37	92.2	38	93.0	39	93.0	40	90.0	41	90.7	42	91.5
43	91.5	44	87.1	45	88.8	46	84.3	47	93.0	48	74.6	49	0.

TIME 2100 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	82.2	3	91.5	4	82.6	5	92.0	6	83.1	7	89.5
8	80.2	9	90.0	10	75.4	11	88.5	12	78.3	13	82.5	14	73.7
15	91.5	16	84.3	17	92.0	18	84.0	19	91.0	20	82.2	21	91.0
22	81.3	23	92.5	24	82.6	25	82.8	26	76.0	27	91.8	28	83.5
29	72.4	30	73.6	31	90.9	32	92.4	33	92.5	34	91.0	35	92.6
36	93.3	37	90.8	38	91.6	39	91.8	40	88.1	41	89.0	42	90.0
43	80.5	44	85.0	45	86.9	46	83.3	47	91.5	48	74.3	49	0.

TIME 2200 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	81.5	3	90.5	4	84.0	5	91.0	6	82.7	7	88.5
8	82.1	9	88.0	10	79.7	11	87.5	12	78.6	13	81.8	14	79.8
15	90.5	16	83.8	17	91.0	18	83.5	19	90.0	20	82.0	21	90.5
22	81.0	23	89.8	24	82.7	25	81.5	26	75.5	27	91.2	28	83.5
29	81.5	30	74.0	31	90.0	32	91.8	33	92.0	34	90.0	35	92.0
36	93.0	37	90.0	38	91.0	39	91.0	40	87.5	41	88.0	42	89.5
43	89.0	44	85.5	45	86.0	46	83.0	47	90.6	48	74.5	49	0.

TIME 2300 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	81.4	3	90.0	4	82.2	5	90.0	6	82.0	7	89.0
8	80.5	9	87.0	10	75.0	11	87.0	12	78.6	13	80.0	14	74.1
15	85.0	16	79.5	17	91.0	18	83.6	19	89.5	20	83.2	21	89.5
22	81.3	23	86.0	24	81.4	25	80.4	26	75.0	27	90.5	28	83.3
29	80.0	30	72.8	31	89.4	32	91.1	33	91.2	34	89.3	35	91.4
36	92.3	37	90.0	38	90.0	39	90.0	40	86.7	41	87.2	42	88.6
43	88.6	44	79.3	45	85.5	46	82.5	47	90.1	48	74.0	49	0.

TIME 2400 DATE 5/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	81.4	3	90.0	4	82.2	5	90.0	6	82.2	7	87.0
8	79.5	9	86.0	10	78.4	11	86.0	12	78.3	13	79.0	14	78.2
15	90.0	16	82.9	17	90.0	18	82.5	19	88.5	20	81.2	21	88.5
22	80.7	23	88.0	24	81.5	25	79.8	26	74.9	27	89.9	28	82.9
29	0.	30	0.	31	88.2	32	90.2	33	90.5	34	88.5	35	90.9
36	91.8	37	88.1	38	85.4	39	89.5	40	85.9	41	86.4	42	88.0
43	87.8	44	84.8	45	84.4	46	82.0	47	89.4	48	74.2	49	0.

TIME 100 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	81.0	3	89.4	4	81.7	5	89.0	6	81.7	7	87.8
8	80.6	9	85.0	10	77.8	11	85.0	12	77.8	13	78.4	14	74.5
15	89.4	16	82.3	17	90.0	18	82.5	19	88.0	20	81.1	21	88.0
22	80.6	23	86.0	24	78.6	25	79.0	26	74.2	27	89.3	28	82.4
29	0.	30	0.	31	87.9	32	90.0	33	90.0	34	88.1	35	90.5
36	91.1	37	87.5	38	88.5	39	88.8	40	85.0	41	85.8	42	87.8
43	87.3	44	84.5	45	83.9	46	81.5	47	89.2	48	73.9	49	0.

TIME 200 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	80.5	3	89.2	4	81.3	5	88.5	6	81.2	7	86.0
8	79.0	9	84.0	10	77.0	11	84.0	12	77.0	13	77.5	14	74.2
15	89.0	16	82.0	17	89.5	18	81.9	19	87.5	20	80.5	21	87.5
22	80.2	23	90.0	24	78.3	25	78.0	26	73.8	27	89.1	28	82.0
29	0.	30	0.	31	87.4	32	89.8	33	90.1	34	87.5	35	90.0
36	90.8	37	87.0	38	88.0	39	88.2	40	84.4	41	85.1	42	87.1
43	87.0	44	84.0	45	83.0	46	81.3	47	88.8	48	73.8	49	0.

TIME 300 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	80.5	3	89.0	4	81.1	5	88.0	6	80.9	7	86.0
8	78.7	9	84.0	10	77.1	11	84.0	12	77.1	13	77.2	14	73.4
15	88.5	16	81.7	17	88.5	18	81.4	19	87.0	20	81.1	21	87.5
22	80.3	23	86.0	24	79.6	25	77.9	26	73.7	27	88.8	28	81.6
29	0.	30	0.	31	87.2	32	89.8	33	90.0	34	87.0	35	89.8
36	90.5	37	87.0	38	87.9	39	88.0	40	83.7	41	85.0	42	86.9
43	86.9	44	84.0	45	83.0	46	81.1	47	88.0	48	73.3	49	0.

TIME 400 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	80.5	3	88.5	4	81.0	5	88.0	6	80.7	7	85.7
8	78.4	9	84.0	10	77.2	11	84.0	12	77.1	13	77.0	14	73.9
15	88.5	16	81.6	17	88.5	18	81.5	19	87.0	20	80.2	21	87.0
22	79.7	23	85.5	24	79.3	25	77.3	26	73.7	27	88.9	28	81.6
29	0.	30	0.	31	87.0	32	89.3	33	90.0	34	87.0	35	89.4
36	90.1	37	86.5	38	87.6	39	87.8	40	83.6	41	84.8	42	86.8
43	86.8	44	83.9	45	82.9	46	81.0	47	88.1	48	73.0	49	0.

TIME 500 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.8	2	80.1	3	88.9	4	81.0	5	88.0	6	80.5	7	85.5
8	78.7	9	84.0	10	77.2	11	84.0	12	77.1	13	76.8	14	73.5
15	88.3	16	81.4	17	88.5	18	81.5	19	87.0	20	80.1	21	84.0
22	81.4	23	86.0	24	79.7	25	77.7	26	73.9	27	88.7	28	81.3
29	0.	30	0.	31	87.0	32	89.2	33	89.5	34	86.8	35	84.9
36	90.0	37	86.6	38	87.9	39	87.7	40	83.6	41	84.8	42	86.7
43	86.4	44	83.8	45	82.9	46	81.0	47	88.1	48	73.0	49	0.

TIME 600 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	91.1	3	89.0	4	81.4	5	88.0	6	80.0	7	86.0
8	79.0	9	94.5	10	77.4	11	84.5	12	77.4	13	78.0	14	73.7
15	88.8	16	91.1	17	88.9	18	81.6	19	87.0	20	81.3	21	87.0
22	89.5	23	86.0	24	79.4	25	78.8	26	73.6	27	89.5	28	82.4
29	0.	30	0.	31	87.9	32	90.0	33	90.0	34	87.6	35	89.8
36	90.5	37	87.1	38	88.0	39	88.1	40	84.9	41	85.5	42	87.1
43	87.1	44	84.5	45	83.6	46	81.8	47	89.1	48	72.9	49	0.

TIME 700 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	90.8	3	89.0	4	81.1	5	88.5	6	80.5	7	86.5
8	79.0	9	94.0	10	76.9	11	84.0	12	76.8	13	81.0	14	74.8
15	89.0	16	92.6	17	88.9	18	81.0	19	87.0	20	80.5	21	87.0
22	79.6	23	86.0	24	79.4	25	83.2	26	70.6	27	90.0	28	81.0
29	0.	30	0.	31	88.1	32	89.7	33	90.0	34	87.9	35	89.8
36	90.8	37	87.2	38	88.0	39	88.2	40	85.8	41	86.1	42	87.3
43	88.0	44	84.8	45	85.8	46	82.5	47	90.0	48	72.6	49	0.

TIME 800 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.3	3	90.2	4	81.6	5	90.0	6	81.4	7	86.0
8	80.0	9	90.0	10	77.9	11	86.0	12	77.5	13	83.0	14	74.9
15	90.0	16	93.2	17	90.0	18	82.4	19	88.5	20	88.0	21	88.0
22	79.5	23	90.0	24	80.6	25	83.8	26	75.9	27	91.0	28	82.6
29	0.	30	0.	31	90.0	32	91.1	33	91.2	34	90.0	35	91.3
36	91.0	37	89.3	38	89.8	39	90.0	40	87.3	41	87.8	42	89.1
43	89.6	44	86.0	45	86.7	46	83.0	47	91.1	48	72.5	49	0.

TIME 900 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	91.3	3	91.0	4	82.2	5	90.0	6	81.1	7	89.0
8	[illegible]	9	[illegible]	10	[illegible]	11	87.5	12	78.9	13	83.0	14	75.3
15	90.5	16	93.3	17	90.0	18	82.2	19	89.0	20	81.1	21	90.0
22	81.4	23	89.5	24	81.7	25	83.6	26	75.5	27	91.7	28	82.8
29	79.6	30	87.4	31	90.5	32	90.8	33	91.0	34	90.2	35	92.0
36	92.2	37	90.0	38	90.4	39	90.8	40	88.0	41	88.5	42	89.8
43	90.1	44	90.2	45	87.2	46	83.3	47	91.6	48	71.0	49	0.

TIME 1000 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	91.5	3	92.5	4	82.4	5	92.0	6	82.3	7	90.0
8	79.5	9	90.0	10	79.2	11	89.0	12	78.6	13	88.0	14	76.1
15	91.0	16	94.1	17	92.0	18	83.1	19	90.0	20	82.0	21	90.0
22	81.1	23	90.0	24	79.5	25	88.2	26	97.2	27	93.0	28	83.2
29	74.7	30	94.2	31	92.5	32	93.0	33	93.0	34	92.2	35	93.0
36	93.5	37	91.5	38	91.8	39	91.8	40	90.5	41	90.4	42	91.2
43	91.7	44	87.2	45	90.0	46	84.6	47	93.5	48	72.2	49	0.

TIME 1100 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	91.5	3	93.[illegible]	4	82.2	5	93.0	6	82.9	7	91.5
8	80.5	9	91.5	10	79.6	11	90.5	12	79.4	13	90.0	14	76.6
15	92.6	16	95.4	17	93.0	18	84.2	19	92.[illegible]	20	83.8	21	92.0
22	81.6	23	93.0	24	81.7	25	91.0	26	78.0	27	94.8	28	83.8
29	0.	30	0.	31	94.2	32	94.2	33	94.6	34	93.8	35	94.5
36	95.0	37	93.4	38	93.2	39	93.2	40	92.5	41	92.2	42	92.8
43	93.5	44	90.5	45	91.5	46	85.5	47	95.0	48	72.0	49	0.

TIME 1200 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	91.9	3	95.0	4	82.2	5	94.0	6	83.0	7	92.5
8	80.8	9	92.0	10	80.1	11	92.0	12	80.0	13	91.0	14	76.6
15	93.0	16	95.6	17	94.0	18	84.7	19	92.5	20	83.5	21	93.0
22	83.0	23	93.0	24	81.6	25	90.8	26	77.6	27	95.9	28	84.0
29	0.	30	0.	31	95.5	32	96.2	33	96.0	34	94.5	35	95.2
36	95.5	37	93.8	38	93.8	39	93.9	40	93.0	41	93.0	42	93.5
43	94.5	44	[illegible]	45	[illegible]	46	85.2	47	96.0	48	71.8	49	0.

TIME 1300 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	96.0	2	97.5	3	95.0	4	82.6	5	95.0	6	83.5	7	93.5
8	80.6	9	93.0	10	80.4	11	92.0	12	79.5	13	93.5	14	76.0
15	94.0	16	96.3	17	94.0	18	84.8	19	93.0	20	84.0	21	93.0
22	82.6	23	95.0	24	82.7	25	92.2	26	78.2	27	97.2	28	84.2
29	0.	30	0.	31	97.0	32	98.0	33	98.1	34	95.5	35	96.0
36	96.9	37	95.5	38	94.6	39	94.7	40	94.7	41	94.0	42	94.5
43	96.2	44	90.0	45	93.8	46	86.4	47	97.8	48	72.0	49	0.

TIME 1400 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	96.0	2	97.0	3	96.5	4	83.5	5	95.5	6	84.1	7	94.0
8	81.0	9	93.5	10	80.9	11	93.5	12	80.5	13	93.0	14	76.9
15	95.0	16	96.1	17	95.5	18	86.1	19	94.0	20	85.0	21	94.0
22	83.6	23	95.0	24	85.6	25	93.5	26	78.2	27	96.9	29	84.4
29	0.	30	0.	31	96.5	32	97.2	33	97.8	34	96.0	35	96.7
36	98.0	37	95.0	38	95.0	39	95.0	40	94.3	41	94.6	42	95.0
43	96.0	44	91.0	45	94.0	46	86.2	47	97.8	48	71.4	49	0.

TIME 1500 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	96.0	2	92.7	3	96.0	4	82.7	5	95.5	6	81.7	7	94.0
8	81.0	9	94.0	10	80.6	11	94.0	12	80.5	13	93.0	14	76.9
15	94.9	16	96.8	17	96.0	18	85.4	19	94.0	20	84.0	21	94.0
22	83.4	23	94.3	24	81.7	25	93.0	26	78.7	27	96.7	28	85.0
29	0.	30	0.	31	96.3	32	96.7	33	97.0	34	96.0	35	96.5
36	97.0	37	95.3	38	95.5	39	95.7	40	94.8	41	94.8	42	95.0
43	95.5	44	90.0	45	93.8	46	86.8	47	97.0	48	71.2	49	0.

TIME 1600 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	92.6	3	95.0	4	83.0	5	95.5	6	84.0	7	94.0
8	81.0	9	94.0	10	80.8	11	93.0	12	80.4	13	92.5	14	76.5
15	94.9	16	96.8	17	96.0	18	85.4	19	94.0	20	84.0	21	95.0
22	83.4	23	94.3	24	81.7	25	93.0	26	78.7	27	96.7	28	85.0
29	0.	30	0.	31	96.3	32	96.7	33	97.0	34	96.0	35	96.5
36	97.0	37	95.3	38	95.5	39	95.7	40	94.8	41	94.8	42	95.0
43	95.5	44	90.0	45	93.8	46	86.8	47	97.0	48	71.2	49	0.

TIME 1700 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	92.2	3	95.0	4	82.8	5	95.0	6	83.6	7	93.5
8	80.8	9	93.0	10	80.3	11	93.0	12	79.6	13	91.0	14	76.0
15	94.5	16	96.4	17	95.0	18	85.0	19	95.0	20	84.4	21	94.0
22	82.1	23	94.3	24	82.9	25	92.9	26	78.0	27	96.0	28	84.5
29	74.5	30	64.2	31	95.8	32	96.0	33	96.0	34	95.0	35	96.0
36	96.5	37	94.5	38	95.0	39	95.0	40	94.0	41	94.0	42	94.3
43	94.6	44	89.1	45	92.9	46	86.0	47	95.9	48	71.1	49	0.

TIME 1800 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.0	3	94.5	4	83.6	5	94.5	6	84.0	7	93.0
8	82.0	9	93.0	10	81.2	11	93.0	12	80.7	13	91.0	14	77.6
15	93.8	16	86.5	17	95.0	18	86.0	19	93.5	20	84.0	21	94.0
22	83.0	23	94.3	24	83.4	25	91.0	26	78.8	27	95.5	28	85.3
29	75.8	30	65.3	31	95.0	32	95.6	33	95.7	34	94.6	35	95.6
36	96.0	37	94.4	38	94.9	39	95.0	40	93.8	41	93.5	42	94.0
43	94.5	44	89.1	45	92.2	46	86.1	47	95.8	48	71.3	49	0.

TIME 1900 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	92.5	3	94.0	4	82.8	5	94.0	6	84.3	7	92.0
8	81.1	9	91.5	10	80.4	11	91.5	12	79.8	13	88.0	14	75.8
15	93.5	16	96.0	17	94.5	18	82.2	19	93.0	20	83.0	21	94.0
22	83.2	23	93.0	24	81.0	25	89.0	26	77.0	27	95.0	28	85.0
29	75.8	30	65.5	31	94.4	32	95.4	33	95.5	34	93.8	35	95.0
36	95.5	37	93.5	38	94.0	39	94.1	40	92.0	41	92.2	42	93.0
43	93.8	44	88.5	45	90.5	46	85.5	47	95.0	48	71.3	49	0.

TIME 2000 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	92.6	3	93.5	4	83.3	5	94.0	6	85.0	7	91.0
8	81.4	9	91.0	10	80.7	11	91.0	12	80.4	13	85.0	14	76.5
15	92.5	16	84.5	17	94.0	18	85.6	19	92.0	20	83.0	21	93.0
22	83.4	23	91.0	24	82.4	25	84.9	26	78.0	27	94.0	28	85.0
29	75.5	30	65.1	31	93.0	32	94.9	33	95.0	34	92.5	35	94.3
36	95.0	37	92.5	38	93.2	39	93.3	40	90.2	41	91.0	42	92.0
43	92.1	44	87.9	45	88.2	46	84.5	47	93.0	48	71.1	49	0.

TIME 2100 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	92.0	3	92.0	4	82.5	5	92.0	6	81.6	7	89.5
8	80.7	9	88.5	10	78.4	11	88.5	12	78.6	13	83.0	14	75.3
15	92.0	16	93.1	17	91.0	18	83.1	19	91.0	20	82.1	21	91.0
22	82.0	23	90.0	24	81.0	25	84.0	26	76.9	27	91.0	28	81.5
29	74.5	30	63.5	31	91.0	32	91.2	33	91.2	34	90.0	35	91.3
36	91.7	37	90.8	38	91.0	39	91.0	40	88.1	41	88.4	42	90.0
43	90.1	44	86.0	45	86.5	46	83.5	47	91.5	48	71.6	49	0.

TIME 2200 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	[illegible]	3	91.5	4	82.5	5	92.0	6	83.5	7	89.0
8	80.5	9	89.0	10	79.6	11	88.0	12	78.6	13	82.0	14	75.0
15	92.4	16	92.5	17	91.0	18	82.9	19	90.0	20	81.7	21	91.0
22	82.0	23	90.2	24	81.7	25	81.4	26	76.0	27	91.6	28	84.0
29	74.0	30	64.5	31	90.5	32	92.6	33	92.6	34	92.0	35	93.8
36	94.3	37	92.1	38	91.0	39	91.0	40	88.3	41	88.4	42	90.0
43	90.9	44	86.0	45	86.5	46	83.5	47	91.5	48	71.6	49	0.

TIME 2300 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.6	3	91.0	4	82.5	5	90.9	6	82.5	7	88.0
8	80.0	9	87.0	10	78.5	11	87.0	12	78.3	13	80.5	14	74.7
15	92.0	16	92.7	17	92.0	18	82.6	19	89.5	20	81.5	21	90.0
22	81.6	23	85.0	24	80.8	25	82.0	26	75.5	27	91.0	28	84.0
29	71.3	30	61.3	31	89.4	32	91.3	33	91.7	34	90.8	35	92.4
36	93.3	37	91.3	38	90.0	39	90.4	40	86.8	41	87.8	42	89.3
43	89.0	44	85.5	45	85.9	46	82.8	47	90.6	48	71.0	49	0.

TIME 2400 DATE 5/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	91.5	3	90.0	4	81.6	5	90.0	6	82.1	7	87.8
8	80.0	9	86.0	10	78.0	11	86.0	12	78.0	13	80.0	14	74.7
15	91.0	16	92.6	17	91.0	18	82.1	19	88.8	20	81.2	21	88.5
22	80.6	23	88.0	24	81.2	25	81.2	26	75.5	27	90.0	28	83.0
29	0.	30	0.	31	88.8	32	91.0	33	91.0	34	89.9	35	91.9
36	92.7	37	88.7	38	89.7	39	89.9	40	86.0	41	87.0	42	88.6
43	88.2	44	85.1	45	84.8	46	82.3	47	90.0	48	71.0	49	0.

TIME 100 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.6	2	91.2	3	89.4	4	81.6	5	89.5	6	81.8	7	87.0
8	79.6	9	85.5	10	78.0	11	85.5	12	77.8	13	78.8	14	74.4
15	90.0	16	92.2	17	90.0	18	81.9	19	88.0	20	80.5	21	88.0
22	80.2	23	87.0	24	81.3	25	78.6	26	74.2	27	89.7	28	82.9
29	0.	30	0.	31	87.1	32	90.3	33	90.5	34	88.6	35	91.0
36	92.0	37	86.0	38	86.8	39	89.0	40	85.5	41	86.0	42	86.0
43	87.5	44	84.8	45	83.8	46	81.1	47	89.1	48	71.2	49	0.

TIME 200 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	90.7	3	89.0	4	81.4	5	88.5	6	81.1	7	86.0
8	79.0	9	84.5	10	77.5	11	84.5	12	77.5	13	77.0	14	73.4
15	89.2	16	91.7	17	90.0	18	82.0	19	87.4	20	80.2	21	87.5
22	79.8	23	85.5	24	79.3	25	77.4	26	73.6	27	88.6	28	82.0
29	0.	30	0.	31	87.0	32	89.2	33	89.7	34	87.3	35	90.0
36	91.0	37	87.1	38	87.9	39	88.2	40	83.8	41	85.0	42	87.0
43	86.7	44	84.1	45	82.8	46	81.2	47	88.2	48	70.8	49	0.

TIME 300 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.8	2	90.3	3	88.3	4	80.8	5	88.0	6	80.6	7	85.5
8	78.5	9	84.0	10	77.0	11	84.0	12	77.0	13	77.6	14	73.8
15	89.0	16	91.1	17	89.5	18	80.6	19	87.0	20	79.8	21	87.0
22	79.7	23	86.0	24	79.8	25	78.0	26	73.3	27	88.2	28	81.4
29	0.	30	0.	31	87.0	32	88.9	33	89.0	34	87.8	35	90.1
36	90.9	37	86.9	38	87.5	39	87.8	40	83.8	41	85.0	42	86.8
43	86.8	44	84.0	45	83.0	46	81.2	47	88.2	48	70.6	49	0.

TIME 400 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	90.5	3	88.8	4	81.2	5	88.0	6	80.6	7	86.0
8	79.0	9	84.0	10	77.2	11	84.0	12	77.1	13	77.3	14	73.5
15	90.0	16	91.0	17	90.0	18	80.7	19	87.0	20	80.1	21	87.0
22	79.5	23	86.0	24	77.8	25	77.9	26	73.7	27	88.6	28	81.5
29	0.	30	0.	31	87.1	32	89.1	33	89.3	34	88.2	35	90.8
36	91.3	37	87.0	38	87.6	39	87.8	40	83.9	41	85.0	42	87.0
43	86.7	44	84.0	45	82.9	46	81.2	47	88.2	48	70.8	49	0.

TIME 500 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.2	2	78.0	3	88.0	4	78.8	5	88.0	6	79.7	7	85.0
8	76.5	9	84.0	10	76.2	11	84.0	12	76.2	13	79.0	14	73.2
15	89.0	16	79.2	17	89.5	18	80.3	19	86.0	20	78.0	21	86.0
22	78.2	23	85.0	24	78.4	25	78.8	26	73.1	27	88.5	28	80.5
29	0.	30	0.	31	87.1	32	88.8	33	88.9	34	88.0	35	90.0
36	90.8	37	86.5	38	87.1	39	87.2	40	84.0	41	85.0	42	86.7
43	86.7	44	84.0	45	83.0	46	81.5	47	88.0	48	70.7	49	0.

TIME 800 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	84.5	4	80.6	5	88.0	6	80.0	7	86.0
8	[illegible]	9	[illegible]	10	77.0	11	84.0	12	76.7	13	79.0	14	74.1
15	[illegible]	16	[illegible]	17	[illegible]	18	81.3	19	86.5	20	79.3	21	87.0
22	[illegible]	23	86.0	24	76.4	25	78.4	26	73.9	27	88.9	28	81.3
29	0.	30	[illegible]	31	87.3	32	99.1	33	81.3	34	88.2	35	90.2
36	[illegible]	37	80.9	38	87.[illegible]	39	87.7	40	84.5	41	85.2	42	87.0
43	[illegible]	44	[illegible]	45	83.3	46	[illegible]	47	88.5	48	70.7	49	0.

TIME 900 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	86.5	4	79.4	5	88.5	6	79.4	7	86.0
8	[illegible]	9	[illegible]	10	76.5	11	84.5	12	75.8	13	81.5	14	73.7
15	[illegible]	16	[illegible]	17	89.5	18	86.6	19	87.0	20	78.9	21	87.0
22	78.7	23	87.0	24	73.2	25	82.1	26	73.9	27	89.3	28	80.4
29	0.	30	0.	31	86.0	32	84.4	33	89.5	34	86.8	35	90.4
36	81.0	37	87.1	38	87.7	39	88.0	40	85.8	41	86.1	42	87.3
43	87.3	44	84.5	45	85.0	46	82.5	47	89.5	48	70.6	49	0.

TIME 1000 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	81.2	3	90.0	4	81.7	5	90.0	6	81.3	7	88.0
8	74.5	9	87.5	10	76.7	11	87.0	12	78.2	13	84.0	14	76.2
15	80.5	16	83.0	17	91.0	18	82.8	19	88.5	20	81.5	21	89.0
22	81.1	23	88.0	24	81.6	25	84.9	26	76.2	27	91.6	28	83.4
29	0.	30	0.	31	90.5	32	91.5	33	91.5	34	91.0	35	92.2
36	76.7	37	94.8	38	90.0	39	90.0	40	88.0	41	88.4	42	89.5
43	90.0	44	81.2	45	87.2	46	83.6	47	91.5	48	70.5	49	0.

TIME 1100 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	81.6	3	91.0	4	82.2	5	92.0	6	83.3	7	89.5
8	80.6	9	88.0	10	78.7	11	88.0	12	78.1	13	85.5	14	76.9
15	91.5	16	93.9	17	92.0	18	83.2	19	90.0	20	82.2	21	90.0
22	81.3	23	90.0	24	81.6	25	85.5	26	76.2	27	92.2	28	83.7
29	0.	30	0.	31	91.5	32	92.2	33	92.2	34	92.0	35	93.0
36	93.5	37	90.8	38	91.0	39	91.0	40	89.0	41	89.2	42	90.4
43	91.0	44	87.0	45	82.0	46	84.0	47	92.2	48	70.5	49	0.

TIME 1200 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	87.6	3	94.0	4	83.5	5	94.0	6	83.4	7	92.5
8	80.9	9	92.0	10	80.0	11	92.0	12	79.7	13	91.0	14	74.1
15	95.7	16	90.9	17	96.0	18	84.1	19	93.0	20	84.3	21	93.5
22	83.0	23	94.0	24	82.1	25	91.4	26	79.0	27	95.0	28	84.5
29	0.	30	0.	31	94.9	32	95.0	33	94.9	34	96.3	35	96.0
36	96.9	37	90.0	38	94.0	39	94.2	40	93.2	41	93.2	42	94.0
43	94.4	44	94.0	45	93.0	46	85.6	47	95.7	48	70.2	49	0.

TIME 1300 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	83.2	3	94.5	4	86.6	5	95.0	6	83.7	7	86.0
8	82.3	9	91.0	10	80.6	11	93.0	12	80.4	13	92.0	14	77.8
15	95.0	16	90.9	17	93.0	18	81.9	19	94.5	20	85.5	21	92.0
22	81.7	23	93.0	24	81.4	25	92.0	26	78.0	27	96.0	28	85.0
29	0.	30	0.	31	95.7	32	95.7	33	95.5	34	97.0	35	97.2
36	97.5	37	95.0	38	95.0	39	95.0	40	94.2	41	94.3	42	95.0
43	95.2	44	89.5	45	93.5	46	86.8	47	96.2	48	70.2	49	0.

TIME 1400 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	86.9	3	95.0	4	83.8	5	95.0	6	83.8	7	94.0
8	81.2	9	94.0	10	81.5	11	94.0	12	81.5	13	93.0	14	78.0
15	95.5	16	97.1	17	96.0	18	84.9	19	94.0	20	84.9	21	94.0
22	83.4	23	95.0	24	82.6	25	94.0	26	79.2	27	96.3	28	85.0
29	0.	30	0.	31	96.7	32	96.0	33	96.0	34	97.2	35	97.5
36	97.8	37	95.2	38	95.2	39	95.5	40	95.2	41	95.0	42	95.2
43	96.0	44	91.0	45	94.4	46	87.1	47	93.0	48	70.3	49	0.

TIME 1500 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	83.0	3	95.0	4	83.7	5	95.0	6	83.6	7	94.0
8	81.3	9	94.0	10	81.1	11	94.0	12	81.5	13	93.0	14	78.0
15	95.0	16	86.5	17	96.0	18	85.4	19	94.0	20	84.5	21	94.5
22	83.5	23	95.0	24	82.7	25	94.0	26	79.2	27	96.5	28	85.2
29	0.	30	0.	31	97.2	32	96.0	33	96.0	34	96.5	35	97.2
36	97.5	37	95.2	38	95.5	39	95.6	40	95.0	41	95.0	42	95.5
43	95.5	44	90.0	45	94.2	46	87.7	47	96.8	48	70.4	49	0.

TIME 1600 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	83.0	3	95.0	4	83.5	5	96.0	6	84.7	7	94.0
8	81.3	9	95.0	10	82.0	11	94.0	12	81.0	13	93.0	14	78.1
15	95.0	16	87.0	17	96.0	18	85.8	19	94.0	20	84.2	21	95.0
22	83.9	23	96.3	24	84.2	25	94.0	26	79.0	27	96.8	28	85.0
29	73.7	30	61.1	31	96.8	32	96.6	33	96.5	34	96.4	35	97.0
36	97.2	37	95.1	38	95.5	39	95.5	40	95.0	41	95.0	42	95.1
43	95.9	44	90.0	45	94.0	46	87.1	47	97.0	48	70.6	49	0.

TIME 1700 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	82.6	3	96.0	4	83.0	5	96.0	6	84.3	7	94.0
8	81.5	9	94.0	10	81.3	11	94.0	12	81.0	13	92.0	14	79.1
15	95.0	16	86.6	17	96.0	18	86.0	19	94.4	20	84.3	21	95.0
22	83.6	23	94.0	24	82.0	25	93.0	26	79.1	27	97.0	28	85.0
29	76.0	30	66.6	31	96.8	32	97.0	33	97.3	34	95.8	35	96.5
36	97.0	37	95.0	38	95.1	39	95.3	40	94.5	41	94.5	42	95.0
43	96.0	44	90.0	45	93.3	46	87.0	47	97.4	48	70.8	49	0.

TIME 1800 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	83.4	5	96.0	6	84.7	7	[illegible]
8	[illegible]	9	[illegible]	10	81.4	11	94.0	12	81.2	13	93.5	14	77.5
15	[illegible]	16	[illegible]	17	96.0	18	86.5	19	93.6	20	83.6	21	94.0
22	[illegible]	23	[illegible]	24	83.0	25	90.5	26	78.9	27	96.[illegible]	28	85.0
29	[illegible]	30	[illegible]	31	96.7	32	97.0	33	97.[illegible]	34	[illegible]	35	96.2
36	[illegible]	37	[illegible]	38	95.0	39	95.0	40	93.0	41	[illegible]	42	94.5
43	[illegible]	44	[illegible]	45	92.9	46	87.0	47	97.0	48	71.0	49	[illegible]

TIME 1900 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	95.5	4	83.3	5	95.0	6	84.9	7	92.5
8	[illegible]	9	[illegible]	10	86.4	11	92.0	12	79.[illegible]	13	85.5	14	76.9
15	[illegible]	16	[illegible]	17	95.6	18	85.6	19	93.0	20	83.0	21	94.0
22	[illegible]	23	[illegible]	24	81.5	25	89.5	26	78.[illegible]	27	96.0	28	85.0
29	[illegible]	30	[illegible]	31	[illegible]	32	96.4	33	96.9	34	94.1	35	95.5
36	[illegible]	37	[illegible]	38	94.5	39	94.4	40	92.7	41	93.0	42	93.8
43	[illegible]	44	[illegible]	45	[illegible]	46	86.8	47	96.0	48	71.0	49	0.

TIME 2000 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	94.0	4	80.5	5	94.0	6	83.0	7	91.4
8	[illegible]	9	[illegible]	10	[illegible]	11	79.6	12	79.6	13	85.0	14	75.4
15	[illegible]	16	[illegible]	17	94.0	18	85.0	19	92.0	20	82.4	21	93.0
22	82.4	23	[illegible]	24	[illegible]	25	85.4	26	76.4	27	94.4	28	84.5
29	77.0	30	[illegible]	31	94.5	32	95.0	33	95.1	34	92.5	35	94.3
36	[illegible]	37	[illegible]	38	93.[illegible]	39	93.[illegible]	40	90.2	41	91.0	42	92.1
43	92.5	44	[illegible]	45	85.3	46	85.4	47	94.1	48	71.0	49	0.

TIME 2100 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	94.0	4	82.5	5	93.0	6	82.9	7	90.0
8	[illegible]	9	[illegible]	10	77.5	11	89.0	12	78.7	13	83.0	14	75.1
15	[illegible]	16	[illegible]	17	92.5	18	84.0	19	91.0	20	81.9	21	91.0
22	[illegible]	23	[illegible]	24	81.0	25	84.0	26	75.8	27	93.0	28	83.7
29	[illegible]	30	[illegible]	31	91.9	32	93.6	33	93.9	34	91.0	35	93.1
36	[illegible]	37	[illegible]	38	91.8	39	92.6	40	88.8	41	89.6	42	91.0
43	[illegible]	44	[illegible]	45	84.0	46	84.9	47	92.9	48	71.0	49	0.

TIME 2200 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	91.5	4	82.0	5	92.0	6	82.6	7	89.0
8	80.7	9	[illegible]	10	84.5	11	88.5	12	78.8	13	83.0	14	74.7
15	[illegible]	16	[illegible]	17	91.0	18	83.0	19	90.0	20	81.3	21	90.5
22	[illegible]	23	[illegible]	24	81.2	25	82.6	26	75.6	27	92.0	28	83.4
29	78.[illegible]	30	71.5	31	92.7	32	92.5	33	92.9	34	90.0	35	92.4
36	[illegible]	37	[illegible]	38	91.1	39	91.1	40	87.9	41	88.9	42	90.0
43	[illegible]	44	[illegible]	45	87.1	46	84.3	47	92.0	48	70.9	49	0.

TIME 2300 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	91.5	4	82.0	5	92.0	6	82.0	7	88.0
8	79.4	9	87.5	10	78.3	11	87.0	12	77.9	13	81.0	14	74.1
15	80.5	16	[illegible]	17	91.5	18	83.3	19	89.0	20	81.1	21	90.0
22	81.0	23	[illegible]	24	81.1	25	80.8	26	76.0	27	91.3	28	83.4
29	75.0	30	[illegible]	31	92.0	32	92.0	33	92.0	34	89.5	35	91.9
36	92.5	37	[illegible]	38	90.1	39	90.5	40	87.0	41	87.9	42	89.1
43	89.2	44	[illegible]	45	86.0	46	84.8	47	91.0	48	70.9	49	0.

TIME 2400 DATE 5/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.5	2	[illegible]	3	90.4	4	81.4	5	90.0	6	81.4	7	88.0
8	79.0	9	[illegible]	10	77.5	11	86.0	12	77.5	13	79.8	14	73.6
15	[illegible]	16	[illegible]	17	91.0	18	82.1	19	89.0	20	80.6	21	89.0
22	[illegible]	23	87.0	24	77.7	25	79.0	26	74.[illegible]	27	90.1	28	82.5
29	0.	30	0.	31	89.0	32	91.0	33	91.0	34	89.1	35	91.7
36	[illegible]	37	[illegible]	38	85.4	39	89.7	40	86.0	41	86.9	42	88.6
43	88.[illegible]	44	[illegible]	45	85.3	46	88.1	47	90.3	48	70.8	49	0.

TIME 2500 DATE 5/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	90.0	4	81.3	5	90.0	6	81.5	7	87.0
8	77.2	9	87.0	10	77.9	11	86.0	12	77.6	13	78.7	14	73.9
15	90.4	16	91.7	17	90.5	18	81.6	19	88.0	20	80.0	21	86.0
22	[illegible]	23	87.0	24	75.2	25	78.4	26	[illegible]	27	89.9	28	82.2
29	0.	30	0.	31	88.2	32	90.2	33	90.6	34	88.7	35	91.2
36	92.[illegible]	37	[illegible]	38	88.8	39	89.0	40	85.0	41	86.1	42	88.0
43	[illegible]	44	[illegible]	45	84.3	46	82.9	47	89.7	48	70.5	49	0.

TIME 2600 DATE 5/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	89.3	4	80.7	5	89.5	6	80.9	7	86.5
8	[illegible]	9	[illegible]	10	77.5	11	85.0	12	77.0	13	78.0	14	73.0
15	[illegible]	16	[illegible]	17	90.0	18	81.3	19	87.8	20	80.0	21	88.0
22	[illegible]	23	[illegible]	24	79.1	25	78.0	26	73.8	27	89.2	28	82.0
29	0.	30	0.	31	87.8	32	90.0	33	90.0	34	88.0	35	90.8
36	[illegible]	37	[illegible]	38	88.2	39	88.4	40	84.6	41	85.5	42	87.5
43	87.1	44	[illegible]	45	83.4	46	82.2	47	89.0	48	70.6	49	0.

TIME 2700 DATE 5/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	79.9	3	89.0	4	80.8	5	89.0	6	80.8	7	86.0
8	78.5	9	84.5	10	76.8	11	84.5	12	76.6	13	77.5	14	78.2
15	89.3	16	81.4	17	90.0	18	81.6	19	87.2	20	79.5	21	88.0
22	79.9	23	86.0	24	79.3	25	77.5	26	73.3	27	88.8	28	81.7
29	0.	30	0.	31	87.2	32	89.5	33	89.7	34	87.3	35	90.0
36	91.0	37	87.0	38	87.8	39	88.0	40	84.0	41	85.0	42	87.0
43	86.7	44	84.1	45	83.0	46	82.0	47	88.8	48	70.5	49	0.

TIME 2800 DATE 5/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	78.8	3	84.0	4	79.4	5	88.0	6	79.0	7	85.0
8	75.7	9	84.0	10	75.4	11	84.0	12	75.5	13	78.5	14	71.2
15	88.0	16	78.9	17	88.0	18	79.5	19	86.0	20	77.0	21	86.0
22	77.3	23	84.5	24	77.1	25	76.8	26	68.1	27	87.1	28	77.5
29	0.	30	0.	31	85.9	32	87.6	33	87.9	34	85.4	35	88.0
36	84.1	37	84.1	38	85.8	39	86.2	40	82.3	41	83.4	42	85.1
43	85.3	44	83.3	45	82.1	46	81.1	47	87.2	48	70.5	49	0.

TIME 2900 DATE 5/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	77.2	3	86.0	4	79.6	5	88.0	6	79.1	7	85.4
8	77.5	9	84.0	10	76.8	11	84.0	12	75.6	13	77.5	14	72.1
15	88.0	16	80.2	17	88.0	18	79.8	19	86.0	20	79.0	21	86.0
22	77.6	23	88.0	24	80.3	25	78.2	26	72.[illegible]	27	88.1	28	80.4
29	0.	30	0.	31	86.9	32	88.8	33	88.8	34	86.8	35	89.0
36	80.0	37	86.2	38	87.0	39	87.0	40	83.6	41	84.5	42	86.3
43	86.5	44	84.0	45	83.0	46	82.0	47	88.2	48	70.4	49	0.

TIME 600		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	94.0	3	89.0	4	80.0	5	89.0	6	80.0	7	86.0
8	77.0	9	84.0	10	78.2	11	84.0	12	75.7	13	78.3	14	72.6
15	84.0	16	80.0	17	85.5	18	80.7	19	86.5	20	78.8	21	86.5
22	78.0	23	85.5	24	78.1	25	79.0	26	73.0	27	85.2	28	81.0
29	0.	30	0.	31	87.6	32	84.5	33	89.5	34	88.5	35	89.6
36	80.5	37	85.6	38	87.5	39	87.4	40	84.2	41	85.0	42	86.9
43	87.0	44	85.9	45	93.5	46	82.2	47	88.8	48	70.6	49	0.

TIME 700		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	94.0	3	85.0	4	79.5	5	90.0	6	80.4	7	87.0
8	74.3	9	80.0	10	77.0	11	85.5	12	76.0	13	80.5	14	73.4
15	89.5	16	81.0	17	80.0	18	81.3	19	87.0	20	79.2	21	88.0
22	74.0	23	85.0	24	78.4	25	81.2	26	74.0	27	81.0	28	81.2
29	0.	30	0.	31	88.9	32	90.2	33	90.2	34	88.8	35	90.5
36	81.0	37	87.5	38	88.0	39	88.1	40	85.5	41	86.2	42	87.8
43	88.2	44	85.0	45	85.0	46	83.4	47	90.1	48	70.4	49	0.

TIME 800		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	90.0	3	91.0	4	81.0	5	91.0	6	81.5	7	88.5
8	79.3	9	85.0	10	79.7	11	87.0	12	79.0	13	84.0	14	75.5
15	90.5	16	82.4	17	90.5	18	82.2	19	88.0	20	81.0	21	89.0
22	81.1	23	90.0	24	82.7	25	85.4	26	77.5	27	92.2	28	82.8
29	0.	30	0.	31	91.5	32	92.5	33	92.8	34	90.8	35	92.0
36	92.2	37	93.3	38	89.5	39	89.8	40	88.1	41	88.5	42	89.9
43	91.0	44	91.7	45	87.9	46	84.6	47	92.8	48	70.2	49	0.

TIME 900		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	91.5	3	93.0	4	81.5	5	92.0	6	81.3	7	90.0
8	80.5	9	90.0	10	79.6	11	88.0	12	78.0	13	85.5	14	76.7
15	91.5	16	83.9	17	92.0	18	83.3	19	89.0	20	82.2	21	90.0
22	81.5	23	92.0	24	82.6	25	86.0	26	79.4	27	94.0	28	84.0
29	0.	30	0.	31	93.0	32	94.5	33	95.2	34	92.0	35	93.5
36	93.0	37	91.0	38	91.0	39	91.0	40	89.8	41	90.0	42	91.2
43	92.5	44	87.8	45	89.4	46	85.0	47	93.8	48	70.2	49	0.

TIME 1000		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	91.9	3	95.0	4	82.5	5	94.0	6	83.8	7	91.5
8	81.5	9	90.0	10	79.6	11	90.0	12	79.3	13	88.0	14	77.5
15	93.0	16	85.0	17	93.5	18	84.3	19	91.0	20	83.2	21	92.0
22	82.9	23	93.0	24	82.9	25	88.2	26	78.0	27	95.5	28	84.5
29	0.	30	0.	31	94.5	32	96.0	33	96.8	34	93.4	35	94.5
36	94.6	37	92.0	38	92.2	39	92.2	40	91.0	41	91.3	42	92.3
43	93.6	44	88.6	45	90.3	46	85.5	47	95.8	48	70.1	49	0.

TIME 1100		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	93.0	3	95.0	4	82.9	5	95.0	6	84.4	7	92.0
8	81.5	9	92.0	10	80.7	11	92.0	12	80.7	13	90.0	14	77.7
15	94.0	16	87.4	17	95.0	18	85.9	19	92.0	20	84.0	21	92.5
22	83.0	23	93.0	24	82.5	25	90.6	26	79.2	27	96.1	28	85.4
29	0.	30	0.	31	95.6	32	96.6	33	96.1	34	95.1	35	96.0
36	96.2	37	93.2	38	93.5	39	93.5	40	93.0	41	93.0	42	93.6
43	94.9	44	89.5	45	92.2	46	86.2	47	96.9	48	70.4	49	0.

TIME 1200		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	92.8	3	95.5	4	[illegible]	5	95.0	6	84.2	7	91.0
8	81.7	9	92.0	10	81.0	11	92.0	12	80.0	13	92.0	14	78.1
15	95.0	16	87.0	17	95.0	18	86.5	19	93.0	20	84.7	21	94.0
22	84.5	23	95.0	24	83.5	25	91.4	26	78.5	27	98.4	28	85.4
29	0.	30	0.	31	96.0	32	96.2	33	96.8	34	96.0	35	96.8
36	96.7	37	95.1	38	95.2	39	95.3	40	94.0	41	93.8	42	94.2
43	95.4	44	89.5	45	93.3	46	86.4	47	98.9	48	70.3	49	0.

TIME 1300		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	92.9	3	95.0	4	83.2	5	95.0	6	83.9	7	93.5
8	81.1	9	94.0	10	81.4	11	93.0	12	80.6	13	92.0	14	77.5
15	94.5	16	87.0	17	95.5	18	86.0	19	93.5	20	84.7	21	94.0
22	84.0	23	95.0	24	83.0	25	94.0	26	79.6	27	96.5	28	84.2
29	0.	30	0.	31	96.2	32	96.5	33	96.8	34	95.6	35	96.2
36	96.8	37	94.6	38	94.8	39	94.9	40	94.5	41	94.4	42	94.8
43	95.3	44	89.9	45	93.0	46	86.6	47	98.8	48	70.4	49	0.

TIME 1400		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	93.1	3	95.5	4	83.6	5	95.5	6	84.2	7	94.0
8	81.2	9	94.0	10	81.1	11	94.0	12	81.0	13	93.0	14	77.8
15	95.0	16	87.6	17	96.0	18	86.7	19	94.0	20	85.2	21	94.5
22	84.1	23	95.0	24	82.5	25	94.4	26	79.4	27	92.4	28	85.2
29	0.	30	0.	31	96.2	32	90.2	33	96.3	34	90.8	35	96.5
36	96.7	37	95.0	38	95.0	39	95.0	40	94.9	41	94.8	42	95.0
43	96.0	44	90.0	45	93.8	46	86.8	47	97.0	48	73.0	49	0.

TIME 1500		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	93.3	3	95.5	4	84.0	5	95.5	6	84.3	7	94.0
8	81.4	9	94.0	10	81.0	11	94.0	12	81.3	13	93.0	14	77.8
15	95.0	16	87.7	17	96.0	18	86.5	19	94.0	20	85.0	21	94.5
22	84.3	23	95.0	24	83.0	25	93.0	26	80.0	27	96.5	28	85.5
29	0.	30	0.	31	96.1	32	96.2	33	96.3	34	95.9	35	96.5
36	96.7	37	95.0	38	95.2	39	95.2	40	94.9	41	94.8	42	95.2
43	96.1	44	89.8	45	93.6	46	86.7	47	96.9	48	70.6	49	0.

TIME 1600		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	93.0	3	95.5	4	83.3	5	95.5	6	84.5	7	94.0
8	81.5	9	94.5	10	81.8	11	94.0	12	81.5	13	92.0	14	77.5
15	95.0	16	87.2	17	96.0	18	86.0	19	94.0	20	84.8	21	95.0
22	84.1	23	95.0	24	85.4	25	93.7	26	79.4	27	96.5	28	85.4
29	75.0	30	64.1	31	96.4	32	96.5	33	96.7	34	96.0	35	96.8
36	97.0	37	95.0	38	95.0	39	95.1	40	94.4	41	94.5	42	95.0
43	95.6	44	89.9	45	93.0	46	86.8	47	96.9	48	70.6	49	0.

TIME 1700		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.5	2	92.9	3	96.0	4	83.0	5	95.5	6	85.0	7	93.5
8	81.3	9	94.0	10	81.2	11	93.5	12	80.8	13	91.5	14	76.9
15	94.5	16	86.5	17	96.0	18	85.9	19	93.5	20	84.4	21	95.0
22	84.5	23	96.0	24	84.3	25	91.0	26	78.9	27	96.8	28	85.0
29	74.0	30	61.5	31	96.3	32	97.0	33	97.5	34	95.2	35	96.1
36	96.3	37	93.8	38	94.5	39	94.9	40	93.8	41	93.8	42	94.8
43	95.4	44	89.7	45	92.8	46	86.5	47	97.0	48	70.9	49	0.

TIME 1800		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	92.5	3	95.0	4	82.8	5	95.0	6	85.1	7	91.8
8	81.1	9	88.5	10	80.0	11	91.5	12	80.0	13	95.5	14	76.1
15	93.5	16	84.7	17	95.0	18	84.0	19	92.5	20	82.9	21	93.0
22	82.4	23	93.0	24	83.7	25	85.5	26	77.5	27	94.3	28	85.2
29	74.0	30	62.0	31	93.8	32	95.7	33	96.0	34	92.5	35	94.2
36	94.5	37	91.5	38	93.0	39	93.0	40	91.0	41	90.5	42	92.9
43	92.5	44	87.8	45	89.4	46	84.5	47	94.0	48	70.0	49	0.

TIME 1900		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	92.1	3	95.0	4	82.5	5	93.0	6	83.8	7	90.0
8	80.4	9	87.8	10	80.0	11	89.8	12	79.7	13	85.0	14	76.2
15	92.0	16	84.3	17	93.0	18	84.5	19	91.0	20	82.4	21	91.5
22	82.2	23	91.0	24	82.3	25	84.5	26	76.4	27	92.8	28	84.0
29	72.0	30	59.5	31	91.6	32	93.5	33	94.0	34	91.3	35	93.1
36	93.8	37	90.2	38	91.5	39	91.7	40	89.2	41	89.8	42	90.8
43	91.0	44	87.0	45	87.9	46	84.2	47	92.9	48	71.2	49	0.

TIME 2000		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	92.5	3	92.5	4	82.4	5	92.5	6	83.9	7	85.0
8	76.0	9	85.0	10	77.1	11	89.0	12	78.0	13	85.0	14	75.4
15	92.0	16	84.6	17	92.5	18	84.4	19	90.5	20	82.4	21	91.0
22	82.0	23	89.8	24	80.7	25	85.0	26	76.0	27	92.5	28	84.1
29	72.1	30	58.8	31	91.5	32	93.	33	93.4	34	90.3	35	91.0
36	93.5	37	90.0	38	91.3	39	91.4	40	89.0	41	89.7	42	90.7
43	91.0	44	87.0	45	87.8	46	84.5	47	92.5	48	71.1	49	0.

TIME 2100		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.4	2	91.7	3	92.0	4	82.3	5	92.0	6	83.1	7	89.5
8	80.4	9	89.0	10	77.0	11	89.6	12	79.0	13	84.5	14	75.1
15	91.4	16	84.9	17	92.0	18	83.9	19	90.0	20	81.6	21	91.0
22	82.5	23	91.0	24	81.5	25	84.7	26	76.1	27	92.1	28	84.0
29	73.6	30	62.2	31	91.3	32	93.2	33	93.0	34	91.8	35	92.4
36	93.4	37	90.0	38	91.0	39	91.0	40	89.0	41	89.2	42	90.2
43	90.5	44	87.0	45	87.5	46	84.8	47	92.2	48	72.8	49	0.

TIME 2200		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	91.6	3	92.0	4	81.8	5	92.0	6	83.2	7	89.5
8	80.3	9	90.0	10	76.0	11	89.0	12	78.7	13	85.0	14	75.4
15	91.0	16	85.8	17	92.0	18	84.0	19	90.0	20	81.7	21	91.0
22	82.0	23	89.0	24	82.5	25	85.1	26	76.0	27	92.3	28	83.7
29	74.2	30	63.5	31	91.5	32	93.0	33	93.4	34	90.8	35	92.4
36	93.0	37	90.0	38	90.9	39	91.0	40	88.7	41	89.2	42	90.1
43	90.7	44	87.0	45	87.5	46	84.3	47	92.3	48	72.2	49	0.

TIME 2300		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	91.4	3	92.0	4	82.1	5	92.0	6	83.0	7	89.0
8	80.0	9	89.0	10	73.1	11	89.0	12	78.0	13	84.5	14	75.2
15	91.0	16	85.9	17	92.0	18	84.0	19	90.0	20	81.9	21	90.5
22	81.6	23	89.0	24	80.5	25	85.0	26	76.4	27	92.0	28	83.5
29	75.2	30	66.0	31	91.1	32	92.6	33	93.0	34	90.5	35	92.1
36	92.9	37	90.5	38	90.8	39	90.9	40	88.5	41	89.0	42	90.0
43	90.5	44	86.8	45	87.4	46	84.5	47	92.0	48	72.0	49	0.

TIME 2400		DATE 5/13/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	91.4	3	91.8	4	82.3	5	92.0	6	83.1	7	89.0
8	79.9	9	88.5	10	78.8	11	88.5	12	78.4	13	84.5	14	76.1
15	91.0	16	83.8	17	92.0	18	83.9	19	90.0	20	81.7	21	90.0
22	81.2	23	89.5	24	81.1	25	85.6	26	76.1	27	92.0	28	83.9
29	0.	30	0.	31	91.2	32	92.8	33	92.9	34	91.0	35	92.3
36	91.0	37	90.1	38	90.8	39	91.0	40	90.5	41	89.0	42	90.1
43	90.5	44	87.0	45	87.5	46	84.8	47	92.1	48	72.5	49	0.

TIME 100		DATE 5/14/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	90.5	3	89.0	4	81.1	5	88.5	6	81.0	7	85.5
8	78.5	9	84.0	10	77.2	11	84.0	12	77.[illegible]	13	76.0	14	73.0
15	88.0	16	81.4	17	88.5	18	81.6	19	87.0	20	79.7	21	87.0
22	79.5	23	85.0	24	78.8	25	76.5	26	73.0	27	88.2	28	81.9
29	0.	30	0.	31	86.6	32	89.0	33	89.5	34	86.1	35	88.9
36	89.8	37	86.5	38	87.5	39	87.5	40	82.9	41	84.1	42	86.3
43	86.0	44	83.9	45	82.2	46	81.7	47	87.8	48	71.8	49	0.

TIME 200		DATE 5/14/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	90.5	3	89.0	4	81.1	5	88.5	6	81.0	7	85.5
8	78.5	9	84.0	10	77.2	11	84.0	12	77.[illegible]	13	76.0	14	73.0
15	88.0	16	81.4	17	88.5	18	81.6	19	87.0	20	79.7	21	87.0
22	79.5	23	85.0	24	78.8	25	76.5	26	73.0	27	88.2	28	81.9
29	0.	30	0.	31	86.6	32	89.0	33	89.5	34	86.1	35	88.9
36	89.8	37	86.5	38	87.5	39	87.5	40	82.9	41	84.1	42	86.3
43	86.0	44	83.9	45	82.2	46	81.7	47	87.8	48	71.8	49	0.

TIME 300		DATE 5/14/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	90.0	3	86.0	4	80.5	5	88.0	6	80.8	7	85.0
8	78.5	9	83.5	10	77.1	11	83.5	12	77.1	13	75.5	14	73.1
15	87.0	16	81.3	17	88.0	18	81.2	19	86.0	20	79.2	21	86.0
22	78.0	23	84.5	24	78.7	25	75.9	26	72.8	27	87.5	28	81.3
29	0.	30	0.	31	85.8	32	88.2	33	88.7	34	85.5	35	88.3
36	89.2	37	86.8	38	86.9	39	87.0	40	82.2	41	83.7	42	85.6
43	85.5	44	83.5	45	81.5	46	80.7	47	87.0	48	71.8	49	0.

TIME 400		DATE 5/14/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	90.0	3	86.0	4	80.5	5	88.0	6	81.1	7	84.8
8	78.4	9	83.5	10	77.2	11	83.5	12	77.2	13	76.5	14	73.3
15	87.4	16	81.5	17	88.0	18	81.6	19	86.0	20	79.5	21	86.0
22	78.7	23	84.5	24	78.5	25	76.1	26	72.0	27	87.8	28	81.6
29	0.	30	0.	31	86.0	32	88.0	33	88.5	34	85.5	35	88.0
36	89.	37	85.5	38	86.5	39	86.7	40	82.5	41	83.6	42	85.4
43	85.3	44	83.2	45	81.2	46	80.8	47	87.0	48	71.7	49	0.

TIME 500		DATE 5/14/1965											
PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	89.9	3	88.0	4	80.9	5	88.0	6	80.9	7	85.0
8	78.4	9	84.0	10	77.3	11	84.0	12	77.3	13	76.8	14	78.7
15	87.5	16	81.5	17	88.0	18	81.5	19	86.0	20	79.4	21	86.0
22	78.9	23	84.5	24	78.7	25	76.5	26	73.3	27	91.6	28	81.5
29	0.	30	0.	31	86.2	32	88.0	33	88.1	34	86.0	35	88.1
36	89.0	37	86.0	38	86.7	39	86.8	40	83.0	41	84.0	42	85.8
43	85.8	44	83.5	45	81.9	46	81.0	47	87.7	48	71.4	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	78.0	5	[illegible]	6	78.1	7	81.8
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	76.1	13	81.5	14	75.3
15	[illegible]	16	[illegible]	17	[illegible]	18	75.0	19	83.5	20	77.3	21	83.5
22	77.1	23	[illegible]	24	77.4	25	78.1	26	74.0	27	[illegible]	28	77.6
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	85.1	34	82.5	35	85.0
36	[illegible]	37	[illegible]	38	[illegible]	39	84.0	40	82.0	41	[illegible]	42	83.1
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	[illegible]	48	71.0	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	[illegible]	6	[illegible]	7	84.5
8	[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	77.0	13	78.5	14	73.9
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	[illegible]
22	[illegible]	23	[illegible]	24	[illegible]	25	[illegible]	26	[illegible]	27	[illegible]	28	[illegible]
29	[illegible]	30	[illegible]	31	[illegible]	32	[illegible]	33	88.1	34	[illegible]	35	[illegible]
36	[illegible]	37	[illegible]	38	[illegible]	39	86.4	40	[illegible]	41	[illegible]	42	[illegible]
43	[illegible]	44	[illegible]	45	[illegible]	46	[illegible]	47	87.0	48	71.1	49	[illegible]

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	88.0	6	8[illegible]	7	[illegible]
8	78.7	9	77.1	10	81.5	11	81.5	12	72.1	13	76.1	14	83.8
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	86.0	20	[illegible]	21	86.0
22	[illegible]	23	[illegible]	24	[illegible]	25	79.0	26	76.1	27	81.[illegible]	28	86.8
29	[illegible]	30	[illegible]	31	77.4	32	79.5	33	78.0	34	[illegible]	35	88.4
36	[illegible]	37	[illegible]	38	[illegible]	39	87.0	40	83.0	41	[illegible]	42	85.7
43	[illegible]	44	[illegible]	45	[illegible]	46	81.0	47	87.9	48	[illegible]	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	69.5	2	[illegible]	3	[illegible]	4	77.7	5	86.0	6	7[illegible].8	7	83.5
8	76.7	9	[illegible]	10	76.1	11	82.0	12	76.1	13	[illegible]	14	76.8
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	94.[illegible]	20	[illegible]	21	84.0
22	77.0	23	[illegible]	24	[illegible]	25	[illegible]	26	76.6	27	[illegible]	28	86.0
29	0.	30	[illegible]	31	[illegible]	32	86.7	33	87.0	34	[illegible]	35	86.[illegible]
36	[illegible]	37	[illegible]	38	84.	39	85.1	40	82.6	41	[illegible]	42	84.5
43	[illegible]	44	[illegible]	45	[illegible]	46	81.1	47	87.3	48	[illegible]	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	[illegible]	3	88.0	4	80.8	5	88.0	6	80.6	7	84.5
8	78.0	9	81.0	10	76.7	11	83.0	12	76.7	13	76.0	14	73.6
15	88.0	16	81.[illegible]	17	88.0	18	81.0	19	86.0	20	79.6	21	86.0
22	78.4	23	[illegible]	24	78.1	25	76.0	26	73.2	27	87.8	28	81.2
29	0.	30	0.	31	86.0	32	88.2	33	88.2	34	86.2	35	88.5
36	89.2	37	85.3	38	86.3	39	86.5	40	82.5	41	83.6	42	85.3
43	85.6	44	83.2	45	81.2	46	80.3	47	37.5	48	70.8	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	77.5	3	80.[illegible]	4	80.5	5	88.[illegible]	6	80.6	7	84.5
8	78.[illegible]	9	[illegible]	10	[illegible]	11	[illegible]	12	77.7	13	78.0	14	73.5
15	88.0	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	77.5	21	80.[illegible]
22	77.1	23	[illegible]	24	77.6	25	78.[illegible]	26	[illegible]	27	81.5	28	81.0
29	0.	30	[illegible]	31	86.[illegible]	32	90.2	33	91.0	34	86.0	35	88.7
36	89.2	37	86.0	38	86.7	39	86.9	40	82.5	41	83.2	42	85.2
43	86.0	44	83.4	45	[illegible]	46	81.0	47	87.0	48	71.0	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	78.0	3	[illegible]	4	80.7	5	88.5	6	71.0	7	85.5
8	78.7	9	83.5	10	77.1	11	83.5	12	77.2	13	76.0	14	72.3
15	88.0	16	81.5	17	[illegible]	18	81.1	19	86.0	20	79.6	21	86.0
22	78.0	23	86.0	24	89.[illegible]	25	76.0	26	73.[illegible]	27	88.8	28	81.2
29	0.	30	0.	31	8[illegible]	32	90.0	33	90.2	34	86.1	35	88.8
36	89.2	37	86.0	38	86.7	39	86.9	40	83.1	41	83.7	42	85.9
43	86.0	44	83.4	45	[illegible]	46	81.0	47	87.0	48	71.0	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	90.0	3	90.[illegible]	4	80.5	5	88.5	6	80.8	7	85.0
8	78.2	9	83.0	10	[illegible]	11	83.0	12	76.3	13	76.0	14	73.2
15	88.0	16	81.5	17	[illegible]	18	80.9	19	86.0	20	79.5	21	86.0
22	78.4	23	84.0	24	[illegible]	25	76.1	26	72.0	27	89.0	28	81.2
29	0.	30	0.	31	86.2	32	90.0	33	91.0	34	86.2	35	88.8
36	89.2	37	86.1	38	86.[illegible]	39	86.9	40	83.9	41	84.8	42	86.0
43	86.7	44	83.4	45	[illegible]	46	80.9	47	89.0	48	71.0	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	[illegible]	3	90.5	4	80.7	5	89.0	6	81.1	7	86.0
8	79.0	9	84.0	10	77.5	11	84.0	12	77.5	13	76.5	14	73.7
15	88.5	16	[illegible]	17	88.5	18	80.8	19	86.5	20	80.0	21	86.0
22	78.5	23	86.0	24	75.4	25	76.2	26	73.9	27	89.2	28	81.4
29	0.	30	0.	31	87.3	32	90.3	33	91.0	34	86.5	35	89.0
36	89.5	37	86.2	38	86.8	39	87.0	40	82.8	41	83.8	42	86.0
43	86.8	44	83.5	45	81.1	46	80.0	47	89.0	48	71.1	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	[illegible]	5	90.0	6	81.1	7	86.0
8	78.[illegible]	9	80.0	10	78.7	11	-0	12	75.6	13	76.3	14	73.5
15	[illegible]	16	[illegible]	17	85.5	18	[illegible]	19	85.5	20	78.4	21	85.0
22	77.7	23	86.0	24	79.4	25	76.9	26	73.0	27	89.0	28	89.0
29	0.	30	[illegible]	31	87.8	32	89.3	33	90.2	34	85.5	35	89.6
36	89.4	37	86.0	38	86.0	39	85.6	40	86.0	41	86.	42	86.0
43	87.2	44	86.6	45	85.5	46	81.6	47	89.0	48	70.0	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	80.2	5	89.5	6	80.7	7	86.0
8	79.1	9	86.0	10	75.0	11	81.0	12	75.0	13	76.0	14	73.2
15	[illegible]	16	[illegible]	17	85.5	18	80.0	19	85.0	20	78.1	21	84.5
22	77.4	23	[illegible]	24	79.4	25	76.4	26	73.0	27	88.4	28	88.5
29	[illegible]	30	[illegible]	31	87.2	32	88.5	33	89.6	34	88.6	35	89.0
36	[illegible]	37	[illegible]	38	85.4	39	85.1	40	86.2	41	86.0	42	85.3
43	85.9	44	[illegible]	45	85.	46	82.4	47	88.5	48	77.0	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	90.5	5	89.0	6	80.8	7	85.5
8	78.7	9	[illegible]	10	[illegible]	11	81.0	12	79.[illegible]	13	76.5	14	72.2
15	[illegible]	16	[illegible]	17	86.5	18	80.2	19	85.0	20	78.1	21	85.0
22	77.4	23	[illegible]	24	79.4	25	77.0	26	73.0	27	88.0	28	88.0
29	0.	30	0.	31	87.2	32	88.3	33	89.3	34	88.5	35	88.8
36	[illegible]	37	[illegible]	38	85.0	39	85.4	40	86.2	41	86.0	42	85.2
43	[illegible]	44	[illegible]	45	[illegible]	46	77.2	47	88.3	48	71.0	49	0.

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	88.6	4	80.5	5	88.0	6	80.2	7	87.0
8	79.5	9	[illegible]	10	77.3	11	80.5	12	74.0	13	76.3	14	73.3
15	[illegible]	16	[illegible]	17	86.0	18	80.4	19	85.5	20	78.5	21	84.0
22	77.0	23	[illegible]	24	77.5	25	77.0	26	73.7	27	88.0	28	88.0
29	0.	30	[illegible]	31	87.7	32	88.2	33	89.1	34	85.0	35	89.2
36	[illegible]	37	[illegible]	38	[illegible]	39	85.5	40	86.2	41	85.6	42	84.8
43	[illegible]	44	[illegible]	45	85.4	46	82.5	47	88.2	48	77.0	49	0.

TIME 1400 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.0	3	90.3	4	81.2	5	90.0	6	81.7	7	89.0
8	80.3	9	80.5	10	75.2	11	86.5	12	77.[illegible]	13	84.0	14	74.8
15	90.4	16	82.2	17	90.0	18	81.3	19	88.[illegible]	20	90.4	21	88.0
22	79.3	23	89.0	24	80.3	25	84.4	26	76.[illegible]	27	90.8	28	90.8
29	[illegible]	30	0.	31	90.8	32	91.5	33	91.5	34	91.4	35	91.1
36	91.8	37	89.7	38	89.6	39	89.5	40	90.1	41	89.4	42	89.0
43	90.0	44	86.8	45	85.9	46	84.1	47	91.4	48	76.0	49	0.

TIME 1500 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.8	2	91.1	3	91.0	4	80.5	5	90.5	6	82.0	7	89.0
8	79.7	9	80.5	10	75.4	11	86.5	12	76.7	13	84.1	14	74.9
15	[illegible]	16	82.3	17	90.1	18	81.0	19	89.0	20	80.2	21	88.5
22	79.5	23	89.5	24	81.[illegible]	25	84.4	26	77.0	27	91.8	28	91.4
29	[illegible]	30	[illegible]	31	91.[illegible]	32	92.3	33	92.7	34	91.6	35	91.5
36	91.9	37	90.[illegible]	38	90.0	39	90.0	40	90.1	41	89.8	42	89.2
43	91.4	44	80.9	45	90.0	46	89.0	47	92.1	48	75.6	49	0.

TIME 1600 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.2	2	91.0	3	91.5	4	80.7	5	90.5	6	81.8	7	89.5
8	80.2	9	89.7	10	80.5	11	88.0	12	77.7	13	84.0	14	75.5
15	91.0	16	82.[illegible]	17	91.0	18	82.0	19	89.2	20	79.8	21	89.0
22	79.5	23	89.5	24	81.0	25	85.0	26	78.5	27	92.1	28	92.0
29	0.	30	0.	31	91.7	32	92.9	33	93.4	34	91.8	35	91.7
36	92.0	37	90.1	38	90.0	39	90.0	40	90.4	41	90.0	42	89.6
43	91.4	44	87.0	45	90.0	46	84.3	47	92.5	48	75.4	49	0.

TIME 1700 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	80.8	3	91.5	4	80.8	5	91.0	6	81.9	7	89.5
8	80.0	9	89.0	10	79.2	11	87.5	12	77.7	13	84.5	14	75.4
15	91.0	16	82.0	17	91.0	18	81.7	19	89.5	20	80.3	21	89.0
22	79.0	23	90.0	24	80.5	25	85.5	26	78.8	27	92.0	28	89.0
29	0.	30	0.	31	91.5	32	92.7	33	93.2	34	92.0	35	92.0
36	92.3	37	90.2	38	90.1	39	90.0	40	90.8	41	90.0	42	89.5
43	91.5	44	87.0	45	90.0	46	84.3	47	92.7	48	75.0	49	0.

TIME 1800 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	80.8	3	91.0	4	80.6	5	91.5	6	82.0	7	89.2
8	79.2	9	89.5	10	79.5	11	88.0	12	77.3	13	85.0	14	75.2
15	91.2	16	81.9	17	91.5	18	81.5	19	89.5	20	80.2	21	89.0
22	79.9	23	89.5	24	79.8	25	85.0	26	78.5	27	92.7	28	84.2
29	0.	30	0.	31	91.7	32	92.2	33	92.8	34	92.4	35	92.3
36	92.5	37	90.1	38	90.0	39	90.0	40	90.9	41	90.2	42	89.8
43	91.0	44	87.0	45	90.0	46	84.8	47	92.5	48	74.6	49	0.

TIME 1900 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	80.5	3	91.0	4	80.6	5	91.0	6	81.0	7	90.0
8	80.0	9	90.0	10	79.5	11	87.0	12	76.2	13	84.5	14	75.0
15	92.5	16	81.5	17	93.0	18	81.0	19	89.0	20	79.2	21	89.0
22	78.7	23	90.0	24	80.0	25	85.5	26	77.0	27	91.8	28	84.1
29	0.	30	0.	31	91.7	32	92.2	33	92.5	34	91.7	35	91.5
36	94.0	37	90.5	38	90.3	39	90.0	40	91.[illegible]	41	90.5	42	90.1
43	91.3	44	87.5	45	90.0	46	85.0	47	92.[illegible]	48	75.0	49	0.

TIME 2000 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	81.6	3	91.0	4	80.6	5	91.0	6	81.2	7	90.0
8	79.5	9	90.0	10	79.1	11	89.0	12	78.0	13	84.5	14	75.1
15	93.0	16	81.5	17	91.5	18	90.2	19	89.5	20	80.0	21	89.7
22	79.4	23	90.0	24	71.3	25	85.5	26	77.6	27	92.0	28	90.8
29	0.	30	0.	31	91.9	32	92.2	33	92.5	34	94.0	35	93.8
36	94.4	37	90.4	38	90.4	39	90.2	40	91.8	41	91.0	42	90.2
43	91.3	44	87.5	45	90.6	46	85.1	47	92.5	48	75.0	49	0.

TIME 2100 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.2	2	91.5	3	92.7	4	81.8	5	91.9	6	82.0	7	92.2
8	80.4	9	91.5	10	75.4	11	90.7	12	79.0	13	92.7	14	77.5
15	94.0	16	83.2	17	92.2	18	81.4	19	91.5	20	81.7	21	91.0
22	80.5	23	94.0	24	81.5	25	93.[illegible]	26	[illegible]	27	94.5	28	95.5
29	0.	30	0.	31	94.7	32	94.1	33	94.[illegible]	34	95.0	35	95.4
36	95.4	37	93.2	38	93.0	39	93.1	40	94.5	41	94.2	42	94.0
43	94.5	44	89.2	45	94.0	46	86.8	47	[illegible]	48	74.5	49	0.

TIME 2200 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	82.0	3	94.0	4	82.2	5	92.0	6	81.5	7	93.8
8	81.4	9	92.0	10	75.5	11	91.5	12	76.0	13	92.5	14	77.4
15	94.8	16	84.0	17	92.5	18	81.2	19	91.0	20	81.6	21	92.0
22	80.5	23	95.0	24	82.4	25	93.0	26	80.9	27	95.3	28	86.7
29	0.	30	0.	31	95.7	32	95.0	33	94.9	34	96.4	35	96.0
36	96.0	37	94.5	38	94.4	39	94.4	40	95.2	41	94.9	42	94.6
43	95.0	44	90.0	45	94.6	46	87.0	47	96.0	48	74.5	49	0.

TIME 2300 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.0	3	94.0	4	81.9	5	92.3	6	81.4	7	94.0
8	81.3	9	92.2	10	80.0	11	92.0	12	78.4	13	92.3	14	77.4
15	94.8	16	84.0	17	92.5	18	81.0	19	94.0	20	82.2	21	92.0
22	80.0	23	94.7	24	81.5	25	95.0	26	81.7	27	95.8	28	82.2
29	0.	30	0.	31	96.0	32	96.0	33	95.2	34	96.8	35	96.0
36	96.6	37	95.0	38	95.0	39	95.0	40	96.0	41	95.0	42	95.0
43	95.5	44	90.5	45	95.0	46	88.0	47	96.2	48	75.0	49	0.

TIME 2400 DATE 5/17/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.4	3	94.0	4	82.0	5	92.5	6	81.8	7	94.0
8	81.3	9	92.2	10	80.0	11	92.0	12	78.5	13	92.5	14	77.5
15	94.5	16	84.0	17	92.5	18	81.5	19	94.0	20	82.0	21	92.2
22	80.5	23	94.7	24	81.9	25	95.2	26	81.0	27	95.5	28	91.4
29	0.	30	0.	31	95.8	32	95.5	33	95.2	34	96.3	35	95.9
36	96.0	37	95.2	38	95.0	39	95.0	40	95.6	41	95.0	42	95.0
43	95.3	44	90.1	45	95.0	46	87.8	47	96.1	48	74.2	49	0.

TIME 100 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.9	3	94.0	4	82.0	5	94.5	6	83.4	7	94.0
8	81.7	9	94.0	10	81.4	11	94.0	12	80.0	13	92.5	14	77.0
15	94.0	16	84.1	17	95.0	18	83.6	19	94.0	20	82.2	21	94.0
22	81.6	23	95.0	24	82.3	25	94.2	26	81.5	27	85.6	28	82.7
29	0.	30	0.	31	95.8	32	95.3	33	95.0	34	96.0	35	95.8
36	96.0	37	95.2	38	95.2	39	95.1	40	96.2	41	95.0	42	94.8
43	95.3	44	90.0	45	94.9	46	[illegible]	47	96.0	48	74.0	49	0.

TIME 200 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.3	3	94.4	4	82.5	5	94.5	6	83.7	7	94.0
8	81.7	9	94.0	10	81.3	11	94.0	12	80.0	13	93.0	14	77.6
15	94.4	16	94.4	17	95.0	18	83.6	19	94.0	20	82.2	21	94.0
22	81.6	23	95.0	24	82.2	25	93.5	26	80.5	27	95.2	28	92.5
29	0.	30	0.	31	95.6	32	95.2	33	95.0	34	96.0	35	95.7
36	95.8	37	95.1	38	95.1	39	95.0	40	95.3	41	95.0	42	94.9
43	95.2	44	90.0	45	94.9	46	87.8	47	95.9	48	74.0	49	0.

TIME 300 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.3	3	94.0	4	82.9	5	94.0	6	83.0	7	94.0
8	80.7	9	94.0	10	80.6	11	94.0	12	80.3	13	93.0	14	76.9
15	94.7	16	94.0	17	96.0	18	84.5	19	95.0	20	83.5	21	96.0
22	83.4	23	95.0	24	82.2	25	94.0	26	81.2	27	95.6	28	93.0
29	0.	30	0.	31	95.6	32	95.3	33	95.1	34	97.5	35	97.2
36	97.1	37	96.4	38	96.4	39	96.5	40	96.1	41	95.1	42	95.6
43	95.1	44	90.0	45	94.4	46	87.5	47	96.1	48	74.0	49	0.

TIME 400 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.3	3	94.5	4	83.4	5	94.0	6	83.3	7	94.0
8	80.9	9	94.0	10	81.5	11	94.0	12	80.2	13	93.0	14	77.6
15	95.2	16	96.0	17	96.0	18	84.5	19	95.5	20	83.7	21	96.0
22	83.4	23	95.0	24	82.2	25	92.8	26	80.5	27	95.5	28	93.5
29	0.	30	0.	31	95.5	32	95.5	33	95.2	34	97.4	35	97.3
36	97.2	37	96.5	38	96.8	39	96.9	40	95.2	41	95.2	42	95.6
43	95.2	44	90.0	45	94.2	46	87.3	47	96.[illegible]	48	74.0	49	0.

TIME 500 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.4	2	82.3	3	94.2	4	83.0	5	94.0	6	83.0	7	94.0
8	80.7	9	94.0	10	80.6	11	94.0	12	80.3	13	93.0	14	76.8
15	95.0	16	96.0	17	96.0	18	84.7	19	95.5	20	84.0	21	96.0
22	83.0	23	95.0	24	82.3	25	94.2	26	81.0	27	95.5	28	83.5
29	0.	30	0.	31	95.5	32	95.4	33	95.0	34	97.0	35	97.0
36	97.2	37	96.0	38	96.4	39	95.6	40	95.0	41	95.0	42	95.4
43	95.0	44	90.0	45	94.9	46	87.3	47	95.9	48	74.0	49	0.

TIME 600 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	82.5	3	94.0	4	83.0	5	94.0	6	83.0	7	93.5
8	80.5	9	94.0	10	80.6	11	94.0	12	80.3	13	92.6	14	77.3
15	94.5	16	96.0	17	96.0	18	84.5	19	95.0	20	83.6	21	96.0
22	83.7	23	95.0	24	82.5	25	94.0	26	81.2	27	95.5	28	94.6
29	0.	30	0.	31	95.5	32	95.4	33	95.0	34	97.0	35	97.0
36	96.4	37	96.0	38	96.4	39	96.5	40	95.0	41	95.0	42	95.4
43	95.0	44	90.0	45	93.8	46	87.4	47	95.9	48	74.0	49	0.

TIME 700 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	82.2	3	94.0	4	83.2	5	94.0	6	83.3	7	93.5
8	80.8	9	94.0	10	80.6	11	94.0	12	80.3	13	92.5	14	77.6
15	94.5	16	96.0	17	96.0	18	84.4	19	95.0	20	83.8	21	96.0
22	83.8	23	94.0	24	81.3	25	93.2	26	81.4	27	95.2	28	93.5
29	0.	30	0.	31	95.4	32	95.3	33	95.0	34	96.8	35	96.8
36	97.0	37	95.8	38	96.2	39	95.0	40	95.0	41	94.8	42	95.2
43	94.9	44	90.0	45	93.9	46	[illegible]	47	96.0	48	74.0	49	0.

TIME 800 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.9	3	94.0	4	83.0	5	[illegible]	6	82.9	7	93.0
8	80.7	9	94.0	10	80.9	11	94.0	12	80.[illegible]	13	93.0	14	78.0
15	94.7	16	87.3	17	96.0	18	86.1	19	[illegible]	20	84.7	21	95.5
22	83.8	23	95.0	24	86.0	25	94.0	26	81.7	27	95.3	28	93.6
29	0.	30	0.	31	95.5	32	95.7	33	[illegible]	34	97.0	35	96.8
36	97.0	37	95.9	38	96.2	39	96.4	40	[illegible]	41	95.0	42	95.3
43	95.0	44	90.0	45	93.9	46	87.2	47	[illegible]	48	74.0	49	0.

TIME 900 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	82.3	3	94.0	4	83.2	[illegible]	[illegible]	6	83.6	7	93.8
8	80.9	9	94.0	10	80.7	11	94.0	[illegible]	[illegible]	13	92.8	14	77.9
15	94.8	16	87.0	17	96.0	18	85.4	[illegible]	[illegible]	20	84.9	21	95.5
22	83.7	23	95.0	24	82.4	25	93.7	[illegible]	[illegible]	27	81.0	28	93.9
29	0.	30	0.	31	95.6	32	95.3	33	[illegible]	34	96.7	35	9.8
36	96.0	37	95.6	38	96.2	39	96.1	[illegible]	[illegible]	41	96.2	42	95.1
43	94.9	44	90.0	45	93.8	46	87.7	47	[illegible]	48	74.0	49	0.

TIME 1000 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.5	2	82.3	3	94.0	4	83.4	5	94.0	6	83.3	7	94.0
8	80.9	9	94.0	10	80.6	11	94.0	12	80.2	13	93.0	14	77.6
15	95.2	16	96.0	17	96.0	18	84.5	19	95.5	20	83.7	21	96.0
22	83.4	23	95.0	24	82.2	25	92.8	26	80.5	27	95.5	28	93.5
29	0.	30	0.	31	95.5	32	95.5	33	95.2	34	97.4	35	97.3
36	97.2	37	96.5	38	96.8	39	96.9	40	95.2	41	95.2	42	95.6
43	95.2	44	90.0	45	94.2	46	87.3	47	96.[illegible]	48	74.0	49	0.

TIME 1100 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.3	2	80.5	3	93.0	4	81.4	5	93.5	6	81.5	7	92.8
8	79.1	9	93.5	10	80.0	11	93.5	12	80.3	13	92.[illegible]	14	76.5
15	93.4	16	85.6	17	95.0	18	84.6	19	93.8	20	83.1	21	94.5
22	82.5	23	94.0	24	80.0	25	93.0	26	[illegible]	27	94.5	28	93.3
29	0.	30	0.	31	94.8	32	94.1	33	[illegible]	34	95.[illegible]	35	95.9
36	96.0	37	94.8	38	95.2	39	95.4	40	94.[illegible]	41	94.1	42	94.5
43	94.1	44	89.1	45	93.5	46	87.1	47	95.0	48	73.8	49	0.

TIME 1200 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.2	3	93.0	4	81.0	5	93.5	6	81.8	7	91.0
8	79.4	9	93.5	10	80.2	11	93.5	12	80.4	13	92.5	14	76.1
15	93.5	16	85.7	17	95.0	18	84.3	19	93.8	20	83.1	21	94.0
22	82.5	23	94.0	24	80.6	25	93.3	26	81.5	27	94.4	28	93.4
29	0.	30	0.	31	94.7	32	94.2	33	[illegible]	34	96.0	35	96.0
36	96.0	37	94.9	38	95.3	39	95.5	40	[illegible]	41	94.1	42	94.5
43	93.7	44	89.5	45	93.5	46	87.1	47	[illegible]	48	73.8	49	0.

TIME 1300 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	80.6	3	93.0	4	80.[illegible]	5	94.0	6	82.[illegible]	7	93.0
8	79.7	9	93.5	10	80.3	11	[illegible]	12	80.7	13	92.8	14	77.0
15	93.8	16	86.2	17	95.5	18	[illegible]	19	94.0	20	83.3	21	94.0
22	82.7	23	93.0	24	79.7	25	[illegible]	26	82.0	27	94.7	28	93.6
29	0.	30	0.	31	94.9	32	[illegible]	33	94.0	34	95.8	35	96.0
36	96.0	37	95.0	38	95.5	39	95.[illegible]	40	94.4	41	94.2	42	94.7
43	94.1	44	89.5	45	93.1	46	[illegible]	47	[illegible]	48	73.7	49	0.

TIME 1400 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	80.9	3	93.8	4	[illegible]	5	[illegible]	6	32.4	7	93.0
8	79.8	9	94.0	10	80.9	[illegible]	[illegible]	[illegible]	[illegible]	13	92.8	14	77.1
15	93.8	16	86.3	17	95.5	[illegible]	[illegible]	[illegible]	[illegible]	20	83.6	21	94.5
22	83.3	23	95.0	24	81.8	[illegible]	[illegible]	[illegible]	[illegible]	27	95.1	28	94.2
29	0.	30	0.	31	95.8	32	[illegible]	[illegible]	[illegible]	34	96.0	35	95.0
36	96.1	37	95.0	38	95.7	[illegible]	[illegible]	40	94.5	41	94.3	42	94.8
43	[illegible]	44	89.7	45	93.0	[illegible]	[illegible]	47	95.9	48	74.0	49	0.

TIME 1500 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.1	3	94.2	4	81.2	5	94.0	6	82.4	7	93.0
8	80.0	9	93.5	10	80.6	11	93.5	12	81.3	13	92.5	14	77.3
15	94.0	16	86.5	17	95.5	18	85.0	19	94.0	20	83.8	21	94.5
22	83.2	23	95.0	24	81.8	25	93.3	26	81.8	27	96.4	28	93.0
29	0.	30	0.	31	95.8	32	96.0	33	95.5	34	96.1	35	96.2
36	96.5	37	95.3	38	95.8	39	95.9	40	94.8	41	94.3	42	95.0
43	95.2	44	90.0	45	93.0	46	87.0	47	96.2	48	74.0	49	0.

TIME 1800 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	80.9	3	94.0	4	79.8	5	94.0	6	82.6	7	93.0
8	80.0	9	94.0	10	80.9	11	93.5	12	80.9	13	93.0	14	77.5
15	94.2	16	87.0	17	95.0	18	81.8	19	94.2	20	83.8	21	95.0
22	84.0	23	94.8	24	81.9	25	94.2	26	82.8	27	95.3	28	85.7
29	0.	30	0.	31	95.5	32	95.5	33	95.0	34	96.0	35	96.2
36	96.5	37	96.0	38	96.0	39	96.0	40	94.5	41	94.2	42	94.9
43	95.0	44	89.8	45	92.7	46	86.7	47	96.0	48	73.7	49	0.

TIME 1700 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.8	2	81.4	3	94.0	4	81.9	5	93.5	6	82.4	7	93.0
8	80.0	9	93.0	10	80.2	11	93.5	12	80.8	13	92.5	14	77.7
15	94.0	16	86.5	17	95.0	18	85.2	19	94.2	20	83.5	21	95.0
22	83.3	23	94.0	24	81.5	25	92.5	26	82.0	27	94.7	28	85.7
29	0.	30	0.	31	95.2	32	95.3	33	95.0	34	96.0	35	96.0
36	96.2	37	95.0	38	95.7	39	95.8	40	94.2	41	94.0	42	94.7
43	94.3	44	90.0	45	91.8	46	86.7	47	95.5	48	73.5	49	0.

TIME 1800 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	81.1	3	93.7	4	81.7	5	94.0	6	82.9	7	92.8
8	80.0	9	93.5	10	80.6	11	94.0	12	81.5	13	92.0	14	77.2
15	94.0	16	86.5	17	95.5	18	85.7	19	94.0	20	83.2	21	95.0
22	83.2	23	93.0	24	80.5	25	92.0	26	80.0	27	94.2	28	85.2
29	0.	30	0.	31	95.0	32	95.2	33	94.9	34	96.0	35	96.0
36	96.3	37	95.2	38	95.7	39	95.7	40	94.6	41	94.0	42	94.9
43	94.4	44	90.0	45	93.0	46	87.5	47	95.5	48	73.0	49	0.

TIME 1900 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.3	3	93.8	4	81.8	5	93.5	6	82.5	7	93.7
8	80.6	9	94.0	10	81.0	11	94.5	12	81.5	13	93.2	14	77.8
15	94.0	16	86.8	17	95.5	18	85.6	19	94.5	20	84.0	21	95.5
22	84.0	23	94.8	24	82.0	25	94.0	26	81.0	27	94.5	28	85.0
29	0.	30	0.	31	95.2	32	95.1	33	94.8	34	96.2	35	96.5
36	96.5	37	95.8	38	96.0	39	96.2	40	94.8	41	94.9	42	95.0
43	94.5	44	89.8	45	93.5	46	87.2	47	95.5	48	72.7	49	0.

TIME 2000 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	80.8	3	93.5	4	81.8	5	94.0	6	82.8	7	94.0
8	80.9	9	93.8	10	80.7	11	93.5	12	80.5	13	93.0	14	77.6
15	94.0	16	86.8	17	95.0	18	85.4	19	94.7	20	83.7	21	95.0
22	83.2	23	94.0	24	81.0	25	93.0	26	80.5	27	94.2	28	84.8
29	0.	30	0.	31	95.0	32	94.8	33	94.3	34	96.0	35	96.0
36	96.2	37	95.9	38	96.0	39	96.2	40	94.1	41	94.3	42	94.7
43	94.2	44	89.5	45	93.2	46	87.0	47	95.3	48	72.5	49	0.

TIME 2100 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.7	2	81.6	3	93.2	4	81.6	5	93.5	6	82.7	7	93.0
8	80.0	9	94.0	10	81.0	11	93.5	12	80.0	13	93.0	14	77.3
15	94.2	16	85.7	17	95.5	18	84.3	19	94.5	20	83.4	21	95.5
22	83.5	23	94.0	24	81.3	25	93.0	26	80.5	27	94.4	28	85.1
29	0.	30	0.	31	95.0	32	94.6	33	94.1	34	96.0	35	96.0
36	96.2	37	95.8	38	95.9	39	95.9	40	94.7	41	94.3	42	94.0
43	94.3	44	89.5	45	94.0	46	87.7	47	95.3	48	72.8	49	0.

TIME 2200 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.7	2	81.0	3	93.0	4	81.0	5	93.8	6	82.6	7	93.0
8	80.0	9	93.2	10	80.0	11	93.0	12	80.0	13	93.0	14	77.3
15	93.5	16	83.9	17	93.5	18	82.3	19	93.5	20	82.1	21	93.5
22	81.5	23	94.0	24	81.0	25	94.1	26	81.2	27	94.0	28	84.8
29	0.	30	0.	31	95.0	32	94.5	33	94.0	34	94.5	35	94.2
36	94.1	37	94.2	38	94.6	39	94.5	40	94.2	41	93.9	42	93.9
43	94.2	44	89.7	45	93.7	46	87.8	47	95.2	48	73.0	49	0.

TIME 2300 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	80.8	3	93.0	4	81.1	5	93.2	6	82.0	7	92.8
8	79.2	9	93.0	10	79.7	11	93.5	12	79.9	13	92.8	14	77.1
15	92.5	16	83.4	17	93.2	18	81.7	19	93.0	20	81.7	21	93.5
22	81.8	23	93.0	24	80.0	25	93.5	26	81.0	27	94.0	28	84.5
29	0.	30	0.	31	94.7	32	94.2	33	94.0	34	94.5	35	94.1
36	94.5	37	94.2	38	94.5	39	94.5	40	94.1	41	94.0	42	94.0
43	94.2	44	89.7	45	94.0	46	88.2	47	95.2	48	73.0	49	0.

TIME 2400 DATE 5/18/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.3	3	91.0	4	80.1	5	91.5	6	80.9	7	89.0
8	77.4	9	88.0	10	77.8	11	88.0	12	76.5	13	84.5	14	74.7
15	91.5	16	81.6	17	91.0	18	80.2	19	91.0	20	79.9	21	91.0
22	79.9	23	88.0	24	78.7	25	85.2	26	77.0	27	90.2	28	83.0
29	0.	30	0.	31	90.9	32	91.2	33	91.0	34	92.1	35	91.8
36	92.3	37	91.8	38	91.9	39	91.5	40	89.9	41	88.8	42	88.3
43	90.3	44	87.0	45	89.7	46	86.2	47	91.2	48	72.0	49	0.

TIME 100 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.3	3	89.0	4	79.5	5	90.0	6	80.5	7	88.0
8	78.0	9	87.0	10	76.9	11	87.0	12	76.5	13	84.2	14	74.7
15	90.0	16	81.3	17	89.5	18	79.6	19	90.0	20	80.0	21	90.0
22	79.8	23	88.0	24	78.7	25	84.0	26	76.4	27	89.6	28	82.2
29	0.	30	0.	31	89.7	32	90.0	33	89.8	34	90.6	35	90.6
36	91.0	37	90.8	38	90.8	39	90.7	40	88.6	41	87.9	42	87.4
43	89.0	44	86.2	45	88.8	46	85.4	47	90.4	48	73.0	49	0.

TIME 200 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.6	3	89.0	4	80.0	5	89.5	6	80.7	7	88.5
8	79.0	9	86.5	10	79.1	11	87.0	12	76.8	13	84.6	14	75.7
15	90.0	16	81.6	17	89.5	18	80.1	19	89.5	20	80.4	21	90.0
22	80.4	23	88.0	24	79.0	25	84.4	26	72.2	27	89.0	28	82.2
29	0.	30	0.	31	89.6	32	89.8	33	89.5	34	90.4	35	90.3
36	90.8	37	90.4	38	90.5	39	90.3	40	88.5	41	87.5	42	87.0
43	88.9	44	86.0	45	88.5	46	85.4	47	90.0	48	73.0	49	0.

TIME 300 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.4	3	88.5	4	79.9	5	89.5	6	81.0	7	87.5
8	78.2	9	87.0	10	77.5	11	87.0	12	77.2	13	84.5	14	75.2
15	89.5	16	91.2	17	89.5	18	80.3	19	89.5	20	80.4	21	90.0
22	80.4	23	88.0	24	78.7	25	84.9	26	77.4	27	89.1	28	82.2
29	0.	30	0.	31	89.3	32	89.4	33	89.3	34	90.1	35	90.1
36	90.6	37	90.2	38	90.1	39	90.1	40	88.4	41	87.5	42	87.0
43	88.5	44	86.0	45	88.2	46	85.3	47	89.9	48	73.0	49	0.

TIME 400 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.5	3	88.5	4	79.8	5	89.0	6	80.5	7	87.3
8	78.4	9	86.5	10	77.3	11	86.8	12	77.2	13	84.0	14	75.2
15	89.5	16	81.3	17	89.5	18	80.4	19	89.5	20	80.6	21	89.5
22	80.2	23	88.0	24	80.0	25	84.0	26	76.0	27	88.8	28	82.0
29	0.	30	0.	31	89.0	32	89.2	33	88.1	34	90.1	35	90.1
36	90.2	37	90.0	38	90.0	39	90.8	40	88.2	41	87.8	42	87.2
43	88.8	44	85.7	45	88.1	46	85.2	47	89.9	48	72.8	49	0.

TIME 500 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	78.4	3	88.5	4	78.1	5	89.5	6	80.9	7	87.2
8	77.5	9	86.5	10	77.1	11	86.5	12	76.7	13	84.6	14	75.5
15	89.5	16	78.6	17	89.0	18	79.9	19	89.5	20	79.0	21	89.5
22	80.2	23	88.0	24	79.4	25	85.2	26	77.0	27	89.0	28	82.0
29	0.	30	0.	31	89.3	32	89.4	33	89.2	34	90.2	35	90.2
36	90.5	37	90.1	38	90.1	39	90.0	40	88.4	41	87.6	42	87.2
43	89.0	44	85.0	45	88.4	46	85.2	47	90.0	48	72.7	49	0.

TIME 600 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.5	3	89.0	4	80.3	5	89.5	6	80.8	7	87.5
8	78.4	9	86.0	10	78.2	11	88.0	12	77.6	13	84.7	14	75.0
15	90.5	16	83.5	17	91.0	18	80.0	19	90.0	20	80.4	21	90.5
22	79.8	23	88.0	24	78.9	25	85.6	26	77.4	27	89.3	28	82.0
29	0.	30	0.	31	89.1	32	89.5	33	89.4	34	81.5	35	82
36	82.2	37	90.8	38	91.2	39	91.3	40	88.0	41	88.2	42	89.0
43	88.8	44	85.5	45	87.2	46	84.8	47	89.5	48	72.5	49	0.

TIME 700 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.7	3	89.0	4	80.4	5	89.0	6	80.4	7	87.5
8	78.4	9	87.5	10	77.6	11	88.0	12	77.8	13	84.0	14	75.2
15	90.5	16	83.0	17	91.5	18	83.2	19	90.0	20	79.8	21	90.5
22	79.8	23	88.0	24	79.4	25	84.0	26	76.2	27	89.0	28	82.0
29	0.	30	0.	31	89.0	32	89.5	33	89.6	34	91.4	35	92.2
36	92.4	37	90.0	38	91.3	39	91.5	40	88.0	41	88.2	42	89.1
43	88.9	44	85.8	45	82.4	46	84.9	47	90.0	48	92.5	49	0.

TIME 800 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	80.0	3	89.0	4	80.9	5	89.5	6	81.2	7	87.5
8	78.8	9	88.0	10	78.8	11	88.0	12	78.3	13	84.3	14	75.8
15	90.7	16	83.7	17	91.5	18	83.3	19	90.5	20	80.8	21	91.0
22	80.9	23	89.5	24	81.0	25	85.8	26	77.6	27	89.6	28	82.8
29	0.	30	0.	31	89.4	32	90.0	33	90.0	34	91.9	35	92.6
36	92.8	37	91.2	38	91.8	39	91.9	40	88.4	41	88.9	42	89.7
43	89.0	44	86.0	45	87.5	46	85.0	47	90.0	48	72.7	49	0.

TIME 900 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	80.5	3	89.4	4	81.4	5	90.0	6	81.9	7	87.9
8	79.4	9	88.0	10	78.8	11	88.0	12	78.0	13	84.5	14	76.2
15	91.0	16	84.2	17	92.0	18	84.2	19	90.8	20	81.4	21	91.0
22	81.0	23	89.5	24	81.5	25	85.0	26	77.0	27	89.8	28	83.0
29	0.	30	0.	31	89.6	32	90.1	33	90.1	34	92.0	35	92.8
36	93.0	37	91.4	38	92.0	39	92.0	40	88.7	41	89.0	42	90.0
43	89.3	44	86.2	45	87.8	46	85.1	47	90.4	48	72.6	49	0.

TIME 1000 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.6	2	80.1	3	89.0	4	80.8	5	90.0	6	81.6	7	87.6
8	78.9	9	88.0	10	79.0	11	88.0	12	78.6	13	84.5	14	75.4
15	91.0	16	85.0	17	92.0	18	83.4	19	90.5	20	81.0	21	91.0
22	81.2	23	89.0	24	81.1	25	85.5	26	78.7	27	89.7	28	82.8
29	0.	30	0.	31	89.3	32	90.0	33	90.0	34	92.4	35	93.0
36	93.0	37	91.3	38	91.8	39	92.0	40	88.6	41	88.9	42	89.7
43	89.1	44	86.0	45	87.5	46	85.0	47	90.2	48	72.6	49	0.

TIME 1100 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	80.3	3	89.0	4	80.3	5	89.5	6	80.9	7	87.5
8	78.5	9	88.0	10	78.8	11	88.0	12	78.4	13	84.5	14	76.1
15	91.0	16	84.1	17	92.0	18	83.9	19	91.5	20	82.5	21	92.0
22	84.8	23	89.5	24	81.5	25	84.9	26	77.8	27	89.7	28	82.7
29	0.	30	0.	31	89.5	32	90.0	33	90.0	34	91.3	35	92.8
36	92.9	37	91.5	38	93.3	39	93.0	40	88.3	41	88.4	42	89.2
43	89.1	44	86.0	45	87.4	46	84.7	47	90.1	48	72.5	49	0.

TIME 1200 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	80.0	3	89.8	4	81.1	5	90.0	6	81.6	7	88.0
8	79.2	9	88.0	10	78.3	11	88.0	12	78.3	13	84.5	14	75.3
15	90.8	16	83.6	17	92.0	18	83.7	19	91.0	20	81.5	21	91.0
22	80.8	23	89.5	24	81.5	25	85.0	26	78.2	27	89.8	28	82.8
29	0.	30	0.	31	89.8	32	90.4	33	90.5	34	91.3	35	92.4
36	92.8	37	91.2	38	91.8	39	91.9	40	88.6	41	88.8	42	89.3
43	89.2	44	86.0	45	88.0	46	84.9	47	90.9	48	72.5	49	0.

TIME 1300 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.9	3	90.0	4	80.4	5	90.0	6	81.4	7	88.0
8	79.0	9	88.0	10	78.5	11	88.0	12	78.1	13	84.5	14	74.7
15	91.0	16	83.7	17	92.0	18	83.3	19	90.5	20	81.5	21	90.5
22	80.8	23	89.5	24	81.0	25	85.3	26	77.6	27	90.0	28	83.3
29	0.	30	0.	31	90.0	32	90.5	33	90.4	34	91.2	35	92.3
36	93.0	37	90.8	38	91.5	39	91.5	40	88.5	41	88.5	42	89.4
43	89.0	44	86.0	45	87.0	46	84.7	47	90.3	48	72.8	49	0.

TIME 1400 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	78.8	3	88.0	4	80.4	5	88.0	6	80.3	7	84.8
8	77.6	9	84.0	10	76.6	11	84.0	12	76.2	13	77.8	14	74.3
15	89.0	16	81.4	17	90.0	18	81.7	19	88.0	20	79.9	21	88.5
22	80.0	23	85.5	24	79.0	25	78.3	26	74.2	27	87.3	28	82.0
29	0.	30	0.	31	86.3	32	86.1	33	88.1	34	88.0	35	90.0
36	90.8	37	87.8	38	88.9	39	89.2	40	84.0	41	84.7	42	84.5
43	85.4	44	83.0	45	82.8	46	81.8	47	87.5	48	72.4	49	0.

TIME 1500 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	87.0	4	79.6	5	86.5	6	79.6	7	84.0
8	77.5	9	[illegible]	10	[illegible]	11	83.0	12	75.9	13	77.5	14	74.0
15	78.7	16	72.0	17	[illegible]	18	81.0	19	67.9	20	79.8	21	87.5
22	79.5	23	74.5	24	75.7	25	78.1	26	74.8	27	86.9	28	82.0
29	0.	30	0.	31	85.4	32	87.3	33	87.2	34	87.5	35	84.8
36	80.4	37	81.3	38	81.4	39	88.7	40	83.6	41	84.1	42	86.0
43	85.5	44	85.5	45	82.2	46	81.2	47	86.8	48	73.0	49	0.

TIME 1600 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.5	2	78.4	3	86.0	4	79.3	5	86.0	6	79.4	7	83.0
8	75.5	9	83.0	10	76.6	11	83.0	12	76.5	13	76.8	14	73.8
15	79.4	16	77.5	17	88.7	18	81.3	19	86.5	20	79.3	21	87.0
22	79.5	23	84.5	24	75.1	25	77.0	26	74.0	27	85.6	28	81.4
29	72.5	30	84.1	31	84.5	32	86.5	33	86.5	34	86.5	35	88.8
36	84.5	37	86.3	38	87.3	39	87.5	40	83.1	41	83.1	42	85.0
43	84.6	44	82.5	45	81.3	46	81.0	47	85.5	48	72.7	49	0.

TIME 1700 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	78.0	3	85.4	4	78.9	5	86.0	6	79.5	7	82.0
8	76.0	9	82.5	10	76.4	11	82.5	12	75.5	13	76.0	14	73.1
15	80.0	16	82.6	17	84.0	18	82.7	19	86.0	20	79.2	21	87.0
22	79.7	23	82.8	24	77.2	25	77.0	26	73.5	27	85.0	28	81.5
29	72.3	30	82.2	31	84.4	32	86.0	33	86.0	34	86.0	35	89.3
36	79.5	37	84.2	38	87.2	39	87.4	40	82.4	41	83.0	42	84.8
43	84.0	44	82.5	45	80.2	46	81.0	47	85.1	48	72.6	49	0.

TIME 1800 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.9	3	85.0	4	78.7	5	86.0	6	79.7	7	82.0
8	76.0	9	82.0	10	76.4	11	81.5	12	75.5	13	76.0	14	73.2
15	87.5	16	81.0	17	87.5	18	80.8	19	85.5	20	78.9	21	86.0
22	79.2	23	86.0	24	80.4	25	77.0	26	73.9	27	85.0	28	81.8
29	71.9	30	81.8	31	84.5	32	86.0	33	86.0	34	86.2	35	88.0
36	84.0	37	86.0	38	86.3	39	86.9	40	82.6	41	82.9	42	84.1
43	84.0	44	82.6	45	81.3	46	81.3	47	85.2	48	72.1	49	0.

TIME 1900 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.7	3	85.5	4	78.6	5	84.5	6	78.6	7	82.0
8	75.9	9	82.0	10	76.1	11	81.8	12	75.5	13	76.0	14	73.4
15	87.0	16	80.5	17	87.8	18	80.8	19	85.8	20	78.9	21	86.0
22	79.5	23	84.1	24	78.6	25	76.8	26	73.7	27	85.5	28	81.6
29	72.8	30	84.0	31	84.5	32	86.2	33	86.4	34	86.0	35	88.3
36	89.0	37	86.0	38	87.0	39	87.0	40	82.3	41	83.0	42	84.5
43	84.0	44	82.5	45	81.0	46	80.9	47	85.2	48	72.2	49	0.

TIME 2000 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.6	3	85.5	4	78.3	5	86.0	6	79.6	7	82.4
8	76.2	9	82.3	10	76.3	11	81.8	12	75.2	13	75.5	14	73.0
15	87.0	16	80.5	17	87.5	18	80.5	19	86.0	20	79.0	21	86.0
22	78.9	23	83.0	24	77.6	25	76.2	26	72.9	27	85.2	28	82.5
29	73.0	30	84.0	31	84.0	32	86.0	33	86.5	34	86.0	35	88.2
36	89.0	37	86.2	38	87.1	39	87.2	40	82.0	41	83.0	42	84.9
43	84.0	44	82.5	45	81.5	46	81.3	47	85.3	48	71.8	49	0.

TIME 2100 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.5	2	77.1	3	85.0	4	78.3	5	85.0	6	78.7	7	82.0
8	75.9	9	82.0	10	76.0	11	81.0	12	74.8	13	75.0	14	72.5
15	87.0	16	80.3	17	87.0	18	79.9	19	85.5	20	78.1	21	86.0
22	78.9	23	82.8	24	77.3	25	76.0	26	72.5	27	84.9	28	82.0
29	72.2	30	82.8	31	84.0	32	85.5	33	85.8	34	85.5	35	89.9
36	88.5	37	85.6	38	86.7	39	87.0	40	81.5	41	82.4	42	84.1
43	83.5	44	82.0	45	81.0	46	81.0	47	85.0	48	71.7	49	0.

TIME 2200 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.4	2	76.0	3	84.7	4	78.1	5	85.0	6	78.7	7	83.0
8	75.9	9	81.5	10	75.5	11	81.0	12	74.7	13	75.0	14	[illegible]
15	86.5	16	74.9	17	87.0	18	79.9	19	85.5	20	78.1	21	[illegible]
22	78.1	23	83.0	24	77.0	25	75.8	26	72.8	27	84.5	28	[illegible]
29	71.0	30	80.1	31	83.8	32	85.5	33	85.5	34	85.3	35	[illegible]
36	88.5	37	85.7	38	86.5	39	86.5	40	82.0	41	82.2	42	[illegible]
43	83.5	44	82.2	45	81.0	46	81.3	47	85.0	48	72.0	49	0.

TIME 2300 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.7	3	85.0	4	78.6	5	85.0	6	78.7	7	[illegible]
8	75.9	9	82.0	10	76.0	11	81.0	12	75.0	13	75.2	14	72.7
15	86.8	16	80.1	17	87.0	18	80.1	19	85.5	20	78.1	21	86.0
22	78.9	23	84.1	24	78.6	25	75.8	26	72.9	27	84.3	28	80.1
29	71.0	30	80.2	31	84.0	32	85.3	33	85.4	34	85.1	35	[illegible]
36	88.2	37	85.8	38	86.5	39	86.9	40	81.5	41	82.4	42	84.1
43	83.9	44	82.1	45	81.1	46	81.1	47	85.0	48	71.5	49	0.

TIME 2400 DATE 5/19/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.5	2	77.2	3	84.5	4	77.8	5	85.0	6	78.7	7	[illegible]
8	75.9	9	82.0	10	76.4	11	81.0	12	74.5	13	75.0	14	[illegible]
15	86.5	16	79.6	17	87.0	18	79.4	19	85.5	20	78.1	21	[illegible]
22	78.1	23	82.8	24	77.1	25	75.6	26	75.6	27	84.5	28	[illegible]
29	0.	30	0.	31	84.0	32	85.0	33	85.1	34	85.1	35	[illegible]
36	87.9	37	85.8	38	86.1	39	86.0	40	83.2	41	82.4	42	[illegible]
43	84.0	44	83.2	45	83.0	46	82.0	47	85.0	48	81.0	49	0.

TIME 100 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.8	3	84.0	4	77.6	5	84.0	6	[illegible]	7	82.0
8	76.0	9	80.0	10	75.3	11	79.0	12	73.9	13	[illegible]	14	73.2
15	85.9	16	79.0	17	84.0	18	77.6	19	84.2	20	[illegible]	21	[illegible]
22	76.4	23	79.7	24	79.7	25	77.0	26	72.4	27	[illegible]	28	80.0
29	0.	30	0.	31	83.6	32	84.9	33	85.0	34	[illegible]	35	85.7
36	85.9	37	85.0	38	84.9	39	89.8	40	83.0	41	82.0	42	[illegible]
43	84.2	44	82.2	45	83.0	46	82.0	47	85.0	48	71.4	49	0.

TIME 200 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.3	3	84.0	4	77.3	5	85.0	6	[illegible]	7	[illegible]
8	75.5	9	81.0	10	75.5	11	80.0	12	74.1	13	[illegible]	14	[illegible]
15	85.5	16	78.9	17	84.0	18	77.2	19	84.0	20	[illegible]	21	[illegible]
22	77.0	23	[illegible]	24	78.9	25	76.2	26	72.0	27	85.0	28	[illegible]
29	0.	30	0.	31	84.0	32	85.0	33	85.1	34	[illegible]	35	[illegible]
36	85.2	37	85.2	38	85.2	39	85.0	40	83.4	41	82.4	42	[illegible]
43	84.2	44	0.	45	83.0	46	82.4	47	85.4	48	[illegible]	49	0.

TIME 300 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.3	3	84.0	4	77.4	5	85.0	6	78.2	7	83.0
8	[illegible]	9	[illegible]	10	75.6	11	80.0	12	73.9	13	76.0	14	72.5
15	[illegible]	16	[illegible]	17	84.0	18	77.1	19	84.5	20	77.6	21	84.0
22	76.7	23	[illegible]	24	76.5	25	76.2	26	72.5	27	85.0	28	80.4
29	0.	30	0.	31	84.8	32	85.3	33	85.2	34	85.5	35	85.8
36	86.3	37	85.5	38	85.5	39	85.0	40	84.2	41	83.5	42	82.5
43	84.0	44	83.0	45	83.6	46	82.4	47	85.7	48	71.5	49	0.

TIME 400 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.0	3	85.5	4	77.8	5	85.0	6	78.0	7	82.5
8	75.7	9	81.0	10	75.0	11	80.0	12	73.9	13	76.0	14	72.7
15	85.5	16	78.6	17	84.0	18	77.0	19	85.0	20	77.9	21	84.0
22	76.7	23	82.8	24	76.9	25	76.2	26	77.6	27	84.8	28	80.0
29	0.	30	0.	31	85.0	32	85.3	33	85.5	34	85.4	35	85.7
36	86.2	37	85.4	38	85.2	39	85.0	40	83.4	41	82.4	42	81.4
43	84.6	44	83.0	45	83.8	46	82.7	47	85.6	48	70.9	49	0.

TIME 500 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	77.4	3	85.0	4	77.4	5	86.0	6	78.8	7	83.5
8	76.3	9	82.0	10	75.6	11	80.0	12	73.8	13	76.0	14	72.3
15	85.0	16	78.9	17	85.0	18	77.6	19	84.5	20	77.3	21	84.0
22	76.4	23	82.8	24	76.5	25	76.5	26	72.5	27	85.1	28	79.9
29	0.	30	0.	31	85.0	32	85.0	33	86.5	34	85.8	35	86.0
36	86.4	37	85.5	38	85.5	39	85.0	40	83.6	41	82.8	42	81.6
43	85.1	44	83.1	45	83.8	46	82.2	47	85.5	48	70.6	49	0.

TIME 600 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	77.5	3	85.5	4	77.5	5	86.0	6	78.6	7	83.0
8	76.0	9	82.0	10	75.8	11	80.0	12	73.7	13	76.5	14	72.6
15	86.0	16	78.9	17	85.0	18	77.6	19	85.0	20	77.7	21	84.0
22	77.5	23	84.1	24	77.9	25	77.0	26	73.0	27	85.5	28	80.1
29	0.	30	0.	31	85.5	32	86.3	33	86.6	34	86.0	35	86.0
36	86.5	37	85.7	38	85.4	39	85.2	40	84.3	41	83.0	42	81.9
43	85.4	44	83.3	45	84.0	46	82.4	47	86.0	48	71.0	49	0.

TIME 700 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	77.0	3	86.0	4	78.4	5	86.0	6	78.7	7	83.0
8	76.0	9	82.0	10	75.8	11	81.0	12	74.7	13	77.0	14	73.4
15	86.0	16	78.8	17	85.5	18	78.3	19	85.5	20	77.7	21	84.5
22	77.5	23	82.8	24	76.5	25	77.1	26	73.6	27	86.0	28	80.6
29	0.	30	0.	31	85.4	32	86.5	33	86.6	34	86.3	35	86.4
36	87.0	37	85.5	38	86.0	39	85.5	40	84.0	41	83.0	42	82.0
43	85.6	44	83.6	45	84.0	46	[illegible]	47	86.6	48	70.8	49	0.

TIME 800 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.5	2	77.0	3	86.0	4	78.5	5	86.5	6	79.1	7	83.0
8	76.2	9	82.0	10	76.0	11	80.5	12	74.2	13	76.5	14	73.0
15	86.5	16	77.1	17	86.0	18	78.7	19	85.3	20	78.0	21	84.5
22	77.2	23	84.0	24	77.8	25	77.0	26	73.8	27	86.0	28	80.8
29	0.	30	0.	31	86.0	32	86.7	33	86.7	34	86.6	35	86.6
36	87.0	37	86.0	38	86.2	39	85.8	40	84.2	41	83.1	42	82.1
43	86.0	44	83.0	45	84.3	46	82.5	47	86.8	48	71.0	49	0.

TIME 1000 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.2	2	77.3	3	86.0	4	78.3	5	86.5	6	78.6	7	83.2
8	76.0	9	82.0	10	75.6	11	81.5	12	74.9	13	76.4	14	72.7
15	87.0	16	78.9	17	86.0	18	78.2	19	85.8	20	77.9	21	84.5
22	76.8	23	83.5	24	75.0	25	77.3	26	73.0	27	86.4	28	80.0
29	0.	30	0.	31	86.0	32	86.6	33	86.8	34	87.0	35	87.1
36	87.6	37	85.5	38	86.5	39	86.0	40	84.6	41	83.5	42	82.5
43	85.8	44	83.7	45	84.3	46	82.7	47	86.9	48	71.0	49	0.

TIME 1100 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	77.5	3	85.5	4	77.5	5	86.0	6	78.2	7	82.5
8	75.5	9	82.0	10	75.0	11	80.0	12	74.1	13	74.5	14	71.9
15	86.2	16	79.9	17	85.0	18	77.5	19	84.0	20	77.3	21	84.0
22	76.7	23	84.5	24	77.9	25	75.2	26	72.1	27	85.8	28	80.3
29	0.	30	0.	31	85.0	32	86.0	33	86.2	34	86.0	35	86.1
36	86.7	37	85.4	38	85.4	39	85.0	40	83.6	41	82.2	42	81.0
43	84.9	44	83.1	45	83.5	46	82.2	47	86.1	48	71.0	49	0.

TIME 1200 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.7	2	79.1	3	86.[illegible]	4	79.3	5	89.0	6	80.3	7	87.0
8	78.0	9	87.0	10	77.5	11	86.0	12	76.2	13	84.5	14	75.4
15	86.9	16	80.2	17	86.0	18	79.5	19	87.8	20	79.3	21	87.5
22	78.8	23	89.0	24	80.2	25	85.2	26	76.7	27	89.8	28	82.9
29	0.	30	0.	31	84.9	32	89.9	33	89.4	34	89.9	35	89.4
36	89.9	37	89.0	38	89.0	39	88.8	40	88.9	41	87.9	42	87.2
43	89.4	44	86.2	45	88.	46	84.6	47	90.1	48	71.0	49	0.

TIME 1300 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	79.4	3	89.4	4	79.7	5	90.0	6	80.4	7	88.0
8	78.3	9	88.0	10	78.[illegible]	11	87.5	12	77.3	13	84.5	14	75.3
15	89.8	16	81.4	17	89.[illegible]	18	80.2	19	89.2	20	79.7	21	88.5
22	78.9	23	89.0	24	79.[illegible]	25	85.1	26	77.2	27	90.3	28	87.5
29	0.	30	0.	31	90.4	32	90.5	33	90.3	34	90.8	35	90.4
36	90.8	37	90.5	38	90.0	39	90.0	40	89.6	41	88.6	42	87.9
43	90.2	44	86.9	45	89.	46	84.7	47	91.2	48	70.8	49	0.

TIME 1400 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.2	3	90.0	4	79.3	5	90.5	6	80.3	7	88.3
8	78.3	9	88.0	10	78.1	11	87.5	12	76.9	13	84.4	14	75.6
15	90.0	16	80.8	17	90.0	18	80.3	19	90.0	20	79.8	21	89.5
22	79.3	23	89.0	24	79.2	25	84.6	26	76.6	27	90.8	28	88.0
29	0.	30	0.	31	90.8	32	90.8	33	90.7	34	91.0	35	90.9
36	91.0	37	90.8	38	90.6	39	90.2	40	89.9	41	89.0	42	88.1
43	90.1	44	86.9	45	89.7	46	84.9	47	91.7	48	70.7	49	0.

TIME 1500 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.2	3	90.0	4	79.5	5	91.0	6	80.5	7	88.5
8	78.4	9	88.0	10	78.3	11	87.0	12	76.6	13	83.5	14	74.9
15	90.0	16	80.8	17	90.0	18	80.1	19	90.0	20	79.6	21	89.5
22	79.0	23	88.0	24	78.8	25	83.0	26	76.1	27	90.7	28	88.8
29	0.	30	0.	31	90.9	32	91.0	33	90.9	34	91.2	35	91.0
36	91.3	37	91.0	38	90.9	39	90.4	40	89.7	41	88.4	42	87.7
43	90.7	44	87.0	45	89.0	46	89.0	47	91.3	48	70.3	49	0.

TIME 1600 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.4	3	90.0	4	79.4	5	91.0	6	80.4	7	88.8
8	78.6	9	88.0	10	77.8	11	87.5	12	77.1	13	84.8	14	74.9
15	90.5	16	91.5	17	90.0	18	79.8	19	90.3	20	80.0	21	89.5
22	79.0	23	89.0	24	79.5	25	84.7	26	76.3	27	91.0	28	89.6
29	81.0	30	72.0	31	91.0	32	91.0	33	91.0	34	91.5	35	91.2
36	91.5	37	91.2	38	91.0	39	91.0	40	90.0	41	89.0	42	88.3
43	90.8	44	87.2	45	89.5	46	85.1	47	91.8	48	70.2	49	0.

TIME 1700 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.7	3	90.0	4	80.1	5	91.0	6	80.7	7	88.7
8	78.9	9	88.5	10	78.5	11	89.8	12	78.9	13	84.5	14	75.0
15	91.0	16	92.2	17	91.0	18	81.0	19	90.3	20	80.1	21	90.0
22	79.5	23	89.4	24	80.1	25	85.3	26	78.0	27	91.0	28	89.9
29	81.0	30	71.5	31	91.0	32	91.1	33	91.0	34	91.8	35	91.4
36	92.0	37	91.5	38	91.3	39	90.9	40	90.3	41	89.3	42	88.6
43	90.8	44	91.0	45	89.4	46	85.3	47	91.4	48	70.0	49	0.

TIME 1800 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.8	2	79.5	3	90.0	4	80.0	5	91.0	6	80.8	7	88.4
8	78.3	9	91.0	10	78.0	11	87.5	12	77.1	13	84.5	14	75.1
15	90.5	16	91.5	17	90.5	18	80.7	19	90.0	20	80.0	21	89.5
22	79.4	23	89.4	24	79.4	25	85.0	26	77.5	27	90.5	28	89.3
29	80.4	30	71.1	31	90.5	32	90.5	33	90.5	34	91.3	35	91.1
36	91.3	37	91.0	38	90.4	39	90.5	40	90.0	41	89.0	42	88.2
43	90.3	44	87.0	45	89.3	46	85.0	47	91.3	48	69.9	49	0.

TIME 1900 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	78.5	3	89.5	4	79.0	5	90.0	6	79.9	7	88.0
8	77.3	9	87.8	10	77.3	11	87.0	12	76.3	13	84.0	14	73.9
15	90.0	16	90.4	17	90.0	18	80.0	19	89.6	20	79.5	21	89.0
22	78.6	23	88.0	24	78.4	25	83.4	26	78.0	27	90.1	28	79.5
29	80.5	30	71.4	31	90.5	32	90.5	33	90.1	34	91.0	35	90.8
36	91.0	37	91.3	38	90.5	39	90.1	40	89.3	41	88.5	42	88.0
43	90.0	44	86.3	45	89.0	46	85.1	47	91.0	48	69.8	49	0.

TIME 2100 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	[illegible]	3	92.0	4	83.2	5	92.0	6	83.9	7	89.3
8	81.1	9	[illegible]	10	80.8	11	85.5	12	77.7	13	77.5	14	73.8
15	91.0	16	91.6	17	90.0	18	81.8	19	88.5	20	79.9	21	87.5
22	79.1	23	86.0	24	82.0	25	78.2	26	74.1	27	92.8	28	92.4
29	84.0	30	74.7	31	91.5	32	93.4	33	93.4	34	91.0	35	91.0
36	91.5	37	91.1	38	85.0	39	88.6	40	89.3	41	85.0	42	88.9
43	91.1	44	87.2	45	87.7	46	84.8	47	91.8	48	69.8	49	0.

TIME 2200 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	92.2	3	91.5	4	82.5	5	92.0	6	83.9	7	88.7
8	80.8	9	88.0	10	80.5	11	85.0	12	77.6	13	77.0	14	74.0
15	90.0	16	87.1	17	89.0	18	81.3	19	87.0	20	79.4	21	87.0
22	79.2	23	88.5	24	82.0	25	77.5	26	73.9	27	92.7	28	92.0
29	83.3	30	74.2	31	90.5	32	92.6	33	93.0	34	90.0	35	90.0
36	90.5	37	89.9	38	87.8	39	87.1	40	88.5	41	88.1	42	88.0
43	90.1	44	87.0	45	87.0	46	84.3	47	91.2	48	69.6	49	0.

TIME 2300 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.4	3	91.0	4	82.3	5	91.0	6	83.0	7	88.0
8	80.1	9	87.0	10	80.0	11	84.0	12	77.0	13	76.5	14	73.6
15	89.5	16	92.0	17	89.0	18	81.4	19	86.5	20	79.4	21	86.2
22	78.7	23	87.8	24	80.5	25	77.2	26	73.9	27	91.5	28	91.2
29	82.0	30	72.5	31	90.0	32	91.6	33	92.2	34	89.5	35	89.5
36	90.0	37	87.2	38	87.0	39	86.8	40	88.0	41	87.7	42	87.5
43	89.5	44	86.4	45	86.5	46	84.0	47	90.5	48	69.6	49	0.

TIME 2400 DATE 5/20/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	81.6	3	90.0	4	82.0	5	90.0	6	82.[illegible]	7	87.5
8	80.0	9	86.5	10	79.9	11	83.5	12	76.6	13	76.3	14	73.5
15	89.0	16	91.7	17	88.0	18	80.6	19	86.0	20	79.0	21	85.5
22	78.2	23	87.8	24	81.0	25	77.0	26	73.6	27	91.1	28	80.9
29	0.	30	0.	31	89.2	32	90.9	33	91.4	34	89.0	35	90.1
36	89.5	37	87.0	38	86.8	39	86.2	40	87.5	41	87.2	42	87.1
43	89.0	44	86.0	45	86.3	46	73.9	47	90.0	48	69.2	49	0.

TIME 100 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	82.1	3	90.0	4	87.5	5	90.0	6	82.6	7	87.0
8	80.0	9	87.0	10	80.6	11	83.5	12	77.0	13	76.2	14	73.5
15	89.0	16	92.0	17	88.0	18	80.8	19	86.0	20	79.2	21	85.5
22	78.5	23	86.0	24	79.4	25	76.8	26	73.2	27	80.7	28	85.9
29	0.	30	0.	31	[illegible]	32	90.6	33	91.1	34	89.0	35	89.0
36	89.4	37	87.0	38	86.6	39	86.2	40	87.5	41	87.1	42	87.0
43	89.0	44	86.0	45	86.1	46	83.8	47	89.8	48	69.5	49	0.

TIME 200 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.2	2	82.0	3	89.5	4	82.0	5	90.0	6	83.1	7	87.0
8	80.1	9	86.0	10	79.9	11	83.5	12	77.2	13	76.0	14	73.0
15	89.0	16	82.0	17	88.0	18	81.0	19	86.0	20	79.2	21	85.0
22	77.9	23	87.8	24	81.3	25	76.7	26	73.0	27	90.1	28	85.5
29	0.	30	0.	31	88.8	32	90.2	33	91.0	34	88.5	35	88.7
36	89.2	37	86.9	38	86.5	39	86.0	40	87.0	41	87.0	42	87.0
43	88.7	44	85.9	45	85.9	46	83.5	47	89.4	48	69.3	49	0.

TIME 300 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	81.7	3	89.5	4	81.7	5	90.0	6	83.1	7	86.5
8	79.6	9	86.0	10	79.9	11	83.5	12	77.2	13	76.0	14	73.0
15	88.5	16	81.5	17	88.0	18	81.0	19	85.5	20	78.9	21	85.0
22	77.8	23	87.8	24	81.2	25	76.4	26	73.2	27	90.0	28	85.4
29	0.	30	0.	31	88.8	32	90.7	33	91.0	34	88.2	35	88.3
36	88.9	37	86.2	38	86.0	39	85.6	40	86.8	41	86.8	42	86.5
43	88.4	44	85.6	45	85.6	46	83.2	47	89.3	48	69.2	49	0.

TIME 400 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	81.5	3	89.5	4	82.2	5	90.0	6	83.6	7	86.0
8	79.5	9	86.0	10	80.2	11	83.5	12	77.2	13	76.0	14	73.4
15	88.5	16	92.0	17	88.0	18	81.2	19	86.5	20	79.8	21	86.0
22	78.5	23	87.8	24	81.2	25	76.2	26	73.2	27	89.8	28	85.2
29	0.	30	0.	31	88.3	32	90.1	33	90.3	34	88.8	35	89.0
36	89.5	37	87.5	38	87.2	39	89.0	40	86.4	41	86.2	42	86.3
43	88.2	44	85.2	45	85.7	46	83.2	47	89.2	48	69.2	49	0.

TIME 500 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	82.1	3	90.0	4	82.8	5	90.0	6	83.7	7	87.0
8	80.5	9	86.0	10	80.2	11	83.0	12	77.0	13	76.0	14	73.2
15	89.0	16	92.2	17	88.0	18	81.2	19	86.0	20	79.4	21	85.0
22	78.5	23	87.8	24	81.2	25	76.4	26	73.4	27	89.8	28	85.4
29	0.	30	0.	31	88.0	32	90.0	33	90.5	34	88.2	35	88.2
36	88.8	37	86.0	38	86.0	39	85.5	40	86.3	41	86.1	42	86.0
43	88.0	44	85.0	45	85.0	46	83.2	47	89.0	48	69.3	49	0.

TIME 600 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	81.9	3	89.0	4	82.1	5	90.0	6	83.7	7	86.5
8	80.1	9	86.0	10	80.2	11	82.5	12	76.6	13	76.0	14	73.3
15	88.5	16	91.8	17	88.5	18	81.4	19	86.0	20	79.5	21	85.0
22	78.1	23	87.8	24	81.7	25	76.0	26	72.5	27	89.5	28	85.4
29	0.	30	0.	31	87.8	32	89.9	33	89.1	34	88.0	35	88.2
36	88.7	37	86.0	38	86.0	39	85.4	40	86.2	41	86.0	42	85.9
43	87.6	44	85.0	45	85.0	46	83.0	47	88.4	48	69.8	49	0.

TIME 700 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	82.1	3	89.0	4	82.6	5	89.0	6	83.2	7	86.0
8	79.9	9	85.5	10	80.1	11	82.0	12	76.5	13	76.0	14	72.7
15	88.0	16	91.6	17	87.0	18	80.6	19	85.5	20	79.2	21	84.0
22	77.6	23	86.0	24	81.8	25	77.0	26	73.2	27	89.4	28	85.5
29	0.	30	0.	31	87.8	32	89.5	33	90.0	34	88.0	35	88.1
36	88.4	37	86.0	38	85.9	39	85.4	40	86.1	41	86.0	42	85.5
43	87.5	44	[illegible]	45	85.2	46	83.0	47	88.5	48	69.9	49	0.

TIME 800 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	82.1	3	89.0	4	82.4	5	89.5	6	83.2	7	86.4
8	80.0	9	86.0	10	80.6	11	82.5	12	76.6	13	76.0	14	73.2
15	88.2	16	91.6	17	88.0	18	81.5	19	85.4	20	78.9	21	85.0
22	78.2	23	87.0	24	80.6	25	76.6	26	73.2	27	89.8	28	85.7
29	0.	30	0.	31	88.3	32	90.1	33	90.5	34	88.3	35	88.3
36	88.7	37	86.3	38	85.6	40	85.6	40	86.0	41	86.3	42	86.0
43	88.1	44	85.5	45	85.2	46	83.2	47	89.0	48	70.0	49	0.

TIME 900 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	82.0	3	90.0	4	82.6	5	90.0	6	84.2	7	86.2
8	79.9	9	85.5	10	81.2	11	82.5	12	76.8	13	76.0	14	73.1
15	88.2	16	91.6	17	87.5	18	81.1	19	85.4	20	79.0	21	84.5
22	77.9	23	87.0	24	80.7	25	76.2	26	72.9	27	90.0	28	85.8
29	0.	30	0.	31	88.3	32	90.5	33	90.5	34	88.0	35	88.0
36	88.5	37	86.0	38	86.0	39	85.4	40	86.2	41	86.0	42	85.4
43	88.1	44	85.3	45	85.0	46	83.0	47	89.0	48	70.0	49	0.

TIME 1000 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	81.6	3	89.8	4	82.4	5	90.0	6	84.0	7	86.0
8	79.5	9	85.0	10	78.9	11	84.0	12	79.4	13	76.0	14	73.0
15	88.2	16	91.6	17	88.0	18	81.8	19	85.9	20	79.9	21	86.0
22	79.0	23	88.4	24	83.5	25	76.2	26	72.7	27	89.7	28	85.6
29	0.	30	0.	31	87.7	32	90.2	33	90.5	34	87.1	35	89.0
36	89.5	37	87.0	38	87.0	39	87.0	40	83.7	41	85.0	42	87.1
43	87.1	44	84.7	45	82.1	46	81.0	47	88.8	48	70.1	49	0.

TIME 1100 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	81.7	3	89.0	4	82.0	5	89.0	6	83.3	7	86.0
8	79.6	9	85.0	10	79.1	11	85.5	12	80.1	13	76.0	14	73.0
15	88.6	16	91.9	17	89.0	18	82.5	19	87.4	20	80.5	21	88.0
22	80.8	23	88.0	24	81.8	25	76.6	26	73.6	27	90.0	28	87.8
29	0.	30	0.	31	87.2	32	89.9	33	90.1	34	87.2	35	89.8
36	90.0	37	88.0	38	88.3	39	88.4	40	83.4	41	85.1	42	87.0
43	87.0	44	84.4	45	81.6	46	80.8	47	88.5	48	70.1	49	69.9

TIME 1200 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	81.8	3	89.0	4	82.3	5	88.5	6	83.0	7	86.0
8	79.7	9	84.5	10	80.5	11	86.0	12	80.5	13	76.0	14	73.2
15	88.8	16	92.1	17	89.5	18	82.9	19	88.0	20	81.0	21	88.0
22	80.6	23	88.0	24	82.0	25	76.2	26	73.3	27	89.2	28	88.2
29	0.	30	0.	31	87.0	32	89.5	33	90.0	34	87.1	35	89.6
36	90.0	37	88.0	38	88.5	39	88.6	40	83.3	41	85.1	42	87.0
43	86.7	44	84.2	45	81.6	46	80.7	47	88.1	48	70.5	49	70.2

TIME 1300 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	82.1	3	89.0	4	82.6	5	89.0	6	83.9	7	86.0
8	79.4	9	85.5	10	79.8	11	86.0	12	80.0	13	76.5	14	73.7
15	88.6	16	92.4	17	89.5	18	83.0	19	88.0	20	81.0	21	88.0
22	81.3	23	89.0	24	79.7	25	76.5	26	73.6	27	89.2	28	88.4
29	0.	30	0.	31	87.2	32	89.6	33	89.9	34	87.5	35	89.9
36	90.0	37	88.2	38	88.8	39	88.9	40	83.8	41	85.5	42	87.2
43	87.0	44	84.2	45	82.0	46	80.9	47	88.4	48	70.9	49	70.4

TIME 1400 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	81.6	3	89.3	4	82.3	5	89.0	6	84.6	7	86.3
8	80.1	9	86.0	10	80.2	11	86.0	12	80.6	13	76.4	14	73.3
15	89.0	16	92.5	17	89.5	18	83.0	19	88.0	20	80.9	21	88.5
22	81.1	23	88.0	24	82.0	25	76.9	26	73.9	27	89.1	28	85.5
29	0.	30	0.	31	87.9	32	90.0	33	90.3	34	87.8	35	90.0
36	90.7	37	88.3	38	89.0	39	89.0	40	84.0	41	85.5	42	87.4
43	87.2	44	84.8	45	82.1	46	81.1	47	88.6	48	71.3	49	70.6

TIME 1500 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	81.9	3	90.0	4	82.6	5	89.5	6	84.3	7	86.5
8	80.3	9	86.0	10	80.1	11	86.0	12	80.5	13	76.5	14	73.2
15	89.0	16	92.6	17	89.5	18	83.1	19	88.2	20	81.0	21	88.5
22	81.1	23	89.0	24	83.1	25	76.8	26	73.8	27	89.7	28	85.6
29	0.	30	0.	31	88.1	32	90.8	33	91.0	34	87.8	35	90.0
36	90.8	37	88.0	38	89.1	39	89.2	40	84.2	41	85.9	42	87.8
43	87.6	44	85.0	45	82.1	46	81.2	47	89.1	48	71.2	49	70.5

TIME 1600 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	83.5	3	90.0	4	83.3	5	89.0	6	83.9	7	86.8
8	81.3	9	85.5	10	86.2	11	86.0	12	80.6	13	86.0	14	77.0
15	89.2	16	83.8	17	89.5	18	82.9	19	88.5	20	82.1	21	89.0
22	81.7	23	89.2	24	82.7	25	84.0	26	78.5	27	89.5	28	86.0
29	0.	30	0.	31	89.0	32	91.0	33	91.2	34	88.7	35	90.4
36	91.0	37	89.1	38	89.8	39	89.9	40	86.0	41	86.8	42	88.1
43	88.6	44	85.5	45	85.5	46	82.7	47	90.3	48	71.0	49	0.

TIME 1700 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.3	2	83.4	3	91.0	4	84.0	5	91.0	6	85.4	7	89.0
8	82.0	9	88.0	10	86.6	11	88.0	12	80.6	13	84.9	14	76.4
15	90.7	16	84.5	17	91.0	18	84.0	19	90.0	20	82.4	21	90.5
22	82.3	23	86.0	24	83.5	25	84.3	26	77.4	27	90.9	28	86.0
29	77.5	30	68.1	31	90.6	32	92.0	33	92.2	34	90.9	35	92.2
36	92.5	37	91.0	38	91.1	39	91.2	40	88.2	41	88.9	42	90.[illegible]
43	90.1	44	86.8	45	87.0	46	84.0	47	91.5	48	70.8	49	0.

TIME 1800 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.3	2	83.9	3	91.4	4	84.2	5	91.0	6	85.2	7	89.8
8	82.3	9	89.0	10	81.3	11	89.0	12	81.3	13	85.0	14	76.5
15	91.5	16	84.1	17	92.0	18	84.7	19	90.8	20	82.7	21	91.0
22	82.3	23	93.0	24	75.7	25	85.4	26	77.5	27	91.3	28	86.1
29	77.5	30	68.3	31	91.1	32	92.5	33	92.5	34	91.5	35	93.0
36	93.1	37	91.8	38	92.0	39	92.0	40	89.1	41	89.7	42	90.5
43	90.4	44	87.0	45	87.9	46	84.1	47	92.0	48	70.8	49	0.

TIME 1900 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.7	3	91.8	4	84.5	5	92.0	6	86.0	7	90.0
8	82.3	9	85.5	10	81.5	11	89.5	12	81.4	13	85.0	14	76.4
15	91.8	16	85.1	17	92.5	18	85.0	19	91.2	20	82.7	21	92.0
22	83.0	23	91.0	24	84.1	25	85.3	26	77.1	27	91.5	28	86.4
29	76.5	30	65.5	31	91.5	32	93.0	33	93.0	34	91.8	35	93.1
36	93.7	37	92.0	38	92.2	39	92.3	40	89.6	41	90.0	42	91.0
43	91.0	44	87.2	45	88.1	46	84.5	47	92.2	48	71.0	49	0.

TIME 2000 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.4	3	92.0	4	84.0	5	92.0	6	85.7	7	90.0
8	82.2	9	90.0	10	81.6	11	90.0	12	81.3	13	85.0	14	75.3
15	91.8	16	85.0	17	92.5	18	85.0	19	91.5	20	82.9	21	92.0
22	92.6	23	93.0	24	85.4	25	85.5	26	77.4	27	91.9	28	86.1
29	76.9	30	66.5	31	92.0	32	93.2	33	93.3	34	92.0	35	93.3
36	93.0	37	92.3	38	92.6	39	92.7	40	89.7	41	90.0	42	91.0
43	91.5	44	87.5	45	88.4	46	84.6	47	92.5	48	71.0	49	0.

TIME 2100 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.7	2	83.7	3	92.5	4	83.8	5	92.0	6	85.7	7	90.5
8	82.0	9	90.0	10	81.4	11	90.0	12	81.3	13	85.0	14	76.9
15	92.0	16	85.1	17	93.0	18	85.1	19	91.3	20	82.4	21	92.0
22	82.6	23	91.0	24	85.5	25	85.5	26	77.5	27	92.2	28	86.0
29	75.0	30	63.0	31	92.2	32	93.7	33	94.0	34	92.0	35	93.5
36	93.9	37	92.1	38	92.5	39	92.6	40	89.6	41	90.1	42	91.2
43	92.0	44	93.0	45	88.7	46	84.9	47	93.0	48	70.9	49	0.

TIME 2200 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	83.3	3	93.0	4	83.5	5	93.0	6	86.5	7	90.6
8	82.4	9	90.0	10	81.3	11	90.0	12	81.1	13	85.0	14	75.1
15	92.0	16	85.2	17	92.8	18	84.2	19	91.5	20	82.8	21	92.0
22	82.5	23	93.0	24	85.1	25	85.9	26	77.8	27	93.0	28	86.0
29	77.4	30	68.0	31	92.7	32	94.3	33	94.4	34	92.0	35	93.6
36	93.4	37	92.5	38	92.9	39	92.6	40	90.0	41	90.4	42	91.5
43	92.3	44	88.2	45	89.0	46	85.0	47	93.5	48	71.0	49	0.

TIME 2300 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	83.5	3	92.5	4	82.9	5	93.0	6	86.4	7	91.0
8	82.5	9	90.0	10	81.3	11	90.0	12	81.0	13	85.0	14	75.5
15	92.0	16	85.1	17	93.0	18	85.0	19	91.5	20	82.6	21	92.0
22	82.5	23	91.0	24	84.1	25	85.9	26	76.4	27	93.1	28	86.0
29	78.2	30	69.5	31	93.0	32	94.5	33	95.3	34	92.0	35	93.6
36	94.0	37	92.1	38	92.7	39	92.8	40	90.1	41	90.6	42	91.6
43	92.6	44	88.3	45	89.0	46	85.1	47	94.0	48	71.1	49	0.

TIME 2400 DATE 5/21/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	83.5	3	93.3	4	84.0	5	93.0	6	86.5	7	91.0
8	82.7	9	90.0	10	81.3	11	90.0	12	81.1	13	85.0	14	75.0
15	92.0	16	85.2	17	93.0	18	85.0	19	91.5	20	83.0	21	92.0
22	82.8	23	94.0	24	85.7	25	85.5	26	77.1	27	93.2	28	86.4
29	0.	30	0.	31	93.0	32	94.7	33	95.4	34	92.5	35	93.8
36	94.0	37	92.6	38	93.0	39	93.0	40	90.2	41	90.6	42	91.7
43	92.6	44	88.7	45	89.2	46	85.0	47	94.0	48	70.0	49	0.

TIME 2400 DATE 5/22/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	-0.	2	-0.	3	-0.	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	-0.	16	-0.	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	-0.	24	-0.	25	-0.	26	-0.	27	-0.	28	-0.
29	-0.	30	-0.	31	-0.	32	-0.	33	-0.	34	-0.	35	-0.
36	-0.	37	-0.	38	-0.	39	-0.	40	-0.	41	-0.	42	-0.
43	-0.	44	-0.	45	-0.	46	-0.	47	-0.	48	-0.	49	-0.

TIME 1000 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	95.0	2	84.6	3	96.4	4	84.7	5	95.0	6	82.3	7	93.0
8	83.2	9	92.5	10	83.2	11	92.0	12	80.5	13	84.2	14	76.5
15	93.8	16	85.1	17	94.0	18	84.4	19	92.5	20	82.6	21	93.0
22	82.1	23	94.0	24	84.4	25	84.2	26	77.5	27	97.0	28	87.5
29	0.	30	0.	31	96.1	32	98.0	33	98.7	34	94.8	35	94.8
36	95.0	37	93.4	38	93.4	39	93.2	40	93.5	41	93.2	42	93.2
43	95.8	44	90.7	45	92.6	46	87.3	47	96.8	48	67.0	49	66.4

TIME 1100 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.2	2	84.7	3	95.7	4	85.7	5	95.0	6	87.0	7	92.8
8	83.6	9	92.0	10	83.2	11	90.0	12	80.1	13	84.2	14	75.9
15	93.2	16	84.8	17	92.5	18	84.0	19	91.0	20	82.0	21	90.5
22	81.5	23	93.0	24	84.3	25	84.7	26	78.0	27	96.0	28	87.5
29	0.	30	0.	31	95.3	32	97.0	33	97.8	34	94.0	35	94.0
36	94.4	37	92.2	38	92.2	39	91.9	40	93.0	41	92.9	42	92.7
43	95.0	44	90.3	45	92.3	46	87.0	47	96.0	48	67.0	49	0.

TIME 1200 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.7	2	84.9	3	94.0	4	84.4	5	94.5	6	86.4	7	92.0
8	83.1	9	92.0	10	83.2	11	89.5	12	79.8	13	85.0	14	76.8
15	93.0	16	85.0	17	92.5	18	84.3	19	91.0	20	82.8	21	90.5
22	81.9	23	93.0	24	84.8	25	86.8	26	79.0	27	95.3	28	87.5
29	0.	30	0.	31	94.7	32	95.9	33	96.5	34	94.0	35	94.0
36	94.2	37	92.1	38	92.1	39	91.9	40	93.0	41	92.8	42	92.6
43	94.6	44	90.0	45	92.3	46	86.9	47	95.2	48	66.8	49	66.3

TIME 1300 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	84.3	3	93.5	4	84.5	5	94.0	6	85.7	7	92.9
8	83.8	9	91.5	10	82.6	11	89.0	12	78.9	13	84.7	14	76.6
15	93.0	16	84.7	17	92.0	18	83.7	19	90.8	20	82.0	21	90.0
22	81.0	23	93.0	24	84.3	25	86.1	26	78.8	27	94.5	28	87.0
29	0.	30	0.	31	94.0	32	94.9	33	95.7	34	93.7	35	93.6
36	94.0	37	91.9	38	91.8	39	91.5	40	92.4	41	92.2	42	92.0
43	93.5	44	89.5	45	91.8	46	86.7	47	94.5	48	66.6	49	66.2

TIME 1400 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.8	2	84.2	3	93.0	4	84.1	5	94.0	6	85.6	7	91.5
8	82.5	9	90.5	10	81.9	11	88.5	12	78.6	13	84.8	14	76.0
15	92.5	16	84.3	17	92.0	18	83.8	19	90.5	20	81.8	21	90.0
22	81.0	23	92.0	24	83.5	25	85.4	26	78.2	27	94.0	28	86.4
29	0.	30	0.	31	93.5	32	94.3	33	95.0	34	93.4	35	93.4
36	93.8	37	91.7	38	91.7	39	91.4	40	92.1	41	91.9	42	91.5
43	93.4	44	89.0	45	91.5	46	86.7	47	94.0	48	66.7	49	66.2

TIME 1500 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	83.9	3	92.3	4	83.8	5	93.5	6	85.3	7	91.0
8	82.5	9	90.5	10	82.1	11	88.5	12	79.0	13	84.6	14	76.5
15	92.3	16	84.3	17	92.0	18	83.8	19	90.5	20	82.1	21	90.0
22	81.2	23	91.0	24	82.6	25	85.1	26	78.5	27	93.7	28	86.5
29	0.	30	0.	31	93.2	32	93.9	33	94.5	34	93.1	35	93.1
36	93.7	37	91.5	38	91.5	39	91.2	40	92.1	41	91.8	42	91.5
43	93.1	44	89.0	45	91.2	46	86.5	47	93.8	48	66.7	49	66.2

TIME 1600 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	84.3	3	92.8	4	84.6	5	93.5	6	85.6	7	91.0
8	82.6	9	90.8	10	82.6	11	89.0	12	79.7	13	84.5	14	76.5
15	92.3	16	84.5	17	92.5	18	84.6	19	90.5	20	82.5	21	90.5
22	81.4	23	92.8	24	84.7	25	85.6	26	88.9	27	94.2	28	92.9
29	83.5	30	73.5	31	93.3	32	94.1	33	94.3	34	93.6	35	93.4
36	93.8	37	92.0	38	91.8	39	91.5	40	92.4	41	91.6	42	91.4
43	93.3	44	89.0	45	91.4	46	87.0	47	94.0	48	66.9	49	66.2

TIME 1700 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	84.0	3	92.5	4	84.4	5	93.0	6	85.2	7	91.0
8	82.6	9	90.5	10	82.5	11	89.0	12	79.4	13	84.3	14	76.1
15	92.0	16	84.5	17	92.0	18	84.1	19	90.8	20	82.5	21	91.0
22	81.8	23	92.8	24	84.5	25	85.1	26	78.4	27	94.0	28	93.2
29	83.4	30	73.0	31	93.5	32	94.1	33	94.3	34	93.5	35	93.3
36	93.7	37	92.0	38	91.8	39	91.5	40	92.5	41	91.8	42	91.5
43	93.5	44	89.0	45	91.0	46	86.6	47	93.8	48	67.0	49	66.2

TIME 1800 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	84.2	3	92.3	4	84.3	5	93.0	6	85.2	7	91.0
8	82.6	9	91.0	10	83.2	11	89.0	12	79.7	13	84.3	14	76.3
15	92.0	16	84.3	17	92.5	18	84.5	19	90.4	20	82.0	21	90.5
22	82.0	23	91.0	24	0.	25	85.2	26	78.5	27	93.7	28	93.0
29	64.1	30	74.5	31	93.1	32	93.8	33	94.0	34	93.5	35	93.3
36	93.7	37	91.5	38	91.5	39	91.2	40	92.2	41	91.9	42	92.6
43	93.0	44	89.0	45	91.0	46	86.7	47	93.7	48	61.6	49	66.3

TIME 1900 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	84.4	3	92.4	4	84.4	5	93.0	6	85.4	7	91.0
8	83.0	9	90.5	10	82.5	11	85.9	12	77.0	13	84.0	14	75.7
15	92.4	16	85.0	17	93.0	18	85.2	19	91.0	20	82.6	21	92.0
22	83.1	23	93.0	24	84.8	25	84.7	26	79.3	27	93.9	28	87.0
29	78.4	30	69.4	31	93.0	32	93.9	33	93.9	34	94.0	35	93.8
36	94.1	37	92.7	38	92.6	39	92.2	40	92.0	41	91.0	42	90.9
43	92.9	44	88.9	45	91.2	46	86.8	47	93.4	48	66.6	49	66.2

TIME 2000 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	84.1	3	92.4	4	84.4	5	93.0	6	85.1	7	91.0
8	82.2	9	89.5	10	80.5	11	89.0	12	78.4	13	84.0	14	75.7
15	92.4	16	83.5	17	92.0	18	83.8	19	90.6	20	82.1	21	90.0
22	81.0	23	91.0	24	82.3	25	85.0	26	77.0	27	93.5	28	86.5
29	79.4	30	71.0	31	92.9	32	93.7	33	93.9	34	93.3	35	93.2
36	93.5	37	91.5	38	91.5	39	91.5	40	91.5	41	90.6	42	90.1
43	92.5	44	88.7	45	90.9	46	86.5	47	93.1	48	66.5	49	66.2

TIME 2100 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	84.6	3	92.5	4	85.3	5	93.0	6	86.0	7	90.5
8	82.5	9	90.0	10	82.4	11	88.0	12	79.0	13	79.0	14	73.1
15	92.0	16	84.1	17	91.5	18	83.6	19	89.4	20	81.4	21	89.0
22	80.6	23	91.0	24	81.3	25	80.0	26	74.3	27	93.6	28	87.1
29	77.9	30	68.0	31	92.8	32	94.0	33	94.0	34	93.0	35	92.9
36	93.1	37	90.2	38	90.2	39	90.0	40	91.6	41	91.0	42	90.5
43	92.0	44	88.4	45	89.8	46	86.0	47	92.8	48	67.0	49	66.5

TIME 2200 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	84.5	3	92.0	4	85.0	5	93.0	6	86.1	7	90.2
8	82.4	9	89.5	10	82.3	11	87.0	12	78.7	13	79.0	14	73.6
15	91.0	16	83.4	17	91.5	18	84.1	19	89.0	20	81.4	21	89.0
22	81.0	23	90.0	24	81.8	25	80.0	26	75.0	27	93.0	28	87.0
29	78.0	30	68.1	31	92.3	32	93.8	33	93.8	34	92.5	35	92.3
36	92.8	37	90.0	38	89.8	39	89.5	40	91.2	41	90.2	42	90.0
43	91.8	44	88.1	45	89.3	46	85.9	47	92.5	48	67.1	49	66.5

TIME 2300 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	84.0	3	91.8	4	84.8	5	92.5	6	85.5	7	89.8
8	82.1	9	89.0	10	81.8	11	87.0	12	80.0	13	78.8	14	73.6
15	91.0	16	83.6	17	91.0	18	83.5	19	88.3	20	81.0	21	88.0
22	80.3	23	89.2	24	82.0	25	79.1	26	74.0	27	92.6	28	86.5
29	78.0	30	69.0	31	91.5	32	93.0	33	93.1	34	92.0	35	91.9
36	92.1	37	89.0	38	89.0	39	89.0	40	90.4	41	90.0	42	89.4
43	91.3	44	88.0	45	88.8	46	85.3	47	91.9	48	67.0	49	66.4

TIME 2400 DATE 5/23/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	84.1	3	91.0	4	84.1	5	91.5	6	84.9	7	89.0
8	81.6	9	88.0	10	81.4	11	85.5	12	78.0	13	77.6	14	73.1
15	90.0	16	83.6	17	90.0	18	82.8	19	87.5	20	80.6	21	87.0
22	79.8	23	86.0	24	81.0	25	78.7	26	78.6	27	91.9	28	85.8
29	77.8	30	69.4	31	90.8	32	92.2	33	92.4	34	91.1	35	91.0
36	91.3	37	88.0	38	88.0	39	88.0	40	89.5	41	89.0	42	88.0
43	90.5	44	87.4	45	89.2	46	84.9	47	91.3	48	66.9	49	0.

TIME 100 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	84.3	3	91.2	4	84.7	5	91.5	6	85.3	7	89.0
8	82.0	9	88.0	10	81.[illegible]	11	85.5	12	78.4	13	77.8	14	73.7
15	91.0	16	84.0	17	90.0	18	83.0	19	87.5	20	80.9	21	87.0
22	80.0	23	79.2	24	82.5	25	78.4	26	73.9	27	92.1	28	86.2
29	78.0	30	69.5	31	91.0	32	92.4	33	92.6	34	91.2	35	91.2
36	91.4	37	88.3	38	88.3	39	88.1	40	89.6	41	89.3	42	88.9
43	90.6	44	87.3	45	88.1	46	84.9	47	91.4	48	66.8	49	0.

TIME 200 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	84.2	3	91.0	4	84.6	5	92.0	6	86.0	7	89.0
8	82.2	9	88.0	10	81.8	11	86.0	12	79.1	13	77.8	14	73.9
15	90.8	16	84.2	17	90.0	18	83.3	19	87.5	20	81.2	21	87.5
22	80.7	23	84.2	24	82.4	25	78.8	26	74.1	27	92.0	28	86.3
29	76.5	30	65.2	31	91.0	32	92.4	33	92.6	34	91.2	35	91.2
36	91.5	37	88.4	38	88.3	39	88.2	40	89.8	41	89.2	42	88.8
43	90.6	44	87.2	45	87.9	46	84.8	47	91.4	48	66.8	49	0.

TIME 300 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	84.3	3	91.0	4	85.0	5	92.0	6	86.1	7	89.0
8	82.2	9	88.0	10	81.9	11	86.0	12	79.3	13	78.0	14	74.0
15	91.0	16	84.2	17	90.0	18	83.3	19	87.5	20	81.2	21	87.5
22	80.8	23	79.2	24	83.0	25	78.6	26	74.4	27	92.0	28	87.0
29	73.6	30	59.2	31	91.0	32	92.6	33	92.6	34	91.1	35	91.0
36	91.5	37	88.2	38	88.1	39	88.0	40	89.9	41	88.9	42	88.4
43	90.5	44	87.4	45	87.9	46	84.9	47	91.2	48	67.2	49	0.

TIME 400 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	84.3	3	91.0	4	85.0	5	92.0	6	86.1	7	89.0
8	82.3	9	88.0	10	81.9	11	85.5	12	78.6	13	77.7	14	73.7
15	91.0	16	84.2	17	90.0	18	83.3	19	87.5	20	81.2	21	87.5
22	80.8	23	84.2	24	83.0	25	78.5	26	73.9	27	92.0	28	86.9
29	76.2	30	65.0	31	[illegible]	32	92.4	33	92.5	34	91.1	35	91.0
36	91.3	37	38.0	38	88.1	39	88.0	40	89.8	41	88.9	42	88.5
43	90.5	44	87.5	45	87.8	46	84.7	47	91.2	48	67.5	49	0.

TIME 500 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	84.3	3	91.0	4	85.0	5	92.0	6	86.1	7	89.0
8	82.3	9	88.0	10	81.9	11	85.5	12	78.6	13	77.7	14	73.6
15	90.5	16	83.9	17	90.0	18	83.3	19	87.5	20	81.4	21	87.5
22	80.8	23	89.2	24	83.0	25	78.4	26	74.2	27	91.9	28	86.9
29	78.4	30	68.5	31	90.5	32	92.3	33	92.3	34	91.0	35	91.0
36	91.2	37	88.0	38	88.0	39	87.8	40	89.4	41	88.9	42	88.4
43	90.2	44	87.2	45	87.8	46	84.5	47	91.0	48	67.8	49	0.

TIME 600 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	84.3	3	91.0	4	85.0	5	92.0	6	86.2	7	89.0
8	82.4	9	88.0	10	82.0	11	85.5	12	78.4	13	77.4	14	73.4
15	90.5	16	83.9	17	90.0	18	83.3	19	87.5	20	81.3	21	87.0
22	80.3	23	84.2	24	82.5	25	78.0	26	73.7	27	91.8	28	87.0
29	78.0	30	68.0	31	90.6	32	92.4	33	92.5	34	91.1	35	91.0
36	91.5	37	88.0	38	88.0	39	87.9	40	89.6	41	88.6	42	86.2
43	90.2	44	87.2	45	87.5	46	84.0	47	91.1	48	67.8	49	0.

TIME 700 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.7	3	91.0	4	85.2	5	91.0	6	85.3	7	88.5
8	81.9	9	88.5	10	82.6	11	85.0	12	78.5	13	77.0	14	72.6
15	90.5	16	83.9	17	90.0	18	83.2	19	87.0	20	80.8	21	86.5
22	79.8	23	88.0	24	81.5	25	78.4	26	74.0	27	91.5	28	86.5
29	78.2	30	68.8	31	90.2	32	92.2	33	92.2	34	90.8	35	90.8
36	91.1	37	88.0	38	88.0	39	87.8	40	89.0	41	88.4	42	88.0
43	90.0	44	87.2	45	87.4	46	84.4	47	90.8	48	67.9	49	0.

TIME 800 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.3	2	84.2	3	91.0	4	85.0	5	91.5	6	85.8	7	88.6
8	82.1	9	88.0	10	82.2	11	85.0	12	78.7	13	77.0	14	73.7
15	90.6	16	84.0	17	90.0	18	83.4	19	87.0	20	80.8	21	86.5
22	80.0	23	89.0	24	82.5	25	77.8	26	73.6	27	91.5	28	86.3
29	77.2	30	67.2	31	90.2	32	92.1	33	92.2	34	90.9	35	90.9
36	91.2	37	87.9	38	87.9	39	87.6	40	89.1	41	88.3	42	87.9
43	90.0	44	87.0	45	87.3	46	84.5	47	91.0	48	68.0	49	0.

TIME 900 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	84.0	3	91.0	4	84.8	5	92.0	6	86.4	7	88.5
8	82.2	9	88.0	10	82.3	11	85.5	12	79.5	13	77.2	14	73.2
15	90.7	16	84.1	17	90.0	18	83.5	19	87.2	20	80.9	21	87.0
22	80.8	23	89.0	24	82.7	25	78.0	26	73.9	27	91.9	28	86.8
29	0.	30	0.	31	90.4	32	92.2	33	92.4	34	91.0	35	91.0
36	91.4	37	87.9	38	88.0	39	87.8	40	89.2	41	88.5	42	88.0
43	90.1	44	87.0	45	87.7	46	84.5	47	91.0	48	68.0	49	67.7

TIME 1000 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.5	3	91.0	4	85.0	5	91.5	6	85.7	7	88.2
8	81.9	9	88.0	10	82.6	11	86.5	12	82.1	13	77.1	14	73.4
15	90.6	16	83.8	17	90.0	18	83.6	19	87.5	20	81.8	21	88.0
22	81.4	23	89.5	24	83.1	25	78.0	26	73.4	27	91.6	28	86.5
29	0.	30	0.	31	90.0	32	92.1	33	92.2	34	90.0	35	91.4
36	91.5	37	88.5	38	88.7	39	88.6	40	86.5	41	88.0	42	88.7
43	89.2	44	86.4	45	84.6	46	82.8	47	90.8	48	68.0	49	67.8

TIME 1100 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.5	3	91.0	4	84.9	5	91.0	6	85.3	7	88.7
8	82.5	9	88.0	10	82.1	11	88.0	12	83.0	13	77.0	14	73.4
15	90.2	16	83.5	17	90.5	18	84.0	19	88.8	20	82.5	21	89.5
22	82.4	23	90.0	24	83.7	25	77.9	26	74.0	27	91.4	28	86.3
29	0.	30	0.	31	90.0	32	92.0	33	92.0	34	89.5	35	91.5
36	91.4	37	89.2	38	89.6	39	89.9	40	85.9	41	88.1	42	89.1
43	89.0	44	86.1	45	84.4	46	82.6	47	90.7	48	68.0	49	67.8

TIME 1200 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.7	3	91.0	4	85.0	5	91.5	6	85.7	7	88.5
8	82.4	9	88.0	10	82.2	11	87.5	12	82.5	13	77.0	14	73.6
15	90.0	16	83.8	17	90.5	18	84.3	19	89.0	20	82.5	21	89.5
22	82.4	23	90.0	24	83.9	25	78.1	26	74.5	27	91.6	28	86.4
29	0.	30	0.	31	90.0	32	92.0	33	92.1	34	89.1	35	91.4
36	91.0	37	89.2	38	90.0	39	90.0	40	85.8	41	88.0	42	89.1
43	89.0	44	86.1	45	84.1	46	82.5	47	90.7	48	68.1	49	67.8

TIME 1300 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.5	3	91.0	4	85.0	5	91.5	6	85.7	7	88.8
8	82.7	9	88.0	10	82.1	11	87.5	12	82.5	13	78.4	14	74.3
15	90.0	16	84.0	17	90.5	18	84.2	19	89.0	20	82.5	21	90.0
22	82.3	23	90.0	24	83.8	25	78.1	26	74.2	27	92.0	28	86.8
29	0.	30	0.	31	90.5	32	92.3	33	92.2	34	89.6	35	91.6
36	91.9	37	90.0	38	90.1	39	90.1	40	86.5	41	88.5	42	89.5
43	89.4	44	86.4	45	84.9	46	82.8	47	91.0	48	68.2	49	68.0

TIME 1400 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.5	3	91.2	4	85.1	5	91.5	6	85.7	7	88.6
8	82.5	9	88.0	10	82.0	11	88.0	12	83.0	13	77.5	14	73.5
15	90.5	16	84.1	17	91.0	18	84.6	19	89.2	20	82.7	21	90.0
22	82.6	23	91.0	24	83.6	25	78.0	26	74.0	27	91.8	28	86.9
29	0.	30	0.	31	90.1	32	92.3	33	92.3	34	89.6	35	91.7
36	92.0	37	89.5	38	90.1	39	90.2	40	86.0	41	88.2	42	89.2
43	89.2	44	86.3	45	84.2	46	82.5	47	90.9	48	68.4	49	68.1

TIME 1500 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	83.9	3	91.0	4	85.0	5	91.5	6	85.7	7	88.4
8	82.6	9	88.0	10	82.2	11	88.0	12	83.0	13	77.7	14	73.7
15	90.5	16	84.2	17	90.5	18	84.1	19	89.0	20	82.3	21	89.5
22	82.2	23	91.5	24	82.9	25	78.3	26	74.1	27	91.7	28	86.8
29	0.	30	0.	31	90.0	32	92.0	33	92.0	34	89.2	35	91.6
36	91.9	37	90.4	38	90.0	39	90.0	40	86.0	41	88.0	42	89.2
43	89.1	44	86.1	45	84.3	46	82.5	47	91.0	48	68.6	49	68.3

TIME 1600 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.5	3	91.0	4	84.9	5	91.0	6	85.2	7	88.5
8	82.1	9	88.0	10	82.7	11	88.0	12	82.5	13	77.5	14	73.6
15	90.5	16	83.5	17	91.0	18	84.5	19	89.3	20	83.5	21	90.0
22	82.6	23	91.0	24	85.0	25	78.0	26	73.8	27	91.5	28	86.4
29	76.7	30	64.2	31	90.0	32	92.0	33	92.0	34	89.0	35	91.3
36	91.7	37	90.0	38	90.4	39	90.4	40	85.7	41	88.5	42	89.0
43	89.1	44	86.1	45	84.0	46	82.4	47	90.5	48	69.0	49	68.5

TIME 1700 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.5	3	91.0	4	84.9	5	91.0	6	85.3	7	88.6
8	82.5	9	88.0	10	82.2	11	88.0	12	82.7	13	77.5	14	73.6
15	90.2	16	84.0	17	91.0	18	84.7	19	89.3	20	82.4	21	90.0
22	82.5	23	91.0	24	84.9	25	78.0	26	74.0	27	91.7	28	86.8
29	75.3	30	62.4	31	90.[illegible]	32	92.2	33	92.1	34	89.0	35	91.4
36	92.0	37	89.4	38	90.0	39	90.2	40	86.0	41	88.0	42	89.1
43	89.0	44	86.0	45	84.0	46	82.5	47	90.7	48	69.0	49	68.9

TIME 1800 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.4	3	91.0	4	84.8	5	91.5	6	85.7	7	88.5
8	82.4	9	88.5	10	82.5	11	88.0	12	82.1	13	77.0	14	73.0
15	91.0	16	84.5	17	90.0	18	83.4	19	89.0	20	82.0	21	90.0
22	82.3	23	91.0	24	84.8	25	77.8	26	73.5	27	91.7	28	86.6
29	76.0	30	64.5	31	90.1	32	92.2	33	92.0	34	88.8	35	90.1
36	91.4	37	89.0	38	90.0	39	90.0	40	85.0	41	87.8	42	89.1
43	89.0	44	86.2	45	84.4	46	82.5	47	90.6	48	69.2	49	69.0

TIME 1900 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.4	3	91.0	4	84.7	5	91.5	6	85.6	7	88.3
8	82.1	9	88.0	10	81.8	11	87.5	12	82.1	13	77.8	14	73.8
15	90.0	16	83.5	17	90.0	18	83.3	19	89.0	20	81.9	21	89.5
22	82.0	23	90.5	24	83.7	25	77.4	26	73.0	27	91.5	28	86.2
29	76.5	30	66.1	31	90.0	32	91.8	33	91.8	34	88.6	35	90.6
36	91.1	37	89.0	38	89.6	39	89.9	40	84.5	41	87.5	42	88.8
43	88.4	44	86.0	45	84.0	46	82.1	47	90.5	48	[illegible]	49	69.0

TIME 2000 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.8	2	83.3	3	91.0	4	84.6	5	91.0	6	85.2	7	88.0
8	82.0	9	87.5	10	81.6	11	87.5	12	82.2	13	76.5	14	72.9
15	89.5	16	83.0	17	90.5	18	83.8	19	88.8	20	81.5	21	89.0
22	81.9	23	91.0	24	85.1	25	77.4	26	73.0	27	90.2	28	86.2
29	76.8	30	66.2	31	89.9	32	91.6	33	91.5	34	88.1	35	90.5
36	91.2	37	88.9	38	89.4	39	89.6	40	84.5	41	87.0	42	88.5
43	88.6	44	86.0	45	84.0	46	82.1	47	90.2	48	69.3	49	69.0

TIME 2100 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	86.7	3	89.5	4	81.0	5	90.0	6	81.7	7	88.4
8	79.9	9	88.5	10	82.0	11	88.5	12	80.5	13	90.5	14	77.2
15	90.0	16	85.0	17	90.5	18	83.6	19	89.0	20	82.6	21	90.0
22	82.1	23	91.0	24	81.4	25	91.5	26	80.8	27	91.5	28	83.5
29	74.4	30	64.5	31	90.7	32	90.7	33	90.4	34	91.0	35	91.5
36	91.9	37	90.3	38	90.7	39	90.8	40	89.5	41	89.7	42	90.3
43	90.5	44	87.0	45	89.3	46	84.9	47	91.7	48	69.5	49	69.1

TIME 2200 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	80.6	3	91.0	4	81.6	5	91.0	6	82.0	7	90.5
8	79.9	9	91.0	10	80.2	11	91.0	12	80.7	13	91.0	14	77.2
15	92.0	16	85.5	17	93.0	18	84.6	19	91.5	20	83.3	21	92.4
22	83.4	23	91.0	24	80.5	25	92.3	26	81.5	27	92.0	28	89.5
29	80.4	30	71.0	31	92.2	32	92.1	33	91.4	34	91.5	35	93.7
36	94.0	37	93.0	38	93.1	39	93.1	40	92.0	41	91.5	42	92.0
43	91.5	44	88.0	45	90.5	46	86.1	47	92.4	48	70.0	49	69.0

TIME 2300 DATE 5/24/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	80.6	3	91.4	4	81.7	5	91.5	6	85.3	7	91.0
8	80.3	9	91.0	10	79.9	11	91.5	12	80.2	13	91.0	14	77.3
15	92.8	16	86.0	17	93.0	18	84.6	19	92.5	20	83.5	21	93.0
22	83.2	23	91.0	24	79.9	25	92.2	26	82.0	27	92.5	28	83.5
29	75.9	30	67.5	31	92.9	32	92.7	33	92.0	34	94.0	35	94.4
36	94.9	37	93.5	38	94.0	39	94.0	40	92.2	41	92.0	42	92.7
43	92.2	44	88.5	45	91.0	46	86.3	47	93.4	48	68.8	49	69.0

TIME 2400 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	81.1	3	92.0	4	82.1	5	91.5	6	81.5	7	91.5
8	80.0	9	91.5	10	79.6	11	91.0	12	79.6	13	91.6	14	76.9
15	93.0	16	85.8	17	94.0	18	85.1	19	93.0	20	83.5	21	93.0
22	82.5	23	93.0	24	81.2	25	91.5	26	82.2	27	93.0	28	83.6
29	76.7	30	68.6	31	93.2	32	93.1	33	82.8	34	94.2	35	94.8
36	95.0	37	94.0	38	94.4	39	94.5	40	92.8	41	92.8	42	93.0
43	92.8	44	88.6	45	91.2	46	86.8	47	93.6	48	69.3	49	0.

TIME 100 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.2	2	81.0	3	92.2	4	81.9	5	92.2	6	81.9	7	92.0
8	80.4	9	92.0	10	80.1	11	92.0	12	80.5	13	91.8	14	77.8
15	93.0	16	85.9	17	94.0	18	85.3	19	93.5	20	85.8	21	94.0
22	83.4	23	93.0	24	81.2	25	92.0	26	81.8	27	93.2	28	89.9
29	80.2	30	70.4	31	93.3	32	93.2	33	92.9	34	94.4	35	95.0
36	95.1	37	94.3	38	94.8	39	95.0	40	92.9	41	93.0	42	93.3
43	93.0	44	89.0	45	92.2	46	86.8	47	94.0	48	69.0	49	0.

TIME 200 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	80.7	3	92.5	4	81.5	5	92.5	6	81.7	7	92.3
8	80.0	9	92.5	10	80.4	11	93.0	12	80.8	13	92.0	14	77.3
15	93.5	16	86.2	17	94.5	18	85.8	19	94.0	20	83.7	21	94.0
22	83.0	23	93.0	24	80.8	25	93.0	26	82.3	27	93.8	28	92.0
29	82.4	30	72.2	31	94.0	32	94.0	33	93.4	34	95.0	35	95.4
36	95.6	37	94.8	38	95.1	39	95.3	40	93.5	41	93.5	42	93.8
43	93.5	44	89.2	45	93.0	46	87.2	47	94.5	48	69.0	49	0.

TIME 300 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	81.0	3	93.0	4	81.7	5	92.5	6	81.6	7	92.5
8	80.1	9	92.5	10	80.2	11	93.0	12	80.5	13	92.2	14	77.9
15	93.6	16	86.1	17	94.5	18	85.2	19	94.0	20	83.6	21	94.5
22	83.3	23	94.8	24	82.0	25	93.0	26	82.4	27	94.1	28	92.5
29	81.2	30	69.8	31	94.2	32	94.0	33	93.6	34	95.0	35	95.6
36	95.8	37	95.0	38	95.3	39	95.5	40	93.8	41	93.7	42	93.9
43	93.8	44	89.3	45	93.2	46	87.6	47	94.8	48	69.2	49	0.

TIME 400 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.4	3	93.0	4	81.4	5	92.5	6	81.4	7	93.0
8	80.0	9	92.5	10	79.8	11	93.0	12	80.5	13	92.5	14	77.8
15	94.0	16	86.5	17	94.5	18	85.0	19	94.0	20	83.2	21	94.5
22	83.0	23	94.8	24	82.0	25	93.3	26	82.2	27	94.2	28	92.6
29	82.1	30	71.1	31	94.3	32	94.2	33	93.8	34	95.1	35	95.8
36	95.9	37	95.0	38	95.4	39	95.5	40	93.8	41	93.8	42	94.0
43	93.8	44	89.8	45	93.5	46	87.6	47	95.5	48	69.1	49	0.

TIME 500 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.5	3	93.0	4	81.3	5	93.0	6	81.7	7	93.0
8	80.3	9	93.0	10	80.4	11	93.0	12	80.5	13	92.4	14	77.7
15	94.0	16	86.5	17	94.5	18	85.2	19	94.0	20	83.6	21	94.5
22	83.0	23	93.0	24	80.1	25	93.0	26	82.2	27	94.3	28	92.8
29	92.8	30	71.0	31	94.4	32	94.4	33	93.9	34	95.2	35	95.8
36	96.0	37	95.0	38	95.4	39	95.6	40	94.0	41	93.8	42	94.1
43	94.0	44	89.8	45	93.5	46	87.7	47	95.0	48	69.2	49	0.

TIME 600 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.2	2	80.4	3	93.2	4	81.4	5	93.5	6	81.9	7	93.0
8	80.3	9	93.0	10	80.4	11	90.3	12	80.5	13	92.5	14	77.7
15	94.0	16	86.8	17	94.5	18	85.4	19	94.0	20	83.6	21	94.5
22	83.0	23	91.0	24	78.1	25	93.0	26	84.5	27	94.5	28	93.0
29	82.6	30	71.6	31	94.7	32	94.5	33	93.4	34	95.2	35	95.8
36	95.4	37	95.0	38	95.5	39	95.8	40	94.0	41	93.9	42	94.0
43	94.0	44	85.5	45	93.6	46	87.8	47	95.1	48	69.4	49	0.

TIME 700 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.8	3	93.0	4	81.4	5	93.5	6	82.0	7	93.0
8	80.5	9	93.0	10	80.2	11	93.0	12	80.5	13	92.5	14	77.8
15	94.0	16	86.6	17	94.0	18	84.5	19	94.0	20	83.6	21	94.0
22	82.7	23	93.0	24	80.2	25	93.0	26	82.2	27	94.6	28	93.0
29	83.0	30	72.4	31	94.5	32	94.3	33	93.4	34	95.1	35	95.6
36	95.8	37	94.9	38	95.3	39	95.5	40	93.8	41	93.9	42	94.1
43	94.0	44	89.7	45	93.5	46	87.8	47	95.1	48	69.3	49	0.

TIME 800 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	81.6	3	93.7	4	82.2	5	94.0	6	82.4	7	93.0
8	80.4	9	93.0	10	80.6	11	93.5	12	81.2	13	92.2	14	77.8
15	94.0	16	86.9	17	94.5	18	82.1	19	94.2	20	84.1	21	95.0
22	83.9	23	93.0	24	80.1	25	93.3	26	82.9	27	94.5	28	93.2
29	0.	30	0.	31	94.9	32	94.6	33	94.1	34	95.1	35	95.6
36	95.8	37	95.0	38	95.5	39	95.6	40	94.0	41	94.0	42	94.1
43	94.1	44	89.9	45	93.8	46	87.8	47	95.2	48	69.4	49	69.2

TIME 900 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	81.1	3	93.8	4	81.7	5	94.0	6	82.4	7	93.0
8	80.4	9	93.0	10	80.5	11	93.5	12	81.6	13	92.1	14	77.9
15	94.0	16	86.7	17	95.0	18	86.2	19	94.3	20	84.2	21	95.0
22	83.9	23	93.0	24	80.3	25	92.7	26	82.6	27	94.5	28	93.2
29	0.	30	0.	31	94.8	32	94.7	33	94.2	34	95.2	35	95.8
36	95.7	37	95.1	38	95.6	39	95.7	40	94.0	41	94.0	42	94.1
43	94.2	44	89.9	45	93.8	46	87.8	47	95.4	48	69.8	49	69.2

TIME 1000 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.7	2	81.0	3	93.8	4	81.7	5	94.0	6	82.0	7	93.0
8	80.7	9	93.0	10	80.6	11	93.5	12	81.1	13	92.2	14	78.0
15	94.0	16	86.7	17	95.0	18	86.0	19	94.5	20	86.0	21	95.0
22	84.7	23	93.0	24	80.7	25	92.3	26	82.6	27	94.8	28	93.5
29	0.	30	0.	31	94.9	32	94.8	33	94.2	34	95.2	35	95.7
36	95.4	37	95.7	38	95.9	39	96.0	40	94.0	41	93.9	42	94.1
43	94.2	44	90.0	45	93.6	46	87.8	47	95.4	48	69.7	49	69.2

TIME 1100 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.9	2	81.1	3	93.9	4	81.8	5	94.0	6	82.0	7	93.0
8	79.7	9	93.0	10	80.2	11	93.5	12	80.9	13	92.3	14	77.4
15	94.0	16	87.1	17	95.0	18	86.5	19	94.3	20	84.3	21	94.5
22	83.6	23	95.0	24	81.6	25	93.7	26	83.1	27	95.0	28	93.6
29	0.	30	0.	31	95.0	32	95.0	33	94.5	34	95.9	35	96.0
36	96.0	37	95.1	38	95.7	39	95.9	40	94.0	41	94.0	42	94.1
43	94.2	44	90.0	45	93.6	46	87.8	47	95.4	48	69.8	49	69.2

TIME 1200 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	81.3	3	94.0	4	82.3	5	94.0	6	82.4	7	93.0
8	80.4	9	93.5	10	81.2	11	94.0	12	81.3	13	92.1	14	78.1
15	94.3	16	87.0	17	95.0	18	86.0	19	94.5	20	84.2	21	95.0
22	84.0	23	93.0	24	80.5	25	93.1	26	82.2	27	95.0	28	93.8
29	0.	30	0.	31	95.0	32	94.7	33	94.1	34	95.5	35	96.0
36	96.1	37	95.0	38	95.7	39	95.8	40	94.1	41	94.0	42	94.7
43	94.3	44	90.0	45	93.9	46	87.8	47	95.7	48	69.9	49	69.2

TIME 1300 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.7	2	81.4	3	93.7	4	82.2	5	94.0	6	82.7	7	93.0
8	80.8	9	93.5	10	81.0	11	93.5	12	81.1	13	92.6	14	77.7
15	94.0	16	87.5	17	95.5	18	87.1	19	94.3	20	85.1	21	95.0
22	84.0	23	94.0	24	81.1	25	93.9	26	82.7	27	95.1	28	94.2
29	0.	30	0.	31	95.1	32	95.0	33	94.5	34	95.8	35	96.0
36	96.2	37	95.2	38	95.7	39	96.0	40	94.1	41	94.2	42	94.5
43	94.4	44	90.0	45	93.5	46	88.0	47	95.5	48	70.0	49	69.5

TIME 1400 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.4		90.8	3	93.5	4	81.8	5	94.0	6	82.7	7	93.0
8	80.5	9	93.0	10	80.8	11	93.5	12	80.9	13	92.5	14	78.0
15	93.6	16	86.6	17	95.0	18	86.2	19	94.2	20	84.4	21	95.0
22	83.9	23	93.0	24	80.7	25	94.5	26	83.8	27	95.0	28	94.0
29	0.	30	0.	31	95.0	32	95.0	33	94.1	34	95.5	35	95.8
36	96.0	37	95.0	38	95.7	39	95.8	40	94.2	41	94.0	42	94.3
43	94.3	44	90.0	45	93.7	46	88.0	47	95.3	48	70.0	49	69.4

TIME 1500 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	91.5	3	93.5	4	82.1	5	94.0	6	82.7	7	93.0
8	80.7	9	93.0	10	80.9	11	93.5	12	81.3	13	92.0	14	77.9
15	94.0	16	87.0	17	95.0	18	86.4	19	94.5	20	84.0	21	95.0
22	84.0	23	91.0	24	79.5	25	93.9	26	83.4	27	95.0	28	94.2
29	85.0	30	75.0	31	95.0	32	95.0	33	94.2	34	95.5	35	95.8
36	96.2	37	95.2	38	95.8	39	95.8	40	94.5	41	94.0	42	94.4
43	94.3	44	90.1	45	93.6	46	87.9	47	95.2	48	70.0	49	69.4

TIME 1600 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	91.3	3	93.3	4	82.1	5	94.0	6	83.4	7	93.0
8	80.7	9	93.0	10	81.4	11	93.8	12	81.4	13	91.5	14	77.7
15	94.0	16	87.5	17	95.0	18	82.5	19	94.0	20	84.2	21	95.0
22	81.8	23	94.4	24	82.1	25	92.1	26	82.5	27	94.4	28	93.9
29	83.5	30	72.5	31	95.0	32	95.0	33	94.2	34	95.5	35	95.8
36	96.2	37	95.0	38	95.7	39	95.8	40	94.7	41	94.0	42	94.5
43	94.5	44	90.0	45	93.0	46	88.5	47	95.7	48	70.0	49	69.3

TIME 1700 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	91.7	3	93.5	4	82.5	5	94.5	6	83.5	7	93.0
8	80.7	9	93.0	10	80.9	11	93.0	12	83.5	13	92.0	14	78.5
15	93.0	16	84.0	17	93.0	18	83.0	19	93.0	20	83.0	21	93.0
22	82.5	23	94.4	24	82.3	25	92.5	26	82.3	27	94.8	28	94.5
29	85.0	30	74.5	31	95.2	32	95.0	33	94.5	34	94.5	35	94.0
36	96.4	37	95.0	38	94.4	39	94.3	40	94.1	41	93.5	42	93.5
43	94.5	44	90.0	45	93.5	46	88.5	47	95.4	48	70.0	49	69.1

TIME 1800 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.3	2	81.6	3	93.5	4	82.1	5	94.0	6	83.0	7	92.5
8	80.3	9	93.0	10	80.5	11	93.0	12	80.2	13	93.0	14	78.6
15	93.0	16	93.1	17	92.0	18	83.1	19	92.8	20	83.2	21	93.0
22	82.5	23	93.0	24	80.5	25	93.0	26	82.2	27	94.5	28	94.1
29	84.1	30	73.8	31	94.8	32	94.5	33	94.1	34	93.9	35	93.7
36	91.9	37	93.5	38	93.9	39	94.0	40	93.9	41	93.5	42	93.4
43	94.2	44	90.0	45	93.5	46	88.3	47	95.0	48	69.7	49	69.0

TIME 1900 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.3	2	81.3	3	93.4	4	81.3	5	94.0	6	83.0	7	92.5
8	80.1	9	93.0	10	80.5	11	93.0	12	80.1	13	92.5	14	78.4
15	92.0	16	83.7	17	93.0	18	83.1	19	93.0	20	83.0	21	92.5
22	82.0	23	94.4	24	82.4	25	93.8	26	82.7	27	94.5	28	94.0
29	84.3	30	73.8	31	94.9	32	94.6	33	94.2	34	94.0	35	93.8
36	93.4	37	93.7	38	94.0	39	94.0	40	93.8	41	93.7	42	93.5
43	94.2	44	90.0	45	93.9	46	88.4	47	95.3	48	69.8	49	69.1

TIME 2000 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.2	2	81.1	3	93.3	4	82.0	5	94.0	6	82.9	7	92.5
8	79.9	9	93.0	10	80.2	11	93.0	12	79.9	13	92.8	14	78.5
15	92.0	16	83.6	17	93.0	18	82.9	19	93.0	20	83.0	21	93.0
22	83.0	23	94.0	24	81.3	25	94.0	26	81.4	27	94.5	28	95.0
29	75.0	30	64.0	31	94.8	32	94.5	33	94.0	34	94.0	35	93.7
36	93.4	37	93.8	38	94.0	39	94.0	40	94.0	41	93.6	42	93.5
43	94.2	44	90.0	45	93.7	46	88.5	47	95.0	48	69.5	49	69.0

TIME 2100 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.2	2	80.9	3	93.2	4	81.6	5	94.0	6	82.9	7	92.5
8	79.6	9	93.0	10	80.2	11	93.0	12	79.9	13	92.8	14	78.5
15	92.0	16	83.4	17	93.0	18	82.7	19	93.0	20	82.0	21	93.0
22	81.9	23	94.4	24	81.6	25	92.9	26	80.0	27	94.5	28	91.0
29	0.	30	0.	31	94.6	32	94.4	33	94.0	34	94.0	35	93.7
36	93.8	37	93.9	38	93.9	39	94.0	40	94.0	41	93.5	42	93.5
43	94.1	44	89.0	45	93.9	46	88.7	47	95.3	48	70.0	49	69.0

TIME 2200 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.6	3	93.0	4	81.4	5	93.8	6	82.6	7	92.5
8	79.4	9	93.0	10	80.2	11	93.0	12	80.0	13	93.0	14	77.6
15	92.0	16	83.2	17	93.0	18	82.2	19	93.0	20	82.6	21	93.0
22	81.5	23	94.4	24	81.6	25	91.6	26	81.4	27	94.3	28	92.5
29	0.	30	0.	31	94.5	32	94.3	33	94.0	34	94.0	35	93.8
36	94.0	37	94.0	38	94.0	39	94.0	40	94.0	41	93.7	42	93.5
43	94.1	44	90.0	45	93.8	46	88.7	47	95.0	48	69.6	49	69.0

TIME 2300 DATE 5/25/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.2	2	80.9	3	93.3	4	81.5	5	94.0	6	82.8	7	92.5
8	80.0	9	93.0	10	80.2	11	93.0	12	80.0	13	92.7	14	77.5
15	92.3	16	83.2	17	93.0	18	82.3	19	93.0	20	[illegible]	21	93.0
22	81.6	23	94.4	24	81.6	25	92.9	26	80.3	27	94.5	28	93.0
29	0.	30	0.	31	94.9	32	94.7	33	94.0	34	94.4	35	94.0
36	94.0	37	94.0	38	94.0	39	94.0	40	94.0	41	93.8	42	93.5
43	94.2	44	90.0	45	94.0	46	89.0	47	95.2	48	70.0	49	69.1

TIME 2400 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	86.7	3	93.0	4	81.6	5	93.0	6	82.0	7	92.2
8	80.1	9	92.0	10	79.3	11	92.0	12	79.6	13	92.0	14	77.5
15	92.2	16	83.4	17	92.0	18	78.4	19	93.0	20	81.3	21	92.0
22	81.0	23	94.4	24	81.3	25	92.2	26	80.5	27	94.0	28	92.5
29	82.7	30	71.8	31	95.3	32	94.1	33	93.4	34	94.0	35	93.8
36	93.8	37	93.9	38	94.0	39	94.0	40	93.8	41	93.2	42	93.1
43	94.0	44	80.0	45	93.6	46	86.6	47	95.0	48	69.7	49	69.0

TIME 100 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.4	3	93.0	4	80.9	5	93.5	6	82.2	7	92.2
8	79.5	9	92.0	10	79.4	11	92.5	12	78.7	13	92.7	14	77.5
15	92.0	16	83.1	17	92.5	18	81.7	19	93.0	20	80.0	21	93.0
22	81.4	23	93.0	24	80.1	25	93.7	26	82.0	27	94.5	28	93.0
29	0.	30	0.	31	94.8	32	94.5	33	94.7	34	94.1	35	93.8
36	93.4	37	94.0	38	94.1	39	94.2	40	94.1	41	94.0	42	93.9
43	94.3	44	70.0	45	94.0	46	69.0	47	95.2	48	69.7	49	69.0

TIME 200 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	81.0	5	93.5	6	82.0	7	92.5
8	79.2	9	92.0	10	79.0	11	92.5	12	79.4	13	92.5	14	77.8
15	92.0	16	83.5	17	92.5	18	81.5	19	93.0	20	81.7	21	93.0
22	81.2	23	93.0	24	80.1	25	93.2	26	81.0	27	94.1	28	93.3
29	0.	30	0.	31	94.6	32	94.5	33	93.4	34	94.2	35	93.6
36	94.0	37	94.0	38	94.1	39	94.0	40	94.0	41	93.7	42	93.6
43	94.0	44	70.0	45	94.0	46	68.8	47	95.0	48	69.5	49	69.0

TIME 300 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	81.0	5	93.5	6	82.0	7	92.5
8	77.9	9	92.0	10	79.4	11	92.5	12	79.0	13	92.7	14	76.7
15	92.2	16	83.0	17	92.5	18	81.4	19	93.2	20	81.0	21	93.0
22	81.2	23	93.0	24	80.1	25	93.1	26	81.0	27	93.5	28	93.0
29	0.	30	0.	31	94.5	32	94.4	33	94.0	34	94.2	35	93.7
36	94.0	37	94.2	38	94.2	39	94.2	40	94.1	41	93.9	42	93.9
43	94.2	44	70.0	45	94.0	46	68.8	47	95.1	48	69.4	49	69.0

TIME 400 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.1	13	92.7	14	77.0
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.7	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	93.2
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.1	48	69.4	49	69.0

TIME 500 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.4	13	92.8	14	77.3
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.7	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.2	48	69.4	49	69.0

TIME 600 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.4	13	92.8	14	77.3
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.3	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.2	48	69.4	49	69.0

TIME 700 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.4	13	92.8	14	77.3
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.3	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.2	48	69.4	49	69.0

TIME 800 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.4	13	92.8	14	77.3
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.3	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.2	48	69.4	49	69.0

TIME 900 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.4	13	92.8	14	77.3
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.3	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.2	48	69.4	49	69.0

TIME 1000 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.4	13	92.8	14	77.3
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.3	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.2	48	69.4	49	69.0

TIME 1100 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.7	5	93.5	6	81.6	7	92.5
8	78.4	9	92.0	10	79.4	11	92.5	12	79.4	13	92.8	14	77.3
15	92.0	16	83.7	17	93.0	18	81.7	19	93.0	20	81.3	21	93.0
22	80.4	23	94.0	24	81.2	25	93.2	26	81.0	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.5	33	94.1	34	94.5	35	94.1
36	94.2	37	94.7	38	94.0	39	94.8	40	94.1	41	93.9	42	93.0
43	94.2	44	70.0	45	94.0	46	68.8	47	95.2	48	69.4	49	69.0

TIME 2300 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.3	2	78.7	3	85.5	4	79.6	5	86.0	6	79.7	7	83.5
8	77.4	9	81.0	10	76.8	11	83.5	12	76.8	13	79.0	14	75.4
15	89.0	16	82.0	17	89.5	18	82.0	19	90.5	20	83.0	21	91.0
22	83.0	23	88.0	24	80.5	25	80.0	26	78.4	27	85.5	28	82.5
29	0.	30	0.	31	85.4	32	86.6	33	88.0	34	88.1	35	90.0
36	90.7	37	91.3	38	91.8	39	91.7	40	89.2	41	84.3	42	85.2
43	85.0	44	71.7	45	83.4	46	82.9	47	85.8	48	71.1	49	70.4

TIME 2400 DATE 5/26/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.5	2	78.2	3	85.5	4	79.C	5	86.0	6	79.5	7	83.5
8	77.2	9	84.0	10	77.5	11	84.0	12	77.0	13	79.0	14	74.9
15	89.0	16	82.0	17	89.0	18	81.8	19	91.0	20	83.4	21	91.0
22	82.8	23	84.0	24	78.1	25	78.5	26	75.0	27	85.0	28	81.0
29	0.	30	0.	31	84.0	32	86.0	33	88.0	34	87.8	35	89.7
36	90.1	37	91.0	38	91.3	39	91.3	40	83.6	41	89.1	42	85.0
43	86.7	44	71.4	45	82.7	46	82.3	47	85.1	48	70.5	49	70.1

TIME 100 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.5	2	77.5	3	84.5	4	78.4	5	84.5	6	78.2	7	82.5
8	76.8	9	82.0	10	75.9	11	82.0	12	75.7	13	77.5	14	73.6
15	88.0	16	81.1	17	88.0	18	80.8	19	89.5	20	80.0	21	90.0
22	81.9	23	84.0	24	78.0	25	78.5	26	74.7	27	84.2	28	80.1
29	0.	30	0.	31	84.0	32	85.0	33	85.0	34	86.7	35	88.9
36	89.1	37	90.2	38	90.8	39	90.8	40	82.5	41	83.2	42	84.3
43	84.0	44	72.9	45	82.2	46	81.9	47	84.6	48	70.5	49	70.1

TIME 200 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	77.4	3	84.0	4	77.9	5	84.0	6	77.8	7	82.0
8	76.4	9	82.0	10	76.1	11	82.0	12	75.6	13	77.0	14	73.6
15	87.5	16	80.7	17	88.0	18	81.2	19	87.0	20	79.4	21	87.5
22	79.6	23	82.0	24	76.8	25	78.0	26	74.4	27	82.8	28	80.0
29	0.	30	0.	31	83.3	32	84.6	33	86.4	34	86.0	35	88.4
36	88.0	37	88.5	38	87.0	39	88.0	40	82.0	41	82.7	42	83.9
43	81.1	44	72.2	45	82.0	46	82.0	47	84.0	48	70.7	49	70.3

TIME 300 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	76.9	3	83.5	4	77.4	5	84.0	6	77.8	7	81.5
8	75.8	9	82.0	10	76.0	11	82.0	12	76.0	13	76.7	14	73.6
15	87.0	16	80.4	17	87.5	18	80.9	19	86.0	20	78.0	21	82.5
22	79.7	23	82.0	24	76.7	25	76.4	26	73.2	27	83.1	28	79.5
29	0.	30	0.	31	83.0	32	84.0	33	83.8	34	85.8	35	87.8
36	88.2	37	89.9	38	88.9	39	87.1	40	82.1	41	82.1	42	83.6
43	83.0	44	72.0	45	81.5	46	81.6	47	83.7	48	70.8	49	70.4

TIME 400 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.8	2	77.1	3	83.4	4	77.4	5	84.0	6	78.0	7	81.6
8	75.3	9	81.5	10	76.2	11	83.0	12	77.1	13	76.1	14	73.6
15	87.0	16	80.4	17	87.5	18	81.0	19	86.0	20	79.2	21	86.0
22	79.1	23	82.0	24	76.8	25	77.4	26	74.2	27	83.5	28	79.6
29	0.	30	0.	31	83.0	32	84.1	33	83.9	34	85.3	35	87.6
36	88.2	37	89.5	38	88.4	39	88.8	40	82.0	41	82.0	42	83.4
43	83.1	44	72.7	45	81.5	46	81.5	47	83.6	48	70.8	49	70.7

TIME 500 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.0	2	76.1	3	83.0	4	77.0	5	84.0	6	77.8	7	81.0
8	75.4	9	80.0	10	76.4	11	82.0	12	76.1	13	76.2	14	73.3
15	87.0	16	80.0	17	87.5	18	80.8	19	85.5	20	78.1	21	86.0
22	79.1	23	82.0	24	76.0	25	78.3	26	73.1	27	83.1	28	79.1
29	0.	30	0.	31	82.7	32	84.0	33	83.5	34	85.2	35	87.2
36	88.0	37	89.2	38	88.2	39	86.9	40	82.2	41	82.0	42	83.2
43	82.7	44	72.6	45	81.5	46	81.6	47	83.4	48	71.0	49	70.

TIME 600 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	76.6	3	83.5	4	77.5	5	84.0	6	77.8	7	81.5
8	75.0	9	80.0	10	76.4	11	82.0	12	75.7	13	77.0	14	73.6
15	87.5	16	80.7	17	87.5	18	80.9	19	87.0	20	80.5	21	86.0
22	79.1	23	82.0	24	76.8	25	76.5	26	73.1	27	83.2	28	79.8
29	0.	30	0.	31	83.2	32	84.6	33	83.9	34	85.6	35	87.2
36	88.3	37	89.4	38	88.3	39	86.3	40	83.0	41	82.2	42	83.4
43	83.2	44	72.3	45	81.9	46	82.1	47	83.6	48	71.8	49	70.9

TIME 700 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.5	2	77.9	3	84.0	4	77.6	5	84.5	6	78.0	7	82.5
8	76.7	9	82.0	10	75.9	11	82.5	12	76.2	13	78.5	14	73.9
15	87.0	16	80.5	17	87.5	18	80.8	19	86.0	20	79.0	21	86.0
22	79.6	23	82.5	24	75.0	25	79.2	26	74.0	27	83.0	28	80.0
29	0.	30	0.	31	83.1	32	85.1	33	84.8	34	86.2	35	88.0
36	88.8	37	90.0	38	88.9	39	87.6	40	83.0	41	83.4	42	84.5
43	84.3	44	73.5	45	83.0	46	82.5	47	85.0	48	71.4	49	70.9

TIME 800 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.0	2	78.5	3	86.0	4	78.8	5	86.0	6	79.0	7	83.0
8	77.7	9	84.0	10	77.1	11	84.5	12	77.5	13	82.5	14	75.3
15	88.3	16	82.0	17	88.0	18	81.3	19	87.0	20	80.3	21	87.5
22	80.5	23	84.5	24	77.8	25	82.4	26	76.3	27	86.4	28	83.3
29	0.	30	0.	31	87.2	32	88.9	33	88.0	34	88.0	35	89.4
36	89.6	37	91.0	38	89.0	39	88.1	40	85.3	41	85.2	42	86.2
43	86.2	44	84.4	45	85.1	46	83.4	47	87.1	48	71.3	49	71.0

TIME 900 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.2	2	79.0	3	87.3	4	79.5	5	88.0	6	80.2	7	86.0
8	78.2	9	86.0	10	78.3	11	86.5	12	78.8	13	84.0	14	75.7
15	89.0	16	82.6	17	89.5	18	82.2	19	88.0	20	81.0	21	88.5
22	80.7	23	88.0	24	80.0	25	84.6	26	77.2	27	87.5	28	87.0
29	0.	30	0.	31	87.8	32	88.1	33	87.9	34	89.3	35	90.4
36	90.6	37	88.9	38	89.2	39	89.2	40	87.0	41	86.9	42	87.8
43	87.7	44	85.0	45	86.2	46	84.0	47	88.1	48	71.5	49	71.0

TIME 1000 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	89.0	2	79.9	3	89.0	4	80.5	5	90.0	6	81.3	7	86.0
8	79.5	9	88.0	10	79.3	11	88.5	12	79.8	13	87.1	14	76.3
15	90.2	16	83.6	17	90.5	18	82.8	19	89.3	20	82.3	21	90.0
22	82.2	23	89.5	24	80.9	25	87.8	26	79.0	27	90.0	28	89.2
29	0.	30	0.	31	90.2	32	90.5	33	89.8	34	91.5	35	91.8
36	92.4	37	91.5	38	90.8	39	90.8	40	89.5	41	89.0	42	90.0
43	89.9	44	86.9	45	88.6	46	85.2	47	90.5	48	71.7	49	71.0

TIME 1100 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.6	2	75.6	3	90.6	4	80.6	5	90.5	6	80.3	7	90.0
8	79.1	9	76.5	10	78.3	11	90.0	12	79.5	13	90.0	14	77.1
15	91.5	16	94.7	17	92.0	18	93.5	19	90.8	20	83.0	21	91.0
22	92.8	23	91.0	24	85.0	25	91.2	26	80.1	27	92.1	28	91.0
29	0.	30	0.	31	92.1	32	92.1	33	91.5	34	93.3	35	93.3
36	93.8	37	92.8	38	92.1	39	92.1	40	91.2	41	91.0	42	91.6
43	91.0	44	90.6	45	90.6	46	90.2	47	92.5	48	71.6	49	71.0

TIME 1200 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.5	2	90.4	3	92.3	4	91.4	5	92.0	6	81.1	7	92.0
8	80.2	9	91.5	10	79.9	11	92.1	12	80.7	13	92.0	14	78.1
15	93.0	16	90.2	17	93.5	18	84.6	19	92.5	20	84.2	21	92.5
22	93.7	23	91.0	24	84.5	25	92.1	26	91.3	27	93.4	28	92.5
29	0.	30	0.	31	93.6	32	93.5	33	93.0	34	94.8	35	94.8
36	93.2	37	91.7	38	93.8	39	93.8	40	93.0	41	92.8	42	93.1
43	93.1	44	90.1	45	92.1	46	87.7	47	[illegible]	48	[illegible]	49	[illegible]

TIME 1300 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.2	2	90.0	3	93.0	4	91.4	5	93.0	6	81.6	7	93.0
8	80.0	9	92.0	10	80.5	11	93.5	12	81.3	13	92.8	14	78.5
15	93.0	16	90.8	17	95.0	18	85.5	19	93.2	20	84.0	21	94.0
22	94.2	23	92.0	24	81.3	25	93.4	26	81.0	27	94.9	28	93.8
29	0.	30	0.	31	94.9	32	94.7	33	94.0	34	96.0	35	95.9
36	94.2	37	93.0	38	94.9	39	95.0	40	94.0	41	93.8	42	94.2
43	94.2	44	90.0	45	93.0	46	87.9	47	95.1	48	91.5	49	0.

TIME 1400 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	94.7	2	90.9	3	94.0	4	91.5	5	94.0	6	84.7	7	93.5
8	80.9	9	95.0	10	81.0	11	94.2	12	81.5	13	93.3	14	78.0
15	94.2	16	92.7	17	95.5	18	85.6	19	94.0	20	84.7	21	94.5
22	94.1	23	94.0	24	81.9	25	93.8	26	81.7	27	95.1	28	94.0
29	0.	30	0.	31	95.4	32	95.0	33	94.6	34	96.2	35	96.2
36	94.2	37	93.4	38	95.3	39	95.7	40	94.7	41	94.5	42	94.9
43	94.9	44	91.2	45	93.6	46	88.1	47	95.6	48	71.4	49	70.9

TIME 1500 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	95.0	2	91.2	3	94.0	4	81.6	5	94.0	6	81.4	7	94.2
8	80.4	9	94.0	10	81.0	11	94.2	12	82.7	13	94.8	14	77.9
15	94.5	16	92.7	17	95.5	18	85.5	19	94.4	20	84.0	21	95.0
22	94.2	23	94.0	24	81.5	25	95.0	26	81.8	27	96.0	28	90.0
29	0.	30	0.	31	96.3	32	96.2	33	95.5	34	96.9	35	96.8
36	96.8	37	93.9	38	96.0	39	96.0	40	95.1	41	95.1	42	95.5
43	95.3	44	90.9	45	94.3	46	88.6	47	96.3	48	71.5	49	71.0

TIME 1600 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.5	2	90.5	3	94.2	4	81.2	5	94.5	6	81.7	7	93.0
8	80.0	9	93.5	10	80.3	11	93.7	12	80.5	13	91.5	14	77.4
15	94.5	16	95.6	17	95.5	18	85.0	19	94.4	20	83.4	21	95.0
22	83.5	23	94.0	24	81.0	25	92.0	26	80.2	27	95.0	28	91.0
29	0.	30	0.	31	95.0	32	95.2	33	94.5	34	95.8	35	96.0
36	96.2	37	95.2	38	95.6	39	95.7	40	94.3	41	93.8	42	94.4
43	94.3	44	90.0	45	93.0	46	87.9	47	95.0	48	71.6	49	71.0

TIME 1700 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	90.2	3	91.2	4	80.4	5	93.5	6	81.5	7	92.2
8	79.1	9	92.5	10	79.5	11	93.0	12	79.9	13	91.2	14	77.2
15	94.0	16	90.2	17	95.0	18	84.8	19	94.0	20	80.0	21	95.0
22	93.2	23	93.0	24	80.5	25	93.0	26	80.3	27	94.0	28	92.5
29	0.	30	0.	31	94.3	32	94.6	33	94.0	34	95.1	35	95.5
36	93.8	37	94.5	38	95.1	39	95.2	40	93.5	41	93.0	42	93.8
43	93.5	44	90.5	45	92.5	46	87.4	47	94.5	48	71.6	49	71.1

TIME 1800 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.0	2	91.6	3	92.7	4	80.5	5	93.0	6	81.4	7	91.5
8	79.0	9	92.0	10	79.4	11	92.5	12	79.5	13	89.8	14	76.7
15	93.5	16	90.5	17	94.7	18	84.5	19	93.5	20	82.5	21	94.5
22	92.8	23	91.0	24	79.0	25	89.8	26	79.2	27	93.0	28	91.7
29	0.	30	0.	31	93.0	32	93.5	33	93.0	34	94.3	35	95.0
36	93.2	37	91.0	38	94.6	39	94.8	40	92.7	41	92.3	42	92.9
43	92.0	44	[illegible]	45	[illegible]	46	87.0	47	93.3	48	72.0	49	71.2

TIME 1900 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.5	2	90.5	3	91.3	4	80.3	5	91.5	6	80.3	7	90.0
8	78.5	9	90.5	10	78.3	11	90.5	12	78.5	13	87.8	14	76.7
15	92.7	16	93.8	17	93.7	18	84.1	19	92.7	20	80.0	21	93.5
22	92.0	23	90.5	24	79.0	25	87.3	26	78.7	27	91.5	28	90.5
29	0.	30	0.	31	91.3	32	92.0	33	91.5	34	93.0	35	94.0
36	92.2	37	91.0	38	93.7	39	94.0	40	90.5	41	90.2	42	91.2
43	90.5	44	87.5	45	89.1	46	85.8	47	91.5	48	71.5	49	71.2

TIME 2000 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	88.7	2	90.0	3	90.0	4	79.7	5	90.7	6	80.8	7	88.0
8	78.1	9	89.0	10	78.7	11	89.0	12	78.0	13	86.8	14	75.9
15	91.5	16	93.0	17	92.5	18	83.2	19	91.5	20	81.4	21	92.5
22	91.7	23	89.5	24	80.5	25	82.2	26	78.0	27	90.0	28	89.0
29	0.	30	0.	31	89.7	32	90.5	33	90.0	34	91.4	35	92.8
36	91.1	37	91.5	38	92.5	39	92.5	40	89.0	41	88.5	42	89.8
43	89.0	44	86.5	45	87.0	46	85.0	47	89.5	48	71.8	49	71.4

TIME 2100 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.5	2	86.5	3	89.0	4	79.2	5	89.0	6	79.8	7	86.5
8	77.7	9	85.0	10	75.7	11	87.0	12	76.8	13	85.0	14	75.0
15	90.5	16	92.0	17	91.5	18	81.0	19	90.0	20	80.0	21	91.5
22	81.0	23	85.5	24	77.4	25	82.4	26	76.2	27	87.7	28	87.2
29	0.	30	0.	31	87.8	32	89.2	33	89.0	34	89.7	35	91.0
36	92.0	37	90.0	38	90.9	39	91.0	40	87.1	41	86.7	42	88.0
43	87.7	44	85.5	45	85.5	46	84.0	47	88.0	48	72.0	49	71.2

TIME 2200 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.5	2	77.5	3	88.2	4	78.5	5	88.0	6	79.2	7	85.2
8	76.7	9	85.0	10	75.2	11	85.0	12	75.5	13	80.5	14	74.3
15	89.7	16	81.3	17	90.0	18	81.3	19	89.2	20	79.5	21	90.0
22	80.0	23	85.5	24	77.5	25	81.0	26	74.5	27	87.3	28	87.0
29	0.	30	0.	31	87.0	32	88.9	33	88.7	34	89.0	35	90.3
36	91.2	37	89.0	38	90.0	39	90.0	40	86.2	41	85.5	42	87.0
43	86.8	44	84.9	45	84.5	46	83.7	47	87.6	48	72.0	49	71.0

TIME 2300 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.0	2	77.5	3	87.7	4	78.2	5	87.5	6	79.2	7	84.5
8	76.3	9	84.0	10	74.3	11	84.7	12	76.0	13	86.0	14	73.0
15	89.0	16	80.0	17	89.7	18	80.3	19	88.0	20	78.0	21	89.0
22	79.0	23	84.5	24	76.5	25	81.1	26	74.0	27	87.0	28	86.0
29	0.	30	0.	31	87.0	32	87.8	33	88.0	34	87.9	35	89.9
36	90.2	37	90.0	38	89.5	39	89.5	40	84.6	41	84.7	42	86.0
43	85.7	44	83.5	45	84.2	46	83.0	47	87.0	48	71.2	49	71.0

TIME 2400 DATE 5/27/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.0	2	77.4	3	87.0	4	78.3	5	86.0	6	78.2	7	83.5
8	76.2	9	83.0	10	75.3	11	83.5	12	75.2	13	78.5	14	74.5
15	88.0	16	80.5	17	88.5	18	80.5	19	88.0	20	79.2	21	88.0
22	79.0	23	83.5	24	76.0	25	79.1	26	74.0	27	85.8	28	83.2
29	0.	30	0.	31	85.1	32	87.1	33	87.2	34	87.3	35	89.4
36	88.2	37	87.8	38	88.7	39	89.6	40	83.2	41	81.9	42	85.5
43	85.2	44	83.8	45	83.0	46	82.2	47	86.0	48	71.4	49	70.9

TIME 100 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.7	2	76.7	3	85.2	4	77.3	5	85.5	6	78.0	7	82.4
8	75.5	9	82.0	10	75.1	11	82.0	12	74.5	13	76.4	14	73.5
15	87.5	16	80.0	17	88.0	18	80.4	19	86.0	20	79.0	21	87.5
22	78.0	23	82.0	24	75.0	25	76.3	26	72.0	27	84.8	28	84.6
29	0.	30	0.	31	84.5	32	86.3	33	86.1	34	86.3	35	88.4
36	88.3	37	86.5	38	87.3	39	88.1	40	83.0	41	83.2	42	84.9
43	84.7	44	[illegible]	45	82.2	46	82.5	47	85.2	48	71.6	49	-0.

TIME 200 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.2	2	76.5	3	85.0	4	77.4	5	85.0	6	77.7	7	82.0
8	75.0	9	82.0	10	74.6	11	82.0	12	75.1	13	76.0	14	73.3
15	87.0	16	79.5	17	87.5	18	80.0	19	86.3	20	78.3	21	86.5
22	78.0	23	82.0	24	74.7	25	78.2	26	74.0	27	84.1	28	81.8
29	0.	30	0.	31	84.5	32	85.3	33	85.3	34	85.9	35	88.0
36	88.0	37	86.2	38	87.3	39	87.8	40	82.5	41	82.5	42	84.0
43	83.3	44	82.8	45	81.6	46	81.9	47	84.6	48	71.2	49	70.8

TIME 300 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	76.4	3	84.2	4	77.2	5	84.0	6	77.0	7	81.4
8	75.0	9	81.0	10	74.8	11	81.8	12	75.0	13	76.0	14	73.3
15	87.0	16	79.9	17	87.2	18	79.5	19	86.0	20	79.0	21	86.0
22	78.1	23	81.0	24	74.9	25	76.0	26	73.0	27	83.7	28	83.3
29	0.	30	0.	31	82.9	32	84.9	33	85.0	34	85.2	35	87.8
36	88.3	37	85.7	38	87.0	39	87.2	40	82.0	41	82.1	42	83.6
43	83.1	44	82.5	45	81.6	46	81.8	47	84.2	48	71.1	49	70.8

TIME 400 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	76.7	3	84.0	4	77.6	5	84.0	6	77.6	7	81.0
8	75.3	9	81.0	10	75.5	11	81.5	12	75.4	13	76.0	14	73.4
15	86.5	16	79.9	17	87.0	18	80.2	19	85.8	20	77.7	21	86.0
22	78.6	23	81.0	24	77.6	25	77.6	26	74.2	27	81.6	28	83.3
29	0.	30	0.	31	83.0	32	85.0	33	85.0	34	85.3	35	87.5
36	88.2	37	85.8	38	86.9	39	87.0	40	82.6	41	82.0	42	83.5
43	83.2	44	82.5	45	81.2	46	81.8	47	84.0	48	71.3	49	70.8

TIME 500 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	76.5	3	84.0	4	77.6	5	84.0	6	77.6	7	81.0
8	75.3	9	81.0	10	75.5	11	81.5	12	75.4	13	76.8	14	73.0
15	86.5	16	80.0	17	87.0	18	80.3	19	85.5	20	78.0	21	86.0
22	78.0	23	81.0	24	77.6	25	78.1	26	74.4	27	84.0	28	83.7
29	0.	30	0.	31	83.3	32	85.0	33	84.8	34	85.4	35	87.6
36	88.2	37	85.8	38	86.9	39	87.0	40	82.2	41	82.2	42	81.8
43	83.4	44	82.2	45	81.1	46	81.9	47	84.1	48	71.2	49	70.8

TIME 600 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	76.7	3	84.0	4	77.5	5	84.0	6	77.5	7	81.5
8	75.4	9	81.5	10	75.7	11	81.5	12	75.3	13	76.4	14	73.5
15	86.0	16	79.5	17	87.0	18	79.8	19	85.8	20	79.3	21	86.0
22	78.5	23	81.0	24	77.0	25	78.2	26	74.0	27	83.8	28	83.2
29	0.	30	0.	31	83.3	32	84.9	33	84.0	34	85.8	35	87.7
36	88.4	37	85.0	38	87.0	39	87.0	40	82.5	41	82.4	42	81.8
43	83.4	44	82.4	45	81.5	46	81.9	47	84.2	48	71.2	49	70.8

TIME 700 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	77.5	3	84.0	4	76.4	5	85.0	6	78.5	7	82.6
8	76.4	9	82.5	10	76.3	11	82.5	12	76.1	13	74.2	14	74.3
15	87.0	16	80.0	17	87.5	18	80.7	19	86.1	20	79.0	21	86.5
22	79.2	23	83.0	24	77.0	25	79.8	26	75.2	27	85.2	28	84.8
29	0.	30	0.	31	84.5	32	85.7	33	85.4	34	86.5	35	88.3
36	89.0	37	86.6	38	87.1	39	87.6	40	83.5	41	83.5	42	85.0
43	84.5	44	83.2	45	83.2	46	82.5	47	86.0	48	71.2	49	70.8

TIME 800 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.5	2	78.2	3	87.0	4	79.2	5	87.5	6	79.8	7	85.5
8	77.9	9	85.0	10	77.4	11	85.8	12	77.0	13	85.0	14	75.9
15	89.0	16	82.6	17	89.0	18	81.7	19	88.0	20	80.6	21	88.4
22	80.0	23	86.5	24	78.1	25	84.4	26	78.6	27	88.4	28	87.4
29	0.	30	0.	31	87.9	32	88.1	33	87.9	34	89.1	35	90.1
36	90.4	37	88.8	38	89.8	39	89.5	40	86.2	41	86.5	42	87.4
43	87.2	44	84.9	45	85.0	46	84.0	47	87.3	48	71.3	49	70.8

TIME 900 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	88.0	2	78.6	3	88.2	4	79.4	5	88.2	6	79.6	7	87.3
8	78.1	9	87.0	10	77.6	11	86.6	12	77.4	13	86.2	14	76.0
15	90.0	16	82.7	17	90.5	18	82.2	19	89.3	20	80.0	21	90.0
22	80.6	23	86.0	24	78.1	25	84.4	26	77.0	27	88.5	28	88.0
29	0.	30	0.	31	88.5	32	89.0	33	88.5	34	90.0	35	91.0
36	91.5	37	90.0	38	90.2	39	90.5	40	87.8	41	87.8	42	88.8
43	88.5	44	85.7	45	87.0	46	84.6	47	89.2	48	71.1	49	70.8

TIME 1000 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	89.5	2	79.2	3	89.5	4	80.3	5	90.0	6	80.7	7	89.0
8	78.8	9	89.0	10	78.7	11	89.2	12	78.5	13	88.5	14	76.5
15	90.0	16	83.7	17	91.7	18	82.8	19	90.2	20	81.5	21	91.0
22	81.5	23	90.7	24	80.4	25	88.8	26	78.6	27	90.9	28	90.0
29	0.	30	0.	31	90.5	32	90.7	33	90.1	34	90.2	35	92.4
36	92.8	37	91.4	38	91.6	39	92.0	40	90.0	41	90.0	42	90.5
43	90.1	44	87.0	45	85.2	46	77.4	47	79.2	48	71.0	49	70.7

TIME 1100 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.8	2	79.6	3	90.8	4	80.4	5	91.0	6	80.7	7	90.5
8	79.7	9	91.0	10	75.4	11	91.0	12	79.5	13	90.2	14	77.0
15	92.0	16	84.5	17	93.0	18	83.7	19	91.7	20	81.0	21	92.4
22	81.8	23	92.0	24	82.2	25	91.0	26	80.0	27	92.0	28	91.5
29	0.	30	0.	31	92.0	32	92.0	33	91.5	34	93.5	35	93.5
36	93.7	37	93.0	38	93.0	39	93.0	40	91.5	41	91.5	42	92.0
43	91.5	44	88.0	45	91.0	46	86.5	47	92.7	48	71.2	49	70.7

TIME 1200 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.0	2	79.6	3	89.8	4	79.0	5	92.0	6	81.0	7	91.5
8	79.7	9	91.9	10	79.6	11	91.9	12	79.8	13	92.0	14	77.5
15	92.6	16	85.3	17	94.0	18	84.3	19	92.5	20	82.6	21	92.5
22	82.0	23	93.0	24	82.5	25	92.3	26	80.6	27	93.0	28	92.5
29	0.	30	0.	31	93.2	32	93.0	33	92.6	34	94.6	35	94.8
36	94.8	37	93.9	38	94.0	39	94.0	40	92.5	41	92.6	42	93.2
43	93.0	44	88.8	45	92.2	46	87.1	47	94.0	48	72.0	49	70.8

TIME 1300 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	92.8	4	80.6	5	92.5	6	81.6	7	92.7
8	79.4	9	93.0	10	81.2	11	93.0	12	81.4	13	92.2	14	77.5
15	94.0	16	85.6	17	94.5	18	84.4	19	93.6	20	82.7	21	94.4
22	84.0	23	91.0	24	77.6	25	92.8	26	80.0	27	94.5	28	94.0
29	0.	30	0.	31	94.2	32	94.1	33	93.8	34	96.0	35	95.8
36	95.3	37	95.0	38	95.0	39	95.0	40	93.6	41	93.6	42	94.2
43	97.8	44	89.5	45	93.0	46	87.6	47	94.5	48	71.2	49	70.7

TIME 1400 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.1	2	79.8	3	93.1	4	80.5	5	93.5	6	81.1	7	93.0
8	79.3	9	93.0	10	80.0	11	93.0	12	79.6	13	92.9	14	77.3
15	94.1	16	85.3	17	95.0	18	83.5	19	94.0	20	83.4	21	94.5
22	81.0	23	93.1	24	79.1	25	92.5	26	80.0	27	94.5	28	94.2
29	0.	30	0.	31	94.8	32	94.5	33	94.0	34	96.4	35	96.0
36	96.2	37	95.5	38	95.5	39	95.5	40	94.4	41	94.0	42	94.5
43	94.2	44	90.0	45	91.5	46	88.1	47	95.1	48	71.5	49	70.6

TIME 1500 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.2	2	79.5	3	93.3	4	80.3	5	93.5	6	81.6	7	93.0
8	79.0	9	93.0	10	79.8	11	93.5	12	80.0	13	92.6	14	77.5
15	91.1	16	85.4	17	95.5	18	83.8	19	94.2	20	90.0	21	95.0
22	82.7	23	94.0	24	80.5	25	92.2	26	80.2	27	95.0	28	94.5
29	0.	30	0.	31	95.0	32	94.8	33	94.2	34	96.5	35	96.2
36	96.2	37	95.8	38	95.8	39	95.8	40	94.2	41	94.2	42	94.9
43	94.5	44	90.0	45	93.5	46	88.0	47	95.1	48	71.1	49	70.5

TIME 1600 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.5	2	79.9	3	93.4	4	80.5	5	94.0	6	81.5	7	93.0
8	79.2	9	93.0	10	75.5	11	94.0	12	80.3	13	92.0	14	76.5
15	94.2	16	85.4	17	96.0	18	84.6	19	94.5	20	82.1	21	95.0
22	82.7	23	94.0	24	80.5	25	92.4	26	80.2	27	95.0	28	94.9
29	0.	30	0.	31	94.8	32	94.8	33	94.1	34	96.5	35	96.2
36	96.4	37	95.8	38	96.0	39	96.0	40	94.2	41	94.0	42	94.5
43	94.2	44	90.0	45	93.0	46	88.0	47	94.7	48	71.0	49	70.3

TIME 1700 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	79.5	3	93.0	4	80.7	5	93.5	6	81.1	7	92.7
8	79.3	9	93.0	10	80.0	11	93.0	12	79.4	13	91.5	14	76.4
15	94.2	16	85.0	17	95.5	18	84.3	19	94.5	20	80.0	21	95.0
22	82.5	23	92.2	24	78.0	25	92.0	26	80.0	27	94.0	28	91.5
29	0.	30	0.	31	94.5	32	94.3	33	93.1	34	96.0	35	96.0
36	96.4	37	96.0	38	95.8	39	95.8	40	93.0	41	93.5	42	94.0
43	93.8	44	89.7	45	92.7	46	87.8	47	94.4	48	71.0	49	70.2

TIME 1800 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.5	2	79.5	3	92.7	4	80.1	5	93.0	6	80.8	7	92.0
8	78.6	9	92.5	10	79.5	11	92.7	12	79.4	13	90.5	14	76.9
15	94.0	16	84.5	17	95.0	18	84.0	19	94.2	20	82.3	21	95.0
22	82.1	23	92.2	24	79.4	25	90.6	26	79.0	27	93.5	28	91.7
29	0.	30	0.	31	93.6	32	93.7	33	93.0	34	95.3	35	95.5
36	95.7	37	95.0	38	95.2	39	95.0	40	93.2	41	93.0	42	93.5
43	93.1	44	89.0	45	92.1	46	87.4	47	93.8	48	70.7	49	70.1

TIME 1900 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.0	2	79.8	3	91.5	4	80.6	5	92.0	6	83.0	7	90.8
8	79.2	9	91.0	10	79.2	11	91.2	12	79.0	13	87.8	14	75.9
15	93.5	16	84.3	17	94.5	18	84.7	19	93.5	20	82.0	21	94.5
22	82.5	23	90.0	24	75.2	25	88.2	26	78.0	27	92.0	28	90.5
29	0.	30	0.	31	92.0	32	92.2	33	92.0	34	94.0	35	94.8
36	94.4	37	94.0	38	94.5	39	94.7	40	91.5	41	91.4	42	92.0
43	91.5	44	88.0	45	90.2	46	86.5	47	92.2	48	70.5	49	70.1

TIME 2000 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	89.5	2	79.0	3	90.5	4	80.0	5	91.0	6	80.7	7	89.0
8	78.5	9	89.0	10	78.3	11	90.0	12	78.5	13	85.5	14	75.2
15	92.2	16	83.0	17	93.5	18	84.2	19	92.5	20	81.3	21	93.0
22	81.4	23	88.5	24	75.2	25	86.5	26	78.5	27	90.0	28	89.0
29	0.	30	0.	31	90.2	32	91.0	33	90.7	34	92.2	35	93.4
36	93.7	37	92.4	38	93.2	39	93.3	40	89.5	41	89.4	42	90.3
43	90.0	44	87.0	45	87.8	46	85.2	47	90.0	48	70.5	49	70.1

TIME 2100 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	88.0	2	78.3	3	89.5	4	79.1	5	89.2	6	79.4	7	87.0
8	77.4	9	87.0	10	77.0	11	87.5	12	77.1	13	82.5	14	74.9
15	91.0	16	82.0	17	91.5	18	82.5	19	91.0	20	80.0	21	91.2
22	80.7	23	87.0	24	76.4	25	82.9	26	76.0	27	88.5	28	87.5
29	0.	30	0.	31	88.2	32	90.0	33	89.6	34	90.1	35	91.7
36	92.2	37	90.7	38	91.5	39	91.6	40	87.6	41	87.2	42	88.5
43	88.0	44	85.6	45	86.0	46	84.3	47	89.0	48	70.7	49	70.2

TIME 2200 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.0	2	77.1	3	88.2	4	78.5	5	88.5	6	79.4	7	86.0
8	77.0	9	86.0	10	76.7	11	86.5	12	76.5	13	81.0	14	74.0
15	90.0	16	81.4	17	90.7	18	81.8	19	90.0	20	79.7	21	90.5
22	80.8	23	85.5	24	77.4	25	87.5	26	76.0	27	87.5	28	86.8
29	0.	30	0.	31	87.2	32	88.7	33	88.5	34	89.2	35	90.8
36	91.5	37	89.7	38	90.5	39	90.7	40	86.5	41	86.4	42	87.5
43	87.2	44	85.0	45	85.1	46	84.0	47	87.8	48	71.0	49	70.3

TIME 2300 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.0	2	77.5	3	87.2	4	78.2	5	87.5	6	79.0	7	85.0
8	76.5	9	85.0	10	76.5	11	85.0	12	75.7	13	80.2	14	73.8
15	89.5	16	81.0	17	90.0	18	81.4	19	89.0	20	70.0	21	89.2
22	73.2	23	85.5	24	77.9	25	80.2	26	74.8	27	86.5	28	86.0
29	0.	30	0.	31	86.2	32	87.6	33	87.4	34	88.4	35	90.0
36	90.8	37	88.9	38	89.9	39	90.0	40	85.6	41	85.5	42	87.0
43	86.3	44	84.5	45	84.6	46	83.5	47	87.0	48	71.0	49	70.2

TIME 2400 DATE 5/28/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.0	2	77.0	3	86.0	4	78.2	5	86.0	6	78.2	7	83.8
8	76.4	9	84.0	10	76.5	11	84.0	12	75.4	13	78.4	14	73.8
15	88.8	16	80.9	17	89.0	18	81.1	19	88.0	20	78.9	21	88.0
22	74.0	23	84.5	24	78.0	25	78.9	26	74.8	27	85.8	28	85.3
29	0.	30	0.	31	85.5	32	87.1	33	86.9	34	88.0	35	89.6
36	90.1	37	88.1	38	89.2	39	89.2	40	85.0	41	84.5	42	85.9
43	85.2	44	83.9	45	83.6	46	83.1	47	86.0	48	71.0	49	70.2

TIME 100 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.5	2	77.4	3	85.7	4	78.3	5	86.0	6	78.5	7	83.0
8	75.9	9	83.0	10	75.9	11	83.5	12	75.8	13	78.0	14	73.8
15	88.2	16	80.5	17	88.5	18	80.8	19	87.5	20	78.0	21	87.5
22	78.4	23	84.5	24	78.2	25	78.5	26	74.2	27	85.0	28	84.6
29	0.	30	0.	31	84.6	32	86.0	33	86.0	34	87.0	35	89.0
36	89.7	37	87.4	38	88.3	39	88.3	40	83.7	41	83.7	42	85.0
43	84.6	44	83.2	45	83.0	46	82.6	47	85.2	48	70.9	49	70.2

TIME 200 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	77.4	3	85.0	4	78.0	5	85.5	6	78.4	7	82.3
8	75.6	9	82.0	10	75.4	11	82.5	12	75.2	13	77.0	14	73.4
15	87.8	16	80.4	17	88.0	18	80.6	19	87.0	20	78.7	21	87.0
22	78.6	23	83.5	24	79.4	25	77.4	26	73.7	27	84.3	28	83.9
29	0.	30	0.	31	83.7	32	85.5	33	85.3	34	86.0	35	88.1
36	88.0	37	86.8	38	87.6	39	87.7	40	83.0	41	82.8	42	84.6
43	83.6	44	82.9	45	82.8	46	82.3	47	84.0	48	71.0	49	70.1

TIME 300 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	76.5	3	84.7	4	77.7	5	84.5	6	77.6	7	82.0
8	75.5	9	82.0	10	75.6	11	82.0	12	75.0	13	77.1	14	74.0
15	87.3	16	80.0	17	88.0	18	80.8	19	86.3	20	70.0	21	84.5
22	78.8	23	84.5	24	78.5	25	78.0	26	74.0	27	83.8	28	83.2
29	0.	30	0.	31	83.2	32	85.0	33	84.9	34	85.7	35	87.9
36	88.5	37	86.1	38	87.1	39	87.1	40	82.8	41	82.8	42	84.3
43	83.5	44	82.5	45	82.5	46	82.2	47	84.5	48	70.7	49	70.1

TIME 400 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	76.8	3	84.0	4	77.4	5	84.0	6	77.2	7	82.0
8	75.5	9	82.0	10	75.6	11	82.0	12	75.1	13	76.8	14	73.8
15	87.0	16	79.9	17	87.5	18	80.4	19	86.0	20	70.3	21	84.0
22	78.2	23	83.5	24	79.2	25	77.5	26	73.1	27	83.8	28	83.2
29	0.	30	0.	31	83.0	32	84.8	33	84.6	34	85.5	35	87.4
36	88.2	37	85.9	38	86.9	39	86.9	40	82.2	41	82.2	42	83.4
43	83.0	44	82.2	45	81.9	46	82.0	47	83.9	48	70.7	49	70.0

TIME 500 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	76.7	3	84.0	4	77.5	5	84.0	6	77.3	7	81.8
8	75.6	9	81.5	10	75.2	11	82.0	12	75.1	13	76.8	14	73.3
15	87.0	16	79.9	17	87.0	18	80.0	19	86.0	20	78.0	21	86.0
22	78.2	23	84.5	24	78.3	25	76.7	26	73.2	27	83.5	28	83.0
29	0.	30	0.	31	83.0	32	84.5	33	84.3	34	85.1	35	87.4
36	88.0	37	85.7	38	86.7	39	86.7	40	82.2	41	82.1	42	83.6
43	82.9	44	82.1	45	82.0	46	82.1	47	83.9	48	70.6	49	70.0

TIME 600 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.2	2	76.5	3	84.0	4	77.4	5	84.0	6	77.2	7	82.0
8	75.3	9	82.0	10	75.4	11	82.0	12	74.8	13	77.8	14	73.1
15	87.2	16	80.0	17	87.5	18	80.4	19	86.0	20	78.3	21	86.0
22	78.2	23	83.5	24	79.0	25	78.2	26	73.8	27	84.0	28	83.7
29	0.	30	0.	31	83.6	32	85.0	33	84.9	34	85.9	35	87.9
36	88.3	37	86.0	38	86.9	39	86.9	40	83.0	41	82.9	42	84.1
43	83.3	44	82.7	45	82.6	46	82.5	47	84.4	48	70.7	49	69.9

TIME 700 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	76.8	3	84.0	4	77.7	5	85.5	6	78.4	7	83.3
8	76.0	9	83.5	10	76.1	11	83.5	12	75.8	13	80.0	14	73.6
15	88.0	16	80.8	17	88.0	18	80.6	19	86.2	20	78.0	21	87.0
22	79.2	23	83.5	24	78.5	25	81.3	26	75.1	27	85.1	28	84.7
29	0.	30	0.	31	84.9	32	85.8	33	85.3	34	87.0	35	88.5
36	88.9	37	86.8	38	87.2	39	87.3	40	84.0	41	84.0	42	85.2
43	84.8	44	83.6	45	84.0	46	83.0	47	85.6	48	70.6	49	69.9

TIME 800 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.0	2	76.8	3	87.0	4	76.5	5	86.4	6	77.8	7	86.8
8	77.4	9	85.8	10	75.2	11	86.0	12	75.7	13	85.0	14	76.0
15	89.5	16	78.0	17	89.0	18	80.0	19	88.2	20	77.0	21	88.0
22	79.0	23	87.0	24	77.2	25	85.0	26	76.8	27	87.2	28	86.6
29	0.	30	0.	31	87.2	32	87.7	33	87.2	34	90.0	35	90.1
36	90.6	37	89.2	38	89.0	39	89.0	40	87.0	41	87.0	42	87.8
43	87.1	44	85.0	45	86.7	46	84.4	47	87.9	48	70.3	49	68.8

TIME 900 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	88.5	2	78.5	3	88.2	4	79.4	5	93.0	6	83.0	7	88.0
8	78.0	9	92.0	10	81.1	11	92.0	12	80.6	13	86.2	14	75.3
15	90.5	16	82.7	17	90.0	18	81.5	19	89.0	20	80.0	21	89.0
22	80.1	23	88.0	24	78.4	25	86.1	26	77.6	27	79.0	28	78.2
29	0.	30	0.	31	89.0	32	89.2	33	88.7	34	91.0	35	91.5
36	91.8	37	90.0	38	90.2	39	90.4	40	88.6	41	88.6	42	88.6
43	88.6	44	86.0	45	88.5	46	85.2	47	89.9	48	70.3	49	-0.

TIME 1000 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.5	2	78.6	3	90.0	4	80.1	5	90.0	6	80.2	7	90.5
8	81.8	9	89.5	10	78.5	11	89.5	12	78.3	13	89.5	14	76.6
15	91.6	16	79.8	17	91.6	18	82.7	19	90.5	20	79.2	21	91.0
22	81.8	23	91.0	24	79.5	25	90.2	26	80.2	27	91.5	28	90.8
29	0.	30	0.	31	91.5	32	91.4	33	90.8	34	93.0	35	93.0
36	93.4	37	91.8	38	92.0	39	91.9	40	91.2	41	90.8	42	91.2
43	91.1	44	87.5	45	90.5	46	86.5	47	91.6	48	70.5	49	68.8

TIME 1100 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.5	2	79.2	3	91.0	4	80.0	5	92.0	6	81.2	7	91.5
8	79.3	9	91.0	10	81.7	11	91.0	12	79.6	13	90.5	14	77.0
15	91.0	16	82.2	17	91.0	18	81.4	19	92.6	20	80.0	21	91.8
22	81.0	23	91.0	24	78.8	25	90.8	26	80.0	27	92.8	28	91.8
29	0.	30	0.	31	92.8	32	92.4	33	92.0	34	93.1	35	93.2
36	93.2	37	93.6	38	93.0	39	93.0	40	92.2	41	92.2	42	92.5
43	92.2	44	88.4	45	91.5	46	87.0	47	93.0	48	70.1	49	68.7

TIME 1200 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.8	2	78.4	3	92.2	4	80.5	5	92.0	6	80.3	7	92.6
8	79.5	9	92.2	10	79.7	11	92.2	12	82.7	13	91.5	14	77.2
15	93.5	16	85.2	17	94.0	18	84.3	19	93.6	20	84.5	21	93.0
22	82.8	23	94.0	24	80.9	25	92.8	26	80.5	27	94.2	28	93.2
29	0.	30	0.	31	94.0	32	93.8	33	93.2	34	95.5	35	95.2
36	95.4	37	94.6	38	94.2	39	94.2	40	93.4	41	93.5	42	93.8
43	93.8	44	89.2	45	92.9	46	87.8	47	94.2	48	70.0	49	0.

TIME 1300 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.8	2	80.2	3	93.4	4	80.8	5	93.0	6	80.7	7	93.5
8	79.6	9	93.0	10	79.8	11	93.0	12	80.2	13	92.0	14	77.1
15	94.4	16	85.6	17	95.5	18	84.6	19	93.5	20	83.7	21	93.5
22	82.5	23	94.0	24	80.2	25	92.2	26	81.0	27	95.0	28	94.0
29	0.	30	0.	31	95.0	32	94.8	33	94.2	34	96.4	35	96.0
36	96.2	37	95.0	38	95.0	39	95.0	40	94.8	41	94.4	42	94.8
43	94.6	44	90.0	45	94.0	46	88.2	47	95.5	48	70.0	49	68.7

TIME 1400 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	94.0	2	80.2	3	93.9	4	80.8	5	94.0	6	84.5	7	94.0
8	79.8	9	93.0	10	79.3	11	93.0	12	79.1	13	92.8	14	77.7
15	95.0	16	85.9	17	95.0	18	84.9	19	94.4	20	83.7	21	94.4
22	82.8	23	94.0	24	80.1	25	92.4	26	81.0	27	95.1	28	94.0
29	0.	30	0.	31	95.0	32	95.0	33	94.5	34	97.0	35	96.5
36	96.5	37	95.5	38	95.5	39	95.5	40	95.0	41	94.8	42	95.0
43	95.0	44	90.2	45	94.4	46	88.0	47	96.0	48	70.0	49	69.6

TIME 1500 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	94.4	2	80.4	3	94.2	4	81.0	5	94.2	6	81.2	7	94.4
8	80.8	9	94.0	10	80.2	11	94.2	12	80.5	13	92.8	14	77.6
15	95.5	16	86.3	17	96.0	18	84.2	19	94.8	20	83.7	21	95.0
22	83.1	23	95.0	24	80.5	25	94.0	26	81.5	27	95.8	28	95.0
29	0.	30	0.	31	96.0	32	95.8	33	95.2	34	97.7	35	97.2
36	97.2	37	96.2	38	96.2	39	96.2	40	95.6	41	95.1	42	95.5
43	95.2	44	90.5	45	94.2	46	88.0	47	96.0	48	70.0	49	69.8

TIME 1600 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	94.5	2	82.0	3	94.8	4	82.1	5	95.0	6	81.6	7	94.4
8	79.5	9	94.5	10	80.8	11	94.5	12	80.5	13	92.5	14	77.2
15	95.8	16	85.8	17	97.0	18	84.7	19	95.0	20	83.7	21	96.0
22	82.8	23	95.0	24	80.3	25	93.4	26	81.0	27	95.8	28	95.1
29	0.	30	0.	31	96.0	32	95.8	33	95.1	34	98.0	35	97.5
36	97.6	37	96.1	38	96.1	39	96.2	40	95.9	41	95.0	42	95.8
43	95.5	44	90.8	45	94.5	46	88.3	47	96.2	48	70.1	49	69.9

TIME 1700 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	94.0	2	80.3	3	94.0	4	80.7	5	95.0	6	81.6	7	93.8
8	79.3	9	94.0	10	80.4	11	94.0	12	80.5	13	91.8	14	77.5
15	95.4	16	85.9	17	97.0	18	84.4	19	95.0	20	83.0	21	95.5
22	82.5	23	95.0	24	81.0	25	91.5	26	80.5	27	95.2	28	95.0
29	0.	30	0.	31	95.5	32	95.5	33	95.0	34	97.8	35	97.4
36	97.2	37	96.0	38	96.0	39	96.2	40	95.4	41	94.7	42	95.1
43	95.0	44	70.2	45	94.0	46	88.0	47	95.8	48	70.2	49	69.0

TIME 1800 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.5	2	80.0	3	94.0	4	80.9	5	94.5	6	81.5	7	93.3
8	79.5	9	93.6	10	79.6	11	94.0	12	80.4	13	90.5	14	76.9
15	95.4	16	84.5	17	96.5	18	84.3	19	95.0	20	82.8	21	95.5
22	82.5	23	95.0	24	80.6	25	90.0	26	79.4	27	94.8	28	94.5
29	0.	30	0.	31	94.0	32	94.1	33	94.1	34	97.8	35	96.5
36	96.4	37	95.5	38	95.0	39	95.8	40	94.9	41	94.0	42	94.5
43	94.1	44	70.0	45	93.0	46	87.5	47	94.7	48	70.0	49	70.0

TIME 1900 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.4	2	77.2	3	92.0	4	79.6	5	91.5	6	79.6	7	91.4
8	78.3	9	91.0	10	78.4	11	89.5	12	77.1	13	88.0	14	75.8
15	95.0	16	85.1	17	96.0	18	85.9	19	94.0	20	83.0	21	95.0
22	83.3	23	92.0	24	80.3	25	87.5	26	79.8	27	92.8	28	89.1
29	0.	30	0.	31	92.6	32	93.0	33	92.5	34	96.8	35	96.9
36	97.0	37	95.0	38	95.5	39	95.5	40	91.8	41	91.1	42	91.0
43	92.0	44	88.2	45	91.1	46	86.7	47	92.5	48	70.6	49	70.1

TIME 2000 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.0	2	79.0	3	90.5	4	79.2	5	91.0	6	79.8	7	94.8
8	82.3	9	88.5	10	77.0	11	87.0	12	75.7	13	85.0	14	74.8
15	94.5	16	85.3	17	95.0	18	85.4	19	94.0	20	83.5	21	94.0
22	82.7	23	91.0	24	80.5	25	89.7	26	76.1	27	90.0	28	82.4
29	0.	30	0.	31	90.0	32	90.7	33	90.7	34	94.5	35	95.4
36	95.4	37	94.0	38	94.5	39	94.5	40	89.1	41	88.8	42	88.6
43	89.5	44	86.9	45	89.0	46	75.0	47	90.3	48	70.7	49	70.2

TIME 2100 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.5	2	77.6	3	88.4	4	77.8	5	89.0	6	79.0	7	87.5
8	77.2	9	86.0	10	75.3	11	85.0	12	74.5	13	82.5	14	73.2
15	92.8	16	83.7	17	93.5	18	83.1	19	92.0	20	81.8	21	93.0
22	81.9	23	89.4	24	79.0	25	82.8	26	76.8	27	88.0	28	81.0
29	0.	30	0.	31	88.0	32	88.5	33	88.6	34	92.4	35	93.6
36	93.4	37	92.0	38	92.9	39	92.9	40	86.6	41	86.6	42	86.8
43	87.7	44	85.4	45	86.5	46	84.0	47	87.8	48	70.7	49	70.4

TIME 2200 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.0	2	78.5	3	87.4	4	78.6	5	88.0	6	79.0	7	86.4
8	77.4	9	85.0	10	76.0	11	83.0	12	74.5	13	81.5	14	73.8
15	92.0	16	84.0	17	92.5	18	84.0	19	91.0	20	82.2	21	92.0
22	82.5	23	88.0	24	79.7	25	81.5	26	76.9	27	87.2	28	81.5
29	0.	30	0.	31	87.0	32	87.5	33	87.6	34	91.0	35	92.6
36	93.0	37	91.0	38	91.6	39	91.8	40	85.0	41	85.0	42	85.4
43	86.4	44	84.5	45	85.1	46	83.3	47	87.0	48	70.5	49	70.5

TIME 2300 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.5	2	77.7	3	86.0	4	77.6	5	87.0	6	78.5	7	85.0
8	76.6	9	84.0	10	75.4	11	82.5	12	75.0	13	80.0	14	73.7
15	91.0	16	83.1	17	92.0	18	84.0	19	90.0	20	81.5	21	91.0
22	82.1	23	86.0	24	75.0	25	80.4	26	74.4	27	86.2	28	81.3
29	0.	30	0.	31	86.3	32	87.0	33	87.0	34	90.6	35	90.7
36	92.5	37	91.0	38	91.0	39	90.9	40	85.0	41	84.4	42	85.0
43	86.0	44	84.3	45	84.9	46	83.4	47	86.6	48	71.1	49	70.5

TIME 2400 DATE 5/29/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.0	2	77.4	3	85.5	4	77.6	5	88.0	6	79.7	7	84.2
8	76.2	9	82.5	10	74.6	11	81.0	12	73.7	13	80.0	14	74.5
15	90.2	16	82.7	17	90.5	18	82.7	19	89.4	20	81.4	21	90.0
22	81.6	23	84.5	24	77.6	25	80.4	26	74.4	27	85.5	28	80.8
29	0.	30	0.	31	85.1	32	86.0	33	86.1	34	89.5	35	91.0
36	91.6	37	89.1	38	90.0	39	90.0	40	83.6	41	83.4	42	83.9
43	85.0	44	83.8	45	83.4	46	82.5	47	85.3	48	70.8	49	70.2

TIME 100 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.5	2	76.5	3	84.7	4	77.2	5	85.5	6	77.8	7	83.0
8	75.5	9	82.0	10	75.1	11	80.0	12	73.6	13	78.0	14	73.6
15	89.5	16	82.1	17	90.0	18	82.5	19	88.5	20	80.8	21	88.5
22	80.8	23	83.5	24	77.1	25	78.8	26	74.9	27	84.8	28	80.1
29	0.	30	0.	31	84.1	32	85.0	33	85.1	34	88.7	35	90.2
36	90.4	37	88.2	38	89.1	39	89.1	40	82.5	41	82.2	42	82.8
43	84.0	44	83.0	45	82.9	46	81.9	47	84.8	48	70.7	49	70.0

TIME 200 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.2	2	76.7	3	84.0	4	77.0	5	84.5	6	77.3	7	82.5
8	75.5	9	80.5	10	74.2	11	79.5	12	73.9	13	77.0	14	72.8
15	89.0	16	82.0	17	89.5	18	82.2	19	88.0	20	80.8	21	88.0
22	80.6	23	83.5	24	77.2	25	78.1	26	74.0	27	84.5	28	[illegible]
29	0.	30	0.	31	83.9	32	84.8	33	84.9	34	88.0	35	90.0
36	90.3	37	87.8	38	88.6	39	88.7	40	81.5	41	81.1	42	82.0
43	83.1	44	82.6	45	81.9	46	81.5	47	83.9	48	70.7	49	70.0

TIME 300 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	76.7	3	83.8	4	77.0	5	84.5	6	77.4	7	82.2
8	75.4	9	80.0	10	73.8	11	78.5	12	73.0	13	76.1	14	72.6
15	89.0	16	81.9	17	89.5	18	82.2	19	87.4	20	80.5	21	88.0
22	80.8	23	83.0	24	76.8	25	76.3	26	73.0	27	84.0	28	83.4
29	0.	30	0.	31	83.2	32	84.3	33	84.5	34	87.6	35	89.6
36	90.0	37	87.6	38	88.1	39	88.1	40	81.1	41	80.8	42	81.1
43	83.0	44	82.2	45	81.9	46	81.6	47	83.8	48	70.5	49	70.0

TIME 400 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	76.0	3	83.2	4	76.1	5	84.0	6	77.1	7	82.0
8	75.0	9	80.0	10	74.0	11	78.5	12	73.2	13	76.8	14	73.2
15	88.8	16	81.3	17	89.0	18	81.7	19	87.0	20	80.1	21	88.0
22	80.8	23	83.0	24	77.2	25	77.2	26	73.2	27	83.7	28	83.0
29	0.	30	0.	31	83.1	32	84.0	33	84.1	34	87.6	35	89.4
36	90.0	37	87.0	38	87.8	39	87.8	40	80.7	41	80.2	42	81.0
43	82.5	44	82.0	45	81.0	46	81.3	47	83.0	48	70.4	49	69.9

TIME 500 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.7	2	76.4	3	83.0	4	76.2	5	84.0	6	77.1	7	82.0
8	75.3	9	80.0	10	74.3	11	78.0	12	72.6	13	76.3	14	72.6
15	88.8	16	81.5	17	89.0	18	81.7	19	87.0	20	80.5	21	87.5
22	80.5	23	83.0	24	77.0	25	77.0	26	72.8	27	83.1	28	82.9
29	0.	30	0.	31	82.9	32	83.8	33	83.9	34	87.3	35	89.1
36	89.9	37	88.8	38	87.3	39	87.3	40	81.0	41	80.7	42	80.9
43	82.8	44	82.0	45	81.0	46	81.2	47	83.1	48	70.0	49	69.8

TIME 600 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	76.5	3	83.2	4	76.6	5	84.0	6	77.0	7	82.0
8	75.2	9	80.0	10	73.8	11	78.5	12	73.1	13	76.4	14	72.7
15	88.8	16	81.5	17	88.5	18	81.3	19	87.0	20	80.5	21	88.0
22	80.8	23	83.0	24	76.8	25	76.0	26	73.3	27	83.7	28	83.1
29	0.	30	0.	31	83.4	32	84.2	33	84.2	34	87.8	35	89.2
36	90.0	37	81.6	38	88.1	39	88.6	40	81.5	41	80.9	42	81.5
43	83.0	44	82.1	45	81.9	46	81.8	47	83.5	48	70.0	49	69.6

TIME 700 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	77.4	3	84.2	4	77.5	5	85.5	6	78.9	7	83.2
8	76.4	9	82.0	10	75.3	11	80.5	12	74.1	13	81.0	14	75.0
15	89.2	16	82.4	17	90.0	18	83.0	19	89.5	20	82.0	21	88.5
22	81.4	23	85.5	24	78.2	25	80.9	26	76.0	27	85.3	28	85.0
29	0.	30	0.	31	85.0	32	85.4	33	85.1	34	88.8	35	90.0
36	90.5	37	88.6	38	85.0	39	88.8	40	83.2	41	83.0	42	83.1
43	84.7	44	83.2	45	83.7	46	82.5	47	85.1	48	69.9	49	69.3

TIME 800 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.3	2	78.3	3	81.3	4	74.0	5	86.5	6	78.6	7	80.0
8	77.6	9	84.0	10	75.9	11	83.6	12	75.6	13	83.0	14	75.0
15	90.5	16	83.7	17	90.0	18	82.3	19	88.0	20	81.5	21	89.5
22	81.7	23	88.0	24	80.1	25	82.5	26	76.2	27	87.0	28	86.4
29	0.	30	0.	31	87.0	32	87.1	33	87.[illegible]	34	90.7	35	91.5
36	91.8	37	86.0	38	90.1	39	90.0	40	86.1	41	86.0	42	86.0
43	87.0	44	84.8	45	86.2	46	83.9	47	87.6	48	69.9	49	0.

TIME 900 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	88.0	2	78.4	3	88.0	4	79.1	5	88.0	6	79.0	7	87.8
8	77.8	9	86.0	10	76.0	11	85.0	12	75.6	13	86.0	14	75.8
15	91.3	16	84.3	17	92.0	18	84.3	19	90.0	20	82.6	21	90.0
22	81.6	23	88.0	24	78.9	25	85.0	26	77.5	27	88.9	28	87.9
29	0.	30	0.	31	88.8	32	88.8	33	88.6	34	92.0	35	92.8
36	93.0	37	91.2	38	91.3	39	91.1	40	87.8	41	87.7	42	87.7
43	88.5	44	85.8	45	87.9	46	84.6	47	89.2	48	69.8	49	69.2

TIME 1000 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	89.9	2	79.2	3	89.4	4	79.5	5	90.5	6	79.8	7	89.5
8	78.4	9	89.0	10	77.8	11	81.5	12	76.7	13	83.5	14	76.6
15	92.2	16	85.6	17	93.0	18	85.7	19	90.6	20	82.6	21	92.0
22	84.2	23	91.0	24	80.2	25	88.3	26	78.9	27	91.0	28	90.0
29	0.	30	0.	31	90.7	32	90.5	33	90.2	34	93.6	35	93.8
36	94.0	37	92.3	38	92.3	39	92.1	40	90.1	41	90.1	42	90.0
43	90.5	44	87.2	45	90.8	46	85.8	47	91.3	48	69.4	49	69.2

TIME 1100 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.2	2	79.7	3	91.0	4	79.8	5	91.7	6	80.6	7	91.0
8	79.2	9	90.0	10	77.2	11	90.0	12	77.5	13	90.9	14	77.2
15	93.4	16	86.5	17	94.0	18	86.5	19	92.0	20	83.0	21	92.5
22	82.4	23	91.0	24	79.5	25	90.0	26	80.0	27	90.5	28	91.4
29	0.	30	0.	31	92.2	32	92.1	33	91.0	34	94.8	35	95.0
36	95.1	37	91.0	38	94.5	39	93.4	40	91.0	41	91.5	42	91.5
43	92.0	44	83.0	45	91.5	46	86.6	47	92.5	48	89.6	49	89.4

TIME 1200 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.5	2	80.0	3	92.2	4	80.4	5	92.0	6	80.5	7	92.2
8	79.4	9	92.0	10	79.0	11	91.5	12	78.0	13	91.5	14	77.1
15	94.2	16	87.6	17	94.5	18	86.6	19	93.0	20	83.5	21	94.0
22	83.0	23	91.0	24	80.4	25	91.5	26	81.1	27	91.5	28	91.0
29	0.	30	0.	31	93.6	32	93.2	33	92.9	34	95.6	35	95.7
36	5.7	37	94.2	38	94.2	39	94.0	40	92.0	41	92.5	42	92.5
43	93.0	44	89.0	45	92.5	46	87.0	47	93.1	48	89.6	49	89.5

TIME 1300 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.0	3	93.0	4	80.2	5	93.0	6	80.6	7	92.8
8	79.5	9	92.0	10	78.8	11	92.0	12	78.5	13	92.0	14	77.5
15	94.5	16	87.6	17	96.0	18	88.0	19	93.0	20	84.6	21	94.5
22	83.3	23	91.0	24	80.0	25	92.1	26	80.5	27	91.5	28	91.8
29	0.	30	0.	31	94.2	32	94.0	33	93.5	34	96.1	35	96.2
36	96.5	37	95.5	38	95.5	39	95.2	40	93.2	41	93.0	42	91.0
43	93.5	44	94.4	45	92.8	46	87.2	47	94.0	48	89.6	49	89.6

TIME 1400 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.4	3	93.0	4	80.6	5	94.0	6	81.6	7	93.0
8	80.0	9	92.0	10	78.8	11	92.0	12	78.5	13	91.6	14	77.5
15	95.0	16	88.4	17	96.0	18	88.2	19	94.0	20	84.6	21	95.5
22	84.2	23	91.0	24	81.5	25	91.5	26	80.5	27	95.5	28	93.8
29	0.	30	0.	31	94.1	32	94.0	33	93.7	34	96.2	35	96.5
36	96.8	37	96.0	38	96.0	39	95.8	40	93.8	41	93.2	42	93.2
43	93.5	44	94.8	45	93.2	46	87.6	47	95.0	48	70.0	49	69.7

TIME 1500 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.5	2	80.6	3	93.5	4	81.0	5	94.0	6	81.6	7	93.0
8	80.0	9	92.0	10	78.8	11	92.0	12	78.5	13	92.5	14	77.8
15	95.0	16	88.2	17	96.0	18	87.8	19	95.0	20	85.6	21	96.0
22	86.0	23	91.0	24	80.0	25	92.8	26	81.5	27	95.0	28	94.5
29	0.	30	0.	31	94.6	32	94.5	33	93.7	34	96.5	35	96.8
36	97.0	37	96.5	38	96.5	39	96.4	40	94.0	41	93.5	42	93.6
43	94.0	44	91.0	45	93.4	46	87.8	47	94.7	48	70.0	49	69.8

TIME 1600 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.7	3	93.0	4	80.5	5	94.0	6	81.7	7	92.8
8	80.1	9	92.0	10	79.0	11	92.0	12	78.6	13	92.0	14	77.8
15	94.8	16	88.2	17	96.0	18	88.1	19	94.0	20	85.6	21	96.0
22	85.5	23	91.0	24	80.5	25	92.0	26	80.1	27	94.2	28	94.1
29	0.	30	0.	31	94.1	32	94.0	33	93.8	34	96.0	35	96.4
36	96.5	37	96.2	38	96.2	39	96.2	40	93.5	41	93.1	42	93.1
43	93.7	44	89.5	45	93.3	46	87.5	47	94.5	48	70.0	49	69.9

TIME 1700 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.5	2	80.3	3	93.0	4	80.7	5	93.0	6	81.2	7	92.5
8	80.1	9	92.0	10	79.5	11	91.0	12	78.2	13	91.5	14	77.7
15	95.0	16	88.2	17	96.0	18	88.0	19	95.0	20	85.3	21	96.0
22	85.4	23	91.0	24	80.5	25	92.0	26	80.6	27	94.0	28	86.6
29	0.	30	0.	31	94.0	32	93.9	33	93.5	34	95.9	35	96.2
36	96.5	37	96.2	38	96.1	39	96.1	40	93.2	41	93.0	42	92.8
43	93.1	44	89.1	45	92.6	46	87.2	47	93.8	48	70.1	49	70.0

TIME 1800 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.0	2	80.1	3	92.0	4	80.1	5	93.0	6	81.1	7	91.5
8	79.4	9	91.0	10	78.8	11	90.5	12	78.0	13	90.0	14	77.2
15	94.4	16	87.5	17	95.0	18	87.6	19	94.5	20	85.3	21	95.5
22	85.5	23	91.0	24	79.5	25	89.1	26	79.2	27	92.8	28	85.5
29	0.	30	0.	31	92.9	32	93.0	33	92.7	34	95.0	35	95.9
36	96.0	37	95.9	38	96.0	39	96.0	40	92.1	41	92.0	42	92.0
43	92.4	44	88.7	45	92.1	46	87.0	47	93.5	48	70.2	49	70.0

TIME 1900 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.5	2	79.4	3	91.0	4	80.2	5	92.0	6	81.0	7	90.0
8	79.0	9	91.0	10	78.5	11	89.0	12	77.5	13	88.0	14	77.1
15	93.8	16	87.6	17	95.0	18	87.6	19	94.0	20	83.9	21	95.0
22	84.6	23	91.0	24	80.0	25	88.3	26	79.5	27	91.7	28	85.0
29	0.	30	0.	31	91.5	32	91.5	33	91.5	34	93.9	35	95.0
36	95.2	37	95.0	38	95.5	39	95.4	40	90.9	41	90.1	42	90.1
43	91.0	44	87.9	45	90.0	46	86.0	47	91.5	48	71.0	49	70.1

TIME 2000 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	89.0	2	79.0	3	89.5	4	80.0	5	90.5	6	80.7	7	88.5
8	78.7	9	87.5	10	77.9	11	86.0	12	76.4	13	84.5	14	76.1
15	93.0	16	85.7	17	93.0	18	85.6	19	93.4	20	84.6	21	94.0
22	84.5	23	89.4	24	81.2	25	84.6	26	78.0	27	89.7	28	84.2
29	0.	30	0.	31	89.5	32	90.1	33	89.0	34	92.2	35	93.9
36	94.2	37	93.9	38	94.5	39	94.1	40	88.1	41	87.9	42	87.9
43	89.0	44	86.4	45	87.9	46	84.9	47	89.8	48	70.6	49	70.0

TIME 2100 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.0	2	78.9	3	88.0	4	79.6	5	89.0	6	80.3	7	86.5
8	78.1	9	85.0	10	76.7	11	84.0	12	76.0	13	82.0	14	75.3
15	92.0	16	85.0	17	92.5	18	85.2	19	92.0	20	83.4	21	93.0
22	84.0	23	88.0	24	80.8	25	82.2	26	77.0	27	88.0	28	83.5
29	0.	30	0.	31	87.6	32	88.3	33	88.3	34	90.5	35	92.5
36	93.0	37	92.3	38	93.0	39	93.0	40	86.0	41	85.6	42	86.0
43	87.0	44	85.0	45	85.6	46	83.6	47	87.5	48	70.5	49	70.1

TIME 2200 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.0	2	78.6	3	86.8	4	79.0	5	87.5	6	79.3	7	85.4
8	77.7	9	84.0	10	76.3	11	83.0	12	75.5	13	81.2	14	75.1
15	90.8	16	84.5	17	91.0	18	84.3	19	91.0	20	83.1	21	91.0
22	82.7	23	86.0	24	79.4	25	82.0	26	77.0	27	87.0	28	83.5
29	0.	30	0.	31	86.9	32	87.2	33	87.3	34	89.5	35	91.5
36	92.0	37	91.2	38	92.0	39	92.0	40	85.3	41	85.0	42	85.0
43	86.5	44	84.6	45	85.0	46	83.3	47	87.0	48	70.6	49	70.1

TIME 2300 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.0	2	78.0	3	86.0	4	78.6	5	87.0	6	79.2	7	84.5
8	76.5	9	83.0	10	75.7	11	82.0	12	75.0	13	80.0	14	74.3
15	90.0	16	83.5	17	91.0	18	84.2	19	90.4	20	82.3	21	91.0
22	83.0	23	86.0	24	79.4	25	80.5	26	76.0	27	86.0	28	85.0
29	0.	30	0.	31	86.0	32	86.8	33	86.8	34	89.0	35	90.9
36	91.5	37	90.5	38	91.2	39	91.1	40	84.4	41	84.0	42	84.0
43	85.8	44	84.0	45	84.1	46	82.9	47	86.1	48	70.8	49	70.2

TIME 2400 DATE 5/30/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	77.6	3	85.0	4	78.0	5	86.0	6	78.7	7	83.5
8	76.4	9	82.0	10	75.8	11	80.0	12	74.5	13	77.8	14	74.0
15	89.6	16	83.0	17	90.0	18	83.2	19	89.2	20	82.1	21	90.0
22	83.9	23	83.5	24	77.7	25	78.2	26	74.9	27	85.0	28	80.1
29	0.	30	0.	31	84.9	32	86.1	33	86.0	34	88.0	35	90.0
36	91.0	37	89.8	38	90.4	39	90.2	40	83.1	41	82.1	42	83.0
43	84.4	44	83.5	45	82.8	46	82.3	47	85.0	48	71.1	49	70.0

TIME 100 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.4	2	77.4	3	84.0	4	77.6	5	85.5	6	78.5	7	82.8
8	74.3	9	82.0	10	75.0	11	79.5	12	74.2	13	77.5	14	73.5
15	89.0	16	82.9	17	89.5	18	83.0	19	88.8	20	82.0	21	88.5
22	81.2	23	82.0	24	76.4	25	79.0	26	74.8	27	84.8	28	79.1
29	0.	30	0.	31	84.0	32	85.0	33	85.0	34	87.4	35	89.5
36	90.0	37	89.0	38	89.8	39	89.8	40	82.0	41	81.7	42	82.1
43	83.8	44	82.9	45	82.0	46	81.8	47	84.2	48	70.5	49	69.8

TIME 200 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	77.1	3	83.6	4	77.6	5	84.0	6	77.6	7	82.0
8	75.4	9	80.0	10	75.1	11	78.0	12	73.8	13	76.3	14	73.6
15	88.3	16	82.3	17	88.5	18	82.5	19	88.0	20	81.4	21	88.5
22	81.7	23	83.0	24	77.9	25	77.1	26	73.2	27	83.5	28	78.4
29	0.	30	0.	31	83.0	32	84.0	33	84.5	34	86.8	35	88.9
36	89.1	37	88.1	38	89.0	39	89.0	40	81.0	41	81.0	42	81.2
43	83.0	44	82.1	45	81.2	46	81.0	47	83.7	48	70.0	49	69.6

TIME 300 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.0	2	76.3	3	83.0	4	76.9	5	84.0	6	77.6	7	81.4
8	75.3	9	80.0	10	74.8	11	78.0	12	73.7	13	76.0	14	73.4
15	88.0	16	81.9	17	88.0	18	82.1	19	87.5	20	81.0	21	88.0
22	81.2	23	82.0	24	76.4	25	77.1	26	73.7	27	83.0	28	78.3
29	0.	30	0.	31	82.9	32	83.9	33	84.0	34	86.2	35	88.6
36	89.0	37	87.9	38	88.6	39	88.5	40	81.0	41	80.9	42	81.0
43	83.0	44	82.0	45	81.4	46	81.1	47	83.8	48	70.0	49	69.4

TIME 400 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.1	2	76.5	3	83.0	4	77.2	5	84.0	6	77.7	7	81.4
8	75.7	9	80.0	10	74.9	11	78.0	12	73.6	13	77.1	14	73.8
15	88.0	16	82.3	17	88.0	18	82.4	19	87.1	20	80.8	21	88.0
22	81.2	23	82.0	24	76.7	25	78.9	26	74.8	27	83.8	28	78.7
29	0.	30	0.	31	83.1	32	84.0	33	84.0	34	86.5	35	88.5
36	89.0	37	87.9	38	88.1	39	88.2	40	80.8	41	80.5	42	81.0
43	82.8	44	82.0	45	80.7	46	80.0	47	83.1	48	70.0	49	69.5

TIME 500 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.0	2	76.3	3	83.0	4	77.0	5	84.0	6	77.6	7	81.0
8	75.1	9	80.0	10	74.4	11	78.0	12	73.8	13	76.0	14	72.8
15	87.1	16	81.8	17	88.0	18	82.0	19	87.0	20	80.5	21	88.0
22	81.2	23	82.0	24	76.6	25	77.6	26	73.4	27	83.1	28	78.0
29	0.	30	0.	31	82.8	32	83.7	33	83.9	34	86.0	35	88.1
36	88.7	37	87.7	38	88.2	39	88.1	40	80.3	41	80.0	42	80.8
43	82.2	44	81.9	45	80.9	46	80.9	47	83.4	48	69.9	49	69.2

TIME 600 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.8	2	76.9	3	83.2	4	76.9	5	84.0	6	77.5	7	81.8
8	75.5	9	80.0	10	74.5	11	78.5	12	73.8	13	76.4	14	72.9
15	88.0	16	82.0	17	88.0	18	82.2	19	87.0	20	80.5	21	88.0
22	80.4	23	81.0	24	77.4	25	77.2	26	73.7	27	83.7	28	78.2
29	0.	30	0.	31	83.1	32	84.0	33	84.0	34	86.5	35	88.4
36	89.0	37	87.8	38	88.2	39	88.0	40	81.1	41	80.8	42	81.0
43	82.9	44	82.0	45	81.8	46	81.2	47	83.9	48	69.9	49	69.1

TIME 700 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	77.4	3	84.2	4	77.7	5	85.0	6	77.9	7	83.0
8	76.2	9	82.0	10	75.8	11	80.0	12	74.1	13	79.0	14	73.9
15	88.5	16	82.8	17	88.5	18	82.8	19	87.8	20	81.0	21	88.0
22	80.8	23	83.5	24	76.6	25	79.1	26	76.7	27	83.0	28	78.9
29	0.	30	0.	31	84.7	32	85.1	33	85.1	34	87.4	35	89.2
36	89.7	37	88.5	38	89.0	39	88.8	40	82.3	41	82.3	42	82.8
43	84.5	44	83.0	45	83.1	46	82.1	47	85.5	48	69.8	49	69.0

TIME 800 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.4	2	77.9	3	86.4	4	78.4	5	86.0	6	77.8	7	86.0
8	77.8	9	84.0	10	75.7	11	83.5	12	75.4	13	84.0	14	75.6
15	90.0	16	84.4	17	90.0	18	84.2	19	89.0	20	82.5	21	89.5
22	83.0	23	88.0	24	78.4	25	84.1	26	77.1	27	87.7	28	80.0
29	0.	30	0.	31	87.3	32	87.6	33	87.2	34	89.7	35	90.8
36	91.0	37	88.0	38	90.1	39	90.0	40	83.6	41	83.5	42	83.5
43	87.0	44	85.0	45	86.0	46	83.6	47	87.0	48	69.7	49	69.2

TIME 900 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	78.7	3	88.0	4	79.1	5	88.0	6	78.9	7	87.5
8	78.4	9	88.0	10	76.5	11	85.5	12	75.6	13	85.5	14	75.2
15	90.9	16	85.0	17	90.5	18	84.0	19	90.0	20	83.5	21	90.0
22	82.2	23	88.0	24	79.0	25	85.1	26	76.7	27	89.0	28	80.1
29	0.	30	0.	31	88.9	32	89.0	33	88.7	34	91.1	35	92.0
36	92.2	37	91.2	38	91.3	39	91.3	40	87.6	41	87.4	42	87.3
43	88.0	44	0.	45	87.9	46	84.6	47	79.7	48	69.6	49	69.1

TIME 1000 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	79.1	3	89.5	4	79.3	5	90.0	6	79.9	7	89.2
8	78.7	9	88.5	10	77.6	11	88.0	12	77.1	13	88.0	14	76.9
15	92.0	16	86.7	17	92.0	18	85.9	19	91.0	20	83.5	21	91.5
22	82.5	23	89.5	24	80.9	25	88.0	26	79.0	27	91.0	28	81.1
29	0.	30	0.	31	90.7	32	90.4	33	90.3	34	92.8	35	91.1
36	93.4	37	92.3	38	92.4	39	92.4	40	90.1	41	90.4	42	90.0
43	90.0	44	87.2	45	90.2	46	85.6	47	91.0	48	69.7	49	69.1

TIME 1100 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.0	2	79.5	3	91.5	4	78.9	5	90.5	6	79.8	7	91.0
8	79.1	9	90.0	10	77.8	11	89.8	12	77.2	13	90.2	14	76.9
15	92.6	16	87.3	17	93.0	18	86.9	19	91.8	20	83.4	21	92.0
22	82.5	23	91.0	24	79.9	25	91.3	26	81.6	27	92.3	28	81.5
29	0.	30	0.	31	92.3	32	92.1	33	91.7	34	94.0	35	94.2
36	94.3	37	93.5	38	93.5	39	93.5	40	91.7	41	91.6	42	91.6
43	92.0	44	90.2	45	91.5	46	86.6	47	92.8	48	89.7	49	89.2

TIME 1200 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.0	2	80.0	3	91.8	4	80.3	5	92.0	6	80.6	7	91.7
8	79.8	9	91.5	10	78.9	11	91.0	12	78.0	13	91.2	14	77.2
15	93.2	16	88.0	17	94.0	18	87.3	19	92.0	20	83.4	21	91.5
22	82.1	23	91.0	24	80.1	25	91.7	26	81.3	27	93.3	28	82.0
29	0.	30	0.	31	93.3	32	93.0	33	92.6	34	94.8	35	95.2
36	95.2	37	93.8	38	93.7	39	93.7	40	92.9	41	92.8	42	92.8
43	93.1	44	89.0	45	92.3	46	87.0	47	93.4	48	89.8	49	89.2

TIME 1300 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.4	3	92.5	4	80.7	5	92.0	6	80.3	7	92.5
8	80.0	9	92.0	10	79.6	11	92.0	12	78.3	13	92.2	14	77.4
15	94.2	16	90.0	17	94.5	18	87.7	19	93.0	20	84.0	21	93.0
22	82.8	23	93.0	24	80.5	25	93.0	26	82.0	27	94.1	28	82.4
29	0.	30	0.	31	94.0	32	93.6	33	93.4	34	95.2	35	95.7
36	95.6	37	95.4	38	95.4	39	95.4	40	93.1	41	93.1	42	93.1
43	93.4	44	89.6	45	92.8	46	87.2	47	94.0	48	89.9	49	89.8

TIME 1400 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.1	3	93.0	4	80.7	5	93.5	6	81.1	7	93.0
8	80.0	9	92.5	10	79.4	11	92.5	12	78.4	13	93.0	14	77.8
15	94.4	16	90.4	17	95.0	18	88.4	19	93.0	20	83.8	21	94.0
22	84.1	23	92.6	24	81.7	25	93.3	26	82.2	27	94.5	28	82.4
29	0.	30	0.	31	94.4	32	94.0	33	93.6	34	96.0	35	96.3
36	96.3	37	94.2	38	94.3	39	94.3	40	93.4	41	93.8	42	93.9
43	94.0	44	90.0	45	89.7	46	93.5	47	87.6	48	70.0	49	69.9

TIME 1500 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.4	3	93.0	4	80.8	5	93.5	6	81.4	7	93.0
8	78.5	9	93.0	10	76.2	11	92.5	12	78.4	13	93.0	14	77.6
15	94.4	16	90.5	17	95.5	18	88.6	19	93.2	20	84.8	21	94.0
22	84.1	23	93.0	24	81.3	25	93.6	26	82.4	27	94.4	28	82.7
29	0.	30	0.	31	94.6	32	94.3	33	94.0	34	96.2	35	96.3
36	96.4	37	94.6	38	94.9	39	94.9	40	94.3	41	94.1	42	94.1
43	94.2	44	90.0	45	93.8	46	87.9	47	95.0	48	70.1	49	70.0

TIME 1600 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.4	3	93.0	4	81.0	5	93.5	6	81.6	7	93.0
8	78.8	9	93.0	10	76.7	11	93.0	12	79.0	13	92.5	14	78.8
15	94.5	16	90.1	17	95.5	18	88.7	19	93.0	20	84.8	21	95.0
22	85.1	23	93.0	24	80.1	25	93.0	26	81.7	27	94.2	28	82.4
29	0.	30	0.	31	94.2	32	94.0	33	93.7	34	95.6	35	96.0
36	96.2	37	94.9	38	95.0	39	95.1	40	94.1	41	94.0	42	94.0
43	94.0	44	90.7	45	93.5	46	87.6	47	94.2	48	70.1	49	70.0

TIME 1700 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.0	2	80.0	3	91.0	4	80.4	5	91.5	6	81.2	7	91.0
8	80.0	9	91.0	10	79.5	11	91.0	12	79.0	13	92.0	14	77.2
15	94.5	16	90.8	17	95.5	18	88.4	19	93.8	20	84.1	21	95.0
22	84.6	23	93.2	24	80.7	25	93.0	26	81.7	27	94.0	28	82.4
29	0.	30	0.	31	93.7	32	93.5	33	94.4	34	95.9	35	96.2
36	95.9	37	93.7	38	95.0	39	95.8	40	93.9	41	93.5	42	93.5
43	93.6	44	90.1	45	93.0	46	86.5	47	94.1	48	70.1	49	70.2

TIME 1800 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.0	2	79.9	3	92.1	4	80.6	5	91.0	6	81.5	7	92.0
8	79.3	9	92.0	10	79.2	11	91.5	12	78.8	13	90.8	14	77.5
15	94.0	16	90.0	17	95.0	18	88.2	19	93.5	20	84.1	21	94.5
22	84.3	23	91.0	24	81.7	25	90.5	26	80.9	27	91.1	28	82.0
29	0.	30	0.	31	93.2	32	93.1	33	93.0	34	95.2	35	96.5
36	96.2	37	93.7	38	94.8	39	95.2	40	93.2	41	92.4	42	92.6
43	92.7	44	90.0	45	92.2	46	87.0	47	93.3	48	71.0	49	70.6

TIME 1900 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.0	2	80.6	3	91.4	4	80.7	5	91.5	6	81.1	7	91.0
8	80.0	9	91.0	10	79.1	11	90.0	12	78.0	13	88.0	14	76.5
15	93.5	16	87.7	17	94.5	18	88.0	19	93.0	20	84.7	21	94.0
22	84.7	23	91.0	24	80.8	25	88.0	26	79.8	27	92.0	28	82.5
29	0.	30	0.	31	91.6	32	92.0	33	92.0	34	93.9	35	95.0
36	95.0	37	93.1	38	94.8	39	94.7	40	91.4	41	91.1	42	91.0
43	91.4	44	88.0	45	90.7	46	86.2	47	92.0	48	71.2	49	71.0

TIME 2000 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	89.0	2	79.9	3	90.0	4	80.5	5	91.0	6	81.5	7	89.0
8	79.2	9	90.5	10	78.5	11	87.0	12	77.1	13	85.2	14	76.2
15	93.5	16	90.3	17	93.0	18	86.5	19	92.0	20	84.7	21	93.0
22	84.0	23	90.0	24	80.7	25	86.1	26	79.0	27	90.5	28	82.0
29	0.	30	0.	31	90.0	32	90.6	33	90.5	34	92.5	35	94.0
36	94.4	37	93.2	38	94.0	39	94.0	40	89.5	41	85.0	42	89.0
43	89.0	44	87.0	45	88.5	46	85.2	47	90.1	48	71.8	49	71.0

TIME 2100 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.5	2	79.4	3	88.3	4	79.7	5	89.0	6	80.3	7	87.0
8	78.5	9	86.5	10	77.8	11	85.0	12	76.6	13	82.8	14	75.6
15	91.0	16	85.3	17	92.5	18	85.9	19	92.0	20	83.1	21	92.5
22	83.1	23	87.0	24	79.7	25	83.0	26	77.2	27	88.5	28	81.0
29	0.	30	0.	31	88.2	32	89.0	33	89.0	34	91.0	35	92.7
36	93.4	37	92.5	38	93.0	39	93.0	40	87.6	41	87.0	42	87.0
43	88.0	44	86.0	45	87.0	46	84.5	47	88.7	48	72.0	49	71.0

TIME 2200 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.5	2	79.1	3	87.0	4	79.0	5	88.0	6	80.0	7	86.0
8	78.0	9	85.0	10	77.2	11	83.5	12	77.1	13	81.5	14	75.1
15	91.0	16	84.9	17	91.0	18	84.8	19	91.0	20	83.1	21	91.0
22	83.2	23	86.0	24	79.7	25	81.5	26	76.0	27	87.3	28	80.1
29	0.	30	0.	31	87.0	32	87.8	33	87.9	34	89.8	35	91.8
36	92.1	37	91.1	38	91.9	39	92.0	40	85.6	41	85.5	42	85.4
43	86.8	44	84.9	45	85.5	46	83.4	47	87.5	48	71.5	49	71.1

TIME 2300 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.5	2	79.6	3	86.5	4	79.0	5	87.0	6	79.4	7	85.0
8	77.6	9	84.0	10	76.5	11	82.5	12	75.5	13	80.5	14	74.6
15	90.5	16	84.3	17	91.0	18	84.8	19	90.4	20	82.7	21	91.0
22	81.3	23	84.0	24	79.0	25	81.5	26	76.0	27	80.5	28	80.5
29	0.	30	0.	31	86.4	32	87.1	33	87.0	34	89.2	35	91.0
36	91.8	37	90.9	38	91.3	39	91.3	40	85.3	41	84.8	42	85.0
43	86.2	44	84.5	45	84.9	46	83.2	47	87.0	48	72.0	49	71.1

TIME 2400 DATE 5/31/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.0	2	79.4	3	85.5	4	78.5	5	86.0	6	79.0	7	84.0
8	77.1	9	84.0	10	76.0	11	80.5	12	74.6	13	79.5	14	74.3
15	90.0	16	84.0	17	90.0	18	83.9	19	90.0	20	82.7	21	90.0
22	80.4	23	83.5	24	79.1	25	80.1	26	75.0	27	85.9	28	80.0
29	0.	30	0.	31	86.3	32	86.3	33	86.1	34	88.1	35	90.2
36	91.0	37	90.3	38	90.7	39	90.7	40	83.8	41	83.0	42	83.5
43	84.7	44	83.6	45	83.2	46	82.4	47	85.6	48	72.0	49	71.0

TIME 100 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	80.1	3	85.0	4	78.6	5	85.5	6	78.7	7	83.0
8	76.8	9	82.0	10	75.8	11	80.0	12	74.2	13	78.8	14	73.3
15	87.5	16	83.3	17	89.0	18	83.7	19	89.0	20	82.0	21	89.0
22	81.3	23	84.5	24	79.2	25	79.5	26	75.5	27	85.0	28	79.8
29	0.	30	0.	31	84.5	32	85.6	33	85.7	34	87.6	35	90.0
36	91.3	37	90.1	38	89.7	39	90.0	40	83.6	41	82.7	42	81.0
43	84.4	44	83.1	45	82.5	46	81.4	47	85.0	48	71.6	49	70.9

TIME 200 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.2	2	77.6	3	84.0	4	77.9	5	85.0	6	78.5	7	82.4
8	76.1	9	81.5	10	75.1	11	79.0	12	74.1	13	77.0	14	73.5
15	88.5	16	83.1	17	89.5	18	83.4	19	88.3	20	81.7	21	88.5
22	81.3	23	83.0	24	77.8	25	77.1	26	73.5	27	84.2	28	79.7
29	0.	30	0.	31	83.8	32	84.9	33	85.1	34	87.4	35	90.0
36	90.1	37	89.3	38	89.1	39	89.2	40	81.7	41	81.1	42	81.8
43	83.3	44	82.7	45	81.1	46	81.1	47	83.9	48	71.5	49	70.8

TIME 300 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.2	2	76.7	3	83.3	4	77.1	5	84.0	6	77.6	7	81.[illegible]
8	75.4	9	80.0	10	74.9	11	78.0	12	73.4	13	76.7	14	74.1
15	88.0	16	82.3	17	88.0	18	82.1	19	87.8	20	81.0	21	88.0
22	81.2	23	82.0	24	76.8	25	77.2	26	73.7	27	83.6	28	79.0
29	0.	30	0.	31	83.0	32	84.0	33	84.3	34	87.0	35	89.3
36	89.7	37	87.7	38	88.5	39	88.4	40	81.1	41	80.9	42	81.2
43	83.0	44	82.5	45	81.0	46	80.9	47	83.8	48	71.3	49	70.8

TIME 400 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	77.1	3	83.0	4	77.0	5	84.0	6	77.7	7	81.5
8	75.8	9	80.0	10	75.0	11	78.0	12	73.8	13	76.8	14	73.7
15	88.0	16	82.5	17	88.0	18	82.1	19	87.0	20	80.9	21	87.5
22	81.0	23	82.0	24	76.9	25	76.8	26	73.0	27	83.6	28	79.0
29	0.	30	0.	31	83.1	32	84.5	33	84.5	34	86.8	35	89.1
36	89.8	37	87.3	38	88.0	39	88.0	40	81.1	41	80.5	42	81.0
43	83.0	44	82.3	45	80.7	46	81.1	47	83.4	48	71.8	49	70.8

TIME 500 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.0	2	76.6	3	83.0	4	77.0	5	84.0	6	77.6	7	81.0
8	75.4	9	79.5	10	74.6	11	78.0	12	73.8	13	76.4	14	73.6
15	88.0	16	83.1	17	88.0	18	82.2	19	87.0	20	81.0	21	87.0
22	80.5	23	83.0	24	77.8	25	77.2	26	74.0	27	83.3	28	79.0
29	0.	30	0.	31	83.0	32	84.0	33	84.0	34	86.6	35	89.0
36	89.3	37	87.0	38	87.8	39	87.8	40	80.9	41	80.4	42	80.9
43	82.9	44	82.1	45	80.9	46	81.0	47	83.5	48	71.3	49	70.5

TIME 600 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	77.0	3	83.2	4	76.9	5	84.0	6	77.5	7	82.0
8	75.8	9	80.0	10	74.6	11	78.0	12	73.4	13	77.0	14	73.9
15	88.0	16	82.3	17	88.0	18	82.4	19	86.8	20	80.8	21	87.3
22	80.8	23	84.0	24	77.6	25	77.2	26	73.8	27	83.9	28	79.1
29	0.	30	0.	31	84.3	32	85.3	33	85.5	34	86.9	35	89.0
36	89.6	37	87.0	38	87.8	39	87.8	40	81.9	41	81.0	42	81.1
43	83.3	44	82.6	45	82.0	46	81.8	47	84.1	48	71.1	49	70.3

TIME 700 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	77.4	3	84.[illegible]	4	77.7	5	85.0	6	78.0	7	82.8
8	76.3	9	82.0	10	75.8	11	80.0	12	74.2	13	79.5	14	74.5
15	88.2	16	82.9	17	89.0	18	83.5	19	87.0	20	81.3	21	88.0
22	81.5	23	84.5	24	78.0	25	80.7	26	75.7	27	85.3	28	80.0
29	0.	30	0.	31	84.9	32	85.3	33	85.2	34	87.9	35	89.8
36	90.0	37	88.2	38	88.2	39	88.2	40	81.9	41	81.3	42	81.0
43	84.0	44	83.2	45	83.3	46	82.2	47	85.3	48	70.9	49	70.1

TIME 800 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	86.0	2	78.0	3	86.0	4	78.3	5	86.5	6	78.5	7	85.0
8	77.1	9	84.0	10	76.2	11	84.0	12	75.6	13	83.0	14	74.6
15	89.4	16	84.3	17	90.0	18	84.4	19	88.0	20	82.3	21	88.0
22	81.2	23	86.0	24	78.7	25	84.4	26	77.1	27	87.3	28	86.1
29	0.	30	0.	31	87.1	32	87.2	33	87.1	34	90.0	35	91.2
36	91.2	37	89.0	38	89.4	39	89.4	40	85.7	41	85.1	42	85.3
43	86.4	44	84.8	45	85.7	46	83.5	47	87.5	48	70.9	49	70.1

TIME 900 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.0	2	78.7	3	87.8	4	79.0	5	88.0	6	79.2	7	87.0
8	78.3	9	86.0	10	77.0	11	85.5	12	76.2	13	86.0	14	75.7
15	90.5	16	85.2	17	90.0	18	84.1	19	89.0	20	82.5	21	89.5
22	82.2	23	86.0	24	78.7	25	86.5	26	78.5	27	88.9	28	88.7
29	0.	30	0.	31	88.8	32	88.9	33	88.7	34	90.7	35	91.8
36	92.0	37	90.1	38	90.2	39	90.4	40	88.2	41	87.8	42	87.2
43	88.0	44	86.1	45	88.0	46	84.8	47	89.5	48	70.8	49	70.1

TIME 1000 DATE 6/1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.3	2	79.4	3	89.5	4	80.5	5	90.0	6	80.4	7	89.4
8	79.5	9	90.5	10	78.5	11	88.0	12	77.2	13	88.8	14	77.3
15	91.7	16	85.8	17	92.0	18	86.6	19	90.0	20	83.0	21	90.0
22	82.5	23	89.5	24	79.6	25	88.9	26	79.4	27	91.0	28	90.1
29	0.	30	0.	31	90.9	32	90.8	33	90.4	34	92.5	35	93.1
36	93.1	37	91.2	38	91.5	39	91.5	40	90.2	41	90.1	42	90.1
43	90.7	44	87.4	45	90.2	46	86.0	47	91.8	48	70.8	49	70.1

TIME 1600 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.4	2	90.3	3	91.0		80.6	5	91.0	6	80.9	7	91.0
8	80.4	9	90.0	10	79.2	11	90.0	12	78.0	13	90.2	14	77.7
15	92.6	16	90	17	93.0	18	87.0	19	91.0	20	83.5	21	91.5
22	83.9	23	91.0	24	80.6		90.0	26	79.7	27	92.4	28	91.0
29	0.	30	0.	31	92.2	32	92.1	33	91.7	34	93.8	35	94.2
36	94.5	37	92.9	38	92.5	39	92.5	40	91.0	41	91.5	42	91.5
43	92.1	44	90.4	45	91.2	46	86.6	47	92.9	48	70.9	49	70.3

TIME 1700 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.0	2	80.3	3	92.0	4	81.0	5	92.5	6	81.4	7	92.0
8	80.4	9	91.5	10	78.8	11	91.0	12	77.8	13	91.0	14	78.9
15	94.0	16	88.8	17	95.0	18	89.2	19	93.0	20	84.6	21	93.5
22	84.2	23	93.0	24	81.5	25	92.0	26	81.5	27	93.5	28	92.2
29	0.	30	0.	31	93.5	32	93.5	33	93.0	34	95.1	35	95.5
36	95.9	37	94.0	38	94.1	39	94.1	40	93.2	41	92.6	42	92.8
43	93.0	44	89.0	45	92.5	46	87.5	47	93.5	48	71.2	49	70.8

TIME 1800 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	91.5	2	80.4	3	91.5	4	80.8	5	92.5	6	81.6	7	91.3
8	80.0	9	91.0	10	78.8	11	91.0	12	78.4	13	90.0	14	77.5
15	93.5	16	88.3	17	94.5	18	88.7	19	92.5	20	84.5	21	93.0
22	84.2	23	91.0	24	80.5	25	89.3	26	79.0	27	92.6	28	81.6
29	0.	30	0.	31	92.9	32	93.0	33	92.8	34	94.8	35	95.1
36	95.5	37	94.0	38	94.1	39	94.2	40	92.1	41	92.0	42	92.0
43	92.4	44	89.0	45	91.6	46	87.1	47	93.0	48	71.4	49	70.5

TIME 1900 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	92.6	2	80.7	3	92.7	4	81.3	5	92.0	6	81.0	7	92.5
8	80.6	9	92.0	10	79.3	11	92.0	12	78.7	13	92.6	14	78.5
15	94.0	16	89.2	17	94.0	18	88.0	19	92.2	20	83.9	21	92.5
22	83.4	23	91.0	24	81.2	25	93.5	26	81.0	27	94.1	28	84.9
29	0.	30	0.	31	94.0	32	94.0	33	93.5	34	95.5	35	95.6
36	96.0	37	93.3	38	93.7	39	93.7	40	94.0		93.2	42	93.2
43	93.7	44	89.5	45	92.7	46	87.7	47	94.0	48	71.5	49	70.8

TIME 1900 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	90.0	2	80.4	3	90.5	4	81.1	5	91.5	6	81.6	7	89.5
8	79.3	9	89.0	10	78.3	11	88.5	12	77.3	13	87.0	14	76.0
15	90.5	16	82.0	17	90.0	18	81.2	19	90.3	20	80.0	21	90.0
22	79.8	23	89.0	24	81.3	25	87.5	26	79.0	27	91.0	28	83.5
29	0.	30	0.	31	91.2	32	91.5	33	91.0	34	90.5	35	90.5
36	91.1	37	91.0	38	91.0	39	91.0	40	92.2	41	90.0	42	90.2
43	91.0	44	88.0	45	90.0	46	86.2	47	91.4	48	71.2	49	70.1

TIME 2000 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	88.5	2	80.0	3	89.0	4	80.2	5	90.0	6	81.0	7	88.0
8	78.9	9	87.0	10	77.8	11	86.0	12	76.5	13	84.8	14	76.7
15	88.5	16	81.3	17	88.0	18	80.6	19	88.4	20	79.7	21	88.0
22	79.1	23	88.0	24	80.4	25	85.2	26	78.0	27	89.8	28	83.4
29	0.	30	0.	31	89.9	32	90.1	33	89.8	34	89.0	35	88.9
36	89.3	37	85.2	38	85.2	39	89.0	40	88.1	41	87.7	42	88.2
43	89.1	44	86.6	45	88.1	46	85.1	47	89.5	48	71.0	49	70.1

TIME 1500 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.7	3	93.0	4	81.4	5	93.5	6	81.8	7	93.0
8	80.4	9	91.0	10	80.0	11	92.5	12	78.8	13	93.0	14	77.6
15	94.2	16	89.2	17	95.0	18	89.0	19	93.0	20	84.3	21	93.5
22	84.5	23	91.0	24	80.5		95.0	26	82.0	27	95.0	28	85.0
29	0.	30	0.	31	94.9	32	94.6	33	94.0	34	96.0	35	96.0
36	96.2	37	94.3	38	94.3	39	94.2	40	94.3	41	94.0	42	94.0
43	94.2	44	90.0	45	93.6	46	88.1	47	94.8	48	71.8	49	70.8

TIME 2100 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.0	2	79.4	3	87.8	4	79.8	5	89.5	6	81.0	7	86.0
8	78.0	9	85.0	10	77.2	11	83.5	12	75.7	13	82.5	14	74.8
15	87.0	16	80.1	17	86.5	18	79.4	19	87.0	20	79.0	21	86.5
22	78.5	23	86.0	24	79.4	25	83.0	26	76.7	27	87.8	28	82.8
29	0.	30	0.	31	87.9	32	88.7	33	88.1	34	87.5	35	87.5
36	87.4	37	87.9	38	87.8	39	87.4	40	86.1	41	85.5	42	86.5
43	87.5	44	85.0	45	86.2	46	84.0	47	87.8	48	71.0	49	70.0

TIME 1600 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	93.0	2	80.8	3	93.0	4	81.4	5	93.0	6	81.4	7	92.8
8	80.3	9	92.5	10	79.3	11	92.5	12	78.9	13	92.4	14	77.8
15	94.0	16	89.0	17	95.0	18	89.0	19	93.0	20	84.3	21	94.0
22	84.5	23	94.0	24	82.0	25	[illegible]	26	81.0	27	94.3	28	92.3
29	0.	30	0.	31	94.2	32	94.2	33	93.7	34	95.8	35	95.8
36	96.1	37	94.1	38	94.2	39	94.2	40	94.1	41	93.5	42	93.8
43	93.8	44	90.0	45	93.0	46	88.0	47	94.0	48	71.7	49	71.0

TIME 2200 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.5	2	78.5	3	86.5	4	79.0	5	87.0	6	79.4	7	84.8
8	77.6	9	83.5	10	76.1	11	82.5	12	75.3	13	81.0	14	74.9
15	86.0	16	79.5	17	88.5	18	79.0	19	85.5	20	78.1	21	85.0
22	77.6	23	86.0	24	79.6	25	82.5	26	76.5	27	86.9	28	83.0
29	0.	30	0.	31	87.0	32	87.4	33	87.0	34	86.6	35	86.5
36	87.0	37	81.0	38	86.9	39	86.5	40	85.8	41	84.8	42	85.5
43	86.7	44	85.0	45	85.2	46	83.5	47	86.9	48	70.6	49	70.0

TIME 2300 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	85.0	2	78.3	3	85.5	4	7[illegible]	5	87.0	6	79.6	7	84.0
8	76.8	9	83.0	10	76.6	11	81.0	12	75.0	13	80.0	14	76.2
15	85.8	16	79.3	17	87.0	18	78.2	19	85.0	20	77.0	21	85.0
22	77.9	23	85.5	24	81.0	25	80.5	26	75.7	27	86.0	28	84.5
29	0.	30	0.	31	86.0	32	86.8	33	86.1	34	86.0	35	85.8
36	86.0	37	86.0	38	86.0	39	85.7	40	86.4	41	86.2	42	84.8
43	86.0	44	84.3	45	84.5	46	83.0	47	86.1	48	70.6	49	70.0

TIME 2400 DATE 6/ 1/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	77.6	3	85.0	4	78.2	5	84.0	6	78.8	7	83.0
8	76.3	9	82.0	10	75.6	11	80.0	12	74.2	13	78.2	14	74.2
15	85.2	16	75.8	17	84.0	18	78.0	19	84.0	20	77.2	21	84.0
22	77.[illegible]	23	85.5	24	79.0	25	79.4	26	75.5	27	85.4	28	80.4
29	0.	30	0.	31	85.3	32	86.3	33	85.6	34	85.3	35	85.2
36	85.7	37	85.3	38	85.2	39	84.8	40	83.3	41	82.7	42	83.9
43	85.9	44	83.9	45	83.4	46	82.7	47	85.0	48	70.7	49	70.0

TIME 100 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.2	2	77.2	3	84.5	4	78.1	5	85.0	6	78.3	7	82.4
8	7[illegible].1	9	80.4	10	74.7	11	7[illegible].0	12	74.2	13	77.6	14	73.7
15	85.0	16	78.8	17	83.5	18	77.5	19	83.3	20	77.0	21	83.0
22	76.2	23	83.0	24	77.0	25	78.4	26	76.8	27	84.5	28	79.6
29	0.	30	0.	31	84.5	32	85.4	33	85.0	34	84.7	35	84.8
36	85.8	37	85.7	38	84.4	39	84.2	40	82.2	41	82.0	42	83.0
43	84.3	44	83.2	45	82.8	46	82.0	47	84.6	48	70.2	49	69.9

TIME 200 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	83.0	2	77.3	3	84.0	4	77.8	5	84.5	6	77.8	7	82.0
8	76.0	9	80.0	10	75.0	11	78.0	12	73.7	13	76.8	14	74.2
15	84.2	16	78.2	17	83.5	18	77.3	19	82.8	20	76.5	21	82.0
22	75.8	23	82.0	24	77.0	25	77.5	26	76.0	27	84.0	28	79.6
29	0.	30	0.	31	83.9	32	84.9	33	84.2	34	84.2	35	84.2
36	84.9	37	84.0	38	83.9	39	83.5	40	81.9	41	81.4	42	82.5
43	83.8	44	83.0	45	82.2	46	81.5	47	84.1	48	70.4	49	69.9

TIME 300 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	77.1	3	84.0	4	77.9	5	84.0	6	77.6	7	81.5
8	75.6	9	80.0	10	75.1	11	78.0	12	76.1	13	76.0	14	73.4
15	84.0	16	78.2	17	82.4	18	76.9	19	82.5	20	76.1	21	82.0
22	76.0	23	81.0	24	76.4	25	76.2	26	73.9	27	83.5	28	79.5
29	0.	30	0.	31	83.6	32	84.8	33	84.1	34	84.0	35	84.0
36	84.2	37	83.9	38	83.6	39	83.2	40	81.6	41	81.0	42	82.1
43	83.5	44	83.0	45	82.0	46	81.7	47	83.9	48	70.5	49	69.9

TIME 400 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.5	2	77.1	3	83.5	4	77.4	5	84.0	6	77.7	7	81.5
8	75.6	9	80.0	10	75.3	11	78.0	12	74.1	13	76.0	14	73.3
15	84.0	16	77.9	17	82.0	18	76.8	19	82.0	20	76.1	21	82.0
22	76.1	23	81.0	24	75.4	25	76.9	26	74.6	27	83.5	28	79.6
29	0.	30	0.	31	83.5	32	84.5	33	84.0	34	84.0	35	84.0
36	84.4	37	83.5	38	83.2	39	83.0	40	81.9	41	80.7	42	81.9
43	83.5	44	82.5	45	82.2	46	81.6	47	83.8	48	70.8	49	69.8

TIME 500 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.0	2	76.7	3	83.0	4	77.1	5	84.0	6	77.0	7	80.5
8	74.4	9	79.0	10	74.0	11	77.0	12	73.0	13	75.0	14	73.3
15	83.9	16	77.6	17	82.0	18	76.7	19	81.4	20	75.5	21	81.0
22	75.3	23	80.5	24	75.8	25	75.5	26	73.0	27	83.0	28	79.4
29	0.	30	0.	31	83.0	32	84.3	33	83.5	34	83.5	35	83.5
36	83.9	37	82.9	38	82.6	39	82.2	40	80.9	41	80.0	42	81.1
43	82.5	44	82.3	45	81.9	46	81.2	47	83.2	48	70.0	49	69.9

TIME 600 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	82.0	2	76.6	3	83.0	4	77.3	5	84.0	6	77.7	7	81.0
8	74.0	9	79.0	10	74.0	11	77.0	12	74.2	13	75.0	14	73.0
15	83.0	16	76.2	17	82.0	18	76.8	19	82.0	20	76.3	21	81.5
22	75.7	23	80.0	24	76.0	25	75.2	26	73.1	27	83.0	28	79.3
29	0.	30	0.	31	82.8	32	83.6	33	83.[illegible]	34	83.4	35	83.4
36	83.9	37	81.0	38	82.8	39	82.2	40	80.4	41	80.0	42	80.9
43	82.0	44	82.0	45	81.7	46	81.3	47	83.2	48	70.5	49	70.0

TIME 700 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	84.0	2	77.5	3	84.0	4	77.7	5	84.0	6	77.7	7	82.3
8	76.2	9	81.0	10	75.8	11	79.0	12	74.1	13	80.0	14	74.8
15	84.0	16	78.0	17	83.5	18	77.5	19	83.3	20	77.0	21	83.0
22	76.1	23	82.0	24	75.8	25	78.2	26	74.3	27	84.5	28	80.4
29	0.	30	0.	31	84.2	32	85.0	33	84.5	34	84.5	35	84.5
36	84.5	37	84.5	38	84.0	39	83.6	40	82.2	41	81.8	42	82.8
43	84.0	44	83.0	45	83.0	46	82.0	47	84.8	48	70.5	49	69.9

TIME 800 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
[illegible]	84.0	2	77.3	3	84.0	4	77.7	5	88.3	6	80.6	7	84.7
8	77.5	9	84.0	10	76.4	11	82.5	12	75.0	13	82.8	14	75.4
15	86.0	16	79.0	17	85.0	18	78.1	19	85.4	20	78.1	21	84.5
22	77.2	23	80.0	24	75.0	25	82.9	26	76.3	27	87.0	28	86.1
29	0.	30	0.	31	86.4	32	87.6	33	88.8	34	86.8	35	86.7
36	86.0	37	86.4	38	86.6	39	86.3	40	85.3	41	85.0	42	85.5
43	87.0	44	84.9	45	85.4	46	83.5	47	87.1	48	70.6	49	70.0

TIME 900 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.0	2	78.9	3	87.6	4	79.4	5	88.0	6	79.8	7	86.9
8	78.5	9	86.3	10	77.4	11	86.0	12	76.6	13	86.0	14	75.8
15	87.0	16	80.6	17	87.0	18	79.4	19	87.1	20	79.0	21	87.0
22	78.5	23	86.0	24	79.7	25	87.0	26	78.1	27	85.2	28	88.6
29	0.	30	0.	31	89.0	32	89.0	33	88.9	34	88.8	35	88.4
36	88.4	37	89.0	38	88.6	39	88.3	40	88.0	41	87.6	42	87.9
43	89.0	44	86.2	45	88.1	46	84.8	47	89.2	48	70.9	49	70.2

TIME 1000 DATE 6/ 2/1965

PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP	PI	TEMP
1	87.2	2	79.3	3	85.0	4	80.2	5	89.5	6	80.7	7	88.4
8	79.2	9	88.5	10	78.3	11	88.0	12	77.1	13	88.4	14	77.0
15	88.9	16	81.9	17	88.5	18	80.2	19	89.6	20	79.9	21	88.5
22	78.8	23	89.0	24	80.2	25	89.1	26	79.2	27	91.0	28	90.2
29	0.	30	0.	31	90.9	32	90.5	33	90.0	34	91.0	35	89.9
36	90.5	37	91.6	38	90.3	39	90.0	40	89.9	41	89.6	42	89.7
43	90.5	44	89.4	45	90.0	46	85.8	47	91.6	48	70.9	49	70.2

TIME 1100 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.8	2	88.5	3	90.8	4	90.8	5	90.5	6	81.1	7	90.0
8	80.0	9	90.0	10	78.7	11	90.0	12	77.8	13	90.7	14	77.7
15	90.8	16	81.9	17	90.0	18	81.[illegible]	19	90.7	20	80.5	21	90.0
22	79.4	23	91.0	24	80.9	25	90.[illegible]	26	90.1	27	92.2	28	91.6
29	0.	30	0.	31	91.9	32	91.8	33	91.3	34	91.5	35	91.2
36	91.1	37	92.2	38	91.9	39	91.8	40	91.3	41	91.2	42	91.2
43	91.9	44	88.2	45	91.5	46	86.6	47	92.3	48	71.0	49	70.3

TIME 1200 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.2	2	80.2	3	91.0	4	80.7	5	91.5	6	81.3	7	90.9
8	79.9	9	91.0	10	79.0	11	91.0	12	78.2	13	91.7	14	77.8
15	90.9	16	82.4	17	90.5	18	81.1	19	91.5	20	80.8	21	91.5
22	80.2	23	93.0	24	81.8	25	92.2	26	80.2	27	93.0	28	92.6
29	0.	30	0.	31	92.9	32	92.7	33	92.2	34	92.4	35	92.2
36	92.1	37	93.3	38	93.0	39	93.0	40	92.8	41	92.6	42	97.5
43	92.9	44	89.0	45	92.6	46	87.1	47	93.3	48	71.0	49	70.5

TIME 1300 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.2	3	92.0	4	81.1	5	92.0	6	81.2	7	91.8
8	80.0	9	92.0	10	79.5	11	91.5	12	78.6	13	92.4	14	77.7
15	91.4	16	82.0	17	90.5	18	80.5	19	92.3	20	80.8	21	91.0
22	79.3	23	93.0	24	80.7	25	92.2	26	80.4	27	93.4	28	93.2
29	0.	30	0.	31	93.5	32	93.3	33	93.0	34	93.0	35	92.9
36	92.9	37	93.8	38	93.6	39	93.4	40	92.9	41	92.7	42	92.7
43	93.1	44	89.4	45	92.6	46	87.3	47	93.1	48	71.2	49	70.8

TIME 1400 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.8	2	80.7	3	92.5	4	81.0	5	92.5	6	81.5	7	92.0
8	80.1	9	92.0	10	81.0	11	92.0	12	78.1	13	93.0	14	77.9
15	92.0	16	82.8	17	92.0	18	81.2	19	93.0	20	81.5	21	92.0
22	79.6	23	95.0	24	82.5	25	92.8	26	80.4	27	94.0	28	93.8
29	0.	30	0.	31	94.0	32	93.8	33	93.4	34	93.6	35	93.2
36	93.1	37	94.2	38	94.0	39	94.0	40	94.0	41	93.8	42	93.8
43	93.4	44	89.9	45	93.7	46	88.0	47	94.5	48	71.5	49	71.2

TIME 1500 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	81.1	3	92.9	4	81.3	5	93.0	6	81.5	7	92.5
8	80.1	9	92.5	10	79.1	11	92.5	12	78.3	13	92.7	14	77.5
15	92.1	16	82.5	17	92.0	18	81.1	19	93.0	20	80.8	21	93.0
22	80.4	23	93.0	24	80.4	25	92.5	26	90.5	27	94.0	28	93.8
29	0.	30	0.	31	94.0	32	94.0	33	93.5	34	93.6	35	93.4
36	93.3	37	94.2	38	94.0	39	94.0	40	93.9	41	93.6	42	93.6
43	93.9	44	0.	45	93.7	46	87.8	47	94.5	48	71.7	49	0.

TIME 1600 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.4	3	93.0	4	80.9	5	92.5	6	80.9	7	92.5
8	80.3	9	92.0	10	79.0	11	92.0	12	78.2	13	92.4	14	77.5
15	92.4	16	82.3	17	92.0	18	81.0	19	93.0	20	80.9	21	92.2
22	79.5	23	93.0	24	80.5	25	92.2	26	80.0	27	94.0	28	94.0
29	0.	30	0.	31	94.0	32	93.8	33	93.4	34	93.4	35	93.2
36	93.1	37	93.7	38	93.6	39	93.5	40	93.5	41	93.3	42	93.3
43	93.8	44	89.8	45	93.4	46	87.6	47	94.2	48	72.0	49	71.9

TIME 1700 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	80.7	3	92.5	4	81.5	5	93.0	6	81.7	7	92.0
8	79.9	9	92.0	10	79.2	11	92.0	12	78.5	13	91.4	14	77.6
15	92.0	16	82.3	17	92.0	18	81.3	19	92.5	20	81.0	21	92.4
22	80.3	23	94.0	24	82.0	25	90.5	26	80.1	27	94.0	28	93.9
29	0.	30	0.	31	93.8	32	93.7	33	93.1	34	93.5	35	93.0
36	93.3	37	93.5	38	93.5	39	93.4	40	93.5	41	92.7	42	93.0
43	93.5	44	89.8	45	93.0	46	88.0	47	94.0	48	73.0	49	72.0

TIME 1800 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.1	3	92.0	4	80.8	5	93.0	6	81.7	7	91.5
8	79.5	9	91.5	10	78.7	11	91.0	12	77.8	13	90.5	14	77.7
15	92.0	16	82.3	17	91.5	18	80.8	19	92.0	20	80.7	21	92.0
22	80.0	23	91.0	24	79.5	25	90.5	26	79.4	27	93.5	28	85.9
29	0.	30	0.	31	93.5	32	93.6	33	92.9	34	93.2	35	92.5
36	93.1	37	93.0	38	93.0	39	92.9	40	93.0	41	92.0	42	92.4
43	93.0	44	89.0	45	92.5	46	88.0	47	93.2	48	73.0	49	72.0

TIME 1900 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	79.5	3	91.0	4	80.1	5	92.0	6	80.9	7	90.0
8	78.7	9	90.0	10	78.2	11	89.0	12	77.1	13	87.5	14	76.3
15	91.0	16	81.3	17	91.0	18	80.5	19	91.0	20	79.0	21	91.0
22	79.5	23	90.0	24	79.5	25	87.8	26	78.2	27	92.0	28	89.5
29	0.	30	0.	31	92.0	32	92.3	33	91.8	34	92.0	35	91.3
36	92.0	37	91.8	38	91.8	39	91.5	40	91.3	41	90.0	42	91.0
43	91.7	44	88.0	45	90.8	46	87.3	47	91.8	48	72.6	49	71.5

TIME 2000 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.2	3	90.0	4	80.2	5	91.0	6	80.7	7	88.5
8	78.2	9	88.0	10	77.7	11	87.0	12	76.6	13	85.0	14	75.5
15	90.0	16	80.7	17	89.0	18	79.8	19	89.5	20	79.0	21	89.0
22	78.8	23	88.0	24	79.0	25	86.2	26	77.0	27	90.0	28	89.0
29	0.	30	0.	31	90.0	32	90.1	33	90.0	34	90.0	35	90.1
36	90.2	37	90.1	38	90.0	39	90.0	40	88.3	41	88.0	42	88.9
43	89.9	44	87.0	45	89.2	46	85.4	47	90.1	48	71.4	49	71.0

TIME 2100 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.2	3	88.5	4	79.5	5	89.5	6	80.2	7	87.0
8	78.0	9	86.5	10	77.5	11	84.5	12	75.7	13	83.0	14	75.0
15	89.0	16	80.3	17	88.0	18	79.3	19	88.0	20	78.0	21	87.5
22	78.3	23	88.0	24	80.1	25	83.5	26	76.5	27	89.0	28	81.1
29	0.	30	0.	31	88.8	32	89.2	33	89.0	34	88.9	35	88.8
36	89.1	37	88.8	38	88.7	39	88.5	40	86.8	41	86.5	42	87.3
43	88.5	44	86.1	45	87.2	46	84.5	47	88.7	48	71.6	49	71.0

TIME 2200 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	78.9	3	87.4	4	79.3	5	89.0	6	80.4	7	85.8
8	77.7	9	85.0	10	76.8	11	83.0	12	75.4	13	81.4	14	74.8
15	88.0	16	80.0	17	87.0	18	78.9	19	86.5	20	78.0	21	86.5
22	78.2	23	86.0	24	79.4	25	82.0	26	76.2	27	87.8	28	80.8
29	0.	30	0.	31	87.8	32	88.5	33	88.1	34	88.0	35	88.0
36	88.3	37	87.8	38	87.6	39	87.4	40	86.0	41	85.3	42	86.3
43	87.5	44	85.5	45	86.3	46	84.3	47	88.0	48	72.0	49	71.0

TIME 2300 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	78.5	3	86.8	4	79.0	5	87.5	6	79.3	7	85.0
8	77.4	9	84.0	10	76.6	11	82.0	12	75.3	13	80.4	14	74.8
15	87.0	16	79.2	17	86.0	18	78.5	19	86.0	20	78.0	21	86.0
22	78.5	23	86.0	24	79.4	25	82.0	26	76.5	27	87.0	28	80.5
29	0.	30	0.	31	87.0	32	87.8	33	87.4	34	87.4	35	87.4
36	87.8	37	87.2	38	87.0	39	87.9	40	85.0	41	84.6	42	85.5
43	87.0	44	85.0	45	85.5	46	83.6	47	87.1	48	71.5	49	70.9

TIME 2600 DATE 6/ 2/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.0	3	86.0	4	78.7	5	87.0	6	79.2	7	84.0
8	76.8	9	83.0	10	76.1	11	81.0	12	74.8	13	79.0	14	74.2
15	86.5	16	79.1	17	85.5	18	78.2	19	85.0	20	77.4	21	85.0
22	77.4	23	85.0	24	78.6	25	79.4	26	75.0	27	86.5	28	80.2
29	0.	30	0.	31	86.0	32	87.0	33	86.6	34	86.5	35	86.5
36	87.0	37	86.0	38	86.0	39	85.8	40	84.0	41	83.4	42	84.5
43	85.8	44	84.4	45	84.6	46	83.2	47	86.2	48	71.6	49	71.5

TIME 100 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.1	3	85.8	4	78.7	5	86.0	6	78.4	7	83.5
8	76.7	9	82.0	10	75.6	11	80.0	12	74.3	13	78.5	14	74.5
15	86.0	16	78.8	17	84.5	18	77.5	19	84.2	20	77.0	21	84.0
22	76.9	23	84.5	24	78.7	25	79.5	26	74.9	27	85.8	28	80.0
29	0.	30	0.	31	85.5	32	86.5	33	86.2	34	86.2	35	86.1
36	86.2	37	85.8	38	85.5	39	85.3	40	83.5	41	83.1	42	84.0
43	85.6	44	84.0	45	84.1	46	82.9	47	85.8	48	71.1	49	69.6

TIME 200 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	77.2	3	85.0	4	77.7	5	86.0	6	78.3	7	83.0
8	76.1	9	81.5	10	75.3	11	79.0	12	73.7	13	77.0	14	73.4
15	86.0	16	78.8	17	84.0	18	77.0	19	84.0	20	76.7	21	84.0
22	76.8	23	83.5	24	77.4	25	78.0	26	74.0	27	85.0	28	79.0
29	0.	30	0.	31	84.9	32	85.9	33	85.4	34	85.3	35	85.3
36	85.5	37	84.9	38	84.7	39	84.4	40	82.6	41	82.1	42	83.1
43	84.4	44	83.6	45	83.2	46	82.2	47	85.0	48	71.2	49	70.8

TIME 300 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	77.2	3	84.8	4	77.6	5	86.0	6	78.3	7	82.5
8	75.7	9	81.0	10	74.8	11	78.5	12	73.2	13	77.0	14	73.7
15	85.2	16	77.8	17	84.0	18	77.2	19	83.2	20	76.0	21	83.0
22	76.1	23	83.0	24	76.7	25	77.0	26	73.6	27	84.8	28	78.8
29	0.	30	0.	31	84.4	32	85.5	33	85.0	34	85.0	35	84.9
36	85.1	37	84.6	38	84.2	39	84.0	40	82.0	41	81.8	42	82.8
43	84.3	44	83.3	45	83.0	46	82.0	47	85.0	48	71.2	49	70.9

TIME 400 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.5	2	76.8	3	84.5	4	77.3	5	85.5	6	77.8	7	82.0
8	75.4	9	80.0	10	74.2	11	78.0	12	73.4	13	75.5	14	73.0
15	85.0	16	77.8	17	84.0	18	77.3	19	83.0	20	75.8	21	82.3
22	75.5	23	82.0	24	76.4	25	76.0	26	73.2	27	84.0	28	78.6
29	0.	30	0.	31	84.0	32	85.0	33	84.7	34	84.7	35	84.6
36	84.8	37	84.0	38	83.7	39	83.4	40	82.3	41	80.9	42	82.2
43	83.2	44	83.0	45	82.1	46	81.9	47	84.1	48	76.8	49	71.0

TIME 500 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	76.4	3	84.2	4	77.0	5	85.5	6	77.8	7	82.0
8	75.5	9	80.0	10	74.3	11	78.0	12	73.5	13	76.0	14	73.3
15	85.0	16	78.0	17	83.5	18	76.9	19	82.3	20	75.5	21	82.0
22	75.6	23	83.0	24	77.0	25	77.0	26	74.0	27	84.7	28	79.1
29	0.	30	0.	31	84.6	32	85.8	33	84.9	34	84.8	35	84.7
36	85.5	37	84.0	38	83.8	39	83.2	40	82.6	41	81.2	42	82.6
43	84.5	44	83.5	45	83.0	46	82.7	47	85.0	48	72.1	49	70.8

TIME 600 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	76.5	3	85.0	4	77.4	5	86.0	6	77.8	7	82.8
8	75.7	9	82.0	10	75.1	11	80.0	12	74.0	13	78.0	14	73.0
15	85.5	16	78.1	17	84.0	18	76.8	19	83.0	20	75.7	21	83.0
22	75.8	23	83.5	24	77.0	25	80.0	26	74.1	27	85.4	28	79.0
29	0.	30	0.	31	85.5	32	86.2	33	85.5	34	86.1	35	85.6
36	86.1	37	85.0	38	84.9	39	84.1	40	83.0	41	82.4	42	83.5
43	85.0	44	84.0	45	83.6	46	82.8	47	85.5	48	71.5	49	70.2

TIME 700 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.2	2	77.2	3	86.8	4	77.6	5	86.5	6	77.7	7	84.0
8	76.5	9	83.0	10	75.3	11	81.5	12	74.3	13	80.0	14	73.5
15	86.0	16	78.2	17	84.5	18	76.9	19	84.5	20	75.5	21	84.0
22	76.1	23	84.5	24	77.4	25	81.6	26	75.6	27	86.8	28	79.1
29	0.	30	0.	31	86.5	32	86.8	33	86.6	34	86.6	35	86.1
36	86.7	37	86.2	38	85.9	39	85.5	40	84.4	41	84.0	42	84.8
43	86.5	44	84.5	45	85.0	46	83.2	47	86.4	48	70.8	49	70.0

TIME 800 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	77.4	3	87.3	4	77.8	5	88.0	6	78.1	7	86.0
8	76.9	9	85.0	10	75.6	11	84.0	12	74.7	13	83.0	14	74.3
15	87.4	16	76.9	17	86.0	18	77.5	19	86.2	20	75.5	21	86.0
22	76.9	23	86.0	24	77.1	25	84.0	26	75.9	27	88.3	28	79.7
29	0.	30	0.	31	88.2	32	88.3	33	88.0	34	88.0	35	87.9
36	88.0	37	87.8	38	87.3	39	87.1	40	86.1	41	86.0	42	86.5
43	88.0	44	80.9	45	86.9	46	84.1	47	88.1	48	70.6	49	70.0

TIME 900 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	77.2	3	88.5	4	77.6	5	89.0	6	78.4	7	87.3
8	76.7	9	86.5	10	75.6	11	86.0	12	74.9	13	86.0	14	74.6
15	88.7	16	79.4	17	87.5	18	77.7	19	87.9	20	78.5	21	87.0
22	76.7	23	88.0	24	72.1	25	88.0	26	77.3	27	90.0	28	79.6
29	0.	30	0.	31	85.9	32	89.8	33	89.2	34	89.5	35	89.2
36	89.2	37	89.8	38	89.0	39	88.7	40	89.1	41	89.1	42	89.0
43	90.3	44	87.0	45	90.0	46	85.3	47	91.5	48	70.6	49	0.

TIME 1000 DATE 6/ 3/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	78.6	3	90.0	4	79.0	5	90.5	6	79.4	7	89.0
8	78.0	9	88.5	10	77.3	11	88.0	12	76.4	13	88.0	14	76.0
15	90.0	16	80.0	17	89.5	18	79.4	19	89.2	20	78.7	21	89.0
22	78.4	23	89.5	24	79.0	25	88.2	26	78.6	27	91.3	28	81.4
29	0.	30	0.	31	91.3	32	91.3	33	90.8	34	91.3	35	90.9
36	91.0	37	90.7	38	90.5	39	90.3	40	90.2	41	90.0	42	90.1
43	91.2	44	88.0	45	90.3	46	86.1	47	91.4	48	70.9	49	70.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	79.7	4	91.5	5	86.4	6	90.6	7	75.7
8	[illegible]	9	[illegible]	10	76.4	11	90.0	12	77.2	13	90.6	14	75.7
15	[illegible]	16	[illegible]	17	91.5	18	79.8	19	90.8	20	75.5	21	90.0
22	78.7	23	[illegible]	24	90.5	25	90.9	26	80.1	27	92.8	28	82.8
29	[illegible]	30	[illegible]	31	[illegible]	32	92.5	33	92.6	34	93.0	35	92.5
36	[illegible]	37	[illegible]	38	[illegible]	39	92.0	40	92.1	41	91.9	42	92.0
43	[illegible]	44	[illegible]	45	[illegible]	46	87.6	47	93.[illegible]	48	70.8	49	70.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	80.1	5	92.[illegible]	6	81.1	7	91.8
8	79.[illegible]	9	77.0	10	75.0	11	92.0	12	78.4	13	91.9	14	77.1
15	92.2	16	[illegible]	17	92.6	18	80.5	19	92.[illegible]	20	79.1	21	92.0
22	[illegible]	23	[illegible]	24	82.0	25	91.9	26	79.[illegible]	27	93.8	28	84.0
29	[illegible]	30	[illegible]	31	93.8	32	93.1	33	93.[illegible]	34	93.0	35	93.5
36	93.5	37	93.[illegible]	38	93.3	39	93.2	40	93.[illegible]	41	93.2	42	93.1
43	93.6	44	[illegible]	45	92.0	46	83.0	47	94.1	48	71.0	49	70.3

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	80.6	5	93.[illegible]	6	81.4	7	92.8
8	77.7	9	[illegible]	10	75.1	11	92.0	12	78.1	13	92.8	14	77.7
15	[illegible]	16	[illegible]	17	[illegible]	18	80.8	19	93.[illegible]	20	80.0	21	92.5
22	[illegible]	23	[illegible]	24	81.0	25	93.4	26	81.0	27	94.6	28	85.6
29	[illegible]	30	[illegible]	31	[illegible]	32	94.1	33	93.8	34	94.7	35	94.0
36	[illegible]	37	[illegible]	38	94.1	39	94.1	40	94.[illegible]	41	93.8	42	93.8
43	[illegible]	44	[illegible]	45	[illegible]	46	88.0	47	94.6	48	71.0	49	70.5

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	93.2	4	80.7	5	93.5	6	81.3	7	92.8
8	79.6	9	[illegible]	10	75.5	11	92.5	12	78.6	13	93.0	14	77.6
15	[illegible]	16	[illegible]	17	93.[illegible]	18	80.8	19	93.[illegible]	20	80.0	21	93.5
22	[illegible]	23	[illegible]	24	81.1	25	93.3	26	80.4	27	94.9	28	82.2
29	[illegible]	30	[illegible]	31	94.7	32	94.3	33	94.[illegible]	34	95.0	35	94.5
36	94.9	37	94.8	38	94.6	39	94.6	40	94.6	41	94.3	42	94.2
43	94.5	44	94.2	45	94.2	46	89.1	47	95.0	48	71.0	49	70.7

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	93.2	4	80.9	5	94.[illegible]	6	81.6	7	93.0
8	79.6	9	93.5	10	80.0	11	93.0	12	78.7	13	93.0	14	77.4
15	[illegible]	16	[illegible]	17	93.5	18	81.3	19	93.8	20	81.0	21	93.5
22	80.6	23	93.0	24	81.8	25	93.2	26	91.2	27	95.0	28	90.1
29	[illegible]	30	[illegible]	31	94.9	32	94.7	33	94.2	34	95.0	35	94.6
36	94.5	37	95.0	38	94.8	39	94.7	40	94.6	41	94.3	42	94.2
43	94.8	44	95.0	45	94.4	46	88.2	47	95.1	48	71.1	49	70.8

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	[illegible]	3	93.2	4	80.6	5	94.2	6	81.9	7	92.8
8	79.5	9	93.5	10	80.0	11	93.0	12	79.0	13	92.5	14	77.3
15	[illegible]	16	[illegible]	17	93.5	18	81.3	19	93.7	20	80.7	21	93.5
22	80.6	23	94.0	24	80.8	25	93.0	26	81.0	27	94.6	28	93.5
29	[illegible]	30	[illegible]	31	94.8	32	94.4	33	94.0	34	95.0	35	94.5
36	94.4	37	94.5	38	94.6	39	94.6	40	94.3	41	94.0	42	94.0
43	94.4	44	95.0	45	94.0	46	88.0	47	94.8	48	71.2	49	70.8

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	79.7	5	91.5	6	90.4	7	90.5
8	78.6	9	90.5	10	78.4	11	89.5	12	77.2	13	87.8	14	76.0
15	[illegible]	16	[illegible]	17	91.5	18	80.6	19	91.4	20	75.0	21	91.5
22	79.0	23	90.0	24	79.0	25	88.5	26	79.0	27	92.3	28	81.7
29	[illegible]	30	[illegible]	31	92.2	32	92.2	33	92.0	34	92.6	35	92.4
36	92.4	37	92.4	38	92.4	39	92.2	40	91.2	41	90.8	42	91.0
43	91.8	44	88.4	45	91.0	46	86.6	47	92.6	48	71.7	49	71.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.2	2	78.8	3	90.0	4	79.5	5	91.0	6	80.3	7	88.9
8	78.2	9	90.5	10	77.5	11	87.0	12	76.2	13	84.8	14	75.5
15	90.7	16	90.2	17	90.5	18	90.1	19	90.0	20	78.5	21	90.0
22	78.5	23	88.8	24	79.2	25	84.8	26	77.0	27	90.1	28	80.6
29	[illegible]	30	[illegible]	31	90.2	32	90.7	33	90.2	34	91.0	35	90.7
36	91.2	37	90.5	38	90.5	39	90.2	40	89.0	41	88.4	42	89.1
43	90.0	44	87.5	45	89.3	46	85.7	47	90.3	48	72.1	49	71.0

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.1	2	[illegible]	3	88.2	4	78.8	5	89.0	6	79.4	7	86.8
8	77.5	9	90.5	10	77.0	11	84.5	12	76.3	13	82.5	14	74.7
15	85.0	16	77.6	17	88.5	18	79.4	19	87.8	20	77.5	21	88.0
22	78.3	23	88.0	24	79.1	25	82.9	26	76.2	27	88.5	28	80.0
29	[illegible]	30	[illegible]	31	88.4	32	89.5	33	88.2	34	89.0	35	89.0
36	89.3	37	90.8	38	88.5	39	88.5	40	88.3	41	86.3	42	87.1
43	88.1	44	86.0	45	87.1	46	84.3	47	88.4	48	71.7	49	71.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	78.1	3	87.5	4	78.7	5	88.5	6	79.4	7	86.0
8	77.3	9	85.5	10	76.8	11	83.2	12	75.1	13	81.2	14	74.3
15	88.0	16	79.0	17	87.8	18	78.9	19	87.6	20	77.5	21	87.0
22	77.8	23	86.0	24	78.5	25	81.4	26	75.5	27	87.4	28	79.3
29	[illegible]	30	[illegible]	31	87.3	32	87.8	33	87.5	34	87.9	35	87.9
36	88.1	37	87.8	38	87.5	39	87.3	40	85.3	41	85.0	42	85.8
43	87.1	44	85.0	45	86.1	46	83.6	47	87.5	48	71.5	49	71.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	86.2	4	78.4	5	88.[illegible]	6	79.4	7	85.0
8	76.8	9	[illegible]	10	76.4	11	83.0	12	75.[illegible]	13	80.0	14	74.3
15	[illegible]	16	[illegible]	17	87.0	18	78.6	19	86.[illegible]	20	76.5	21	86.5
22	77.6	23	[illegible]	24	77.6	25	80.[illegible]	26	75.0	27	86.5	28	79.0
29	[illegible]	30	[illegible]	31	86.[illegible]	32	87.0	33	86.8	34	87.0	35	87.1
36	7[illegible]	37	[illegible]	38	86.[illegible]	39	86.5	40	84.[illegible]	41	84.4	42	85.1
43	86.[illegible]	44	84.0	45	85.3	46	83.3	47	86.[illegible]	48	71.5	49	71.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	86.6	4	78.6	5	86.[illegible]	6	77.4	7	85.0
8	76.[illegible]	9	[illegible]	10	75.1	11	80.5	12	72.7	13	78.5	14	73.6
15	85.[illegible]	16	77.8	17	86.0	18	77.8	19	85.[illegible]	20	76.2	21	85.0
22	76.8	23	84.0	24	77.[illegible]	25	79.1	26	74.[illegible]	27	85.8	28	78.5
29	[illegible]	30	[illegible]	31	85.0	32	86.[illegible]	33	86.[illegible]	34	86.2	35	86.1
36	86.6	37	[illegible]	38	85.4	39	85.4	40	83.[illegible]	41	83.0	42	84.1
43	85.[illegible]	44	[illegible]	45	84.1	46	83.[illegible]	47	85.[illegible]	48	71.8	49	71.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.[illegible]	2	[illegible]	3	85.0	4	77.3	5	86.[illegible]	6	77.8	7	83.4
8	75.7	9	[illegible]	10	74.7	11	80.0	12	73.0	13	77.8	14	73.6
15	86.[illegible]	16	77.2	17	84.5	18	76.8	19	84.0	20	75.5	21	84.0
22	76.1	23	82.0	24	75.3	25	78.1	26	73.0	27	85.0	28	78.0
29	[illegible]	30	[illegible]	31	84.[illegible]	32	85.4	33	85.[illegible]	34	85.4	35	85.4
36	85.0	37	85.0	38	84.8	39	84.5	40	82.7	41	82.2	42	83.2
43	84.0	44	81.0	45	83.5	46	82.0	47	85.[illegible]	48	71.4	49	71.2

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	78.8	3	84.6	4	77.1	5	85.[illegible]	6	78.0	7	82.8
8	75.0	9	[illegible]	10	75.0	11	79.0	12	73.0	13	76.5	14	73.0
15	85.5	16	77.8	17	84.0	18	76.7	19	83.[illegible]	20	75.4	21	83.5
22	76.1	23	81.0	24	77.5	25	76.0	26	73.[illegible]	27	84.1	28	77.8
29	[illegible]	30	[illegible]	31	84.0	32	84.9	33	84.0	34	84.8	35	84.8
36	85.0	37	84.0	38	83.8	39	83.5	40	81.9	41	81.3	42	82.7
43	84.0	44	81.0	45	82.5	46	81.8	47	84.2	48	71.4	49	71.1

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.6	2	78.6	3	84.2	4	76.8	5	85.5	6	77.7	7	82.2
8	75.2	9	80.5	10	74.3	11	78.0	12	72.7	13	76.3	14	73.3
15	85.3	16	77.7	17	83.9	18	76.9	19	83.0	20	75.0	21	82.5
22	75.5	23	83.0	24	76.8	25	76.5	26	73.0	27	84.0	28	77.7
29	[illegible]	30	[illegible]	31	83.0	32	84.6	33	84.1	34	84.5	35	84.5
36	84.9	37	84.0	38	83.6	39	83.2	40	81.8	41	81.0	42	82.3
43	83.9	44	82.8	45	82.8	46	81.8	47	84.1	48	71.5	49	71.1

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	78.0	3	84.0	4	76.8	5	85.2	6	77.6	7	82.0
8	75.0	9	80.5	10	74.1	11	78.0	12	73.2	13	76.0	14	72.7
15	85.0	16	77.9	17	84.0	18	77.6	19	82.8	20	75.5	21	82.0
22	75.2	23	83.0	24	76.0	25	76.9	26	73.2	27	83.8	28	77.7
29	[illegible]	30	[illegible]	31	83.9	32	84.7	33	84.1	34	84.1	35	84.1
36	84.0	37	83.6	38	83.2	39	82.9	40	81.1	41	80.6	42	82.0
43	83.5	44	82.5	45	82.2	46	81.8	47	84.0	48	71.2	49	71.0

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.4	2	78.5	3	84.0	4	76.5	5	85.0	6	77.4	7	82.4
8	75.2	9	80.5	10	74.0	11	78.5	12	72.7	13	76.4	14	72.7
15	85.0	16	77.6	17	84.0	18	77.0	19	83.0	20	75.0	21	82.5
22	75.5	23	83.0	24	76.5	25	76.1	26	72.3	27	84.0	28	77.4
29	[illegible]	30	[illegible]	31	84.0	32	84.9	33	84.4	34	84.1	35	84.1
36	84.8	37	84.0	38	83.5	39	83.1	40	82.0	41	81.2	42	82.2
43	83.0	44	81.5	45	82.3	46	81.9	47	84.0	48	71.3	49	69.9

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	76.8	3	85.0	4	77.4	5	86.0	6	77.7	7	83.0
8	75.5	9	82.0	10	75.0	11	80.0	12	73.6	13	78.0	14	72.7
15	86.[illegible]	16	78.0	17	84.[illegible]	18	76.1	19	84.0	20	76.1	21	84.0
22	76.5	23	80.0	24	78.8	25	78.7	26	73.7	27	85.0	28	78.0
29	[illegible]	30	[illegible]	31	85.0	32	85.0	33	85.1	34	85.1	35	85.1
36	85.4	37	85.0	38	84.6	39	84.0	40	82.6	41	82.2	42	83.2
43	84.2	44	83.5	45	83.5	46	82.2	47	85.1	48	71.1	49	69.9

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.5	2	77.3	3	86.0	4	77.8	5	86.[illegible]	6	77.8	7	83.4
8	76.6	9	84.0	10	76.0	11	82.0	12	74.1	13	81.0	14	74.3
15	86.5	16	78.3	17	85.5	18	77.6	19	85.0	20	78.0	21	84.5
22	76.5	23	80.0	24	78.2	25	82.0	26	76.0	27	86.5	28	79.0
29	[illegible]	30	[illegible]	31	86.6	32	86.9	33	86.4	34	86.3	35	86.2
36	86.5	37	86.1	38	85.9	39	85.5	40	84.5	41	84.1	42	84.9
43	85.[illegible]	44	84.5	45	85.1	46	83.0	47	86.4	48	71.0	49	69.8

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.[illegible]	2	78.2	3	87.4	4	78.9	5	88.6	6	78.7	7	86.4
8	77.4	9	86.0	10	76.9	11	84.0	12	74.9	13	83.5	14	75.2
15	88.0	16	79.4	17	87.0	18	78.6	19	87.0	20	78.0	21	86.0
22	77.2	23	86.0	24	78.4	25	83.3	26	76.6	27	88.6	28	79.9
29	[illegible]	30	[illegible]	31	88.2	32	88.2	33	88.0	34	88.0	35	87.9
36	88.1	37	87.0	38	87.5	39	87.2	40	86.5	41	86.3	42	86.8
43	88.2	44	85.0	45	87.1	46	84.5	47	88.1	48	71.0	49	70.8

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.[illegible]	2	77.9	3	85.0	4	79.2	5	89.5	6	79.6	7	87.8
8	77.9	9	87.5	10	77.3	11	86.0	12	75.8	13	86.2	14	75.9
15	89.0	16	80.0	17	88.0	18	78.9	19	88.3	20	78.5	21	88.0
22	78.1	23	88.0	24	78.7	25	86.2	26	78.0	27	90.0	28	81.0
29	[illegible]	30	[illegible]	31	85.8	32	89.8	33	89.2	34	89.5	35	89.3
36	89.4	37	89.5	38	89.3	39	88.8	40	88.1	41	87.9	42	88.2
43	89.0	44	86.8	45	88.8	46	84.9	47	90.1	48	70.9	49	70.6

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	78.7	3	90.0	4	79.5	5	90.0	6	79.5	7	89.0
8	78.0	9	89.0	10	77.8	11	88.0	12	76.4	13	88.5	14	76.7
15	90.0	16	80.4	17	89.5	18	79.6	19	90.0	20	79.2	21	89.5
22	78.7	23	91.0	24	80.4	25	88.1	26	77.2	27	91.2	28	88.1
29	[illegible]	30	[illegible]	31	91.0	32	91.0	33	90.3	34	90.9	35	90.5
36	90.7	37	91.1	38	90.6	39	90.3	40	90.1	41	89.9	42	90.0
43	90.9	44	88.5	45	90.2	46	85.9	47	91.3	48	70.8	49	70.6

TIME 1100 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	75.3	3	91.0	4	80.0	5	90.0	6	75.0	7	90.8
8	78.4	9	91.5	10	77.4	11	89.2	12	76.5	13	90.0	14	76.2
15	91.1	16	91.9	17	91.1	18	75.3	19	91.1	20	74.8	21	90.0
22	78.4	23	91.0	24	75.1	25	89.2	26	78.5	27	92.2	28	91.2
29	0.	30	0.	31	90.1	32	92.0	33	91.5	34	92.1	35	91.8
36	91.1	37	92.2	38	92.0	39	92.0	40	91.4	41	91.2	42	91.2
43	92.0	44	90.0	45	91.9	46	86.8	47	92.5	48	70.8	49	70.4

TIME 1200 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	75.0	3	91.0	4	80.4	5	92.0	6	80.0	7	91.4
8	78.1	9	91.5	10	78.0	11	91.0	12	77.5	13	91.8	14	77.6
15	92.0	16	91.9	17	92.0	18	80.7	19	92.0	20	75.9	21	92.0
22	79.1	23	91.0	24	80.5	25	92.0	26	80.0	27	93.3	28	92.4
29	0.	30	0.	31	91.1	32	92.9	33	92.9	34	93.1	35	92.9
36	92.1	37	93.0	38	92.1	39	92.5	40	92.7	41	92.5	42	92.5
43	92.1	44	91.1	45	92.7	46	87.2	47	93.0	48	70.8	49	70.4

TIME 1300 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	75.0	3	92.4	4	80.8	5	92.0	6	80.8	7	92.0
8	79.4	9	92.0	10	78.0	11	92.0	12	78.0	13	92.2	14	77.4
15	92.0	16	91.9	17	92.0	18	80.8	19	92.0	20	80.4	21	92.0
22	79.0	23	91.0	24	80.4	25	92.1	26	80.1	27	93.6	28	93.0
29	0.	30	0.	31	91.8	32	93.5	33	93.0	34	93.9	35	93.8
36	93.0	37	93.0	38	93.4	39	93.3	40	93.1	41	93.2	42	93.2
43	91.0	44	92.9	45	91.2	46	87.6	47	94.0	48	70.6	49	70.4

TIME 1400 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	75.6	3	91.0	4	80.1	5	92.0	6	80.5	7	91.5
8	79.4	9	90.0	10	78.2	11	90.0	12	78.2	13	87.5	14	75.7
15	92.0	16	91.0	17	91.0	18	80.2	19	92.0	20	75.9	21	92.0
22	80.4	23	91.0	24	80.5	25	87.4	26	77.9	27	91.5	28	82.1
29	0.	30	0.	31	92.0	32	92.1	33	91.8	34	92.3	35	92.1
36	92.9	37	93.1	38	93.1	39	92.9	40	91.5	41	91.7	42	90.0
43	91.0	44	88.2	45	91.0	46	86.7	47	91.9	48	72.0	49	71.6

TIME 1500 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	75.6	3	91.0	4	80.0	5	91.0	6	80.4	7	92.9
8	78.6	9	88.5	10	78.0	11	88.0	12	77.1	13	84.5	14	75.3
15	90.5	16	81.5	17	90.0	18	79.8	19	91.0	20	75.2	21	91.0
22	79.7	23	91.0	24	80.3	25	84.0	26	76.9	27	89.8	28	81.5
29	0.	30	0.	31	92.0	32	90.1	33	90.0	34	90.9	35	90.8
36	91.2	37	92.0	38	92.0	39	91.8	40	89.5	41	88.8	42	88.0
43	89.4	44	87.0	45	85.5	46	85.6	47	90.1	48	72.0	49	71.7

TIME 1600 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	75.0	3	90.0	4	80.5	5	91.0	6	80.4	7	92.9
8	78.0	9	88.5	10	78.0	11	88.0	12	77.1	13	84.5	14	75.3
15	90.5	16	81.5	17	90.0	18	79.8	19	91.0	20	75.2	21	91.0
22	79.7	23	91.0	24	80.3	25	84.0	26	76.9	27	89.8	28	81.5
29	0.	30	0.	31	92.0	32	90.1	33	90.0	34	90.9	35	90.8
36	91.2	37	92.0	38	92.0	39	91.8	40	89.5	41	88.8	42	88.0
43	89.4	44	87.0	45	85.5	46	85.6	47	90.1	48	72.0	49	71.7

TIME 1700 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	75.0	3	91.0	4	80.1	5	93.1	6	80.0	7	91.5
8	78.9	9	92.0	10	79.0	11	91.0	12	77.0	13	90.0	14	76.5
15	92.5	16	91.9	17	92.5	18	80.7	19	92.0	20	79.5	21	93.0
22	80.2	23	91.0	24	80.0	25	90.1	26	79.0	27	93.2	28	82.5
29	0.	30	0.	31	91.5	32	93.5	33	92.9	34	93.5	35	93.3
36	93.4	37	93.4	38	93.4	39	93.4	40	92.9	41	92.2	42	92.2
43	91.0	44	89.0	45	92.8	46	87.5	47	93.5	48	72.0	49	71.5

TIME 1800 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	75.0	3	91.0	4	80.1	5	93.1	6	80.0	7	91.5
8	78.9	9	92.0	10	79.0	11	91.0	12	77.0	13	90.0	14	76.5
15	92.5	16	91.9	17	92.5	18	80.7	19	92.0	20	79.5	21	93.0
22	80.2	23	91.0	24	80.0	25	90.1	26	79.0	27	93.2	28	82.5
29	0.	30	0.	31	91.5	32	93.5	33	92.9	34	93.5	35	93.3
36	93.4	37	93.4	38	93.4	39	93.4	40	92.9	41	92.2	42	92.2
43	91.0	44	89.0	45	92.8	46	87.5	47	93.5	48	72.0	49	71.5

TIME 1900 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	75.6	3	91.0	4	80.1	5	92.0	6	80.5	7	91.5
8	79.4	9	90.0	10	78.2	11	90.0	12	78.2	13	87.5	14	75.7
15	92.0	16	91.0	17	91.0	18	80.2	19	92.0	20	75.9	21	92.0
22	80.4	23	91.0	24	80.5	25	87.4	26	77.9	27	91.5	28	82.1
29	0.	30	0.	31	92.0	32	92.1	33	91.8	34	92.3	35	92.1
36	92.9	37	93.1	38	93.1	39	92.9	40	91.5	41	91.7	42	90.0
43	91.0	44	88.2	45	91.0	46	86.7	47	91.9	48	72.0	49	71.6

TIME 2000 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	75.0	3	90.0	4	79.8	5	91.0	6	80.4	7	89.0
8	78.0	9	88.5	10	78.0	11	88.0	12	77.1	13	84.5	14	75.3
15	90.5	16	81.5	17	90.0	18	79.8	19	91.0	20	75.2	21	91.0
22	79.7	23	91.0	24	80.3	25	84.0	26	76.9	27	89.8	28	81.5
29	0.	30	0.	31	92.0	32	90.1	33	90.0	34	90.9	35	90.8
36	91.2	37	92.0	38	92.0	39	91.8	40	89.5	41	88.8	42	88.0
43	89.4	44	87.0	45	85.5	46	85.6	47	90.1	48	72.0	49	71.7

TIME 2100 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	77.5	3	88.0	4	78.0	5	89.0	6	78.7	7	87.0
8	77.1	9	86.0	10	76.3	11	85.5	12	76.4	13	82.0	14	73.9
15	88.4	16	79.5	17	85.0	18	79.1	19	89.0	20	78.3	21	0.
22	78.9	23	88.0	24	79.1	25	82.0	26	75.0	27	88.0	28	80.2
29	0.	30	0.	31	87.9	32	88.5	33	88.1	34	89.3	35	89.3
36	89.8	37	90.5	38	90.3	39	90.2	40	87.5	41	86.6	42	85.8
43	87.5	44	85.5	45	87.6	46	84.5	47	88.1	48	72.0	49	71.6

TIME 2200 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	77.2	3	87.0	4	78.1	5	88.5	6	78.0	7	86.0
8	77.2	9	85.0	10	75.7	11	84.5	12	75.1	13	81.5	14	74.5
15	88.5	16	79.1	17	87.0	18	77.9	19	88.8	20	78.0	21	89.0
22	78.7	23	86.0	24	78.1	25	82.0	26	75.2	27	87.0	28	80.0
29	0.	30	0.	31	87.1	32	87.8	33	87.2	34	88.5	35	88.5
36	89.0	37	89.5	38	89.5	39	89.4	40	86.8	41	85.7	42	84.8
43	86.8	44	85.0	45	86.4	46	84.0	47	87.1	48	71.9	49	71.7

TIME 2300 DATE 6/ 4/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.8	2	77.0	3	86.5	4	77.2	5	87.5	6	78.0	7	85.0
8	76.7	9	85.0	10	76.4	11	84.5	12	75.1	13	80.2	14	73.4
15	89.0	16	79.2	17	85.0	18	78.5	19	88.0	20	77.8	21	89.0
22	79.2	23	86.0	24	78.1	25	81.0	26	75.4	27	87.5	28	79.1
29	0.	30	0.	31	86.5	32	87.1	33	86.8	34	89.2	35	89.1
36	89.7	37	89.0	38	89.0	39	88.8	40	86.6	41	85.2	42	84.5
43	86.1	44	84.5	45	86.0	46	83.9	47	86.6	48	72.0	49	71.8

TIME 2400 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.8	2	77.0	3	86.5	4	77.2	5	87.5	6	78.0	7	85.0
8	76.7	9	85.0	10	76.4	11	84.5	12	75.1	13	80.2	14	73.4
15	89.0	16	79.2	17	85.0	18	78.5	19	88.0	20	77.8	21	89.0
22	79.2	23	86.0	24	78.1	25	81.0	26	75.4	27	87.5	28	79.1
29	0.	30	0.	31	86.5	32	87.1	33	86.8	34	89.2	35	89.1
36	89.7	37	89.0	38	89.0	39	88.8	40	86.6	41	85.2	42	84.5
43	86.1	44	84.5	45	86.0	46	83.9	47	86.6	48	72.0	49	71.8

TIME 200 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.2	2	76.9	3	86.5	4	77.0	5	85.2	6	77.9	7	82.5
8	76.0	9	81.5	10	75.4	11	81.5	12	75.2	13	77.0	14	73.9
15	82.0	16	79.0	17	86.5	18	78.5	19	85.8	20	77.7	21	86.2
22	78.6	23	83.5	24	77.5	25	78.2	26	74.3	27	84.0	28	78.7
29	0.	30	0.	31	86.0	32	85.0	33	85.5	34	86.8	35	86.5
36	87.3	37	86.2	38	86.2	39	86.0	40	83.3	41	82.2	42	81.2
43	83.2	44	82.5	45	83.2	46	82.0	47	86.1	48	71.7	49	71.4

TIME 300 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.2	2	76.8	3	86.2	4	77.3	5	85.0	6	77.8	7	82.2
8	75.7	9	81.5	10	75.8	11	81.0	12	75.0	13	76.8	14	73.5
15	82.0	16	78.7	17	85.7	18	78.1	19	85.2	20	77.6	21	85.7
22	78.4	23	83.5	24	77.7	25	77.0	26	73.2	27	83.9	28	78.5
29	0.	30	0.	31	83.5	32	84.8	33	84.2	34	84.3	35	84.2
36	86.8	37	86.0	38	86.0	39	85.7	40	83.3	41	82.3	42	81.4
43	83.4	44	82.5	45	83.0	46	82.0	47	84.0	48	71.6	49	71.3

TIME 400 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.8	3	86.0	4	77.3	5	84.8	6	77.9	7	81.8
8	75.5	9	80.8	10	75.2	11	80.8	12	74.9	13	76.0	14	73.4
15	86.7	16	78.6	17	85.5	18	78.3	19	85.0	20	78.0	21	85.3
22	78.5	23	82.0	24	76.3	25	76.7	26	73.0	27	83.6	28	78.4
29	0.	30	0.	31	83.3	32	84.4	33	84.0	34	83.8	35	83.8
36	86.5	37	85.5	38	85.5	39	85.2	40	82.5	41	81.5	42	80.8
43	82.7	44	82.0	45	83.0	46	81.8	47	84.2	48	71.4	49	71.1

TIME 500 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.9	3	85.8	4	77.2	5	84.7	6	77.8	7	82.0
8	75.7	9	81.0	10	75.4	11	81.0	12	75.1	13	76.7	14	73.6
15	86.7	16	78.7	17	85.3	18	78.1	19	84.5	20	77.4	21	85.5
22	78.4	23	82.0	24	76.3	25	76.7	26	73.0	27	83.5	28	78.4
29	0.	30	0.	31	83.3	32	84.4	33	84.0	34	83.8	35	83.8
36	86.5	37	85.5	38	85.5	39	85.2	40	82.5	41	81.5	42	80.8
43	82.7	44	82.0	45	83.0	46	81.8	47	84.2	48	71.4	49	71.1

TIME 600 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.9	3	85.8	4	77.2	5	84.7	6	77.8	7	82.0
8	75.7	9	81.0	10	75.4	11	81.0	12	75.1	13	76.7	14	73.6
15	86.7	16	78.7	17	85.3	18	78.1	19	84.5	20	77.4	21	85.5
22	78.4	23	82.0	24	76.3	25	76.7	26	73.0	27	83.5	28	78.4
29	0.	30	0.	31	83.3	32	84.4	33	84.0	34	83.8	35	83.8
36	86.5	37	85.5	38	85.5	39	85.2	40	82.5	41	81.5	42	80.8
43	82.7	44	82.0	45	83.0	46	81.8	47	84.2	48	71.4	49	71.1

TIME 700 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.9	3	85.8	4	77.2	5	84.7	6	77.8	7	82.0
8	75.7	9	81.0	10	75.4	11	81.0	12	75.1	13	76.7	14	73.6
15	86.7	16	78.7	17	85.3	18	78.1	19	84.5	20	77.4	21	85.5
22	78.4	23	82.0	24	76.3	25	76.7	26	73.0	27	83.5	28	78.4
29	0.	30	0.	31	83.3	32	84.4	33	84.0	34	83.8	35	83.8
36	86.5	37	85.5	38	85.5	39	85.2	40	82.5	41	81.5	42	80.8
43	82.7	44	82.0	45	83.0	46	81.8	47	84.2	48	71.4	49	71.1

TIME 800 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.9	3	85.8	4	77.2	5	84.7	6	77.8	7	82.0
8	75.7	9	81.0	10	75.4	11	81.0	12	75.1	13	76.7	14	73.6
15	86.7	16	78.7	17	85.3	18	78.1	19	84.5	20	77.4	21	85.5
22	78.4	23	82.0	24	76.3	25	76.7	26	73.0	27	83.5	28	78.4
29	0.	30	0.	31	83.3	32	84.4	33	84.0	34	83.8	35	83.8
36	86.5	37	85.5	38	85.5	39	85.2	40	82.5	41	81.5	42	80.8
43	82.7	44	82.0	45	83.0	46	81.8	47	84.2	48	71.4	49	71.1

TIME 900 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.9	3	85.8	4	77.2	5	84.7	6	77.8	7	82.0
8	75.7	9	81.0	10	75.4	11	81.0	12	75.1	13	76.7	14	73.6
15	86.7	16	78.7	17	85.3	18	78.1	19	84.5	20	77.4	21	85.5
22	78.4	23	82.0	24	76.3	25	76.7	26	73.0	27	83.5	28	78.4
29	0.	30	0.	31	83.3	32	84.4	33	84.0	34	83.8	35	83.8
36	86.5	37	85.5	38	85.5	39	85.2	40	82.5	41	81.5	42	80.8
43	82.7	44	82.0	45	83.0	46	81.8	47	84.2	48	71.4	49	71.1

TIME 1000 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.9	3	85.8	4	77.2	5	84.7	6	77.8	7	82.0
8	75.7	9	81.0	10	75.4	11	81.0	12	75.1	13	76.7	14	73.6
15	86.7	16	78.7	17	85.3	18	78.1	19	84.5	20	77.4	21	85.5
22	78.4	23	82.0	24	76.3	25	76.7	26	73.0	27	83.5	28	78.4
29	0.	30	0.	31	83.3	32	84.4	33	84.0	34	83.8	35	83.8
36	86.5	37	85.5	38	85.5	39	85.2	40	82.5	41	81.5	42	80.8
43	82.7	44	82.0	45	83.0	46	81.8	47	84.2	48	71.4	49	71.1

TIME 1100 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	75.0	3	91.0	4	80.1	5	91.0	6	80.3	7	90.0
8	79.0	9	90.0	10	78.0	11	90.0	12	78.0	13	90.0	14	78.0
15	91.0	16	81.0	17	91.0	18	80.5	19	91.0	20	80.3	21	91.5
22	90.5	23	90.0	24	80.5	25	90.9	26	79.9	27	92.3	28	87.8
29	0.	30	0.	31	92.4	32	92.2	33	91.6	34	92.7	35	92.5
36	92.0	37	91.8	38	92.5	39	92.4	40	92.1	41	91.5	42	91.4
43	92.2	44	88.4	45	92.6	46	87.0	47	93.	48	76.2	49	69.8

TIME 1200 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	79.8	3	92.0	4	81.0	5	92.	6	81.8	7	92.0
8	79.5	9	92.0	10	79.3	11	92.0	12	79.0	13	92.0	14	77.5
15	92.0	16	81.2	17	92.0	18	80.6	19	92.5	20	81.0	21	92.0
22	80.5	23	91.0	24	80.4	25	92.5	26	80.5	27	93.5	28	90.8
29	0.	30	0.	31	93.3	32	93.6	33	92.8	34	93.8	35	93.5
36	93.7	37	93.6	38	93.4	39	93.5	40	93.2	41	92.9	42	92.8
43	93.2	44	89.2	45	93.1	46	87.5	47	94.0	48	76.2	49	69.8

TIME 1300 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.2	3	92.5	4	81.0	5	92.5	6	81.0	7	92.0
8	79.5	9	92.4	10	79.2	11	93.0	12	79.7	13	92.8	14	78.0
15	92.0	16	81.0	17	92.5	18	81.0	19	92.8	20	81.3	21	93.0
22	81.1	23	89.4	24	81.0	25	89.8	26	81.5	27	94.2	28	92.0
29	0.	30	0.	31	94.1	32	93.9	33	93.4	34	94.6	35	94.2
36	94.4	37	94.2	38	94.0	39	94.1	40	94.0	41	93.7	42	93.6
43	94.2	44	91.0	45	93.6	46	88.6	47	94.5	48	76.2	49	69.8

TIME 1400 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.4	3	92.5	4	80.6	5	93.0	6	81.4	7	92.5
8	79.5	9	92.5	10	79.4	11	93.0	12	79.4	13	93.0	14	78.6
15	93.0	16	81.5	17	93.0	18	81.5	19	93.0	20	81.6	21	91.0
22	81.1	23	94.0	24	81.0	25	92.8	26	82.1	27	94.0	28	92.2
29	0.	30	0.	31	94.1	32	93.8	33	93.4	34	94.4	35	94.0
36	94.2	37	94.0	38	94.0	39	94.1	40	94.0	41	93.6	42	93.6
43	94.0	44	91.8	45	93.7	46	87.9	47	94.5	48	76.2	49	69.9

TIME 1500 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.4	3	92.8	4	80.5	5	93.5	6	81.6	7	92.8
8	79.5	9	93.0	10	79.8	11	93.0	12	79.6	13	92.8	14	77.8
15	93.0	16	81.7	17	93.0	18	81.6	19	93.0	20	81.7	21	91.5
22	81.6	23	94.0	24	80.5	25	93.0	26	80.5	27	94.6	28	92.5
29	0.	30	0.	31	94.4	32	94.0	33	93.8	34	94.5	35	94.2
36	94.6	37	94.1	38	94.2	39	94.2	40	94.2	41	93.9	42	93.8
43	94.1	44	90.0	45	94.0	46	88.2	47	94.4	48	76.5	49	70.0

TIME 1600 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	80.4	3	93.0	4	81.3	5	93.0	6	81.5	7	92.8
8	79.6	9	93.0	10	80.4	11	93.0	12	80.0	13	92.3	14	77.5
15	93.0	16	92.0	17	93.0	18	81.6	19	93.0	20	81.5	21	93.0
22	81.6	23	94.5	24	82.3	25	92.2	26	80.4	27	93.9	28	92.5
29	0.	30	0.	31	94.0	32	93.7	33	93.4	34	94.0	35	93.9
36	94.0	37	94.0	38	94.0	39	94.0	40	94.0	41	93.5	42	93.5
43	94.0	44	90.0	45	93.6	46	88.0	47	94.5	48	76.7	49	70.1

TIME 1700 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.3	2	80.3	3	92.4	4	80.8	5	93.0	6	81.5	7	92.0
8	79.1	9	92.0	10	79.2	11	92.5	12	79.0	13	91.5	14	77.4
15	92.5	16	81.6	17	93.0	18	81.6	19	92.5	20	81.5	21	93.0
22	81.4	23	93.0	24	80.5	25	91.9	26	82.4	27	93.6	28	92.7
29	0.	30	0.	31	93.2	32	93.5	33	93.0	34	93.5	35	93.9
36	93.5	37	93.5	38	93.0	39	94.5	40	92.5	41	92.3	42	92.6
43	93.2	44	89.3	45	93.0	46	86.8	47	93.8	48	71.5	49	70.3

TIME 1800 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.2	3	92.0	4	80.5	5	93.0	6	81.7	7	91.5
8	79.2	9	91.5	10	79.2	11	91.5	12	78.6	13	90.5	14	76.9
15	92.4	16	81.5	17	92.0	18	81.0	19	92.3	20	81.3	21	92.5
22	81.1	23	92.0	24	80.3	25	90.4	26	77.2	27	92.8	28	89.0
29	0.	30	0.	31	93.1	32	92.7	33	92.5	34	93.5	35	93.5
36	93.5	37	93.3	38	93.0	39	93.5	40	92.2	41	92.0	42	91.8
43	92.6	44	89.0	45	92.2	46	87.2	47	93.0	48	71.0	49	70.6

TIME 1900 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	91.0	3	91.0	4	80.3	5	92.5	6	81.0	7	90.6
8	78.1	9	90.0	10	78.2	11	90.5	12	78.3	13	88.0	14	76.5
15	92.0	16	81.8	17	91.5	18	80.9	19	91.8	20	81.3	21	91.5
22	80.6	23	89.4	24	78.7	25	88.5	26	78.5	27	91.8	28	92.0
29	0.	30	0.	31	91.6	32	91.6	33	91.4	34	92.0	35	92.1
36	92.5	37	92.1	38	92.2	39	92.2	40	91.0	41	90.4	42	90.0
43	91.6	44	88.6	45	90.8	46	86.4	47	91.5	48	71.0	49	70.9

TIME 2000 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	[illegible]	3	90.0	4	80.0	5	91.0	6	80.9	7	88.5
8	78.0	9	[illegible]	10	78.0	11	88.5	12	77.6	13	89.0	14	75.8
15	91.0	16	[illegible]	17	90.5	18	80.0	19	90.1	20	80.1	21	91.0
22	81.1	23	[illegible]	24	80.3	25	85.0	26	77.2	27	89.8	28	81.2
29	0.	30	1.	31	90.0	32	90.1	33	90.0	34	90.9	35	90.9
36	91.3	37	[illegible]	38	91.1	39	91.0	40	89.2	41	88.5	42	88.0
43	89.7	44	[illegible]	45	85.0	46	85.4	47	90.0	48	71.1	49	71.0

TIME 2100 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	[illegible]	3	89.0	4	79.9	5	89.0	6	80.2	7	87.0
8	78.1	9	90.0	10	77.1	11	88.5	12	77.0	13	87.5	14	74.6
15	90.0	16	80.0	17	89.5	18	80.0	19	89.0	20	77.8	21	89.5
22	79.0	23	88.0	24	78.1	25	82.5	26	76.3	27	88.0	28	80.5
29	0.	30	0.	31	88.1	32	88.5	33	88.4	34	89.5	35	89.5
36	90.0	37	89.5	38	89.7	39	89.7	40	87.5	41	86.9	42	86.0
43	88.0	44	85.7	45	87.5	46	84.5	47	88.4	48	71.4	49	71.1

TIME 2200 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	[illegible]	3	87.5	4	79.9	5	89.0	6	80.5	7	86.0
8	77.7	9	[illegible]	10	77.1	11	85.0	12	76.4	13	85.5	14	74.9
15	89.0	16	[illegible]	17	81.0	18	79.5	19	88.1	20	79.2	21	88.5
22	79.0	23	[illegible]	24	80.0	25	81.4	26	75.0	27	87.1	28	80.1
29	0.	30	0.	31	87.3	32	87.7	33	87.4	34	88.5	35	88.5
36	89.3	37	89.0	38	88.9	39	88.9	40	86.0	41	86.0	42	85.1
43	87.4	44	83.2	45	86.7	46	84.2	47	87.4	48	71.5	49	71.1

TIME 2300 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	78.4	3	87.0	4	79.2	5	88.0	6	79.6	7	85.5
8	77.7	9	84.5	10	77.0	11	84.5	12	76.3	13	85.5	14	74.4
15	88.5	16	79.9	17	87.5	18	79.1	19	88.0	20	79.5	21	88.0
22	79.0	23	88.0	24	81.2	25	81.0	26	76.0	27	87.0	28	79.9
29	0.	30	0.	31	87.0	32	87.4	33	87.0	34	88.0	35	88.1
36	88.0	37	88.5	38	88.5	39	88.3	40	86.0	41	85.1	42	84.3
43	86.5	44	85.0	45	86.0	46	83.5	47	87.0	48	71.7	49	71.1

TIME 2400 DATE 6/ 5/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	78.0	3	86.0	4	78.3	5	86.5	6	78.6	7	86.3
8	77.2	9	83.0	10	76.1	11	82.5	12	75.1	13	75.0	14	74.0
15	88.0	16	79.5	17	86.5	18	78.6	19	87.0	20	78.7	21	87.0
22	79.0	23	88.0	24	79.4	25	79.5	26	75.2	27	85.5	28	79.3
29	0.	30	0.	31	85.6	32	86.3	33	86.0	34	87.1	35	87.1
36	87.9	37	87.3	38	87.3	39	87.3	40	84.8	41	83.8	42	83.0
43	85.2	44	84.0	45	84.7	46	82.9	47	86.1	48	71.8	49	71.5

TIME 100 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.7	2	77.8	3	85.2	4	78.1	5	86.0	6	78.5	7	84.5
8	76.6	9	82.0	10	75.6	11	82.0	12	75.3	13	78.0	14	74.0
15	87.3	16	79.3	17	86.0	18	78.6	19	86.0	20	78.3	21	86.0
22	78.5	23	83.0	24	77.0	25	78.8	26	74.2	27	85.0	28	79.0
29	0.	30	0.	31	84.1	32	85.8	33	85.1	34	86.8	35	86.8
36	87.2	37	86.9	38	86.8	39	86.8	40	84.2	41	83.3	42	82.6
43	84.6	44	83.8	45	84.0	46	82.6	47	85.1	48	72.0	49	71.5

TIME 200 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.8	2	77.4	3	84.8	4	77.9	5	85.5	6	78.4	7	82.9
8	76.4	9	82.0	10	76.1	11	81.5	12	75.4	13	77.0	14	73.6
15	87.0	16	79.2	17	83.0	18	78.1	19	84.8	20	75.0	21	83.0
22	76.1	23	83.0	24	77.0	25	76.6	26	73.6	27	84.0	28	79.0
29	0.	30	0.	31	84.1	32	85.1	33	84.4	34	84.4	35	84.3
36	87.0	37	86.5	38	86.3	39	86.3	40	83.4	41	82.9	42	82.2
43	84.0	44	83.6	45	83.2	46	82.2	47	84.4	48	82.1	49	71.5

TIME 300 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	76.7	3	84.0	4	77.4	5	85.0	6	77.9	7	82.2
8	75.6	9	81.0	10	75.4	11	81.0	12	75.0	13	76.6	14	73.3
15	86.5	16	78.8	17	83.0	18	77.8	19	83.0	20	79.1	21	83.5
22	78.4	23	83.0	24	78.7	25	78.4	26	73.3	27	84.0	28	78.6
29	0.	30	0.	31	83.8	32	84.8	33	84.5	34	85.8	35	85.8
36	86.5	37	85.4	38	86.0	39	85.4	40	83.2	41	82.2	42	81.5
43	83.4	44	82.2	45	83.0	46	82.0	47	84.1	48	72.2	49	71.8

TIME 400 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	82.8	2	76.7	3	84.0	4	77.4	5	84.0	6	77.0	7	84.0
8	77.5	9	80.0	10	74.8	11	80.0	12	74.4	13	76.0	14	73.3
15	86.0	16	78.6	17	84.5	18	77.7	19	86.0	20	78.7	21	84.5
22	77.7	23	83.0	24	75.7	25	75.2	26	72.8	27	83.2	28	78.2
29	0.	30	0.	31	83.0	32	84.5	33	84.0	34	85.5	35	85.5
36	86.1	37	85.4	38	85.4	39	85.3	40	83.3	41	81.9	42	81.1
43	83.1	44	82.5	45	82.6	46	82.0	47	84.0	48	72.0	49	71.8

TIME 500 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	76.7	3	84.0	4	77.4	5	84.0	6	77.6	7	82.5
8	75.6	9	80.5	10	75.0	11	80.5	12	74.0	13	76.5	14	73.4
15	86.0	16	78.7	17	84.5	18	77.7	19	86.0	20	77.6	21	84.5
22	77.6	23	82.0	24	75.7	25	77.5	26	73.0	27	83.0	28	78.2
29	0.	30	0.	31	83.6	32	84.6	33	84.6	34	85.3	35	85.2
36	86.0	37	85.3	38	85.5	39	85.5	40	83.0	41	81.0	42	81.2
43	83.2	44	82.0	45	82.7	46	82.0	47	84.0	48	72.1	49	71.8

TIME 600 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.5	2	77.0	3	84.0	4	77.2	5	84.2	6	77.5	7	82.5
8	76.0	9	81.0	10	75.0	11	81.0	12	74.0	13	77.5	14	73.5
15	86.0	16	78.7	17	84.5	18	77.5	19	85.0	20	77.9	21	84.5
22	77.5	23	83.0	24	77.0	25	78.0	26	74.1	27	84.2	28	78.6
29	0.	30	0.	31	84.1	32	85.0	33	84.8	34	85.5	35	85.5
36	86.3	37	86.0	38	85.9	39	85.6	40	83.3	41	82.5	42	82.0
43	84.0	44	83.0	45	83.5	46	82.8	47	84.9	48	72.1	49	71.7

TIME 700 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.5	2	77.7	3	85.0	4	77.8	5	86.0	6	78.4	7	84.0
8	76.3	9	83.0	10	76.2	11	83.0	12	75.0	13	80.0	14	74.2
15	87.0	16	79.9	17	85.5	18	78.3	19	85.0	20	78.3	21	85.5
22	78.2	23	86.0	24	75.0	25	80.8	26	75.4	27	85.0	28	79.2
29	0.	30	0.	31	85.0	32	86.2	33	85.2	34	86.9	35	86.8
36	87.1	37	87.0	38	87.0	39	86.9	40	85.2	41	84.4	42	83.9
43	85.9	44	84.1	45	85.4	46	83.2	47	86.8	48	72.2	49	71.8

TIME 800 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.8	2	78.1	3	86.8	4	78.9	5	88.0	6	80.0	7	86.0
8	78.0	9	85.5	10	77.4	11	85.5	12	77.1	13	83.5	14	76.0
15	88.0	16	80.1	17	87.0	18	79.5	19	87.0	20	78.2	21	87.5
22	79.5	23	87.0	24	79.2	25	83.8	26	76.9	27	87.9	28	80.5
29	0.	30	0.	31	87.0	32	87.0	33	87.0	34	87.9	35	88.0
36	88.4	37	88.1	38	88.1	39	88.0	40	87.0	41	86.4	42	86.0
43	87.8	44	85.1	45	87.1	46	84.2	47	88.2	48	72.0	49	71.8

TIME 900 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.0	3	86.2	4	79.7	5	89.0	6	80.4	7	87.5
8	78.6	9	87.0	10	77.8	11	87.5	12	78.0	13	86.0	14	77.2
15	89.0	16	80.5	17	88.0	18	80.0	19	88.0	20	80.1	21	88.0
22	79.5	23	88.0	24	79.1	25	85.7	26	77.5	27	85.4	28	81.4
29	0.	30	0.	31	85.4	32	89.5	33	88.5	34	89.5	35	89.5
36	90.0	37	89.8	38	89.8	39	89.5	40	88.5	41	88.0	42	87.8
43	89.4	44	86.8	45	88.8	46	85.2	47	89.7	48	72.1	49	71.6

TIME 1000 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.8	3	89.8	4	80.6	5	90.0	6	80.7	7	89.0
8	78.0	9	89.0	10	78.5	11	89.5	12	78.6	13	88.4	14	76.9
15	90.0	16	81.0	17	90.0	18	81.0	19	90.0	20	81.2	21	90.0
22	80.6	23	90.0	24	80.0	25	88.4	26	79.3	27	90.9	28	82.5
29	0.	30	0.	31	90.9	32	90.8	33	90.1	34	91.0	35	90.9
36	91.1	37	90.9	38	90.8	39	90.8	40	90.2	41	90.0	42	89.9
43	90.9	44	87.5	45	90.3	46	88.2	47	91.5	48	72.0	49	71.8

TIME 1100 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	80.2	3	91.0	4	81.2	5	93.5	6	82.2	7	90.6
8	79.6	9	90.0	10	78.7	11	90.5	12	79.0	13	94.5	14	77.5
15	91.0	16	78.3	17	91.0	18	81.1	19	91.0	20	81.5	21	91.0
22	81.1	23	92.0	24	81.0	25	90.8	26	80.2	27	92.4	28	84.3
29	0.	30	0.	31	92.2	32	92.0	33	91.6	34	92.2	35	92.1
36	92.4	37	92.2	38	92.0	39	92.0	40	91.9	41	91.4	42	91.3
43	92.2	44	88.0	45	91.8	46	87.0	47	92.0	48	72.1	49	71.7

TIME 1200 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.8	3	91.8	4	81.3	5	92.0	6	81.5	7	91.4
8	79.6	9	91.5	10	79.8	11	91.5	12	79.5	13	91.9	14	78.0
15	92.0	16	82.1	17	92.0	18	81.8	19	92.0	20	82.1	21	92.0
22	81.5	23	93.0	24	81.7	25	92.2	26	80.5	27	93.2	28	89.4
29	0.	30	0.	31	93.1	32	92.9	33	92.5	34	93.1	35	93.0
36	93.1	37	93.0	38	92.9	39	92.9	40	92.9	41	92.4	42	92.2
43	93.0	44	89.2	45	92.3	46	87.2	47	93.5	48	72.1	49	71.9

TIME 1300 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.9	3	92.0	4	81.2	5	92.0	6	81.3	7	92.0
8	80.0	9	92.0	10	79.5	11	92.0	12	79.5	13	92.5	14	78.0
15	92.4	16	82.0	17	92.0	18	81.6	19	92.0	20	81.7	21	92.0
22	81.1	23	93.0	24	80.6	25	92.5	26	81.0	27	93.0	28	90.8
29	0.	30	0.	31	93.8	32	93.5	33	93.0	34	93.8	35	94.6
36	93.8	37	93.8	38	93.5	39	93.7	40	93.9	41	93.6	42	93.5
43	93.9	44	90.0	45	93.5	46	87.8	47	94.5	48	72.3	49	71.9

TIME 1400 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	80.8	3	92.5	4	81.7	5	93.0	6	82.0	7	92.2
8	80.0	9	92.0	10	79.8	11	92.0	12	79.5	13	93.0	14	78.8
15	92.5	16	82.1	17	92.0	18	81.4	19	92.5	20	82.0	21	92.0
22	79.3	23	93.0	24	81.4	25	92.5	26	80.9	27	94.1	28	91.5
29	0.	30	0.	31	94.0	32	93.8	33	93.3	34	93.9	35	93.9
36	94.0	37	94.0	38	93.5	39	94.0	40	93.8	41	93.1	42	93.0
43	93.9	44	89.6	45	93.0	46	87.9	47	94.0	48	72.4	49	72.0

TIME 1500 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	81.4	3	92.4	4	81.5	5	93.0	6	82.2	7	92.2
8	80.2	9	92.0	10	79.8	11	92.0	12	79.6	13	92.8	14	78.2
15	92.6	16	82.5	17	92.0	18	81.6	19	92.6	20	82.2	21	92.5
22	81.7	23	93.0	24	81.4	25	93.8	26	82.0	27	94.4	28	92.0
29	0.	30	0.	31	94.1	32	93.9	33	93.5	34	94.0	35	93.9
36	94.0	37	94.0	38	94.0	39	94.0	40	94.0	41	93.6	42	93.5
43	94.0	44	89.9	45	93.8	46	88.1	47	94.5	48	72.9	49	72.4

TIME 1600 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	81.4	3	93.0	4	82.0	5	93.0	6	82.2	7	92.8
8	80.3	9	93.0	10	80.7	11	93.0	12	80.6	13	92.0	14	78.0
15	93.0	16	82.6	17	92.0	18	82.3	19	93.0	20	82.0	21	93.0
22	82.0	23	93.0	24	81.2	25	91.0	26	80.5	27	93.7	28	91.5
29	0.	30	0.	31	91.8	32	93.8	33	93.3	34	93.9	35	93.9
36	94.0	37	94.0	38	94.0	39	94.0	40	93.7	41	93.1	42	93.0
43	93.8	44	89.5	45	93.9	46	87.9	47	94.6	48	72.0	49	73.0

TIME 1700 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	81.3	3	92.5	4	81.6	5	93.0	6	82.1	7	92.3
8	80.2	9	93.0	10	80.4	11	93.0	12	80.4	13	91.4	14	77.9
15	93.0	16	82.7	17	93.0	18	82.4	19	93.0	20	82.4	21	93.0
22	82.2	23	92.5	24	80.9	25	92.0	26	80.5	27	94.0	28	84.3
29	0.	30	0.	31	93.9	32	94.0	33	93.5	34	93.8	35	94.3
36	94.0	37	94.0	38	93.7	39	94.5	40	93.2	41	92.7	42	92.6
43	93.5	44	89.9	45	93.1	46	87.5	47	93.9	48	74.0	49	73.2

TIME 1800 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	81.0	3	92.0	4	81.5	5	93.0	6	82.4	7	91.5
8	80.0	9	91.8	10	80.1	11	91.8	12	80.1	13	90.4	14	77.7
15	92.5	16	82.4	17	92.5	18	82.1	19	92.3	20	82.1	21	92.5
22	82.0	23	93.0	24	81.7	25	90.5	26	78.8	27	92.4	28	83.5
29	0.	30	0.	31	92.8	32	92.9	33	92.3	34	93.0	35	93.8
36	93.8	37	92.5	38	92.8	39	93.5	40	92.5	41	92.0	42	91.7
43	92.8	44	89.0	45	92.7	46	87.6	47	93.3	48	73.9	49	73.9

TIME 1900 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	82.8	3	92.0	4	83.1	5	93.0	6	83.9	7	91.5
8	81.7	9	90.5	10	80.0	11	90.5	12	79.7	13	88.0	14	76.9
15	92.3	16	83.3	17	92.0	18	82.9	19	92.0	20	82.8	21	91.5
22	80.9	23	93.0	24	83.5	25	88.0	26	79.0	27	93.0	28	85.0
29	0.	30	0.	31	93.0	32	93.0	33	93.0	34	93.0	35	93.0
36	93.3	37	92.5	38	92.5	39	92.5	40	92.3	41	91.0	42	90.9
43	92.7	44	89.0	45	91.9	46	87.1	47	93.3	48	74.1	49	74.0

TIME 2000 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	82.3	3	91.8	4	82.9	5	91.5	6	82.5	7	90.0
8	80.6	9	88.5	10	79.4	11	89.0	12	79.4	13	84.5	14	75.9
15	92.0	16	83.2	17	91.5	18	82.5	19	91.5	20	82.1	21	91.0
22	82.1	23	91.0	24	82.9	25	84.5	26	77.3	27	92.0	28	84.7
29	0.	30	0.	31	91.5	32	92.1	33	92.5	34	92.0	35	92.0
36	92.5	37	91.6	38	91.6	39	91.5	40	90.5	41	89.4	42	89.0
43	91.3	44	88.0	45	90.5	46	86.3	47	92.0	48	74.5	49	74.2

TIME 2100 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	82.0	3	91.0	4	82.5	5	91.5	6	82.7	7	88.5
8	80.3	9	87.0	10	79.0	11	87.0	12	78.6	13	82.0	14	74.7
15	91.0	16	82.5	17	90.5	18	83.3	19	90.0	20	81.6	21	90.0
22	81.6	23	89.0	24	82.0	25	82.4	26	77.0	27	91.0	28	84.1
29	0.	30	0.	31	90.1	32	91.2	33	91.5	34	91.2	35	91.0
36	92.0	37	90.8	38	90.8	39	90.6	40	89.4	41	87.8	42	87.2
43	90.0	44	87.0	45	89.2	46	85.6	47	90.7	48	75.0	49	74.5

TIME 2200 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	81.5	3	89.8	4	81.8	5	91.0	6	82.7	7	87.0
8	81.0	9	86.0	10	79.0	11	86.5	12	78.8	13	80.5	14	75.0
15	90.0	16	81.7	17	89.5	18	81.6	19	89.0	20	81.3	21	89.0
22	81.1	23	89.0	24	82.3	25	81.0	26	75.8	27	90.0	28	84.0
29	0.	30	0.	31	89.1	32	90.1	33	90.8	34	90.0	35	90.0
36	90.8	37	90.0	38	90.0	39	89.8	40	88.0	41	86.5	42	86.0
43	89.0	44	86.5	45	88.1	46	85.0	47	89.8	48	74.8	49	74.2

TIME 2300 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	81.0	3	89.0	4	81.4	5	90.5	6	82.4	7	86.5
8	79.1	9	85.0	10	77.9	11	88.5	12	78.0	13	79.5	14	74.3
15	89.5	16	81.5	17	85.0	18	81.3	19	88.5	20	80.6	21	89.0
22	81.2	23	89.0	24	82.4	25	80.1	26	78.0	27	89.5	28	82.6
29	0.	30	0.	31	88.4	32	89.8	33	90.1	34	89.5	35	89.5
36	90.0	37	89.3	38	89.3	39	89.1	40	87.4	41	86.0	42	85.3
43	88.5	44	86.2	45	87.6	46	84.9	47	89.2	48	74.9	49	74.2

TIME 2400 DATE 6/ 6/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	80.8	3	88.7	4	81.0	5	89.5	6	81.6	7	86.0
8	78.5	9	84.0	10	77.3	11	84.5	12	77.6	13	79.0	14	74.7
15	89.0	16	81.1	17	88.0	18	80.4	19	88.0	20	80.5	21	88.0
22	80.5	23	87.0	24	80.5	25	79.2	26	74.9	27	88.5	28	82.8
29	0.	30	0.	31	87.8	32	88.9	33	89.7	34	88.9	35	88.9
36	89.4	37	88.7	38	88.7	39	88.5	40	86.9	41	85.5	42	84.0
43	87.9	44	85.7	45	87.0	46	84.6	47	88.5	48	74.8	49	74.3

TIME 100 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.3	2	80.4	3	88.0	4	80.5	5	89.0	6	81.3	7	85.0
8	78.0	9	83.5	10	77.3	11	84.0	12	77.3	13	77.0	14	73.4
15	88.0	16	81.0	17	82.5	18	80.2	19	87.0	20	79.2	21	87.0
22	79.6	23	87.0	24	80.7	25	77.9	26	74.0	27	87.9	28	82.9
29	0.	30	0.	31	87.0	32	88.5	33	89.1	34	88.3	35	88.3
36	89.0	37	88.0	38	88.0	39	87.7	40	86.0	41	84.2	42	83.7
43	87.0	44	85.0	45	86.2	46	84.1	47	87.8	48	74.8	49	74.1

TIME 200 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.5	2	80.0	3	87.5	4	80.1	5	88.0	6	80.6	7	84.0
8	77.3	9	82.0	10	76.1	11	83.0	12	76.7	13	76.3	14	73.6
15	88.2	16	80.7	17	87.0	18	80.0	19	86.2	20	79.0	21	86.5
22	79.4	23	85.0	24	79.1	25	77.0	26	73.8	27	87.0	28	82.5
29	0.	30	0.	31	86.1	32	88.0	33	88.8	34	87.9	35	87.9
36	88.5	37	87.6	38	87.5	39	87.2	40	85.6	41	83.8	42	83.2
43	86.5	44	84.9	45	85.5	46	83.8	47	87.1	48	74.6	49	73.9

TIME 300 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.2	2	79.7	3	87.0	4	79.7	5	88.0	6	80.7	7	84.0
8	77.5	9	82.0	10	76.3	11	82.5	12	76.2	13	76.0	14	73.2
15	88.0	16	80.5	17	86.5	18	79.5	19	86.2	20	79.2	21	86.0
22	79.1	23	85.0	24	79.0	25	76.6	26	73.3	27	87.0	28	82.6
29	0.	30	0.	31	86.0	32	87.7	33	88.2	34	87.5	35	87.4
36	88.1	37	87.2	38	87.1	39	87.0	40	85.0	41	83.5	42	82.9
43	86.1	44	0.	45	85.3	46	83.7	47	87.0	48	74.2	49	73.6

TIME 400 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.2	2	79.4	3	87.0	4	79.8	5	88.0	6	80.6	7	84.0
8	77.4	9	82.0	10	76.1	11	82.5	12	76.3	13	76.0	14	73.4
15	88.0	16	80.5	17	86.0	18	79.0	19	86.2	20	79.2	21	86.0
22	79.0	23	85.0	24	79.0	25	76.7	26	73.4	27	87.0	28	82.2
29	0.	30	0.	31	86.1	32	87.3	33	88.0	34	87.3	35	87.3
36	88.0	37	87.1	38	87.1	39	86.9	40	85.0	41	83.6	42	82.8
43	86.1	44	84.8	45	85.3	46	83.6	47	86.9	48	74.1	49	73.3

TIME 500 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.4	2	79.5	3	87.0	4	79.7	5	88.0	6	80.6	7	84.0
8	77.2	9	82.0	10	76.1	11	82.5	12	76.3	13	76.0	14	73.0
15	88.0	16	80.5	17	86.5	18	79.5	19	86.0	20	78.9	21	86.0
22	79.0	23	85.0	24	78.7	25	77.0	26	73.2	27	87.2	28	82.5
29	0.	30	0.	31	86.2	32	87.5	33	88.0	34	87.4	35	87.4
36	88.0	37	87.1	38	87.0	39	86.9	40	85.0	41	83.0	42	83.0
43	86.4	44	84.9	45	85.3	46	83.8	47	87.1	48	73.9	49	73.1

TIME 600 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.4	2	79.8	3	87.5	4	80.0	5	88.0	6	80.2	7	84.5
8	77.5	9	82.5	10	76.2	11	83.0	12	76.4	13	77.0	14	73.6
15	88.0	16	80.4	17	86.5	18	79.2	19	86.5	20	79.4	21	86.0
22	78.9	23	85.0	24	78.5	25	77.9	26	73.5	27	87.3	28	82.8
29	0.	30	0.	31	86.8	32	87.8	33	88.2	34	87.8	35	87.7
36	88.3	37	87.5	38	87.4	39	87.1	40	85.8	41	84.1	42	83.4
43	86.3	44	85.2	45	85.8	46	84.0	47	87.5	48	73.8	49	73.0

TIME 700 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.3	2	79.8	3	88.0	4	79.8	5	88.5	6	80.5	7	85.5
8	77.4	9	84.0	10	77.0	11	84.0	12	76.7	13	79.8	14	74.3
15	88.5	16	80.8	17	83.5	18	80.2	19	87.0	20	79.5	21	87.0
22	79.6	23	86.0	24	79.0	25	80.5	26	74.9	27	88.6	28	83.9
29	0.	30	0.	31	88.0	32	88.8	33	89.6	34	88.5	35	88.6
36	89.0	37	88.3	38	88.2	39	88.0	40	86.6	41	85.3	42	85.0
43	88.0	44	85.8	45	87.2	46	84.5	47	89.0	48	73.9	49	72.8

TIME 800 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.4	2	81.0	3	85.7	4	81.4	5	90.0	6	81.5	7	88.0
8	79.5	9	86.0	10	77.8	11	86.0	12	77.6	13	83.6	14	76.0
15	89.9	16	81.7	17	86.5	18	78.8	19	89.0	20	81.6	21	86.5
22	78.6	23	86.0	24	80.2	25	84.2	26	76.9	27	90.4	28	86.5
29	0.	30	0.	31	90.2	32	90.5	33	90.6	34	90.4	35	90.2
36	90.6	37	90.1	38	90.0	39	89.8	40	88.9	41	88.0	42	87.7
43	90.1	44	87.0	45	85.3	46	85.5	47	91.0	48	73.4	49	72.8

TIME 900 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	81.8	3	90.5	4	81.8	5	91.0	6	82.1	7	89.3
8	80.5	9	88.5	10	79.1	11	88.5	12	78.6	-13	86.0	14	76.5
15	90.8	16	82.3	17	90.5	18	81.9	19	90.0	20	81.3	21	90.0
22	81.1	23	91.0	24	82.2	25	86.4	26	79.3	27	91.6	28	88.8
29	0.	30	0.	31	91.4	32	91.6	33	91.6	34	91.6	35	91.5
36	91.7	37	91.3	38	91.2	39	91.1	40	90.3	41	89.0	42	89.3
43	91.0	44	88.0	45	90.3	46	86.2	47	92.1	48	73.5	49	72.9

TIME 1000 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	82.0	3	91.5	4	82.3	5	92.0	6	82.9	7	90.5
8	80.4	9	90.0	10	79.4	11	90.0	12	79.4	13	88.0	14	77.1
15	91.5	16	82.5	17	91.5	18	82.4	19	91.0	20	81.9	21	91.0
22	81.5	23	91.0	24	81.5	25	89.6	26	79.2	27	93.0	28	88.3
29	0.	30	0.	31	92.8	32	92.8	33	92.7	34	92.6	35	92.5
36	92.6	37	92.5	38	92.3	39	92.2	40	91.8	41	91.2	42	90.0
43	92.7	44	88.8	45	91.8	46	87.0	47	93.3	48	73.6	49	73.0

TIME 1100 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.4	2	92.7	3	92.8	4	83.0	5	93.5	6	83.4	7	92.0
8	81.0	9	91.5	10	80.0	11	91.5	12	80.0	13	90.8	14	77.7
15	92.5	16	83.0	17	92.0	18	82.4	19	92.1	20	82.2	21	92.0
22	81.9	23	93.0	24	82.5	25	90.8	26	79.8	27	93.9	28	86.6
29	0.	30	0.	31	93.9	32	93.8	33	93.7	34	93.7	35	93.5
36	93.6	37	93.6	38	93.6	39	93.4	40	93.0	41	92.5	42	92.3
43	92.1	44	89.5	45	92.7	46	87.3	47	94.2	48	73.5	49	73.3

TIME 1200 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	92.7	3	92.0	4	83.1	5	94.0	6	84.4	7	92.5
8	81.4	9	92.0	10	81.0	11	92.0	12	80.1	13	92.0	14	77.9
15	93.0	16	93.2	17	93.0	18	83.1	19	93.0	20	82.0	21	93.0
22	82.5	23	93.0	24	82.1	25	93.0	26	81.0	27	94.5	28	86.9
29	0.	30	0.	31	94.5	32	94.4	33	94.2	34	94.1	35	94.1
36	94.1	37	94.2	38	94.1	39	94.1	40	94.0	41	93.6	42	93.4
43	94.4	44	90.1	45	92.6	46	88.0	47	95.1	48	73.7	49	73.5

TIME 1300 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.5	3	94.0	4	83.7	5	94.5	6	85.0	7	93.6
8	82.0	9	93.5	10	81.2	11	94.0	12	81.5	13	93.0	14	78.8
15	94.0	16	93.9	17	94.0	18	94.0	19	94.0	20	83.5	21	94.0
22	83.3	23	93.0	24	82.2	25	92.9	26	81.1	27	93.1	28	87.2
29	0.	30	0.	31	95.0	32	95.0	33	94.4	34	94.9	35	94.9
36	94.7	37	95.0	38	94.8	39	94.9	40	94.5	41	94.0	42	94.0
43	95.0	44	91.3	45	94.1	46	88.1	47	95.6	48	73.9	49	73.8

TIME 1400 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.6	3	94.0	4	83.7	5	94.5	6	84.5	7	93.2
8	81.9	9	93.5	10	81.2	11	93.5	12	81.2	13	92.5	14	78.6
15	94.0	16	93.5	17	94.0	18	93.6	19	94.0	20	83.4	21	94.0
22	83.0	23	93.0	24	83.9	25	93.0	26	81.0	27	95.0	28	88.2
29	0.	30	0.	31	95.0	32	95.0	33	94.8	34	94.9	35	94.9
36	95.0	37	95.0	38	95.0	39	95.0	40	94.5	41	94.2	42	94.0
43	94.8	44	90.4	45	94.5	46	88.4	47	95.6	48	74.0	49	74.0

TIME 1500 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.2	3	94.0	4	83.6	5	94.5	6	84.4	7	93.3
8	81.3	9	93.5	10	81.4	11	94.0	12	81.0	13	93.0	14	78.0
15	94.0	16	93.2	17	94.0	18	83.4	19	94.0	20	82.9	21	94.0
22	82.7	23	93.0	24	83.5	25	94.8	26	81.3	27	95.0	28	87.1
29	0.	30	0.	31	95.2	32	95.0	33	95.0	34	95.0	35	95.0
36	95.2	37	95.0	38	95.0	39	95.0	40	94.6	41	94.2	42	94.2
43	95.1	44	90.5	45	94.9	46	88.3	47	95.6	48	74.6	49	74.3

TIME 1600 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	93.2	3	94.0	4	83.4	5	95.0	6	84.6	7	93.3
8	81.3	9	93.5	10	80.6	11	93.5	12	80.6	13	92.5	14	77.7
15	94.0	16	93.0	17	94.0	18	83.2	19	94.0	20	82.5	21	94.0
22	82.8	23	93.0	24	82.1	25	93.0	26	80.2	27	94.8	28	86.7
29	0.	30	0.	31	94.8	32	94.5	33	94.8	34	95.0	35	94.9
36	95.0	37	94.9	38	94.9	39	94.9	40	94.5	41	94.0	42	94.0
43	94.9	44	90.3	45	94.0	46	88.2	47	95.1	48	74.9	49	74.9

TIME 1700 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	92.7	3	92.0	4	83.1	5	94.0	6	84.4	7	92.5
8	81.4	9	92.0	10	81.0	11	92.5	12	80.1	13	92.0	14	77.1
15	93.0	16	93.2	17	93.0	18	82.7	19	93.0	20	82.3	21	93.5
22	82.5	23	93.0	24	83.6	25	90.0	26	78.2	27	94.0	28	87.2
29	0.	30	0.	31	94.5	32	94.5	33	94.6	34	94.5	35	94.2
36	94.2	37	93.0	38	93.8	39	94.2	40	93.5	41	92.5	42	92.5
43	93.2	44	89.4	45	91.3	46	87.8	47	94.5	48	75.5	49	75.2

TIME 1800 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	92.5	3	92.5	4	82.6	5	93.5	6	83.7	7	91.5
8	80.4	9	92.5	10	79.1	11	91.0	12	79.5	13	87.8	14	76.4
15	92.0	16	92.0	17	91.0	18	81.0	19	91.1	20	82.0	21	91.0
22	82.6	23	91.0	24	83.5	25	88.0	26	78.2	27	93.1	28	86.0
29	0.	30	0.	31	92.9	32	93.1	33	93.1	34	93.1	35	93.0
36	93.2	37	91.0	38	93.0	39	93.0	40	92.0	41	91.0	42	90.8
43	92.3	44	90.0	45	92.0	46	87.1	47	93.1	48	76.0	49	75.8

TIME 1900 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	91.9	3	91.5	4	82.1	5	93.0	6	83.5	7	90.0
8	80.4	9	89.0	10	79.1	11	89.0	12	78.7	13	84.5	14	75.5
15	92.0	16	90.6	17	92.0	18	82.5	19	91.0	20	81.2	21	91.5
22	81.4	23	91.0	24	82.1	25	85.0	26	77.2	27	91.9	28	85.3
29	0.	30	0.	31	91.5	32	92.3	33	92.2	34	92.0	35	92.0
36	92.5	37	91.9	38	92.0	39	91.9	40	90.8	41	89.3	42	89.2
43	91.1	44	88.0	45	90.9	46	86.8	47	92.0	48	76.3	49	76.0

TIME 2000 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.6	3	91.0	4	81.6	5	91.0	6	82.1	7	88.5
8	79.5	9	87.0	10	78.0	11	87.5	12	78.4	13	82.0	14	75.0
15	91.0	16	90.2	17	90.5	18	81.6	19	90.0	20	81.0	21	90.5
22	81.6	23	89.0	24	81.5	25	82.3	26	76.0	27	90.2	28	85.0
29	0.	30	0.	31	90.0	32	91.2	33	91.2	34	90.8	35	90.5
36	91.5	37	90.4	38	90.8	39	90.5	40	89.5	41	87.8	42	87.5
43	90.0	44	87.0	45	85.5	46	86.2	47	90.5	48	77.0	49	76.1

TIME 2100 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	91.1	3	89.0	4	81.2	5	90.0	6	81.8	7	87.0
8	78.4	9	85.0	10	77.3	11	85.5	12	77.9	13	80.0	14	74.2
15	89.5	16	91.4	17	85.0	18	81.0	19	88.5	20	80.3	21	89.0
22	80.5	23	88.0	24	81.0	25	80.3	26	76.4	27	89.5	28	83.1
29	0.	30	0.	31	89.0	32	90.0	33	90.0	34	89.6	35	89.5
36	90.1	37	89.5	38	89.5	39	89.5	40	88.1	41	86.3	42	86.3
43	88.0	44	83.0	45	88.2	46	85.5	47	89.2	48	77.0	49	76.0

TIME 2200 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	91.0	3	89.8	4	81.4	5	90.5	6	81.9	7	87.5
8	79.4	9	85.0	10	76.9	11	86.0	12	77.6	13	81.0	14	74.7
15	90.0	16	91.6	17	85.0	18	80.9	19	89.0	20	80.5	21	89.0
22	80.6	23	88.0	24	80.3	25	81.0	26	75.3	27	89.8	28	84.9
29	0.	30	0.	31	85.2	32	90.0	33	90.2	34	90.0	35	89.7
36	90.4	37	90.0	38	89.9	39	89.9	40	88.5	41	86.3	42	86.3
43	88.9	44	86.8	45	88.5	46	86.7	47	89.6	48	76.8	49	76.0

TIME 2300 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	91.1	3	89.0	4	81.2	5	90.0	6	81.8	7	87.0
8	78.4	9	85.0	10	77.3	11	85.5	12	77.9	13	80.0	14	74.2
15	89.5	16	91.4	17	85.0	18	81.0	19	88.5	20	80.3	21	89.0
22	80.5	23	88.0	24	81.0	25	80.3	26	76.4	27	89.5	28	83.1
29	0.	30	0.	31	89.0	32	90.0	33	90.0	34	89.6	35	89.5
36	90.1	37	89.5	38	89.5	39	89.5	40	88.1	41	86.3	42	86.3
43	88.0	44	83.0	45	88.2	46	85.5	47	89.2	48	77.0	49	76.0

TIME 2400 DATE 6/ 7/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	90.0	3	88.3	4	80.6	5	89.0	6	81.0	7	86.0
8	78.0	9	83.5	10	76.7	11	84.0	12	76.9	13	77.9	14	74.3
15	89.0	16	91.1	17	88.0	18	80.6	19	88.0	20	80.2	21	88.0
22	80.3	23	87.0	24	80.5	25	78.3	26	74.1	27	88.5	28	82.3
29	0.	30	0.	31	87.5	32	85.0	33	89.2	34	88.8	35	88.8
36	89.2	37	88.6	38	88.7	39	88.6	40	86.7	41	84.8	42	84.0
43	87.1	44	83.0	45	87.0	46	84.8	47	88.1	48	76.0	49	75.4

TIME 100 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	90.0	3	87.8	4	80.0	5	88.5	6	81.2	7	84.8
8	77.5	9	83.0	10	77.0	11	84.0	12	77.3	13	77.2	14	73.6
15	88.3	16	90.8	17	88.0	18	80.8	19	87.8	20	80.5	21	87.5
22	80.2	23	86.0	24	79.6	25	78.0	26	74.0	27	87.5	28	82.1
29	0.	30	0.	31	87.0	32	88.0	33	88.7	34	88.1	35	88.1
36	88.5	37	88.1	38	88.1	39	88.0	40	86.0	41	84.3	42	84.0
43	86.9	44	83.0	45	86.5	46	84.6	47	87.8	48	75.8	49	75.1

TIME 200 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	90.2	3	87.1	4	80.1	5	88.0	6	80.8	7	84.2
8	77.1	9	82.0	10	76.1	11	83.5	12	77.0	13	76.8	14	73.8
15	88.0	16	90.8	17	87.0	18	80.0	19	87.0	20	79.5	21	87.0
22	79.7	23	85.0	24	78.7	25	77.4	26	73.8	27	87.0	28	82.0
29	0.	30	0.	31	86.5	32	87.0	33	88.0	34	87.9	35	87.9
36	88.2	37	87.9	38	87.9	39	87.0	40	85.5	41	83.8	42	80.0
43	86.1	44	83.5	45	86.0	46	84.4	47	87.2	48	75.1	49	74.5

TIME 300 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	91.5	3	91.0	4	81.8	5	91.5	6	82.2	7	89.2
8	80.1	9	88.0	10	78.0	11	88.0	12	78.0	13	86.0	14	76.3
15	90.7	16	91.2	17	90.0	18	81.7	19	90.0	20	82.2	21	90.0
22	81.5	23	91.0	24	82.3	25	86.2	26	78.1	27	92.0	28	84.4
29	0.	30	0.	31	91.6	32	91.9	33	91.9	34	91.4	35	91.3
36	91.6	37	91.2	38	91.2	39	91.1	40	90.4	41	89.4	42	89.5
43	91.1	44	88.2	45	90.8	46	86.7	47	92.4	48	73.9	49	73.3

TIME 400 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.8	2	90.8	3	91.2	4	79.7	5	88.0	6	80.6	7	84.2
8	80.2	9	82.0	10	75.8	11	83.5	12	76.9	13	76.5	14	73.5
15	88.0	16	90.5	17	87.0	18	80.0	19	89.1	20	79.2	21	87.0
22	79.5	23	85.0	24	78.4	25	76.8	26	73.1	27	87.8	28	82.0
29	0.	30	0.	31	87.0	32	88.0	33	88.3	34	88.0	35	88.0
36	88.6	37	88.0	38	88.0	39	87.9	40	85.8	41	84.0	42	83.6
43	86.8	44	83.0	45	86.1	46	84.4	47	87.7	48	74.6	49	73.9

TIME 500 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.8	2	90.8	3	91.2	4	79.7	5	88.0	6	80.6	7	84.2
8	80.2	9	82.0	10	75.8	11	83.5	12	76.9	13	76.5	14	73.5
15	88.0	16	90.5	17	87.0	18	80.0	19	89.1	20	79.2	21	87.0
22	79.5	23	85.0	24	78.4	25	76.8	26	73.1	27	87.8	28	82.0
29	0.	30	0.	31	87.0	32	88.0	33	88.3	34	88.0	35	88.0
36	88.6	37	88.0	38	88.0	39	87.9	40	85.8	41	84.0	42	83.6
43	86.8	44	83.0	45	86.1	46	84.4	47	87.7	48	74.6	49	73.9

TIME 600 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.0	2	90.0	3	88.0	4	80.6	5	88.5	6	80.7	7	85.0
8	77.0	9	83.0	10	76.5	11	84.0	12	77.0	13	77.0	14	73.4
15	88.5	16	91.0	17	87.5	18	80.1	19	87.5	20	79.2	21	87.5
22	79.8	23	85.0	24	78.5	25	77.6	26	73.9	27	88.0	28	82.0
29	0.	30	0.	31	87.3	32	88.2	33	88.7	34	88.1	35	88.1
36	88.9	37	88.3	38	88.3	39	88.1	40	86.0	41	84.4	42	84.0
43	86.9	44	83.0	45	86.6	46	84.5	47	87.9	48	74.0	49	73.7

TIME 700 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	90.3	3	88.2	4	80.5	5	89.1	6	81.1	7	86.0
8	78.4	9	84.0	10	76.8	11	85.0	12	77.7	13	79.8	14	73.6
15	88.8	16	91.3	17	88.0	18	80.7	19	88.0	20	80.2	21	88.0
22	80.2	23	89.0	24	82.0	25	80.6	26	75.0	27	88.9	28	82.6
29	0.	30	0.	31	88.5	32	89.1	33	89.4	34	88.9	35	88.0
36	89.5	37	89.1	38	88.1	39	89.0	40	87.2	41	85.9	42	85.8
43	88.0	44	0.	45	87.9	46	85.6	47	89.1	48	74.0	49	73.2

TIME 800 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	90.9	3	89.6	4	81.4	5	90.0	6	81.4	7	88.0
8	79.4	9	86.0	10	77.6	11	86.5	12	77.7	13	83.8	14	76.2
15	89.0	16	91.8	17	89.0	18	81.1	19	89.0	20	80.0	21	89.0
22	80.5	23	88.0	24	79.8	25	85.0	26	87.0	27	90.9	28	83.4
29	0.	30	0.	31	90.3	32	90.8	33	90.8	34	90.3	35	90.2
36	90.7	37	90.3	38	90.2	39	90.2	40	89.2	41	88.0	42	87.0
43	90.0	44	87.3	45	87.6	46	86.0	47	91.1	48	74.0	49	73.4

TIME 900 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.8	2	91.5	3	90.8	4	81.8	5	91.5	6	82.2	7	89.2
8	80.1	9	88.0	10	78.0	11	88.0	12	78.0	13	86.0	14	76.3
15	90.7	16	91.2	17	90.0	18	81.7	19	90.0	20	82.2	21	90.0
22	81.5	23	91.0	24	82.3	25	86.2	26	78.1	27	92.0	28	84.4
29	0.	30	0.	31	91.6	32	91.9	33	91.9	34	91.4	35	91.3
36	91.6	37	91.2	38	91.2	39	91.1	40	90.4	41	89.4	42	89.5
43	91.1	44	88.2	45	90.8	46	86.7	47	92.4	48	73.9	49	73.3

TIME 1000 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	92.1	3	91.8	4	82.2	5	92.0	6	82.5	7	90.8
8	80.7	9	90.0	10	78.7	11	90.0	12	78.9	13	88.7	14	76.6
15	91.3	16	92.5	17	91.0	18	82.0	19	91.2	20	81.2	21	91.5
22	81.7	23	91.0	24	81.5	25	88.3	26	78.0	27	93.1	28	85.6
29	0.	30	0.	31	92.9	32	93.0	33	93.0	34	92.6	35	92.6
36	92.6	37	92.7	38	92.6	39	92.6	40	91.9	41	91.2	42	91.1
43	92.5	44	89.0	45	91.9	46	87.2	47	93.5	48	74.0	49	73.9

TIME 1100 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	82.5	3	92.5	4	82.4	5	93.0	6	83.2	7	91.5
8	80.0	9	91.0	10	79.1	11	91.0	12	79.6	13	90.2	14	77.2
15	92.0	16	82.8	17	92.0	18	82.5	19	92.0	20	82.2	21	92.0
22	82.0	23	93.0	24	82.8	25	90.2	26	79.6	27	93.9	28	87.0
29	0.	30	0.	31	93.8	32	93.8	33	93.6	34	93.2	35	93.1
36	93.4	37	93.3	38	93.3	39	93.2	40	93.0	41	90.0	42	90.0
43	93.1	44	89.3	45	92.8	46	87.8	47	94.1	48	74.0	49	71.5

TIME 1200 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.1	2	82.8	3	93.1	4	83.2	5	94.0	6	84.2	7	92.5
8	81.0	9	91.0	10	79.7	11	92.0	12	80.0	13	92.0	14	77.8
15	92.8	16	83.2	17	92.5	18	82.7	19	93.0	20	82.2	21	93.0
22	82.7	23	93.0	24	82.5	25	92.2	26	80.5	27	94.4	28	89.0
29	0.	30	0.	31	94.2	32	94.2	33	94.1	34	94.0	35	93.4
36	94.0	37	94.0	38	94.0	39	94.0	40	93.0	41	93.3	42	91.2
43	94.2	44	90.0	45	93.8	46	88.0	47	95.0	48	74.1	49	73.8

TIME 1300 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.5	2	82.8	3	93.5	4	82.9	5	94.0	6	83.7	7	92.8
8	80.8	9	93.0	10	79.8	11	93.0	12	80.2	13	92.5	14	77.6
15	93.0	16	82.7	17	93.5	18	83.2	19	93.0	20	83.5	21	93.5
22	82.5	23	95.0	24	83.4	25	92.5	26	80.2	27	94.5	28	91.2
29	0.	30	0.	31	94.5	32	94.4	33	94.2	34	94.0	35	94.0
36	94.0	37	94.2	38	94.1	39	94.2	40	94.0	41	93.7	42	93.5
43	94.2	44	90.1	45	93.7	46	88.0	47	95.0	48	74.2	49	74.1

TIME 1400 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.7	2	82.6	3	94.0	4	83.2	5	94.0	6	83.6	7	93.0
8	80.6	9	93.0	10	79.8	11	93.0	12	80.4	13	93.0	14	77.6
15	93.0	16	82.8	17	93.0	18	82.5	19	93.5	20	82.5	21	94.0
22	82.8	23	95.0	24	83.7	25	92.5	26	80.0	27	94.9	28	85.5
29	0.	30	0.	31	94.7	32	94.7	33	94.4	34	94.2	35	94.2
36	94.3	37	94.4	38	94.4	39	94.6	40	94.3	41	94.0	42	94.0
43	94.4	44	90.2	45	94.1	46	88.2	47	95.1	48	74.6	49	74.5

TIME 1500 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.7	2	83.0	3	94.0	4	83.2	5	94.0	6	83.6	7	93.0
8	81.1	9	92.5	10	80.2	11	93.0	12	80.2	13	92.4	14	77.6
15	93.4	16	83.0	17	93.0	18	82.5	19	89.8	20	82.8	21	93.5
22	82.4	23	95.0	24	83.7	25	92.2	26	80.2	27	94.6	28	85.6
29	0.	30	0.	31	94.6	32	94.6	33	94.3	34	94.2	35	94.1
36	94.2	37	94.2	38	94.4	39	94.5	40	94.1	41	93.6	42	93.4
43	94.3	44	90.0	45	93.8	46	88.2	47	95.0	48	75.0	49	75.2

TIME 1600 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.8	2	82.9	3	93.8	4	83.0	5	94.5	6	84.2	7	93.0
8	80.9	9	93.5	10	80.4	11	92.0	12	79.3	13	92.0	14	77.3
15	93.4	16	82.9	17	93.0	18	82.3	19	93.8	20	82.7	21	93.5
22	81.2	23	94.0	24	83.0	25	91.2	26	80.5	27	94.2	28	84.6
29	0.	30	0.	31	94.4	32	94.5	33	94.2	34	94.2	35	94.0
36	94.2	37	94.2	38	94.3	39	94.3	40	94.0	41	93.5	42	93.3
43	94.0	44	90.0	45	93.8	46	88.0	47	94.8	48	75.3	49	75.2

TIME 1700 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.0	2	82.5	3	93.0	4	82.6	5	94.6	6	83.7	7	92.0
8	80.1	9	92.0	10	79.1	11	92.5	12	80.1	13	91.0	14	77.0
15	93.0	16	83.2	17	93.0	18	82.6	19	93.0	20	82.0	21	93.0
22	82.0	23	94.0	24	83.4	25	90.3	26	78.4	27	94.0	28	84.5
29	0.	30	0.	31	93.6	32	94.1	33	94.5	34	94.0	35	93.8
36	93.8	37	93.8	38	93.8	39	93.9	40	93.2	41	92.4	42	92.7
43	93.6	44	89.6	45	93.0	46	87.8	47	94.1	48	76.0	49	75.6

TIME 1800 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.1	2	82.0	3	92.8	4	82.3	5	94.0	6	83.9	7	91.5
8	80.2	9	91.0	10	78.5	11	91.5	12	79.3	13	90.0	14	77.1
15	92.4	16	82.3	17	92.5	18	82.4	19	92.5	20	81.9	21	93.0
22	82.0	23	93.0	24	82.9	25	90.3	26	79.0	27	93.3	28	84.0
29	0.	30	0.	31	93.1	32	93.5	33	93.5	34	93.2	35	93.1
36	93.3	37	93.2	38	93.4	39	93.4	40	92.4	41	91.8	42	91.7
43	92.7	44	89.0	45	92.2	46	87.4	47	93.5	48	76.0	49	75.9

TIME 1900 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	0.	2	0.	3	0.	4	0.	5	0.	6	0.	7	0.
8	0.	9	0.	10	0.	11	0.	12	0.	13	0.	14	0.
15	0.	16	0.	17	0.	18	0.	19	0.	20	0.	21	0.
22	0.	23	0.	24	0.	25	88.0	26	76.0	27	89.0	28	81.0
29	0.	30	0.	31	89.0	32	90.5	33	90.5	34	91.3	35	92.5
36	92.9	37	91.5	38	92.0	39	92.0	40	87.9	41	88.0	42	89.4
43	89.2	44	87.0	45	87.3	46	85.0	47	89.5	48	76.3	49	76.0

TIME 2000 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.2	3	89.0	4	79.0	5	89.0	6	79.8	7	87.0
8	78.1	9	87.0	10	77.7	11	87.5	12	77.4	13	84.0	14	75.6
15	91.5	16	81.6	17	91.5	18	82.1	19	91.0	20	80.8	21	91.0
22	80.7	23	88.0	24	79.4	25	84.0	26	76.6	27	88.3	28	80.6
29	0.	30	0.	31	88.0	32	89.0	33	89.0	34	91.0	35	92.3
36	92.5	37	91.0	38	91.5	39	91.5	40	87.9	41	88.1	42	89.3
43	89.5	44	86.1	45	87.3	46	84.9	47	89.3	48	76.5	49	76.1

TIME 2100 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.2	3	88.5	4	79.5	5	89.0	6	80.0	7	87.3
8	78.3	9	88.0	10	78.1	11	88.0	12	77.6	13	84.8	14	75.4
15	91.3	16	81.8	17	92.0	18	82.6	19	90.8	20	80.9	21	91.0
22	80.5	23	88.0	24	79.1	25	85.0	26	77.5	27	88.8	28	81.1
29	0.	30	0.	31	88.5	32	89.5	33	89.3	34	91.4	35	92.5
36	93.0	37	91.3	38	91.6	39	91.8	40	88.3	41	88.3	42	89.3
43	88.6	44	86.6	45	87.4	46	85.1	47	89.1	48	77.0	49	76.1

TIME 2200 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.1	3	88.3	4	79.4	5	89.0	6	80.0	7	87.0
8	78.1	9	87.5	10	77.7	11	87.5	12	77.3	13	84.5	14	75.3
15	91.0	16	81.2	17	91.5	18	82.1	19	90.5	20	81.1	21	91.0
22	81.1	23	88.0	24	79.0	25	85.0	26	77.5	27	88.5	28	81.0
29	0.	30	0.	31	88.5	32	89.2	33	89.0	34	91.1	35	92.1
36	93.0	37	91.0	38	91.5	39	91.6	40	88.1	41	88.1	42	89.2
43	88.6	44	86.4	45	87.4	46	85.1	47	89.2	48	78.7	49	76.0

TIME 2300 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.0	3	88.5	4	79.5	5	89.0	6	80.0	7	87.5
8	78.1	9	87.0	10	77.8	11	88.0	12	77.3	13	85.0	14	75.6
15	91.0	16	81.3	17	92.0	18	82.5	19	91.0	20	81.1	21	91.0
22	81.4	23	88.0	24	79.0	25	85.0	26	77.3	27	89.2	28	81.0
29	0.	30	0.	31	89.0	32	89.5	33	89.2	34	91.5	35	92.8
36	93.1	37	91.4	38	91.6	39	92.0	40	88.3	41	88.6	42	89.8
43	89.0	44	86.7	45	87.5	46	85.1	47	89.5	48	76.0	49	70.3

TIME 2400 DATE 6/ 8/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.0	3	88.0	4	79.7	5	89.0	6	79.8	7	87.5
8	78.1	9	88.0	10	77.8	11	88.0	12	77.3	13	85.0	14	75.6
15	91.5	16	81.4	17	92.0	18	82.5	19	90.8	20	80.8	21	91.0
22	80.3	23	88.0	24	79.0	25	85.8	26	77.5	27	89.1	28	81.2
29	0.	30	0.	31	89.0	32	89.8	33	89.4	34	91.6	35	92.8
36	93.1	37	91.4	38	91.9	39	92.0	40	88.3	41	88.6	42	89.8
43	89.0	44	86.7	45	87.5	46	85.1	47	89.5	48	76.0	49	70.3

TIME 100 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	79.0	3	88.0	4	79.5	5	89.0	6	80.0	7	87.4
8	78.2	9	88.0	10	78.1	11	88.0	12	77.5	13	85.0	14	75.6
15	91.2	16	81.4	17	92.0	18	82.8	19	90.8	20	81.0	21	91.5
22	81.1	23	88.0	24	79.0	25	84.9	26	77.0	27	89.4	28	81.0
29	0.	30	0.	31	88.9	32	89.5	33	89.3	34	91.2	35	92.7
36	93.1	37	91.5	38	91.0	39	92.0	40	88.2	41	88.5	42	89.6
43	89.0	44	86.5	45	87.5	46	85.2	47	89.6	48	75.9	49	75.2

TIME 200 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	78.9	3	88.8	4	79.7	5	89.0	6	79.7	7	87.5
8	78.2	9	88.0	10	77.8	11	88.0	12	77.5	13	85.0	14	75.6
15	91.2	16	81.4	17	92.0	18	82.8	19	90.8	20	81.0	21	91.5
22	81.1	23	88.0	24	79.0	25	84.9	26	77.0	27	89.4	28	81.0
29	0.	30	0.	31	88.9	32	89.5	33	89.3	34	91.2	35	92.7
36	93.1	37	91.4	38	91.8	39	91.9	40	88.2	41	88.5	42	89.7
43	89.0	44	86.6	45	87.8	46	85.3	47	89.6	48	75.8	49	75.0

TIME 300 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	78.0	3	88.8	4	79.7	5	89.0	6	79.7	7	87.5
8	78.0	9	88.0	10	77.9	11	88.0	12	77.5	13	84.8	14	75.5
15	91.2	16	81.3	17	92.0	18	83.3	19	90.5	20	80.7	21	91.5
22	81.2	23	88.0	24	78.9	25	85.0	26	77.0	27	89.4	28	81.2
29	0.	30	0.	31	88.0	32	89.9	33	89.5	34	91.2	35	92.6
36	93.0	37	91.4	38	91.8	39	92.0	40	88.3	41	88.5	42	89.8
43	89.0	44	86.8	45	87.9	46	85.5	47	89.9	48	75.8	49	75.0

TIME 400 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.1	3	89.0	4	79.5	5	89.5	6	80.2	7	87.5
8	78.2	9	88.0	10	78.3	11	88.0	12	77.5	13	85.0	14	75.7
15	91.0	16	81.0	17	92.5	18	80.8	19	90.4	20	80.4	21	90.0
22	79.9	23	88.0	24	78.9	25	85.1	26	77.1	27	89.6	28	81.7
29	0.	30	0.	31	89.7	32	90.0	33	89.8	34	90.9	35	91.6
36	91.9	37	91.0	38	91.1	39	91.2	40	89.2	41	88.3	42	88.0
43	89.5	44	87.0	45	88.8	46	86.0	47	89.8	48	75.7	49	76.9

TIME 500 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.1	3	89.0	4	79.5	5	90.0	6	80.6	7	87.0
8	77.5	9	87.0	10	77.3	11	87.5	12	77.3	13	85.0	14	75.6
15	89.5	16	80.8	17	88.5	18	79.7	19	89.0	20	79.8	21	89.5
22	80.3	23	88.0	24	79.0	25	85.5	26	77.8	27	89.4	28	81.3
29	0.	30	0.	31	89.6	32	89.9	33	89.8	34	89.5	35	89.6
36	90.0	37	90.0	38	90.0	39	90.0	40	88.7	41	88.0	42	87.5
43	89.5	44	87.0	45	88.5	46	85.8	47	89.8	48	75.6	49	74.8

TIME 600 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.3	3	89.0	4	79.8	5	90.0	6	80.7	7	87.2
8	77.8	9	87.0	10	77.7	11	87.5	12	77.6	13	85.0	14	75.6
15	89.0	16	80.6	17	88.0	18	79.5	19	89.0	20	80.2	21	89.0
22	80.2	23	88.0	24	79.3	25	85.5	26	77.9	27	89.4	28	81.8
29	0.	30	0.	31	89.6	32	89.9	33	89.8	34	89.5	35	89.4
36	90.0	37	90.0	38	90.0	39	90.0	40	88.5	41	87.9	42	87.5
43	89.5	44	87.0	45	88.5	46	85.7	47	89.9	48	75.4	49	74.8

TIME 700 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.4	3	89.0	4	79.9	5	90.0	6	80.7	7	89.0
8	77.8	9	87.0	10	77.8	11	87.0	12	77.2	13	85.0	14	75.7
15	89.0	16	80.5	17	88.0	18	79.6	19	89.0	20	80.0	21	89.0
22	80.3	23	88.0	24	89.4	25	85.4	26	87.9	27	89.3	28	81.9
29	0.	30	0.	31	89.7	32	89.9	33	89.5	34	89.5	35	89.4
36	89.9	37	89.9	38	90.0	39	89.9	40	88.4	41	87.9	42	87.5
43	89.4	44	87.0	45	88.6	46	85.6	47	90.0	48	75.1	49	74.6

TIME 800 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	79.9	3	89.4	4	80.2	5	90.0	6	80.6	7	88.0
8	78.8	9	87.5	10	78.9	11	87.5	12	77.5	13	85.7	14	76.0
15	89.5	16	81.2	17	88.5	18	80.2	19	89.4	20	80.9	21	89.0
22	80.5	23	88.0	24	79.3	25	86.0	26	78.2	27	89.4	28	82.0
29	0.	30	0.	31	89.8	32	90.0	33	89.8	34	89.8	35	89.8
36	90.1	37	90.0	38	90.0	39	90.0	40	88.8	41	88.3	42	87.8
43	89.7	44	89.0	45	89.0	46	85.8	47	90.0	48	75.0	49	74.8

TIME 900 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	79.7	3	89.0	4	79.8	5	90.0	6	80.6	7	87.5
8	78.2	9	87.0	10	77.8	11	87.5	12	77.6	13	84.8	14	75.8
15	89.5	16	80.9	17	89.0	18	80.0	19	89.9	20	80.5	21	89.5
22	80.5	23	88.0	24	79.3	25	85.2	26	77.9	27	89.4	28	82.2
29	0.	30	0.	31	89.5	32	89.9	33	89.8	34	89.9	35	89.8
36	90.2	37	90.2	38	90.1	39	90.1	40	88.6	41	87.9	42	87.5
43	89.3	44	87.2	45	88.6	46	85.7	47	89.7	48	75.2	49	74.6

TIME 1000 DATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	79.5	3	89.0	4	80.2	5	89.5	6	80.6	7	87.2
8	78.5	9	86.5	10	77.7	11	87.0	12	77.4	13	84.6	14	75.7
15	89.5	16	80.8	17	88.5	18	80.0	19	89.0	20	80.3	21	89.0
22	80.4	23	88.0	24	79.5	25	85.9	26	78.6	27	89.3	28	82.0
29	0.	30	0.	31	89.2	32	89.6	33	89.2	34	89.6	35	89.8
36	90.0	37	89.9	38	90.1	39	90.0	40	88.3	41	87.8	42	87.2
43	89.1	44	86.8	45	88.4	46	85.2	47	89.5	48	75.0	49	74.6

TIME 1100 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	75.2	3	81.8	4	80.0	5	89.5	6	86.6	7	87.0
8	78.0	9	86.5	10	77.6	11	87.0	12	77.5	13	84.4	14	75.7
15	83.2	16	91.5	17	82.5	18	80.0	19	89.2	20	86.4	21	89.0
22	80.3	23	88.0	24	79.4	25	85.4	26	78.3	27	89.1	28	82.6
29	0.	30	0.	31	85.3	32	89.4	33	89.3	34	85.8	35	89.9
36	90.0	37	90.0	38	90.0	39	90.0	40	88.1	41	87.6	42	87.7
43	89.1	44	88.8	45	86.2	46	85.4	47	89.5	48	75.0	49	75.7

TIME 1200 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	75.1	3	82.8	4	79.6	5	89.5	6	86.4	7	87.0
8	77.7	9	87.0	10	77.7	11	87.0	12	77.2	13	84.6	14	75.7
15	84.3	16	91.4	17	85.0	18	79.9	19	89.2	20	86.3	21	89.0
22	80.0	23	88.0	24	79.4	25	85.2	26	77.7	27	89.1	28	83.0
29	0.	30	0.	31	85.1	32	89.4	33	89.3	34	85.5	35	89.5
36	90.0	37	90.0	38	90.0	39	89.5	40	88.2	41	87.8	42	87.2
43	89.0	44	88.4	45	82.3	46	85.4	47	89.5	48	75.0	49	74.6

TIME 1300 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	75.2	3	85.8	4	79.8	5	89.0	6	79.9	7	87.5
8	78.5	9	88.0	10	78.7	11	88.0	12	78.1	13	84.6	14	75.7
15	90.8	16	92.0	17	91.0	18	82.2	19	90.0	20	86.7	21	90.5
22	80.8	23	88.0	24	79.6	25	85.0	26	77.5	27	88.8	28	84.3
29	0.	30	0.	31	86.7	32	89.3	33	89.2	34	91.0	35	92.0
36	92.2	37	91.1	38	91.2	39	91.3	40	88.1	41	88.1	42	89.2
43	88.3	44	88.3	45	87.1	46	85.0	47	89.3	48	75.0	49	74.7

TIME 1400 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	75.0	3	86.5	4	79.4	5	89.0	6	79.9	7	87.3
8	78.1	9	87.5	10	77.9	11	88.0	12	77.7	13	84.6	14	75.8
15	91.0	16	91.4	17	91.5	18	82.6	19	90.5	20	86.8	21	91.0
22	81.1	23	88.0	24	79.4	25	85.0	26	87.3	27	88.8	28	85.6
29	0.	30	0.	31	88.6	32	89.3	33	89.2	34	91.0	35	92.2
36	92.6	37	91.2	38	91.5	39	91.7	40	88.2	41	88.1	42	89.2
43	88.8	44	88.3	45	87.2	46	85.9	47	89.3	48	75.3	49	74.8

TIME 1500 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	75.1	3	88.5	4	79.5	5	89.0	6	79.9	7	87.3
8	78.3	9	88.0	10	78.4	11	88.0	12	77.7	13	84.6	14	75.7
15	91.0	16	91.5	17	91.5	18	82.6	19	90.5	20	81.1	21	91.0
22	80.9	23	88.0	24	79.4	25	84.5	26	77.3	27	88.8	28	81.8
29	0.	30	0.	31	88.6	32	89.2	33	89.1	34	90.7	35	92.2
36	92.3	37	91.0	38	91.4	39	91.4	40	88.0	41	88.1	42	89.2
43	88.7	44	88.0	45	87.2	46	84.8	47	89.1	48	75.8	49	75.0

TIME 1600 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	75.5	3	86.7	4	79.9	5	89.5	6	86.4	7	87.3
8	78.2	9	88.0	10	78.5	11	88.5	12	78.3	13	84.7	14	75.6
15	91.2	16	92.0	17	92.2	18	83.7	19	90.7	20	81.0	21	91.5
22	81.5	23	87.0	24	76.5	25	84.9	26	77.2	27	88.9	28	82.0
29	0.	30	0.	31	88.5	32	89.1	33	89.0	34	90.6	35	92.4
36	92.5	37	91.0	38	91.5	39	91.5	40	87.8	41	88.0	42	89.1
43	88.6	44	88.1	45	87.1	46	84.7	47	89.2	48	75.7	49	75.0

TIME 1700 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	75.4	3	82.7	4	79.6	5	89.0	6	86.6	7	87.4
8	78.4	9	86.0	10	78.6	11	88.7	12	78.0	13	84.7	14	75.7
15	91.3	16	92.4	17	92.0	18	84.1	19	91.0	20	82.0	21	92.0
22	82.0	23	88.7	24	79.4	25	84.8	26	77.2	27	88.8	28	82.1
29	0.	30	0.	31	88.5	32	89.2	33	89.1	34	91.0	35	92.5
36	92.6	37	91.6	38	91.5	39	91.0	40	87.0	41	88.0	42	89.2
43	88.0	44	87.0	45	87.1	46	84.5	47	89.2	48	75.9	49	75.2

TIME 1800 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	75.5	3	90.5	4	80.0	5	91.2	6	83.5	7	88.0
8	77.7	9	87.0	10	77.7	11	87.0	12	77.4	13	78.0	14	75.2
15	89.5	16	91.4	17	88.7	18	79.9	19	89.2	20	86.3	21	89.0
22	80.9	23	88.5	24	81.4	25	79.0	26	74.0	27	90.4	28	87.5
29	0.	30	0.	31	85.0	32	91.3	33	91.3	34	89.5	35	89.5
36	90.0	37	87.2	38	87.2	39	87.0	40	88.4	41	88.5	42	86.0
43	89.0	44	87.0	45	80.3	46	85.0	47	90.0	48	76.2	49	75.7

TIME 1900 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	75.2	3	91.3	4	83.8	5	92.0	6	84.4	7	89.0
8	81.7	9	86.2	10	81.0	11	88.5	12	78.0	13	78.5	14	74.2
15	90.8	16	92.0	17	91.0	18	82.5	19	87.5	20	86.5	21	87.5
22	79.9	23	88.0	24	81.7	25	78.0	26	72.7	27	91.3	28	89.0
29	0.	30	0.	31	92.2	32	92.3	33	92.4	34	92.2	35	90.2
36	90.4	37	88.0	38	88.0	39	87.8	40	89.2	41	88.5	42	88.0
43	90.4	44	87.5	45	85.0	46	85.8	47	91.5	48	76.2	49	75.7

TIME 2000 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.0	3	91.7	4	83.8	5	92.3	6	84.7	7	89.0
8	81.1	9	88.7	10	81.0	11	87.0	12	78.0	13	78.0	14	74.5
15	90.8	16	88.0	17	90.5	18	82.9	19	88.5	20	86.2	21	88.0
22	79.9	23	90.0	24	82.4	25	79.0	26	74.2	27	92.0	28	84.4
29	0.	30	0.	31	90.7	32	92.8	33	92.8	34	91.0	35	91.0
36	91.5	37	88.6	38	88.5	39	88.4	40	89.7	41	89.0	42	89.6
43	90.8	44	88.0	45	85.9	46	86.0	47	91.0	48	76.1	49	75.5

TIME 2100 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.5	3	91.5	4	84.2	5	92.0	6	84.2	7	89.0
8	81.4	9	88.0	10	81.8	11	88.0	12	78.1	13	78.4	14	73.5
15	90.4	16	91.0	17	90.0	18	82.7	19	88.5	20	86.2	21	88.0
22	80.2	23	88.0	24	80.8	25	79.1	26	74.2	27	91.6	28	84.9
29	0.	30	0.	31	90.8	32	92.5	33	92.6	34	91.1	35	91.1
36	91.6	37	88.8	38	88.8	39	88.5	40	90.0	41	89.0	42	88.8
43	90.4	44	88.0	45	85.5	46	86.1	47	91.5	48	76.1	49	75.4

TIME 2200 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.0	3	91.7	4	83.8	5	92.0	6	84.7	7	89.0
8	81.1	9	88.7	10	81.0	11	87.0	12	78.0	13	78.0	14	74.5
15	90.8	16	88.0	17	90.5	18	82.9	19	88.5	20	86.2	21	88.0
22	79.9	23	90.0	24	82.4	25	79.0	26	74.2	27	92.0	28	84.4
29	0.	30	0.	31	90.7	32	92.8	33	92.8	34	91.0	35	91.0
36	91.5	37	88.6	38	88.5	39	88.4	40	89.7	41	89.0	42	89.6
43	90.8	44	88.0	45	85.9	46	86.0	47	91.0	48	76.1	49	75.5

TIME 2300 LATE 6/ 9/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.5	3	91.5	4	84.2	5	92.0	6	84.2	7	89.0
8	81.4	9	88.0	10	81.8	11	88.0	12	78.1	13	78.4	14	73.5
15	90.4	16	91.0	17	90.0	18	82.7	19	88.5	20	86.2	21	88.0
22	80.2	23	88.0	24	80.8	25	79.1	26	74.2	27	91.6	28	84.9
29	0.	30	0.	31	90.8	32	92.5	33	92.6	34	91.1	35	91.1
36	91.6	37	88.8	38	88.8	39	88.5	40	90.0	41	89.0	42	88.8
43	90.4	44	88.0	45	85.5	46	86.1	47	91.5	48	76.1	49	75.4

TIME 100 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.8	3	91.2	4	84.0	5	92.6	6	84.3	7	79.2
8	81.2	9	88.5	10	81.3	11	86.5	12	79.0	13	78.5	14	73.7
15	90.8	16	83.0	17	90.0	18	82.6	19	88.0	20	80.6	21	88.0
22	80.5	23	89.0	24	82.0	25	79.1	26	73.9	27	92.0	28	85.4
29	0.	30	0.	31	90.8	32	92.5	33	92.7	34	91.2	35	91.2
36	91.5	37	88.8	38	88.8	39	88.5	40	89.9	41	89.0	42	88.6
43	90.9	44	88.0	45	85.5	46	86.0	47	91.5	48	75.8	49	75.1

TIME 200 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.8	3	91.0	4	84.0	5	92.0	6	84.4	7	89.0
8	81.5	9	88.0	10	80.7	11	86.0	12	78.5	13	78.2	14	73.8
15	90.8	16	83.1	17	90.0	18	82.5	19	88.0	20	80.6	21	88.0
22	80.4	23	88.0	24	80.7	25	79.9	26	74.8	27	91.5	28	85.2
29	0.	30	0.	31	90.5	32	92.4	33	92.5	34	91.0	35	91.0
36	91.3	37	88.8	38	88.6	39	88.4	40	89.8	41	89.0	42	88.6
43	90.7	44	87.8	45	85.3	46	85.8	47	91.2	48	75.2	49	74.9

TIME 300 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.6	2	83.7	3	91.0	4	83.9	5	92.0	6	84.8	7	89.0
8	81.7	9	88.0	10	81.0	11	86.0	12	78.7	13	78.2	14	73.9
15	90.8	16	83.3	17	90.0	18	82.9	19	88.0	20	80.5	21	87.5
22	80.1	23	87.0	24	80.0	25	79.7	26	75.0	27	92.0	28	85.8
29	0.	30	0.	31	90.5	32	92.0	33	92.4	34	91.0	35	91.0
36	91.3	37	88.5	38	88.6	39	88.4	40	89.8	41	89.0	42	88.6
43	90.8	44	86.0	45	85.4	46	86.0	47	91.2	48	75.3	49	-0.

TIME 400 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.6	3	90.0	4	84.2	5	91.0	6	83.7	7	89.0
8	81.4	9	88.0	10	80.9	11	87.5	12	81.2	13	78.3	14	74.0
15	91.0	16	82.2	17	91.0	18	83.3	19	88.5	20	81.1	21	89.0
22	80.9	23	88.0	24	80.8	25	79.2	26	74.5	27	92.2	28	85.5
29	0.	30	0.	31	90.1	32	91.9	33	92.0	34	90.7	35	92.0
36	92.1	37	90.6	38	89.9	40	88.0	41	88.0	42	89.7
43	89.2	44	88.9	45	85.9	46	84.0	47	91.0	48	75.0	49	74.7

TIME 500 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.8	2	83.2	3	91.0	4	84.0	5	91.5	6	83.2	7	89.4
8	81.5	9	88.5	10	81.0	11	88.0	12	81.2	13	78.0	14	73.7
15	91.0	16	82.1	17	91.5	18	83.2	19	89.5	20	81.2	21	90.0
22	81.3	23	88.0	24	81.6	25	79.0	26	74.0	27	92.3	28	85.6
29	0.	30	0.	31	90.1	32	91.8	33	91.9	34	89.2	35	90.0
36	92.4	37	90.1	38	90.0	39	88.0	40	85.9	41	88.0	42	89.8
43	89.0	44	86.2	45	85.4	46	83.6	47	90.4	48	74.8	49	74.6

TIME 600 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.6	2	83.7	3	91.0	4	84.1	5	91.0	6	84.1	7	89.8
8	82.1	9	88.5	10	81.3	11	88.0	12	81.4	13	79.0	14	74.7
15	91.2	16	82.4	17	91.0	18	83.1	19	90.0	20	81.9	21	90.0
22	83.1	23	90.0	24	82.8	25	79.7	26	75.1	27	92.2	28	86.0
29	0.	30	0.	31	92.0	32	91.8	33	91.9	34	89.8	35	92.1
36	92.6	37	90.3	38	90.7	39	90.8	40	86.0	41	88.1	42	90.0
43	89.4	44	83.0	45	85.6	46	84.9	47	91.1	48	75.0	49	74.9

TIME 700 DATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	83.3	3	90.7	4	84.0	5	91.0	6	84.0	7	89.0
8	81.6	9	88.5	10	81.4	11	88.0	12	81.4	13	78.4	14	74.4
15	91.0	16	82.3	17	91.5	18	83.7	19	89.5	20	80.9	21	90.0
22	83.2	23	90.0	24	82.8	25	79.8	26	75.0	27	92.1	28	85.9
29	0.	30	0.	31	90.0	32	91.8	33	91.8	34	89.5	35	92.2
36	92.4	37	90.1	38	90.6	39	90.8	40	86.2	41	88.0	42	90.0
43	89.3	44	86.9	45	85.8	46	84.0	47	91.1	48	75.0	49	74.5

TIME 800 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.6	2	83.7	3	91.0	4	84.1	5	91.0	6	84.1	7	89.8
8	82.1	9	88.5	10	81.3	11	88.0	12	81.4	13	79.0	14	74.7
15	91.2	16	82.4	17	91.0	18	83.1	19	90.0	20	81.9	21	90.0
22	83.1	23	90.0	24	82.8	25	79.7	26	75.1	27	92.2	28	86.0
29	0.	30	0.	31	92.0	32	91.8	33	91.9	34	89.8	35	92.1
36	92.6	37	90.3	38	90.7	39	90.8	40	86.0	41	88.1	42	90.0
43	89.4	44	83.0	45	85.6	46	84.9	47	91.1	48	75.0	49	74.9

TIME 900 DATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	83.3	3	90.7	4	84.0	5	91.0	6	84.0	7	89.0
8	81.6	9	88.5	10	81.4	11	88.0	12	81.4	13	78.4	14	74.4
15	91.0	16	82.3	17	91.5	18	83.7	19	89.5	20	80.9	21	90.0
22	83.2	23	90.0	24	82.8	25	79.8	26	75.0	27	92.1	28	85.9
29	0.	30	0.	31	90.0	32	91.8	33	91.8	34	89.5	35	92.2
36	92.4	37	90.1	38	90.6	39	90.8	40	86.2	41	88.0	42	90.0
43	89.3	44	86.9	45	85.8	46	84.0	47	91.1	48	75.0	49	74.5

TIME 1000 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.6	3	90.0	4	84.0	5	91.0	6	83.7	7	89.7
8	82.0	9	88.5	10	81.6	11	88.5	12	81.3	13	80.0	14	74.8
15	91.2	16	82.7	17	91.5	18	83.8	19	90.0	20	82.1	21	90.0
22	81.7	23	90.0	24	82.9	25	80.9	26	75.5	27	92.6	28	87.7
29	0.	30	0.	31	90.8	32	92.2	33	92.4	34	90.1	35	92.3
36	93.0	37	90.8	38	91.0	39	91.1	40	87.1	41	88.5	42	90.3
43	90.0	44	87.5	45	86.7	46	84.1	47	91.4	48	75.1	49	74.8

TIME 1100 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	84.9	3	91.2	4	84.1	5	91.0	6	84.0	7	89.5
8	81.6	9	88.0	10	81.6	11	88.0	12	80.7	13	78.5	14	74.4
15	91.5	16	82.6	17	91.5	18	83.7	19	90.1	20	81.9	21	90.0
22	81.6	23	90.0	24	82.8	25	78.0	26	74.8	27	92.2	28	89.2
29	0.	30	0.	31	90.0	32	92.2	33	92.1	34	89.7	35	92.1
36	92.7	37	91.7	38	90.9	39	91.1	40	86.9	41	87.4	42	90.0
43	89.4	44	87.2	45	85.8	46	84.5	47	90.6	48	75.2	49	74.8

TIME 1200 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	84.8	3	90.5	4	83.8	5	90.5	6	84.0	7	87.5
8	80.5	9	88.0	10	75.2	11	86.5	12	79.6	13	76.3	14	73.8
15	90.4	16	81.8	17	91.5	18	82.9	19	89.0	20	81.4	21	89.0
22	80.9	23	88.0	24	81.4	25	78.9	26	74.0	27	91.3	28	86.0
29	0.	30	0.	31	88.4	32	91.4	33	91.5	34	89.5	35	91.0
36	91.4	37	90.2	38	89.8	39	90.1	40	85.1	41	85.8	42	88.3
43	88.5	44	86.7	45	84.7	46	83.6	47	89.8	48	75.0	49	74.3

TIME 1300 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	84.8	3	91.0	4	84.0	5	91.0	6	84.0	7	89.2
8	81.0	9	88.0	10	80.7	11	88.0	12	81.2	13	78.0	14	73.8
15	91.0	16	81.9	17	91.5	18	83.0	19	89.6	20	81.5	21	90.0
22	81.1	23	90.0	24	82.1	25	79.0	26	74.5	27	92.3	28	85.9
29	0.	30	0.	31	90.0	32	92.0	33	92.0	34	89.8	35	92.1
36	92.7	37	90.1	38	90.7	40	88.0	41	88.0	42	90.0
43	89.4	44	86.9	45	85.8	46	84.9	47	91.0	48	75.0	49	75.5

TIME 1400 LATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	83.8	3	91.0	4	84.0	5	91.0	6	84.0	7	89.2
8	81.0	9	88.0	10	80.7	11	88.0	12	81.2	13	78.0

TIME 1400 DATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.6	2	94.0	3	91.0	4	84.6	5	91.0	6	84.4	7	88.8
8	81.8	9	94.0	10	81.8	11	86.0	12	82.5	13	76.2	14	72.9
15	90.0	16	91.7	17	90.0	18	83.1	19	89.0	20	81.7	21	89.0
22	81.9	23	91.0	24	84.2	25	77.1	26	74.0	27	92.2	28	86.7
29	0.	30	0.	31	90.0	32	92.0	33	92.0	34	88.6	35	91.1
36	91.5	37	89.3	38	90.0	39	90.5	40	85.2	41	87.8	42	89.2
43	88.0	44	86.5	45	84.5	46	83.4	47	90.4	48	73.9	49	73.1

TIME 1500 DATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	95.0	3	90.0	4	84.6	5	90.0	6	84.2	7	88.5
8	81.5	9	87.5	10	81.5	11	87.5	12	82.1	13	76.4	14	73.3
15	90.0	16	91.9	17	90.0	18	83.2	19	88.6	20	81.5	21	89.0
22	82.0	23	91.5	24	83.7	25	77.1	26	77.4	27	92.2	28	86.7
29	0.	30	0.	31	90.0	32	91.9	33	91.9	34	88.4	35	90.9
36	91.5	37	89.1	38	89.8	39	90.0	40	85.1	41	87.8	42	89.0
43	88.0	44	86.5	45	84.1	46	83.1	47	90.2	48	73.8	49	73.1

TIME 1600 DATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.9	2	93.8	3	90.0	4	84.3	5	90.5	6	84.2	7	88.2
8	81.5	9	87.5	10	81.4	11	87.5	12	82.0	13	76.0	14	73.2
15	90.0	16	92.0	17	90.0	18	83.2	19	88.2	20	81.3	21	88.5
22	81.6	23	89.0	24	78.5	25	76.8	26	73.0	27	91.8	28	86.0
29	0.	30	0.	31	89.6	32	91.5	33	91.5	34	88.0	35	90.8
36	91.0	37	88.8	38	89.5	39	89.8	40	84.6	41	87.4	42	88.8
43	88.3	44	86.1	45	83.9	46	82.9	47	90.1	48	73.7	49	73.1

TIME 1700 DATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.2	2	93.5	3	92.0	4	83.9	5	90.0	6	83.8	7	88.0
8	81.2	9	87.0	10	81.1	11	87.0	12	81.9	13	76.0	14	73.2
15	89.5	16	91.5	17	89.5	18	83.1	19	88.0	20	81.0	21	88.0
22	83.1	23	90.0	24	83.4	25	71.8	26	73.9	27	91.4	28	86.5
29	0.	30	0.	31	89.7	32	91.8	33	91.5	34	88.0	35	90.2
36	91.2	37	88.6	38	89.1	39	89.2	40	84.8	41	87.0	42	88.5
43	88.1	44	86.1	45	83.6	46	82.9	47	89.9	48	74.0	49	73.1

TIME 1800 DATE 6/10/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.2	2	83.5	3	90.1	4	84.0	5	90.0	6	83.7	7	88.0
8	81.2	9	87.0	10	81.1	11	87.0	12	81.9	13	76.0	14	73.2
15	89.5	16	91.7	17	89.5	18	82.7	19	88.0	20	80.8	21	88.0
22	81.5	23	89.5	24	82.5	25	76.7	26	73.4	27	91.6	28	86.0
29	0.	30	0.	31	89.2	32	91.3	33	91.3	34	88.2	35	90.1
36	90.9	37	88.4	38	89.0	39	89.1	40	84.5	41	86.9	42	88.5
43	88.0	44	86.0	45	83.5	46	82.9	47	89.6	48	73.9	49	72.9

TIME 100 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	93.5	3	90.0	4	83.8	5	90.0	6	83.7	7	87.8
8	81.0	9	86.5	10	81.2	11	86.5	12	81.4	13	75.6	14	73.0
15	89.3	16	91.2	17	89.5	18	83.0	19	88.0	20	81.1	21	88.0
22	81.4	23	89.5	24	83.1	25	76.3	26	73.7	27	91.5	28	85.9
29	0.	30	0.	31	88.9	32	91.1	33	91.1	34	87.7	35	90.0
36	90.8	37	88.2	38	89.1	39	89.1	40	84.0	41	86.6	42	88.1
43	87.8	44	85.8	45	83.4	46	82.6	47	89.2	48	73.5	49	72.5

TIME 200 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	94.3	3	90.0	4	83.8	5	90.0	6	83.8	7	87.4
8	81.0	9	86.5	10	80.8	11	86.0	12	80.9	13	75.8	14	72.9
15	89.2	16	91.3	17	89.0	18	82.3	19	88.0	20	81.0	21	88.0
22	81.0	23	89.5	24	82.9	25	76.0	26	73.2	27	91.3	28	85.9
29	0.	30	0.	31	88.8	32	91.1	33	91.0	34	87.7	35	90.1
36	90.8	37	88.4	38	89.0	39	89.2	40	84.0	41	86.4	42	88.1
43	87.9	44	85.7	45	83.0	46	82.5	47	89.0	48	72.7	49	72.1

TIME 300 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	92.4	3	90.0	4	84.0	5	90.0	6	84.0	7	87.4
8	81.0	9	86.5	10	80.9	11	86.5	12	81.3	13	75.9	14	73.1
15	89.2	16	91.3	17	89.5	18	82.5	19	88.0	20	80.8	21	88.0
22	81.1	23	88.0	24	81.8	25	73.6	26	73.5	27	91.0	28	85.7
29	0.	30	0.	31	88.8	32	90.9	33	90.9	34	87.5	35	90.1
36	90.8	37	88.0	38	88.9	39	89.0	40	83.8	41	86.6	42	88.0
43	87.9	44	85.5	45	83.3	46	82.4	47	89.1	48	72.6	49	71.9

TIME 400 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	93.4	3	90.0	4	84.0	5	90.0	6	83.9	7	87.2
8	80.6	9	86.0	10	80.5	11	86.0	12	80.8	13	75.9	14	73.0
15	89.0	16	91.1	17	89.0	18	82.5	19	87.8	20	80.8	21	88.0
22	81.2	23	89.5	24	82.7	25	77.2	26	74.1	27	91.0	28	85.3
29	0.	30	0.	31	88.5	32	90.6	33	90.7	34	87.0	35	89.8
36	90.2	37	87.9	38	88.5	39	88.9	40	83.6	41	86.1	42	87.8
43	87.3	44	85.3	45	83.0	46	82.3	47	89.0	48	72.5	49	71.9

TIME 500 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	93.4	3	90.0	4	83.8	5	90.0	6	83.8	7	87.2
8	80.4	9	86.0	10	80.3	11	86.0	12	80.8	13	75.1	14	72.3
15	89.0	16	91.2	17	89.5	18	82.8	19	87.8	20	80.7	21	88.0
22	81.2	23	89.5	24	83.1	25	76.0	26	73.0	27	90.6	28	85.5
29	0.	30	0.	31	88.5	32	90.8	33	90.9	34	87.0	35	89.7
36	90.0	37	87.8	38	88.4	39	88.6	40	83.4	41	86.1	42	87.8
43	87.1	44	85.5	45	82.8	46	82.2	47	88.8	48	72.3	49	71.8

TIME 600 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.8	2	93.3	3	90.0	4	83.5	5	90.0	6	84.0	7	87.2
8	80.5	9	86.5	10	81.0	11	86.0	12	80.9	13	76.0	14	72.8
15	89.0	16	91.1	17	89.5	18	82.5	19	88.0	20	81.0	21	88.0
22	81.2	23	89.5	24	83.1	25	76.9	26	73.0	27	91.0	28	85.8
29	0.	30	0.	31	88.8	32	90.8	33	90.8	34	87.3	35	90.0
36	90.5	37	88.0	38	88.9	39	89.0	40	84.0	41	86.5	42	88.0
43	87.8	44	85.6	45	83.3	46	82.7	47	89.0	48	72.5	49	71.7

TIME 700 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	93.4	3	90.0	4	83.8	5	90.0	6	84.0	7	87.0
8	80.7	9	86.0	10	80.6	11	86.0	12	81.1	13	76.2	14	73.0
15	89.0	16	91.5	17	89.0	18	82.0	19	88.0	20	81.1	21	88.0
22	81.1	23	89.5	24	83.2	25	79.0	26	75.3	27	91.0	28	85.9
29	0.	30	0.	31	88.6	32	90.8	33	90.9	34	87.1	35	90.0
36	90.1	37	88.0	38	88.8	39	89.0	40	84.3	41	86.1	42	87.8
43	87.0	44	85.8	45	84.0	46	82.9	47	89.3	48	72.4	49	71.6

TIME 800 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	93.4	3	90.0	4	84.2	5	89.0	6	83.4	7	87.0
8	81.0	9	86.0	10	80.8	11	85.5	12	79.2	13	75.6	14	72.8
15	89.0	16	91.8	17	89.5	18	82.4	19	87.4	20	80.4	21	87.0
22	81.1	23	90.0	24	81.8	25	76.3	26	73.6	27	90.0	28	85.2
29	0.	30	0.	31	88.8	32	90.8	33	91.0	34	88.3	35	89.5
36	90.0	37	87.4	38	87.7	39	87.7	40	87.2	41	87.1	42	87.0
43	88.0	44	86.7	45	86.9	46	84.1	47	89.4	48	72.2	49	71.6

TIME 900 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	93.0	3	90.0	4	84.6	5	90.0	6	84.2	7	86.8
8	80.5	9	86.0	10	80.8	11	86.0	12	81.0	13	76.0	14	73.0
15	89.3	16	91.8	17	89.5	18	82.5	19	88.0	20	81.0	21	88.0
22	81.0	23	89.5	24	83.1	25	76.3	26	73.7	27	91.5	28	85.9
29	0.	30	0.	31	88.8	32	91.1	33	91.1	34	87.7	35	90.0
36	90.8	37	88.2	38	88.9	39	89.1	40	84.0	41	86.6	42	88.1
43	87.8	44	85.8	45	83.4	46	82.6	47	89.2	48	73.5	49	72.5

TIME 1000 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	93.5	3	90.0	4	84.6	5	90.0	6	84.3	7	86.7
8	80.7	9	86.0	10	80.8	11	84.0	12	78.4	13	75.8	14	73.0
15	89.0	16	92.0	17	89.0	18	82.8	19	85.1	20	80.2	21	83.0
22	79.2	23	88.0	24	80.5	25	76.2	26	73.8	27	89.9	28	85.5
29	0.	30	0.	31	88.5	32	91.1	33	91.0	34	88.3	35	88.6
36	89.2	37	86.2	38	86.3	39	86.1	40	87.2	41	86.3	42	86.1
43	86.7	44	86.6	45	86.1	46	84.1	47	89.0	48	72.3	49	71.9

TIME 1100 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	93.4	3	90.0	4	84.4	5	90.0	6	84.1	7	87.0
8	80.7	9	86.0	10	80.6	11	86.0	12	81.1	13	76.2	14	73.1
15	89.0	16	92.0	17	88.0	18	82.4	19	88.0	20	80.9	21	88.5
22	81.1	23	89.0	24	80.0	25	77.0	26	73.9	27	90.0	28	85.6
29	0.	30	0.	31	88.7	32	90.7	33	90.9	34	88.8	35	88.9
36	89.2	37	86.9	38	86.8	39	86.5	40	87.4	41	86.5	42	86.3
43	89.0	44	86.6	45	87.0	46	84.5	47	89.4	48	72.5	49	71.8

TIME 1200 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.2	2	93.4	3	90.0	4	84.4	5	90.0	6	84.3	7	87.2
8	81.2	9	86.0	10	80.6	11	84.0	12	78.1	13	74.6	14	73.5
15	89.0	16	93.0	17	88.0	18	82.4	19	88.5	20	80.2	21	88.0
22	79.6	23	88.0	24	81.7	25	76.9	26	74.0	27	90.0	28	86.0
29	0.	30	0.	31	89.2	32	91.2	33	91.2	34	89.2	35	89.2
36	90.0	37	87.5	38	87.2	39	87.0	40	88.4	41	87.0	42	86.8
43	89.3	44	87.2	45	87.5	46	85.1	47	89.8	48	72.6	49	71.7

TIME 1300 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	93.4	3	90.0	4	84.4	5	90.0	6	84.1	7	87.0
8	81.0	9	86.0	10	80.9	11	84.0	12	78.1	13	76.2	14	73.1
15	89.0	16	92.9	17	88.0	18	82.4	19	88.0	20	80.9	21	85.5
22	79.2	23	88.0	24	80.0	25	77.0	26	73.9	27	90.0	28	85.6
29	0.	30	0.	31	88.7	32	90.7	33	90.9	34	88.8	35	88.9
36	89.2	37	86.9	38	86.8	39	86.5	40	87.4	41	86.5	42	86.3
43	89.0	44	86.6	45	87.0	46	84.5	47	89.4	48	72.5	49	71.8

TIME 1400 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.2	2	93.4	3	90.0	4	84.4	5	90.0	6	84.3	7	87.2
8	81.2	9	86.0	10	80.6	11	84.0	12	78.1	13	74.6	14	73.5
15	89.0	16	93.0	17	88.0	18	82.4	19	88.5	20	80.2	21	88.0
22	79.6	23	88.0	24	81.7	25	76.9	26	74.0	27	90.0	28	86.0
29	0.	30	0.	31	89.2	32	91.2	33	91.2	34	89.2	35	89.2
36	90.0	37	87.5	38	87.2	39	87.0	40	88.4	41	87.0	42	86.8
43	89.3	44	87.2	45	87.5	46	85.1	47	89.8	48	72.6	49	71.7

TIME 1500 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.5	2	93.6	3	90.0	4	84.6	5	90.0	6	84.2	7	87.8
8	81.8	9	86.0	10	86.0	11	84.0	12	78.2	13	76.3	14	73.4
15	89.3	16	93.1	17	88.2	18	82.5	19	88.0	20	80.4	21	86.0
22	79.5	23	88.0	24	80.0	25	77.1	26	74.3	27	90.2	28	86.2
29	0.	30	0.	31	89.2	32	91.6	33	91.5	34	89.4	35	89.6
36	90.1	37	77.8	38	87.5	39	87.2	40	88.4	41	87.2	42	87.0
43	89.5	44	87.2	45	87.8	46	85.2	47	89.4	48	72.8	49	71.8

TIME 1600 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.8	2	93.9	3	90.5	4	85.0	5	91.0	6	85.5	7	88.0
8	81.7	9	86.5	10	81.1	11	84.5	12	78.1	13	76.5	14	73.6
15	89.5	16	93.5	17	85.0	18	83.3	19	87.0	20	80.9	21	86.5
22	80.0	23	88.0	24	80.0	25	77.5	26	74.3	27	90.6	28	86.4
29	0.	30	0.	31	91.5	32	91.5	33	91.4	34	89.8	35	89.8
36	90.1	37	88.0	38	87.7	39	87.5	40	88.7	41	87.4	42	87.1
43	89.4	44	87.2	45	88.2	46	85.4	47	90.0	48	72.5	49	71.5

TIME 1700 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	89.0	2	93.1	3	91.0	4	85.0	5	91.0	6	85.1	7	88.0
8	81.8	9	87.0	10	81.5	11	85.0	12	78.0	13	76.5	14	73.5
15	89.0	16	93.0	17	89.0	18	83.0	19	87.0	20	80.4	21	86.5
22	80.0	23	88.0	24	79.6	25	77.2	26	74.5	27	90.9	28	86.7
29	0.	30	0.	31	90.9	32	92.0	33	92.0	34	85.9	35	89.9
36	90.4	37	88.0	38	87.5	39	87.5	40	88.5	41	87.4	42	87.2
43	90.0	44	87.2	45	88.1	46	85.1	47	90.0	48	72.0	49	71.5

TIME 1800 DATE 6/11/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	93.0	3	90.8	4	84.9	5	91.0	6	85.1	7	88.0
8	81.7	9	86.5	10	80.8	11	85.0	12	78.9	13	76.5	14	73.4
15	89.0	16	93.3	17	85.0	18	83.0	19	87.0	20	80.4	21	86.5
22	79.8	23	88.0	24	79.6	25	77.5	26	74.4	27	90.9	28	86.5
29	0.	30	0.	31	89.8	32	91.8	33	91.8	34	90.0	35	89.9
36	90.1	37	88.0	38	87.6	39	87.2	40	88.1	41	87.4	42	87.0
43	90.0	44	87.5	45	88.2	46	85.4	47	90.1	48	72.3	49	71.5

TIME 1200 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	85.1	4	[illegible]	5	[illegible]	6	85.1	7	88.0
8	[illegible]	9	[illegible]	10	81.1	11	85.0	12	79.0	13	76.8	14	73.7
15	[illegible]	16	[illegible]	17	[illegible]	18	[illegible]	19	[illegible]	20	[illegible]	21	86.5
22	[illegible]	23	[illegible]	24	81.[illegible]	25	77.5	26	74.2	27	91.0	28	86.8
29	0.	30	[illegible]	31	[illegible]	32	92.1	33	92.[illegible]	34	90.0	35	90.0
36	[illegible]	37	[illegible]	38	[illegible]	39	87.5	40	88.[illegible]	41	87.6	42	87.2
43	[illegible]	44	[illegible]	45	86.2	46	85.3	47	90.1	48	72.0	49	71.3

TIME [illegible] LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	-0.	5	-0.	6	-0.	7	-0.
8	-0.	9	-0.	10	-0.	11	-0.	12	-0.	13	-0.	14	-0.
15	[illegible]	16	[illegible]	17	-0.	18	-0.	19	-0.	20	-0.	21	-0.
22	-0.	23	[illegible]	24	[illegible]	25	-0.	26	-0.	27	-0.	28	-0.
29	[illegible]	30	[illegible]	31	[illegible]	32	-0.	33	-0.	34	-0.	35	-0.
36	[illegible]	37	[illegible]	38	[illegible]	39	-0.	40	-0.	41	-0.	42	-0.
43	[illegible]	44	[illegible]	45	[illegible]	46	-0.	47	-0.	48	-0.	49	-0.

TIME 100 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	77.5	3	[illegible]	4	78.3	5	85.7	6	75.5	7	83.0
8	76.1	9	[illegible]	10	[illegible]	11	84.5	12	77.7	13	77.7	14	73.9
15	[illegible]	16	77.0	17	[illegible]	18	81.8	19	88.5	20	74.8	21	89.5
22	[illegible]	23	[illegible]	24	[illegible]	25	77.5	26	73.7	27	85.0	28	79.0
29	0.	30	[illegible]	31	84.9	32	85.1	33	85.2	34	86.7	35	88.9
36	89.[illegible]	37	[illegible]	38	[illegible]	39	85.5	40	82.0	41	82.6	42	82.9
43	[illegible]	44	[illegible]	45	[illegible]	46	82.0	47	78.0	48	71.8	49	71.4

TIME 200 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.5	2	77.0	3	85.2	4	78.3	5	86.2	6	75.2	7	83.0
8	76.1	9	[illegible]	10	76.1	11	84.5	12	77.7	13	77.0	14	73.6
15	[illegible]	16	[illegible]	17	85.0	18	81.9	19	88.7	20	79.0	21	89.5
22	79.5	23	75.9	24	76.3	25	77.1	26	73.6	27	85.1	28	79.5
29	0.	30	[illegible]	31	84.7	32	85.8	33	85.7	34	87.0	35	89.3
36	90.7	37	[illegible]	38	85.3	39	85.5	40	82.7	41	82.4	42	82.8
43	[illegible]	44	[illegible]	45	81.3	46	82.0	47	77.2	48	72.2	49	71.4

TIME 300 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	77.0	3	85.0	4	78.0	5	86.0	6	78.9	7	82.8
8	76.[illegible]	9	[illegible]	10	75.7	11	84.0	12	77.4	13	76.5	14	73.4
15	[illegible]	16	[illegible]	17	85.0	18	81.7	19	88.2	20	79.2	21	89.0
22	79.9	23	[illegible]	24	75.6	25	76.5	26	73.0	27	85.0	28	79.0
29	0.	30	[illegible]	31	84.4	32	85.5	33	85.5	34	86.5	35	89.0
36	89.[illegible]	37	87.8	38	88.7	39	89.2	40	82.0	41	82.0	42	82.2
43	[illegible]	44	[illegible]	45	81.3	46	81.5	47	76.4	48	71.5	49	71.5

TIME 400 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.1	3	85.0	4	78.0	5	86.0	6	78.9	7	82.5
8	75.8	9	[illegible]	10	75.8	11	83.5	12	77.2	13	76.0	14	73.3
15	[illegible]	16	[illegible]	17	84.5	18	81.2	19	87.7	20	78.2	21	88.5
22	79.2	23	85.5	24	79.7	25	75.8	26	72.8	27	84.5	28	78.7
29	0.	30	0.	31	83.6	32	85.0	33	85.2	34	86.0	35	88.8
36	89.5	37	87.0	38	88.0	39	88.5	40	81.2	41	81.3	42	81.6
43	[illegible]	44	[illegible]	45	80.9	46	81.2	47	76.0	48	71.5	49	71.5

TIME 500 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	84.5	4	77.6	5	85.0	6	78.7	7	82.2
8	75.7	9	[illegible]	10	75.4	11	83.0	12	76.0	13	76.0	14	73.1
15	[illegible]	16	[illegible]	17	84.5	18	81.1	19	87.2	20	78.7	21	88.0
22	79.1	23	[illegible]	24	75.7	25	76.5	26	73.0	27	84.5	28	78.4
29	0.	30	0.	31	83.2	32	84.8	33	85.0	34	85.7	35	88.5
36	[illegible]	37	[illegible]	38	81.5	39	88.0	40	81.0	41	81.0	42	81.5
43	[illegible]	44	[illegible]	45	81.0	46	81.0	47	76.4	48	71.7	49	71.0

TIME 600 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.2	2	77.4	3	85.0	4	78.0	5	86.0	6	78.9	7	82.7
8	76.0	9	[illegible]	10	75.5	11	83.0	12	76.0	13	76.0	14	73.6
15	[illegible]	16	[illegible]	17	88.5	18	81.4	19	87.0	20	78.0	21	88.0
22	79.7	23	[illegible]	24	76.5	25	78.3	26	73.0	27	84.6	28	78.6
29	0.	30	0.	31	85.0	32	85.0	33	85.0	34	85.8	35	88.3
36	89.0	37	[illegible]	38	87.3	39	87.7	40	81.0	41	81.7	42	81.9
43	[illegible]	44	[illegible]	45	81.0	46	81.5	47	77.0	48	71.5	49	71.0

TIME 700 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	85.0	4	78.5	5	86.7	6	79.1	7	84.0
8	76.7	9	[illegible]	10	76.3	11	84.5	12	77.6	13	80.2	14	74.2
15	[illegible]	16	[illegible]	17	[illegible]	18	82.2	19	87.5	20	75.7	21	88.5
22	80.0	23	87.0	24	80.1	25	80.8	26	74.0	27	86.0	28	79.0
29	0.	30	[illegible]	31	85.5	32	86.3	33	86.3	34	87.1	35	89.5
36	90.5	37	87.5	38	88.4	39	88.5	40	83.7	41	83.6	42	83.7
43	[illegible]	44	[illegible]	45	83.5	46	82.6	47	81.5	48	71.0	49	71.0

TIME 800 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	77.5	3	87.2	4	79.0	5	88.0	6	75.9	7	86.0
8	77.7	9	[illegible]	10	77.1	11	86.2	12	79.4	13	84.0	14	75.0
15	[illegible]	16	[illegible]	17	90.0	18	82.8	19	88.0	20	80.0	21	89.5
22	80.5	23	86.0	24	75.3	25	83.8	26	77.4	27	87.6	28	80.0
29	0.	30	0.	31	87.5	32	88.0	33	87.8	34	88.8	35	90.7
36	91.2	37	89.3	38	85.8	39	90.0	40	86.1	41	85.9	42	86.0
43	[illegible]	44	[illegible]	45	85.9	46	83.8	47	83.9	48	71.8	49	71.2

TIME 900 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.2	2	79.0	3	88.6	4	79.8	5	89.0	6	80.0	7	87.5
8	77.9	9	87.0	10	77.4	11	88.0	12	78.2	13	86.0	14	76.2
15	[illegible]	16	[illegible]	17	90.5	18	83.0	19	90.0	20	81.4	21	90.0
22	81.3	23	90.0	24	80.3	25	86.1	26	77.1	27	89.0	28	80.7
29	0.	30	0.	31	89.4	32	85.6	33	89.3	34	90.2	35	91.8
36	92.3	37	90.6	38	91.0	39	91.4	40	88.0	41	87.8	42	87.8
43	89.0	44	88.5	45	87.8	46	86.8	47	86.0	48	71.8	49	71.2

TIME 1000 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.5	2	79.1	3	90.2	4	79.4	5	90.5	6	80.1	7	89.8
8	77.8	9	90.0	10	78.0	11	90.0	12	78.3	13	88.6	14	76.9
15	92.0	16	83.0	17	92.0	18	84.2	19	91.2	20	82.0	21	92.0
22	82.6	23	92.0	24	80.3	25	90.5	26	78.5	27	91.5	28	80.9
29	0.	30	0.	31	91.9	32	91.8	33	91.4	34	92.1	35	93.4
36	93.8	37	92.8	38	93.0	39	93.2	40	91.0	41	90.7	42	90.6
43	91.5	44	88.2	45	90.8	46	86.4	47	90.3	48	72.0	49	71.4

TIME 1100 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	[illegible]	3	91.5	4	80.7	5	92.0	6	81.2	7	91.0
8	78.4	9	91.0	10	78.9	11	91.5	12	79.5	13	90.8	14	77.1
15	[illegible]	16	[illegible]	17	93.5	18	85.6	19	92.5	20	83.5	21	96.0
22	84.2	23	93.0	24	80.8	25	92.0	26	79.9	27	92.6	28	82.0
29	0.	30	[illegible]	31	93.1	32	92.9	33	92.5	34	93.3	35	94.3
36	94.5	37	90.0	38	94.0	39	94.1	40	92.2	41	91.8	42	90.9
43	93.0	44	[illegible]	45	91.6	46	87.0	47	98.0	48	72.1	49	71.6

TIME 1200 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	[illegible]	3	92.6	4	81.0	5	93.0	6	81.5	7	92.6
8	79.2	9	92.0	10	78.8	11	92.0	12	79.0	13	92.0	14	77.5
15	[illegible]	16	[illegible]	17	94.0	18	86.2	19	93.8	20	84.0	21	94.5
22	84.7	23	93.0	24	80.1	25	93.6	26	80.2	27	93.8	28	82.3
29	0.	30	[illegible]	31	94.2	32	94.0	33	93.8	34	94.8	35	95.6
36	95.0	37	95.0	38	95.2	39	95.5	40	93.8	41	93.3	42	93.2
43	94.0	44	[illegible]	45	93.0	46	87.8	47	92.0	48	72.4	49	71.8

TIME 1300 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	[illegible]	3	92.2	4	81.2	5	94.0	6	82.0	7	93.2
8	79.5	9	93.5	10	80.2	11	93.5	12	80.8	13	92.8	14	77.5
15	[illegible]	16	[illegible]	17	95.0	18	87.7	19	94.4	20	84.9	21	95.5
22	85.7	23	93.0	24	80.7	25	93.5	26	80.4	27	94.3	28	82.8
29	0.	30	[illegible]	31	94.8	32	94.6	33	94.4	34	95.2	35	96.0
36	96.3	37	95.8	38	96.0	39	96.2	40	94.5	41	94.0	42	94.0
43	94.0	44	[illegible]	45	93.0	46	88.5	47	93.5	48	72.9	49	72.0

TIME 1400 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	[illegible]	3	92.0	4	81.0	5	94.0	6	82.2	7	93.0
8	79.8	9	93.0	10	80.3	11	93.0	12	80.8	13	93.0	14	77.9
15	[illegible]	16	[illegible]	17	[illegible]	18	85.2	19	92.3	20	83.2	21	94.0
22	83.6	23	96.0	24	77.6	25	84.0	26	77.0	27	90.2	28	84.4
29	0.	30	[illegible]	31	92.2	32	91.0	33	90.4	34	91.7	35	93.8
36	[illegible]	37	93.0	38	91.3	39	93.8	40	88.6	41	88.1	42	88.4
43	[illegible]	44	[illegible]	45	87.9	46	85.2	47	0.	48	73.5	49	72.9

TIME 1500 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	[illegible]	3	92.2	4	81.7	5	94.0	6	82.2	7	93.2
8	79.5	9	93.5	10	80.2	11	94.0	12	80.8	13	93.0	14	77.9
15	[illegible]	16	[illegible]	17	95.0	18	87.8	19	95.0	20	85.2	21	96.0
22	85.7	23	96.5	24	82.4	25	93.9	26	81.2	27	94.0	28	83.0
29	0.	30	[illegible]	31	94.5	32	94.6	33	94.1	34	95.1	35	96.1
36	96.0	37	[illegible]	38	96.2	39	96.4	40	94.1	41	93.8	42	93.8
43	94.0	44	[illegible]	45	93.8	46	88.2	47	93.1	48	73.6	49	72.4

TIME 1600 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	[illegible]	3	92.2	4	81.2	5	94.0	6	82.2	7	93.2
8	79.5	9	93.5	10	80.2	11	94.0	12	80.8	13	93.0	14	77.9
15	[illegible]	16	[illegible]	17	[illegible]	18	85.2	19	92.3	20	83.2	21	94.0
22	83.6	23	96.0	24	77.6	25	84.0	26	77.0	27	90.2	28	84.4
29	0.	30	[illegible]	31	92.2	32	91.0	33	90.4	34	91.7	35	93.8
36	[illegible]	37	93.0	38	91.3	39	93.8	40	88.6	41	88.1	42	88.4
43	[illegible]	44	[illegible]	45	87.9	46	85.2	47	0.	48	73.5	49	72.9

TIME 1700 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.0	2	81.0	3	93.1	4	81.6	5	94.0	6	82.1	7	93.0
8	80.0	9	92.5	10	79.6	11	93.0	12	81.0	13	91.4	14	77.6
15	[illegible]	16	[illegible]	17	95.0	18	87.4	19	95.0	20	85.3	21	96.0
22	85.5	23	94.0	24	77.2	25	91.8	26	80.5	27	94.0	28	84.0
29	0.	30	0.	31	94.4	32	94.5	33	94.0	34	95.0	35	96.0
36	97.0	37	95.5	38	96.0	39	96.0	40	94.0	41	93.0	42	93.1
43	94.0	44	[illegible]	45	92.8	46	88.0	47	0.	48	74.5	49	73.1

TIME 1800 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.5	2	[illegible]	3	92.6	4	81.0	5	93.0	6	81.9	7	92.0
8	79.2	9	92.0	10	78.8	11	92.0	12	80.3	13	91.0	14	77.9
15	[illegible]	16	[illegible]	17	95.0	18	86.6	19	94.3	20	84.0	21	95.0
22	85.1	23	94.0	24	78.2	25	91.1	26	80.1	27	93.3	28	84.2
29	0.	30	[illegible]	31	93.9	32	94.0	33	93.1	34	94.5	35	95.6
36	96.0	37	93.0	38	95.8	39	96.0	40	93.0	41	92.0	42	92.1
43	93.0	44	93.5	45	91.5	46	87.5	47	0.	48	74.1	49	73.0

TIME 1900 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	[illegible]	3	92.0	4	81.0	5	92.0	6	81.3	7	90.5
8	79.6	9	90.0	10	78.0	11	91.0	12	80.5	13	87.5	14	76.3
15	[illegible]	16	[illegible]	17	94.5	18	86.0	19	93.5	20	84.0	21	94.5
22	84.0	23	96.0	24	78.0	25	88.4	26	79.3	27	92.0	28	83.6
29	0.	30	[illegible]	31	92.1	32	92.1	33	92.0	34	93.0	35	94.9
36	95.0	37	93.5	38	94.5	39	95.0	40	91.0	41	90.1	42	90.5
43	[illegible]	44	[illegible]	45	85.7	46	86.4	47	0.	48	73.6	49	72.9

TIME 2000 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	[illegible]	3	90.5	4	81.0	5	81.5	6	85.0	7	79.4
8	87.1	9	76.0	10	85.0	11	75.6	12	85.0	13	76.0	14	93.0
15	[illegible]	16	[illegible]	17	[illegible]	18	85.2	19	92.3	20	83.2	21	93.0
22	83.6	23	86.0	24	77.6	25	84.0	26	77.0	27	90.2	28	84.4
29	0.	30	[illegible]	31	90.2	32	91.0	33	90.4	34	91.7	35	93.8
36	[illegible]	37	[illegible]	38	88.6	39	91.1	40	88.6	41	88.1	42	88.4
43	[illegible]	44	[illegible]	45	87.9	46	85.2	47	0.	48	73.5	49	72.9

TIME 2100 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.0	2	[illegible]	3	89.5	4	80.5	5	89.5	6	80.8	7	87.0
8	78.0	9	[illegible]	10	78.0	11	88.0	12	80.0	13	82.5	14	75.6
15	[illegible]	16	[illegible]	17	92.0	18	84.2	19	91.0	20	82.5	21	92.0
22	83.1	23	[illegible]	24	76.0	25	83.2	26	77.5	27	90.0	28	84.0
29	0.	30	[illegible]	31	88.2	32	89.9	33	89.1	34	90.0	35	92.5
36	93.5	37	[illegible]	38	92.0	39	92.5	40	87.0	41	86.4	42	86.7
43	[illegible]	44	[illegible]	45	85.6	46	84.1	47	0.	48	73.5	49	72.8

TIME 2200 LATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	[illegible]	2	[illegible]	3	[illegible]	4	79.5	5	89.0	6	80.5	7	86.0
8	78.0	9	[illegible]	10	77.5	11	86.5	12	78.0	13	81.6	14	74.8
15	[illegible]	16	[illegible]	17	91.0	18	83.3	19	90.0	20	81.6	21	90.5
22	81.3	23	94.3	24	77.0	25	82.4	26	76.3	27	88.0	28	81.7
29	0.	30	[illegible]	31	87.0	32	88.6	33	88.1	34	89.2	35	91.4
36	92.5	37	[illegible]	38	90.0	39	91.1	40	86.0	41	85.5	42	86.0
43	[illegible]	44	[illegible]	45	85.0	46	84.0	47	0.	48	73.7	49	72.5

TIME 2300 DATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.4	2	74.9	3	87.0	4	79.2	5	88.0	6	79.6	7	85.5
8	77.4	9	84.0	10	77.0	11	86.0	12	78.4	13	80.0	14	74.2
15	80.0	16	81.6	17	90.5	18	81.0	19	89.6	20	81.1	21	89.8
22	81.5	23	84.3	24	77.4	25	81.0	26	75.3	27	87.2	28	81.0
29	0.	30	0.	31	87.0	32	87.6	33	87.4	34	88.3	35	90.8
36	90.5	37	86.5	38	85.9	39	90.1	40	85.0	41	85.0	42	85.0
43	88.3	44	85.0	45	84.2	46	83.5	47	0.	48	73.1	49	72.3

TIME 2400 DATE 6/12/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.8	2	78.8	3	86.4	4	78.8	5	87.6	6	79.3	7	84.7
8	77.7	9	82.5	10	76.0	11	84.5	12	77.6	13	79.3	14	74.2
15	84.3	16	81.8	17	90.0	18	82.8	19	88.4	20	80.6	21	89.0
22	80.5	23	86.0	24	80.1	25	80.6	26	75.4	27	86.5	28	80.4
29	0.	30	0.	31	86.1	32	87.6	33	87.0	34	87.5	35	90.0
36	91.[illegible]	37	87.9	38	89.1	39	89.8	40	83.8	41	83.7	42	84.0
43	83.3	44	84.2	45	83.0	46	82.8	47	0.	48	72.9	49	72.2

TIME 100 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.8	2	78.8	3	85.8	4	78.6	5	86.5	6	78.9	7	84.0
8	77.1	9	82.0	10	76.0	11	84.0	12	77.8	13	78.0	14	73.7
15	84.0	16	81.1	17	89.0	18	81.6	19	88.0	20	80.5	21	88.0
22	80.0	23	84.5	24	78.3	25	77.6	26	73.9	27	85.8	28	79.9
29	0.	30	0.	31	85.4	32	86.3	33	86.1	34	86.9	35	89.5
36	90.1	37	87.4	38	86.5	39	89.0	40	83.0	41	83.0	42	83.5
43	84.4	44	83.9	45	82.4	46	82.4	47	0.	48	72.8	49	72.0

TIME 200 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.8	2	78.0	3	85.0	4	78.1	5	86.6	6	78.6	7	83.2
8	76.7	9	81.5	10	76.2	11	83.5	12	77.4	13	77.0	14	74.2
15	83.5	16	81.8	17	89.5	18	81.5	19	87.2	20	79.8	21	88.0
22	80.2	23	84.5	24	78.1	25	77.0	26	73.3	27	85.2	28	79.3
29	0.	30	0.	31	84.9	32	86.0	33	85.6	34	86.1	35	88.9
36	90.0	37	87.0	38	86.0	39	88.5	40	82.4	41	82.1	42	82.6
43	84.0	44	83.3	45	81.5	46	81.9	47	0.	48	72.5	49	71.7

TIME 300 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.4	2	78.0	3	84.5	4	78.1	5	86.0	6	78.8	7	83.0
8	76.5	9	81.0	10	75.6	11	83.0	12	77.3	13	77.0	14	73.9
15	83.0	16	81.0	17	88.0	18	81.2	19	87.0	20	79.8	21	87.5
22	79.5	23	83.5	24	77.0	25	77.0	26	73.0	27	85.0	28	79.0
29	0.	30	0.	31	84.3	32	85.4	33	85.1	34	85.9	35	88.6
36	90.0	37	87.0	38	87.7	39	88.1	40	82.1	41	82.0	42	82.5
43	84.0	44	83.2	45	81.4	46	81.6	47	0.	48	72.4	49	71.4

TIME 400 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.1	2	77.5	3	84.0	4	78.0	5	85.5	6	78.1	7	83.0
8	76.3	9	80.0	10	74.5	11	83.0	12	77.0	13	76.1	14	73.1
15	83.1	16	80.5	17	86.0	18	81.1	19	87.0	20	79.8	21	87.5
22	79.7	23	83.5	24	76.0	25	76.0	26	73.0	27	85.0	28	79.5
29	0.	30	0.	31	84.1	32	85.4	33	85.1	34	85.8	35	88.5
36	89.4	37	87.2	38	87.3	39	87.9	40	81.5	41	81.3	42	81.9
43	83.3	44	82.7	45	81.5	46	81.2	47	0.	48	72.0	49	71.1

TIME 500 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.8	3	85.0	4	78.0	5	86.0	6	78.8	7	83.2
8	76.4	9	82.0	10	75.9	11	84.0	12	77.9	13	76.2	14	72.9
15	88.0	16	80.5	17	88.0	18	81.1	19	87.0	20	79.9	21	87.5
22	79.9	23	84.5	24	78.2	25	75.7	26	72.8	27	85.0	28	79.1
29	0.	30	0.	31	84.2	32	85.4	33	85.2	34	85.7	35	88.2
36	89.3	37	86.2	38	87.3	39	87.9	40	81.5	41	81.4	42	82.0
43	83.3	44	83.0	45	80.5	46	81.2	47	0.	48	71.6	49	70.8

TIME 600 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.9	2	77.9	3	85.0	4	77.7	5	86.0	6	78.8	7	83.0
8	76.1	9	82.0	10	75.9	11	83.5	12	77.2	13	77.8	14	73.6
15	88.1	16	80.4	17	88.0	18	80.9	19	87.0	20	79.5	21	86.5
22	78.6	23	84.5	24	78.1	25	78.3	26	73.9	27	85.3	28	79.1
29	0.	30	0.	31	85.0	32	85.8	33	85.7	34	86.0	35	88.7
36	89.4	37	86.8	38	87.6	39	88.0	40	82.5	41	82.4	42	83.0
43	84.1	44	83.3	45	82.1	46	82.0	47	0.	48	75.1	49	70.6

TIME 700 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.2	2	77.6	3	85.6	4	78.0	5	86.0	6	78.1	7	84.0
8	78.0	9	82.0	10	75.5	11	84.0	12	77.3	13	79.0	14	74.1
15	88.5	16	80.6	17	88.0	18	81.0	19	87.2	20	75.6	21	88.0
22	80.0	23	86.0	24	79.3	25	80.1	26	74.6	27	86.1	28	79.5
29	0.	30	0.	31	86.0	32	86.5	33	86.4	34	86.9	35	89.0
36	89.9	37	87.4	38	88.0	39	88.6	40	83.1	41	83.7	42	84.0
43	85.5	44	84.0	45	83.6	46	82.7	47	0.	48	71.0	49	70.4

TIME 800 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.2	2	78.2	3	86.8	4	78.7	5	87.5	6	78.8	7	85.0
8	77.2	9	84.0	10	76.7	11	85.0	12	77.5	13	80.5	14	74.0
15	89.0	16	81.2	17	89.0	18	81.7	19	88.0	20	80.2	21	88.5
22	80.0	23	86.0	24	78.7	25	81.2	26	74.9	27	87.0	28	80.0
29	0.	30	0.	31	86.5	32	87.2	33	87.1	34	87.5	35	89.8
36	90.2	37	88.0	38	88.8	39	89.0	40	84.5	41	84.5	42	84.8
43	86.6	44	84.8	45	83.9	46	83.0	47	0.	48	71.0	49	70.4

TIME 900 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.5	2	78.7	3	88.4	4	79.0	5	89.5	6	79.4	7	87.2
8	77.8	9	86.5	10	76.6	11	88.0	12	78.7	13	85.0	14	74.5
15	90.0	16	81.6	17	90.0	18	82.6	19	89.2	20	80.9	21	90.0
22	81.1	23	89.0	24	79.2	25	85.2	26	76.5	27	85.0	28	81.0
29	0.	30	0.	31	88.2	32	89.2	33	89.2	34	85.6	35	91.1
36	91.5	37	90.0	38	90.2	39	90.7	40	87.5	41	87.3	42	87.2
43	88.8	44	86.3	45	87.0	46	84.6	47	0.	48	71.0	49	70.5

TIME 1000 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.2	3	90.4	4	79.7	5	91.0	6	80.2	7	89.5
8	78.5	9	89.0	10	77.8	11	90.0	12	79.7	13	88.5	14	76.5
15	91.5	16	83.3	17	92.0	18	84.5	19	91.0	20	82.5	21	92.0
22	83.0	23	89.5	24	78.8	25	88.2	26	78.7	27	91.1	28	83.3
29	0.	30	0.	31	91.4	32	91.2	33	91.6	34	91.4	35	92.6
36	93.0	37	91.8	38	92.1	39	92.3	40	90.1	41	90.0	42	90.0
43	91.0	44	88.0	45	90.0	46	86.0	47	0.	48	71.0	49	70.5

TIME 1100 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.5	2	80.0	3	91.8	4	80.3	5	92.0	6	80.6	7	91.0
8	79.6	9	90.0	10	78.0	11	91.0	12	79.6	13	90.4	14	77.2
15	92.5	16	81.0	17	93.0	18	85.2	19	92.0	20	83.2	21	93.0
22	83.7	23	93.0	24	81.2	25	91.3	26	79.9	27	92.5	28	85.6
29	0.	30	0.	31	92.9	32	92.8	33	92.4	34	92.8	35	93.8
36	94.1	37	93.2	38	93.5	39	93.8	40	91.9	41	91.5	42	91.4
43	92.2	44	88.9	45	91.2	46	86.8	47	0.	48	71.0	49	70.6

TIME 1200 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.8	2	80.3	3	93.0	4	80.9	5	93.5	6	81.3	7	92.2
8	79.7	9	92.0	10	79.0	11	92.0	12	79.8	13	92.0	14	77.3
15	93.5	16	85.0	17	94.0	18	85.5	19	93.0	20	83.8	21	94.0
22	84.4	23	93.0	24	80.3	25	91.4	26	79.9	27	93.6	28	89.4
29	0.	30	0.	31	94.0	32	93.8	33	93.5	34	93.8	35	94.8
36	95.0	37	94.2	38	94.6	39	94.8	40	93.0	41	92.8	42	92.8
43	91.7	44	89.7	45	93.0	46	87.3	47	0.	48	71.1	49	70.8

TIME 1300 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	93.2	2	81.0	3	93.5	4	81.5	5	94.0	6	82.3	7	93.0
8	80.2	9	92.5	10	79.3	11	93.0	12	80.2	13	92.5	14	77.9
15	94.2	16	85.6	17	94.5	18	86.4	19	94.0	20	84.8	21	94.5
22	84.5	23	93.0	24	80.4	25	94.0	26	81.2	27	94.0	28	90.2
29	0.	30	0.	31	94.6	32	94.5	33	94.2	34	94.5	35	95.4
36	95.8	37	94.9	38	95.3	39	95.5	40	93.9	41	93.4	42	93.2
43	94.0	44	90.0	45	92.9	46	87.6	47	0.	48	71.4	49	70.9

TIME 1400 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.8	2	80.5	3	93.0	4	81.1	5	94.0	6	82.0	7	92.2
8	79.9	9	92.0	10	79.3	11	92.0	12	79.3	13	92.5	14	77.4
15	94.0	16	85.3	17	94.0	18	85.5	19	94.0	20	84.5	21	94.5
22	84.7	23	93.0	24	80.5	25	93.0	26	80.8	27	93.5	28	90.1
29	0.	30	0.	31	93.9	32	94.0	33	93.7	34	94.1	35	95.2
36	95.8	37	94.8	38	95.1	39	95.3	40	93.2	41	92.8	42	92.9
43	93.6	44	89.8	45	92.7	46	87.4	47	0.	48	71.5	49	71.0

TIME 1500 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.6	3	93.0	4	81.1	5	94.0	6	82.2	7	92.4
8	79.5	9	92.0	10	79.0	11	92.0	12	79.3	13	92.5	14	77.5
15	94.0	16	85.3	17	95.0	18	86.9	19	94.0	20	84.6	21	95.0
22	85.1	23	93.0	24	80.0	25	93.0	26	80.8	27	93.5	28	90.2
29	0.	30	0.	31	94.0	32	93.9	33	93.8	34	94.2	35	95.3
36	95.9	37	94.8	38	95.2	39	95.5	40	93.4	41	93.0	42	93.0
43	93.3	44	90.9	45	92.9	46	87.7	47	0.	48	71.9	49	71.2

TIME 1600 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.6	3	93.0	4	81.4	5	94.0	6	82.4	7	92.3
8	79.7	9	92.0	10	79.0	11	92.5	12	80.0	13	92.0	14	77.5
15	94.0	16	85.1	17	95.0	18	87.6	19	94.0	20	84.5	21	95.0
22	85.1	23	93.0	24	78.9	25	92.4	26	80.5	27	93.0	28	90.0
29	0.	30	0.	31	93.6	32	93.5	33	93.1	34	94.0	35	95.1
36	95.	37	94.7	38	95.0	39	95.1	40	93.0	41	92.6	42	92.6
43	93.1	44	89.5	45	92.4	46	87.3	47	0.	48	72.0	49	71.7

TIME 1700 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	92.0	2	80.5	3	92.0	4	80.9	5	93.0	6	81.7	7	91.0
8	79.5	9	91.5	10	79.2	11	92.0	12	80.4	13	91.0	14	77.6
15	94.0	16	85.4	17	94.5	18	86.4	19	93.5	20	83.5	21	94.5
22	84.3	23	89.5	24	77.9	25	91.4	26	79.8	27	92.5	28	89.1
29	0.	30	0.	31	92.5	32	93.2	33	94.0	34	93.0	35	94.3
36	94.3	37	93.0	38	93.8	39	95.0	40	91.0	41	90.8	42	92.1
43	92.5	44	89.0	45	91.5	46	86.9	47	0.	48	73.0	49	72.0

TIME 1800 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	80.0	3	91.8	4	80.8	5	93.0	6	81.9	7	91.0
8	79.6	9	91.0	10	78.8	11	91.0	12	79.9	13	90.0	14	77.1
15	93.5	16	84.4	17	94.0	18	85.6	19	93.0	20	83.6	21	94.0
22	83.8	23	89.5	24	78.7	25	90.0	26	80.0	27	91.8	28	89.1
29	0.	30	0.	31	92.3	32	92.1	33	92.8	34	93.1	35	95.5
36	95.5	37	92.5	38	93.7	39	94.7	40	91.1	41	90.7	42	91.1
43	91.7	44	88.5	45	90.6	46	86.5	47	0.	48	72.9	49	72.1

TIME 1900 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	90.0	2	79.7	3	91.0	4	80.5	5	91.0	6	80.7	7	89.5
8	79.0	9	89.0	10	78.1	11	90.0	12	79.3	13	87.5	14	76.1
15	93.0	16	84.0	17	93.0	18	84.6	19	92.0	20	82.5	21	93.0
22	82.6	23	88.0	24	78.0	25	87.9	26	78.6	27	90.5	28	88.4
29	0.	30	0.	31	90.6	32	91.0	33	91.0	34	92.0	35	93.6
36	94.1	37	91.8	38	93.0	39	93.1	40	89.3	41	89.3	42	89.3
43	90.0	44	87.4	45	88.9	46	85.4	47	0.	48	73.0	49	72.5

TIME 2000 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	88.8	2	79.7	3	89.0	4	79.7	5	90.0	6	80.2	7	88.0
8	78.6	9	87.0	10	77.6	11	88.5	12	79.0	13	84.5	14	75.5
15	92.0	16	83.1	17	92.5	18	84.1	19	91.0	20	82.5	21	92.0
22	82.1	23	86.0	24	77.6	25	84.0	26	78.9	27	89.0	28	81.3
29	0.	30	0.	31	88.9	32	89.2	33	89.2	34	90.0	35	92.5
36	93.1	37	90.1	38	91.5	39	92.0	40	87.2	41	87.2	42	87.2
43	88.0	44	86.0	45	86.5	46	84.2	47	0.	48	73.0	49	72.9

TIME 2100 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	87.2	2	79.1	3	88.0	4	79.6	5	89.0	6	80.3	7	86.5
8	78.5	9	85.5	10	77.4	11	87.0	12	78.9	13	82.5	14	75.0
15	91.0	16	82.3	17	91.5	18	83.4	19	90.0	20	81.6	21	91.0
22	81.7	23	84.5	24	77.4	25	83.0	26	75.9	27	87.5	28	80.9
29	0.	30	0.	31	87.2	32	88.0	33	88.0	34	89.0	35	91.1
36	92.1	37	89.1	38	90.2	39	90.9	40	85.3	41	85.3	42	85.5
43	86.4	44	85.0	45	84.9	46	83.5	47	0.	48	73.0	49	72.2

TIME 2200 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	86.0	2	78.5	3	87.0	4	79.1	5	88.0	6	80.0	7	85.0
8	77.5	9	84.0	10	77.0	11	85.5	12	78.4	13	81.0	14	74.8
15	90.0	16	81.5	17	90.5	18	82.9	19	89.0	20	81.3	21	89.5
22	81.0	23	85.0	24	76.0	25	81.0	26	75.0	27	86.8	28	80.1
29	0.	30	0.	31	86.1	32	87.0	33	87.0	34	88.0	35	90.5
36	91.1	37	88.2	38	89.5	39	90.0	40	84.5	41	84.5	42	84.8
43	85.3	44	84.1	45	84.0	46	83.0	47	0.	48	73.0	49	72.8

TIME 2400 DATE 6/13/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.3	2	78.4	3	86.0	4	78.6	5	87.6	6	79.1	7	86.5
8	77.5	9	83.5	10	76.7	11	85.0	12	78.0	13	80.0	14	74.2
15	84.0	16	81.8	17	96.0	18	82.5	19	88.0	20	80.5	21	89.0
22	80.6	23	81.0	24	74.7	25	80.1	26	74.5	27	86.0	28	80.0
29	0.	30	0.	31	85.5	32	86.3	33	86.2	34	87.1	35	90.0
36	90.7	37	87.7	38	88.9	39	85.2	40	83.8	41	83.8	42	84.0
43	85.0	44	84.0	45	87.1	46	82.8	47	0.	48	73.5	49	73.0

TIME 2300 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	85.0	2	77.8	3	85.5	4	78.0	5	86.0	6	78.2	7	84.0
8	76.7	9	81.0	10	75.5	11	84.0	12	77.2	13	78.7	14	73.6
15	84.2	16	81.2	17	85.0	18	81.6	19	88.0	20	80.5	21	88.0
22	79.6	23	81.0	24	74.6	25	78.7	26	73.5	27	85.1	28	79.5
29	0.	30	0.	31	84.7	32	85.4	33	85.3	34	86.3	35	89.1
36	90.1	37	87.0	38	88.0	39	88.3	40	82.3	41	82.3	42	82.7
43	81.4	44	81.1	45	81.8	46	81.8	47	0.	48	73.2	49	72.8

TIME 2200 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.4	3	84.5	4	77.6	5	85.5	6	78.0	7	83.0
8	76.4	9	81.0	10	75.2	11	83.0	12	77.0	13	77.8	14	73.7
15	88.3	16	81.4	17	85.5	18	81.4	19	87.2	20	79.8	21	88.0
22	80.0	23	81.0	24	74.9	25	77.9	26	73.0	27	84.7	28	79.3
29	0.	30	0.	31	84.0	32	85.0	33	84.8	34	85.9	35	88.6
36	89.6	37	86.5	38	87.6	39	88.0	40	82.0	41	81.8	42	82.2
43	81.4	44	81.0	45	81.0	46	81.6	47	0.	48	73.2	49	72.8

TIME 2100 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	77.3	3	84.0	4	77.4	5	85.0	6	77.7	7	82.2
8	76.0	9	80.0	10	74.5	11	82.0	12	76.5	13	76.9	14	73.5
15	88.0	16	81.6	17	88.0	18	81.1	19	86.8	20	75.6	21	87.5
22	79.5	23	81.0	24	75.2	25	76.6	26	73.2	27	84.1	28	79.2
29	0.	30	0.	31	83.7	32	84.7	33	84.3	34	85.3	35	88.2
36	89.1	37	86.0	38	87.2	39	87.6	40	81.1	41	81.1	42	81.6
43	81.0	44	80.5	45	81.6	46	81.3	47	0.	48	73.2	49	72.8

TIME 2000 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	77.3	3	84.0	4	77.4	5	85.0	6	77.6	7	82.0
8	75.9	9	80.0	10	74.9	11	82.0	12	76.5	13	76.3	14	73.3
15	87.0	16	81.4	17	88.0	18	81.0	19	86.3	20	79.2	21	87.0
22	79.1	23	81.0	24	75.5	25	76.4	26	73.0	27	84.0	28	79.1
29	0.	30	0.	31	84.1	32	84.3	33	84.3	34	85.0	35	87.8
36	88.5	37	85.3	38	86.8	39	87.2	40	80.8	41	80.8	42	81.2
43	80.3	44	80.5	45	80.4	46	81.0	47	0.	48	73.2	49	72.8

TIME 1900 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.0	2	77.2	3	84.0	4	77.4	5	85.0	6	77.6	7	81.8
8	75.7	9	80.0	10	75.0	11	82.0	12	76.7	13	76.1	14	73.1
15	87.5	16	81.8	17	87.5	18	80.8	19	86.0	20	78.9	21	86.5
22	78.7	23	81.0	24	75.4	25	76.2	26	72.9	27	83.8	28	79.0
29	0.	30	0.	31	83.0	32	84.3	33	84.2	34	85.0	35	87.6
36	88.7	37	85.0	38	86.8	39	87.0	40	80.8	41	80.7	42	81.2
43	82.4	44	82.2	45	86.5	46	81.0	47	0.	48	73.2	49	72.7

TIME 1800 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.4	3	84.5	4	77.7	5	85.6	6	78.2	7	83.0
8	76.4	9	81.0	10	75.6	11	83.5	12	77.4	13	75.6	14	73.9
15	88.0	16	81.4	17	86.0	18	81.4	19	86.8	20	79.7	21	87.0
22	79.7	23	81.0	24	76.5	25	80.3	26	74.3	27	85.2	28	79.8
29	0.	30	0.	31	85.0	32	85.6	33	85.5	34	86.2	35	88.5
36	89.5	37	87.0	38	87.8	39	88.0	40	83.0	41	83.0	42	83.2
43	84.0	44	82.0	45	82.7	46	82.3	47	80.3	48	72.9	49	72.5

TIME 1700 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.7	2	77.4	3	84.9	4	77.7	5	86.6	6	78.2	7	83.0
8	76.4	9	81.0	10	75.6	11	83.5	12	77.4	13	75.6	14	73.9
15	88.0	16	81.6	17	86.0	18	81.4	19	86.8	20	79.7	21	87.0
22	79.7	23	81.0	24	76.5	25	80.3	26	74.3	27	85.2	28	79.8
29	0.	30	0.	31	85.0	32	85.6	33	85.5	34	86.2	35	88.5
36	89.5	37	87.0	38	87.8	39	88.0	40	83.0	41	83.0	42	83.2
43	84.0	44	82.0	45	82.7	46	82.3	47	80.3	48	72.9	49	72.5

TIME 1600 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.4	3	84.5	4	77.7	5	85.6	6	78.2	7	82.0
8	76.0	9	80.0	10	74.7	11	82.0	12	76.6	13	77.0	14	73.2
15	87.5	16	81.4	17	87.5	18	80.7	19	86.4	20	79.1	21	86.5
22	78.7	23	81.0	24	77.2	25	77.3	26	73.0	27	84.0	28	78.9
29	0.	30	0.	31	83.2	32	84.2	33	84.2	34	84.8	35	87.8
36	88.4	37	85.6	38	86.6	39	87.0	40	80.5	41	81.0	42	81.2
43	82.0	44	82.2	45	86.5	46	81.6	47	0.	48	72.8	49	72.6

TIME 1500 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	83.5	2	77.4	3	84.0	4	77.3	5	85.6	6	77.4	7	82.0
8	75.8	9	80.0	10	74.7	11	82.0	12	76.6	13	77.0	14	73.2
15	87.5	16	81.4	17	87.5	18	80.7	19	86.4	20	79.1	21	86.5
22	78.7	23	81.0	24	77.2	25	77.3	26	73.0	27	84.0	28	78.9
29	0.	30	0.	31	83.2	32	84.2	33	84.2	34	84.8	35	87.8
36	88.4	37	85.6	38	86.6	39	87.0	40	80.5	41	81.0	42	81.2
43	82.0	44	82.2	45	86.5	46	81.6	47	0.	48	72.8	49	72.6

TIME 1400 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.4	3	84.5	4	77.7	5	85.6	6	78.2	7	83.0
8	76.4	9	81.0	10	75.6	11	83.5	12	77.4	13	75.6	14	73.9
15	88.0	16	81.4	17	86.0	18	81.4	19	86.8	20	79.7	21	87.0
22	79.7	23	81.0	24	76.5	25	80.3	26	74.3	27	85.2	28	79.8
29	0.	30	0.	31	85.0	32	85.6	33	85.5	34	86.2	35	88.5
36	89.5	37	87.0	38	87.8	39	88.0	40	83.0	41	83.0	42	83.2
43	84.0	44	82.0	45	82.7	46	82.3	47	80.3	48	72.9	49	72.5

TIME 1300 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.4	3	84.5	4	77.7	5	85.6	6	78.2	7	83.0
8	76.4	9	81.0	10	75.6	11	83.5	12	77.4	13	75.6	14	73.9
15	88.0	16	81.4	17	86.0	18	81.4	19	86.8	20	79.7	21	87.0
22	79.7	23	81.0	24	76.5	25	80.3	26	74.3	27	85.2	28	79.8
29	0.	30	0.	31	85.0	32	85.6	33	85.5	34	86.2	35	88.5
36	89.5	37	87.0	38	87.8	39	88.0	40	83.0	41	83.0	42	83.2
43	84.0	44	82.0	45	82.7	46	82.3	47	80.3	48	72.9	49	72.5

TIME 1200 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	84.0	2	77.4	3	84.5	4	77.7	5	85.6	6	78.2	7	83.0
8	76.4	9	81.0	10	75.6	11	83.5	12	77.4	13	75.6	14	73.9
15	88.0	16	81.4	17	86.0	18	81.4	19	86.8	20	79.7	21	87.0
22	79.7	23	81.0	24	76.5	25	80.3	26	74.3	27	85.2	28	79.8
29	0.	30	0.	31	85.0	32	85.6	33	85.5	34	86.2	35	88.5
36	89.5	37	87.0	38	87.8	39	88.0	40	83.0	41	83.0	42	83.2
43	84.0	44	82.0	45	82.7	46	82.3	47	80.3	48	72.9	49	72.5

TIME 1100 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	79.8	3	91.0	4	80.3	5	92.0	6	80.9	7	90.0
8	78.9	9	90.0	10	78.0	11	90.5	12	78.9	13	90.0	14	76.6
15	92.3	16	84.3	17	92.5	18	84.2	19	92.0	20	83.1	21	92.5
22	83.2	23	93.0	24	81.8	25	92.0	26	79.1	27	92.0	28	89.1
29	0.	30	0.	31	92.4	32	92.4	33	92.1	34	92.8	35	93.6
36	94.1	37	93.1	38	93.5	39	93.5	40	91.6	41	91.1	42	91.1
43	92.1	44	88.8	45	91.0	46	87.0	47	0.	48	73.0	49	72.5

TIME 1000 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	94.8	2	79.3	3	90.0	4	80.0	5	90.9	6	80.1	7	88.8
8	79.0	9	80.5	10	77.9	11	89.0	12	78.7	13	88.0	14	76.2
15	91.2	16	83.2	17	92.0	18	84.4	19	90.6	20	82.5	21	91.5
22	82.5	23	92.0	24	81.6	25	88.2	26	78.0	27	90.4	28	87.0
29	0.	30	0.	31	90.8	32	90.9	33	90.5	34	91.0	35	92.3
36	92.9	37	91.6	38	91.9	39	92.0	40	89.3	41	89.1	42	89.2
43	90.3	44	87.2	45	85.2	46	85.7	47	0.	48	72.9	49	72.4

TIME 1900 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	83.8	3	91.0	4	83.1	5	92.0	6	84.3	7	89.4
8	82.1	9	89.5	10	82.8	11	90.5	12	83.5	13	79.3	14	73.7
15	91.5	16	83.9	17	92.0	18	85.4	19	92.0	20	85.6	21	92.5
22	84.5	23	88.0	24	80.8	25	78.8	26	74.0	27	92.3	28	86.1
29	0.	30	0.	31	92.1	32	92.8	33	92.5	34	90.1	35	92.3
36	92.9	37	91.5	38	91.9	39	93.0	40	88.5	41	90.0	42	91.2
43	90.0	44	87.3	45	87.3	46	84.9	47	0.	48	72.5	49	72.0

TIME 2000 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	84.5	3	92.0	4	84.3	5	93.0	6	85.4	7	90.0
8	82.5	9	90.0	10	82.6	11	91.0	12	83.5	13	77.0	14	73.6
15	91.0	16	83.4	17	91.5	18	84.6	19	91.0	20	83.7	21	91.5
22	84.0	23	89.0	24	81.6	25	77.0	26	73.3	27	92.5	28	86.5
29	0.	30	0.	31	92.5	32	93.4	33	93.4	34	89.2	35	91.9
36	92.8	37	91.0	38	92.0	39	92.0	40	87.8	41	89.6	42	91.0
43	89.5	44	87.0	45	86.0	46	77.0	47	0.	48	72.8	49	72.1

TIME 2100 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.3	2	84.3	3	92.0	4	84.6	5	93.0	6	85.6	7	89.8
8	82.7	9	89.0	10	82.7	11	90.0	12	83.6	13	76.0	14	73.0
15	90.8	16	83.3	17	91.0	18	84.5	19	90.3	20	83.5	21	91.0
22	84.0	23	91.0	24	84.0	25	76.0	26	72.9	27	92.0	28	86.5
29	0.	30	0.	31	91.8	32	93.0	33	93.0	34	88.6	35	91.3
36	92.1	37	90.0	38	91.2	39	91.3	40	87.0	41	89.0	42	90.2
43	89.0	44	86.5	45	85.0	46	83.6	47	0.	48	72.6	49	72.0

TIME 2200 DATE 6/14/1965

PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP	PT	TEMP
1	91.0	2	84.3	3	91.5	4	84.4	5	92.0	6	85.1	7	89.3
8	82.4	9	89.0	10	83.0	11	89.5	12	83.8	13	76.0	14	73.4
15	90.5	16	83.1	17	91.0	18	84.9	19	90.0	20	83.5	21	90.5
22	83.5	23	89.0	24	82.4	25	76.2	26	72.9	27	91.3	28	85.9
29	0.	30	0.	31	91.0	32	92.0	33	92.2	34	88.0	35	90.9
36	91.0	37	89.5	38	90.5	39	90.5	40	86.0	41	88.2	42	89.9
43	88.1	44	86.0	45	84.1	46	83.1	47	0.	48	72.5	49	72.1

APPENDIX C

Effective Temperature Distribution

CONFIGURATION NO 1-N
TEST NO. 1 (Minimum Shelter Response)
VENTILATION RATE 13.2 cfm/occ
AVG. SHELTER E.T. 83.3°
AVG. E.T. OF ROOM 1 83.5
2 80.9
3 86.3
4 86.4

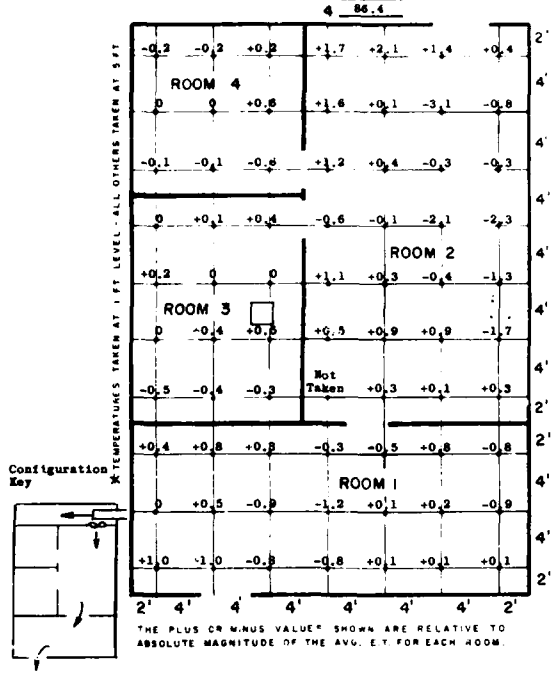

CONFIGURATION NO. 1-N
TEST NO. 1 (Maximum Shelter Response)
VENTILATION RATE 13.2 cfm/occ
AVG. SHELTER E.T. 89°
AVG. E.T. OF ROOM 1 87.5
2 87.7
3 92.4
4 91.2

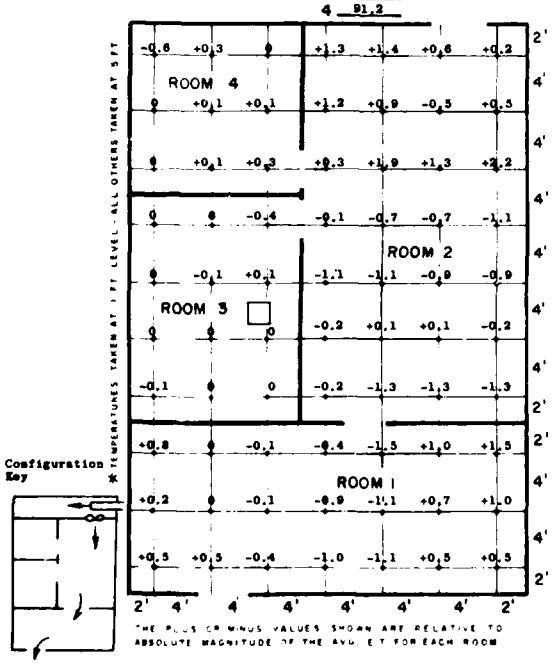

CONFIGURATION NO. 1-N
TEST NO. 2
VENTILATION RATE 13.27 cfm/occ
AVG. SHELTER E.T. 83.6°
AVG. E.T. OF ROOM 1 83.4
2 81.1
3 86.3
4 85.1

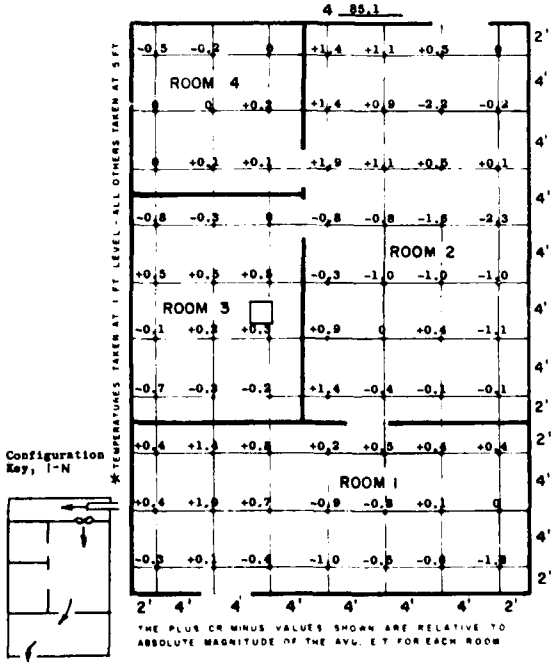

CONFIGURATION NO. 1-N
TEST NO. 3
VENTILATION RATE 13.5 cfm/occ
AVG. SHELTER E.T. 85.3°
AVG. E.T. OF ROOM 1 85.3
2 83.6
3 87.4
4 86.5

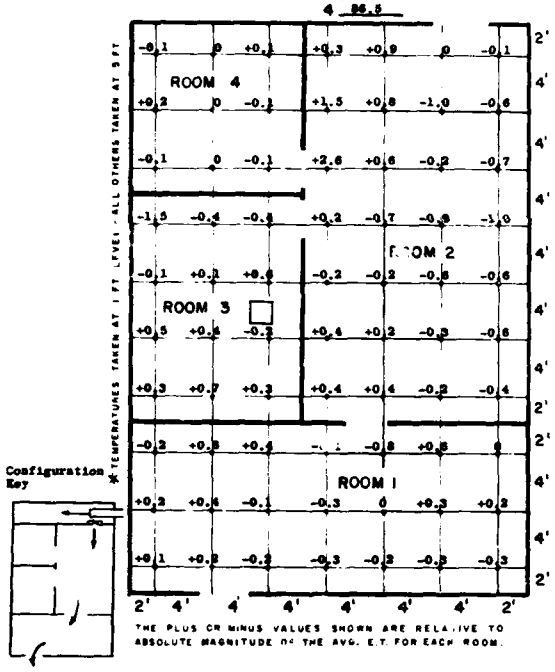

CONFIGURATION NO. 1-N
TEST NO. 4
VENTILATION RATE 13.4 cfm/occ
AVG. SHELTER E.T. 88.2°
AVG. E.T. OF ROOM 1 88.1
2 86.6
3 90.9
4 88.3

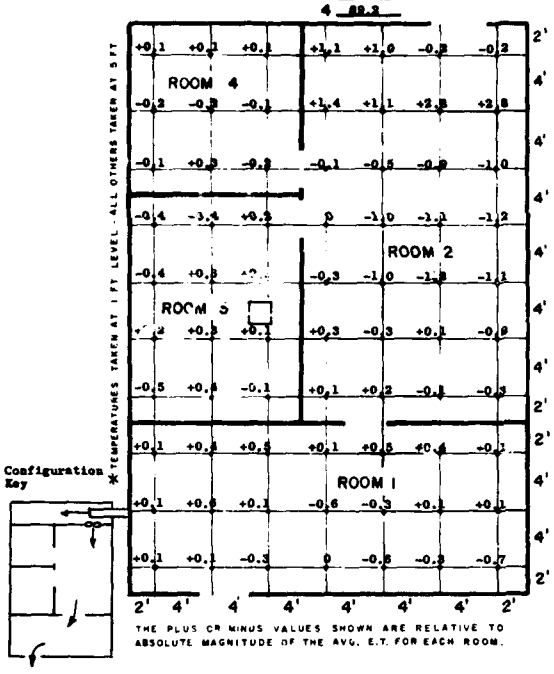

CONFIGURATION NO. 1-N
TEST NO. 5
VENTILATION RATE 17.91 cfm/occ
AVG. SHELTER E.T. 87.4°
AVG. E.T. OF ROOM 1 86.7
2 85.6
3 90.2
4 88.6

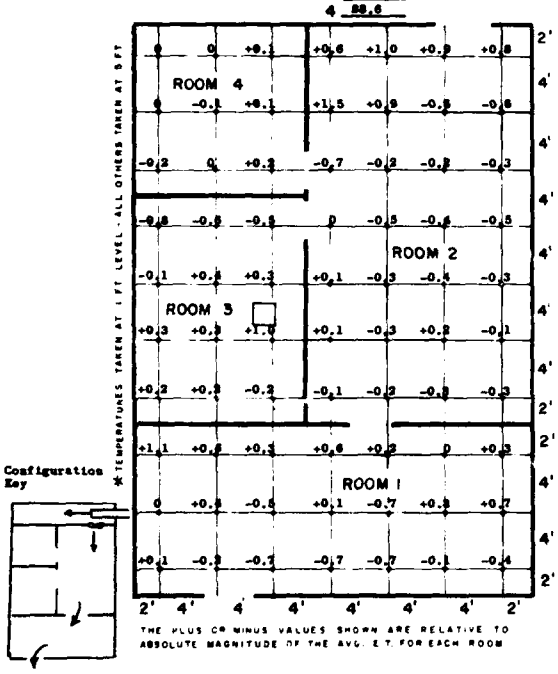

CONFIGURATION NO. 1-N
TEST NO. 6
VENTILATION RATE 17.9 cfm/occ
AVG. SHELTER E.T. 84.2°
AVG. E.T. OF ROOM 1 84.2
2 84.5
3 86.3
4 85.7

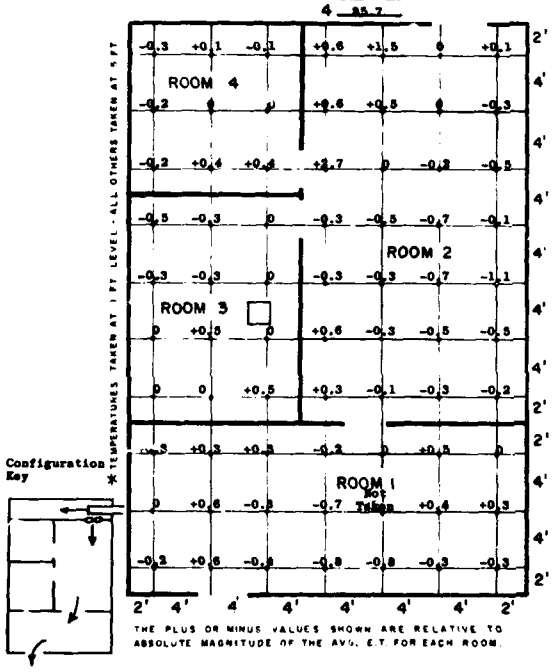

CONFIGURATION NO. 1-P
TEST NO. 18
VENTILATION RATE 13.3 cfm/occ
AVG. SHELTER E.T. ——
AVG. E.T. OF ROOM 1 ——
2 ——
3 83.4
4 82.8

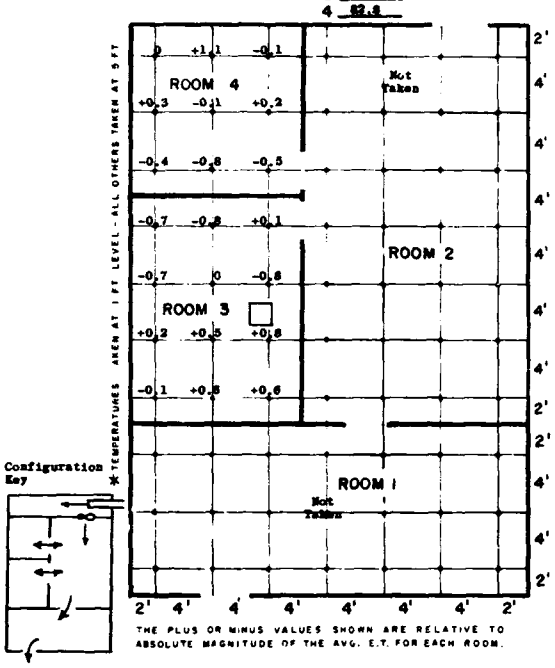

CONFIGURATION NO. 1-P
TEST NO. 18
VENTILATION RATE 17.91 cfm/occ
AVG. SHELTER E.T. 83.6°
AVG. E.T. OF ROOM 1 84.2
2 82.8
3 85.0
4 84.4

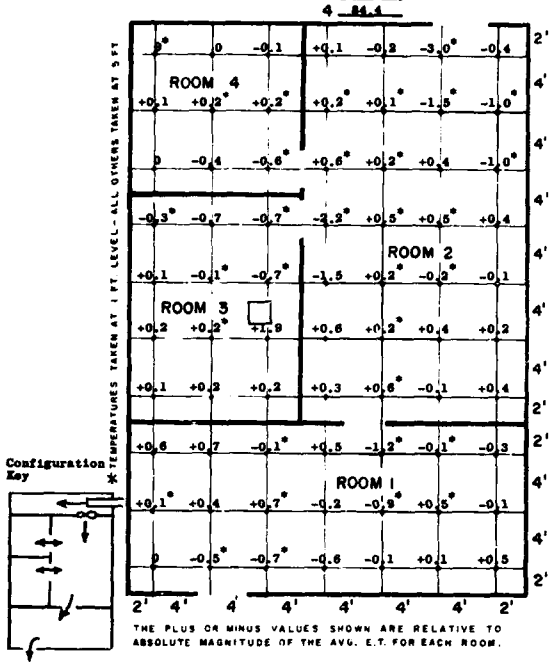

CONFIGURATION NO. 1-P
TEST NO. 19
VENTILATION RATE 19.0 cfm/occ
AVG. SHELTER E.T. 81.1°
AVG. E.T. OF ROOM 1 81.5
2 79.7
3 82.2
4 82.3

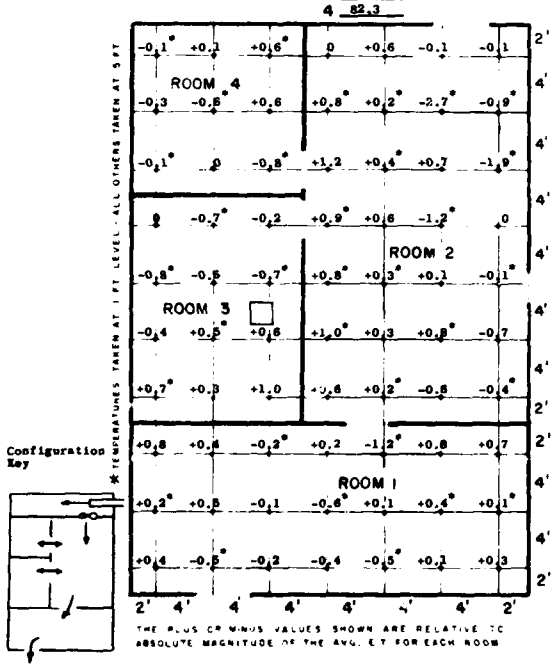

CONFIGURATION NO. 1-P
TEST NO. 20
VENTILATION RATE 22.5 cfm/occ
AVG. SHELTER E.T. 86.6°
AVG. E.T. OF ROOM 1 86.7
2 85.9
3 87.4
4 87.3

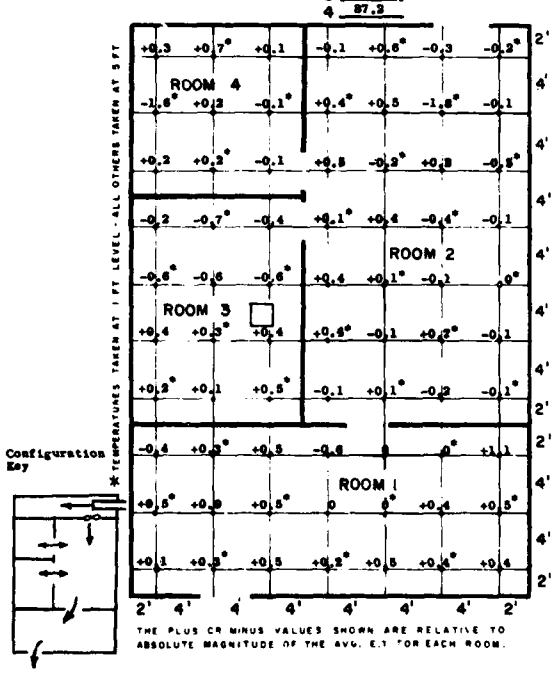

CONFIGURATION NO. 1-P
TEST NO. 21
VENTILATION RATE 22.5 cfm/occ
AVG. SHELTER E.T. 83.5°
AVG. E.T. OF ROOM 1 83.8
2 85.8
3 84.9
4 84.7

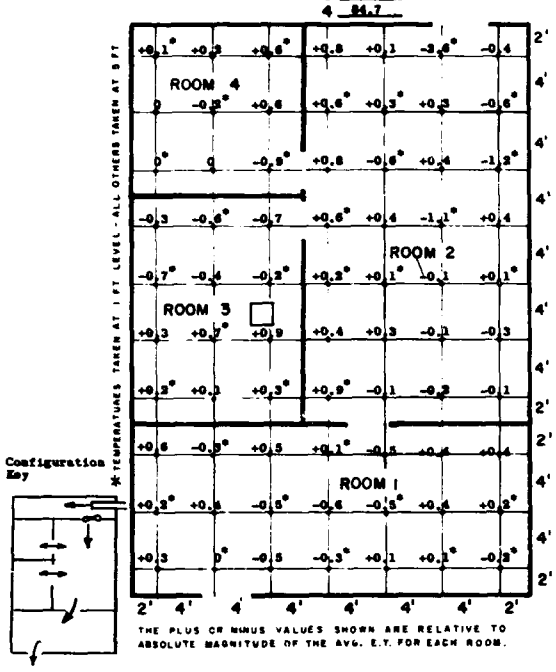

THE PLUS OR MINUS VALUES SHOWN ARE RELATIVE TO ABSOLUTE MAGNITUDE OF THE AVG. E.T. FOR EACH ROOM.

CONFIGURATION NO. 1-P
TEST NO. 24
VENTILATION RATE 13.3 cfm/occ
AVG. SHELTER E.T. 87.8°
AVG. E.T. OF ROOM 1 88.3
2 86.5
3 90.3
4 88.7

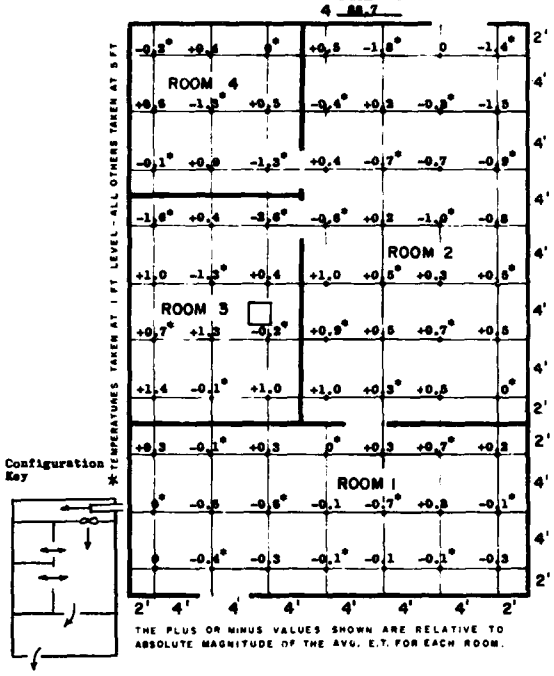

THE PLUS OR MINUS VALUES SHOWN ARE RELATIVE TO ABSOLUTE MAGNITUDE OF THE AVG. E.T. FOR EACH ROOM.

CONFIGURATION NO. 2-P
TEST NO. 37 (Maximum Shelter Response)
VENTILATION RATE 18
AVG. SHELTER E.T. 83.8°
AVG. E.T. OF ROOM 1 84.9
2 85.2
3 85.2
4 84.8

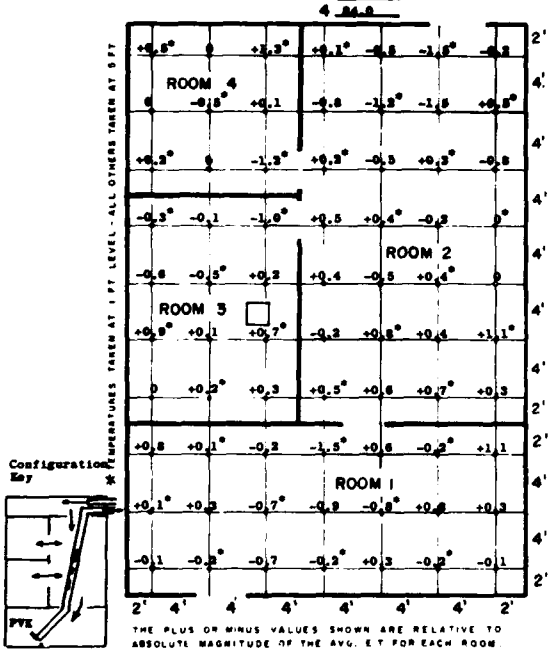

THE PLUS OR MINUS VALUES SHOWN ARE RELATIVE TO ABSOLUTE MAGNITUDE OF THE AVG. E.T. FOR EACH ROOM.

CONFIGURATION NO. 2-P
TEST NO. 38
VENTILATION RATE 10.8 cfm/occ
AVG. SHELTER E.T. 83.5°
AVG. E.T. OF ROOM 1 84.9
2 81.0
3 83.8
4 81.2

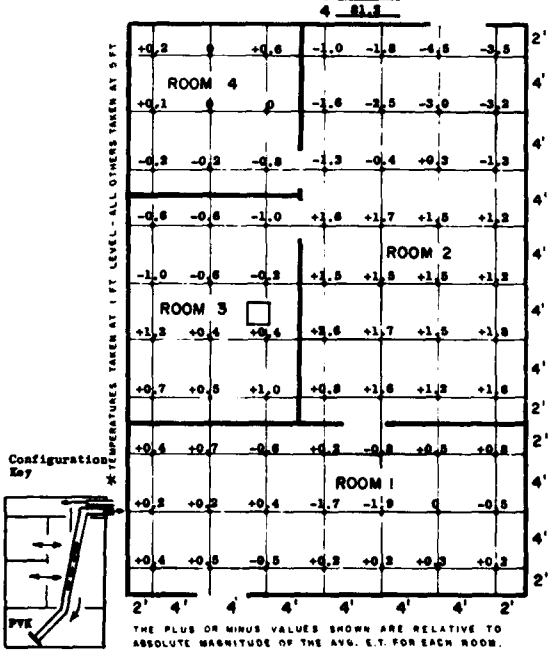

THE PLUS OR MINUS VALUES SHOWN ARE RELATIVE TO ABSOLUTE MAGNITUDE OF THE AVG. E.T. FOR EACH ROOM.

CONFIGURATION NO. 2-N
TEST NO. 39
VENTILATION RATE 10.5 cfm/occ
AVG. SHELTER E.T. 83.1°
AVG. E.T. OF ROOM 1 85.5
2 83.4
3 85.9
4 84.0

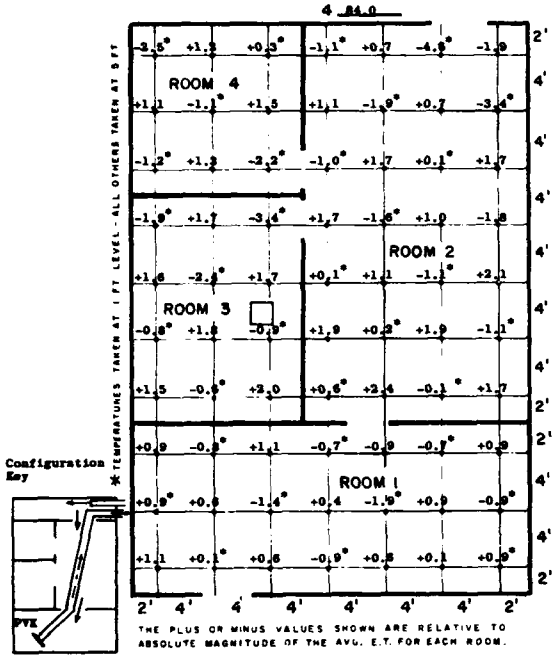

CONFIGURATION NO. 2-N
TEST NO. 40
VENTILATION RATE 10.5 cfm/occ
AVG. SHELTER E.T. 85.5°
AVG. E.T. OF ROOM 1 87.5
2 84.5
3 88.0
4 87.0

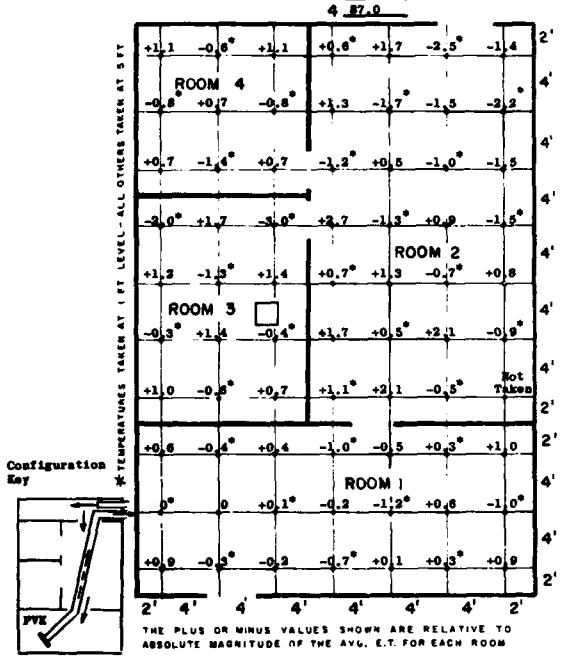

CONFIGURATION NO. 2-P
TEST NO. 41
VENTILATION RATE 10.5 cfm/occ
AVG. SHELTER E.T. 86.2°
AVG. E.T. OF ROOM 1 88.3
2 85.0
3 87.3
4 85.3

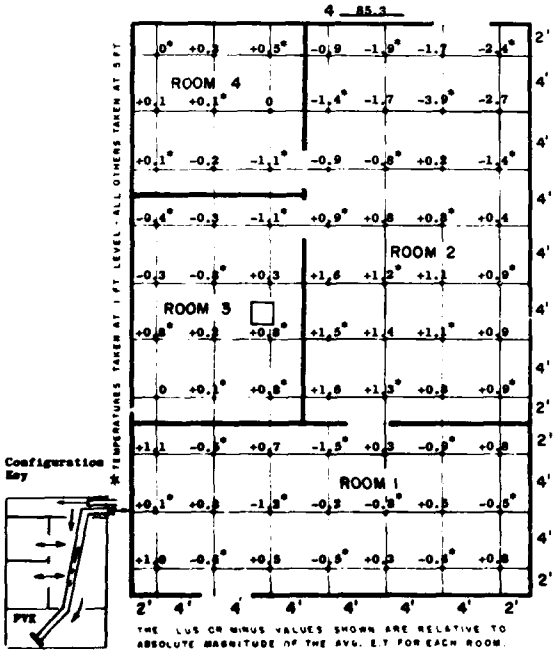

CONFIGURATION NO. 2-P
TEST NO. 42 (R)
VENTILATION RATE 8.0 cfm/occ
AVG. SHELTER E.T. 84.5°
AVG. E.T. OF ROOM 1 87.1
2 82.9
3 86.2
4 83.6

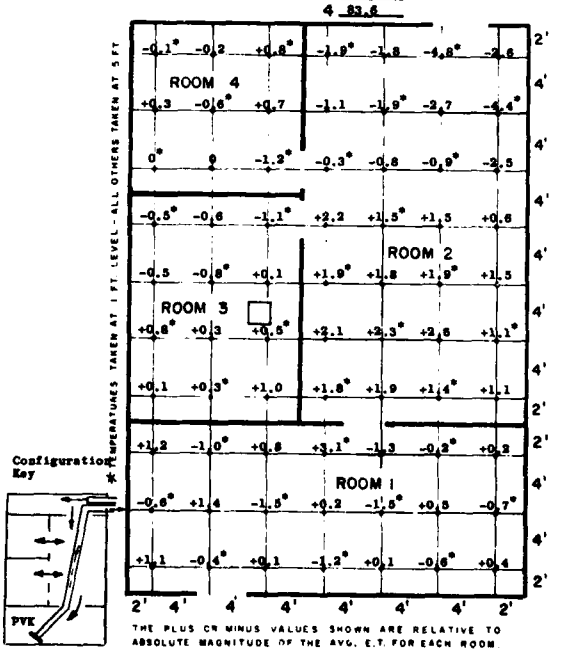

CONFIGURATION NO. 2-N
TEST NO. 43
VENTILATION RATE 8.0 cfm/occ
AVG. SHELTER E.T. 84.2°
AVG. E.T. OF ROOM 1 87.4
2 84.4
3 90.4
4 85.9

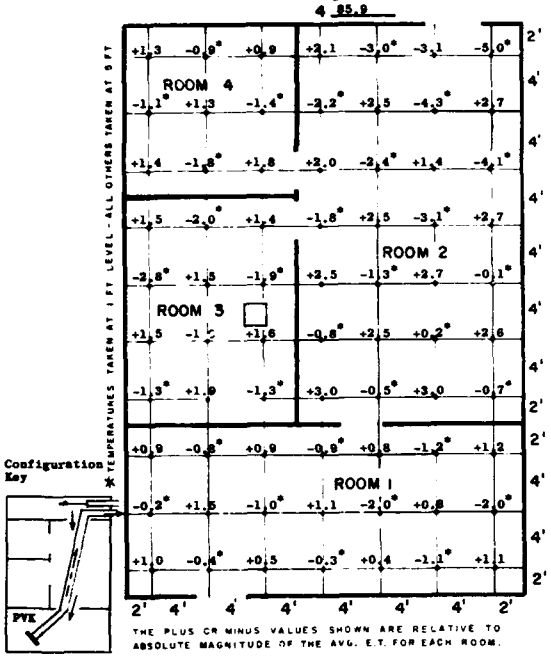

CONFIGURATION NO. 2-N
TEST NO. 44
VENTILATION RATE 22.1 cfm/occ
AVG. SHELTER E.T. 87.1°
AVG. E.T. OF ROOM 1 86.5
2 85.7
3 90.2
4 88.6

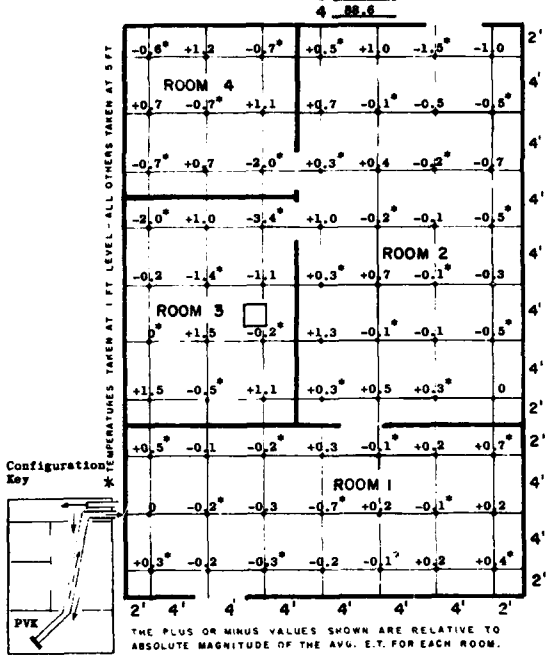

CONFIGURATION NO. 2-N
TEST NO. 46 (Minimum Shelter Response)
VENTILATION RATE 24.0 cfm/occ
AVG. SHELTER E.T. 80.0°
AVG. E.T. OF ROOM 1 80.2
2 78.3
3 83.1
4 82.0

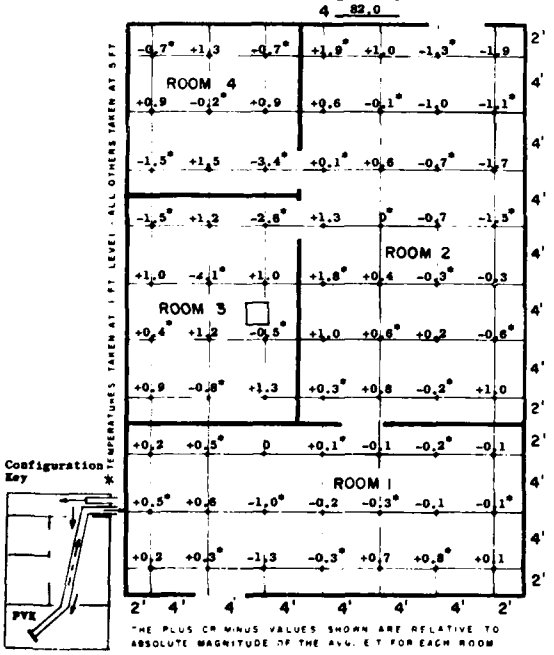

CONFIGURATION NO. 2-N
TEST NO. 46 (Maximum Shelter Response)
VENTILATION RATE 25.0 cfm/occ
AVG. SHELTER E.T. ——
AVG. E.T. OF ROOM 1 ——
2 85.6
3 89.5
4 88.6

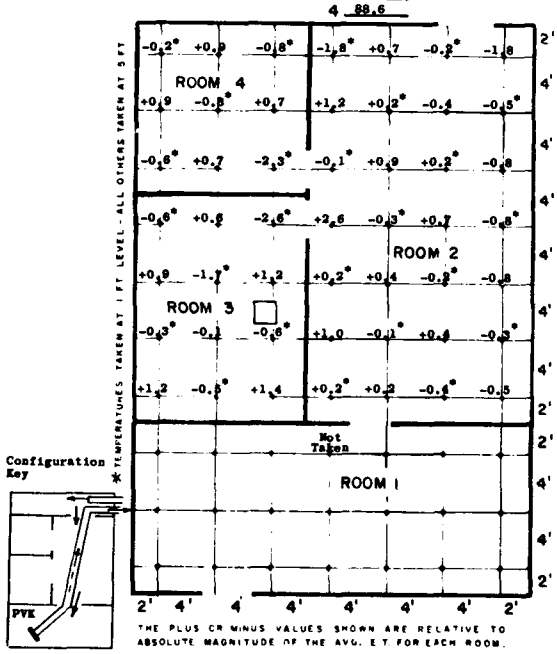

CONFIGURATION NO. 2-B
TEST NO. 47 (Maximum Shelter Response)
VENTILATION RATE 35 cfm/pcc
AVG. SHELTER E.T. 87.0°
AVG. E.T. OF ROOM 1 86.2
2 85.4
3 92.0
4 88.7

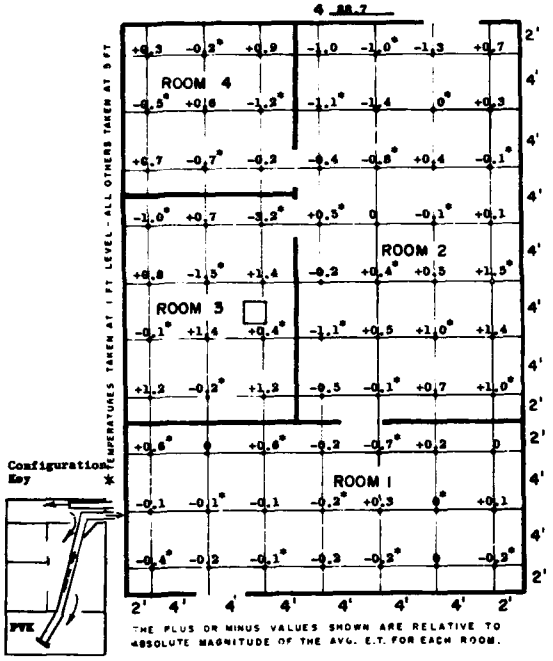

CONFIGURATION NO. 2-B
TEST NO. 47 (Maximum Shelter Response)
VENTILATION RATE 35 cfm/pcc
AVG. SHELTER E.T. ——
AVG. E.T. OF ROOM 1 ——
2 ——
3 91.3
4 89.5

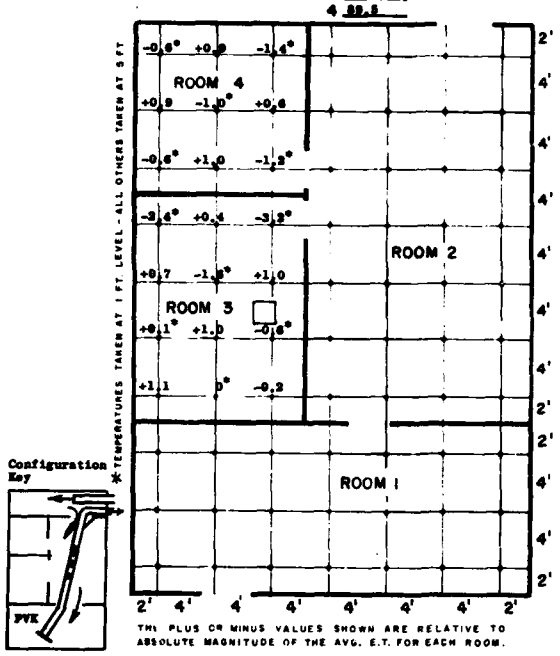

CONFIGURATION NO. 2-B
TEST NO. 47 (Minimum Shelter Response)
VENTILATION RATE 24 cfm/pcc
AVG. SHELTER E.T. ——
AVG. E.T. OF ROOM 1 ——
2 77.9
3 84.6
4 83.8

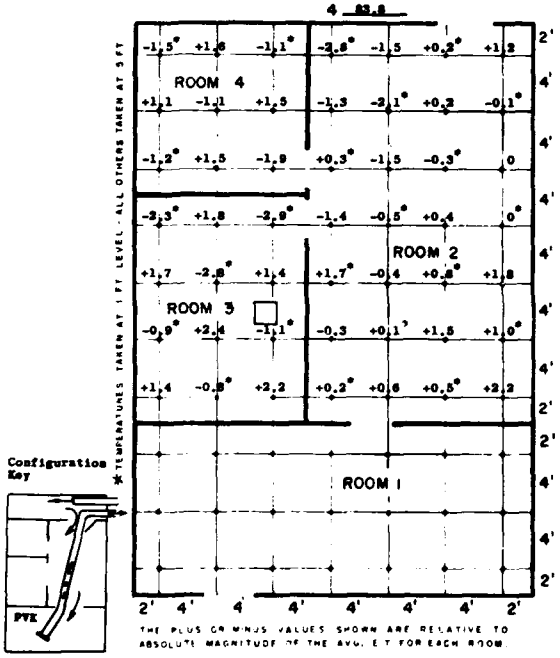

CONFIGURATION NO. 2-BP
TEST NO. 49 (Minimum Shelter Response)
VENTILATION RATE 35 cfm/pcc
AVG. SHELTER E.T. 79.3°
AVG. E.T. OF ROOM 1 79.9
2 78.1
3 80.4
4 79.0

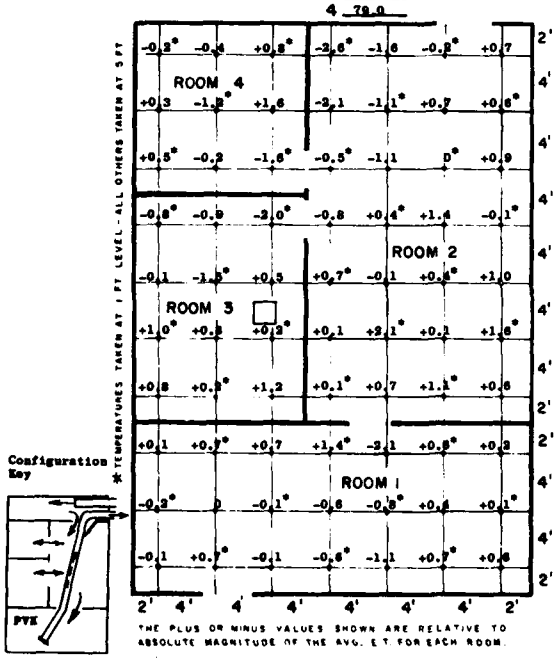

CONFIGURATION NO. 2-BP
TEST NO. 48 (Maximum Shelter Response)
VENTILATION RATE 24.5 cfm/occ
AVG. SHELTER E.T. 85.6°
AVG. E.T. OF ROOM 1 86.0
2 85.2
3 86.1
4 85.7

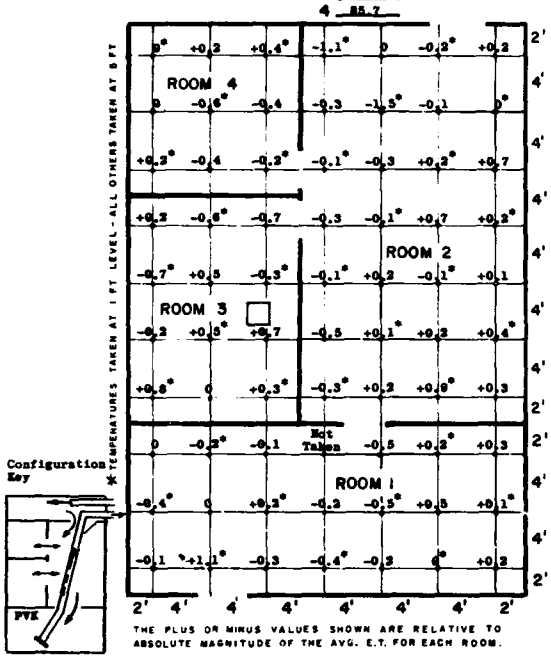

CONFIGURATION NO. 2-BP
TEST NO. 48 (Minimum Shelter Response)
VENTILATION RATE 25 cfm/occ
AVG. SHELTER E.T. 80.8°
AVG. E.T. OF ROOM 1 80.5
2 78.1
3 80.8
4 78.7

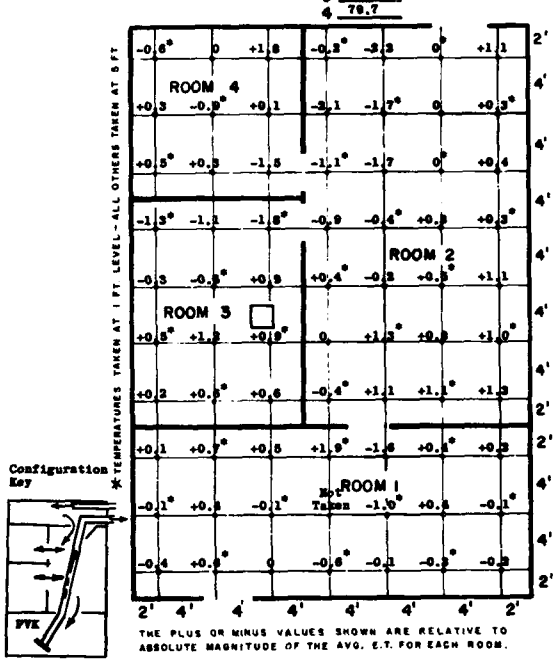

CONFIGURATION NO. 2-BP
TEST NO. 48 (Minimum Shelter Response)
VENTILATION RATE 25 cfm/occ
AVG. SHELTER E.T. 79.2°
AVG. E.T. OF ROOM 1 80.6
2 77.9
3 81.0
4 80.2

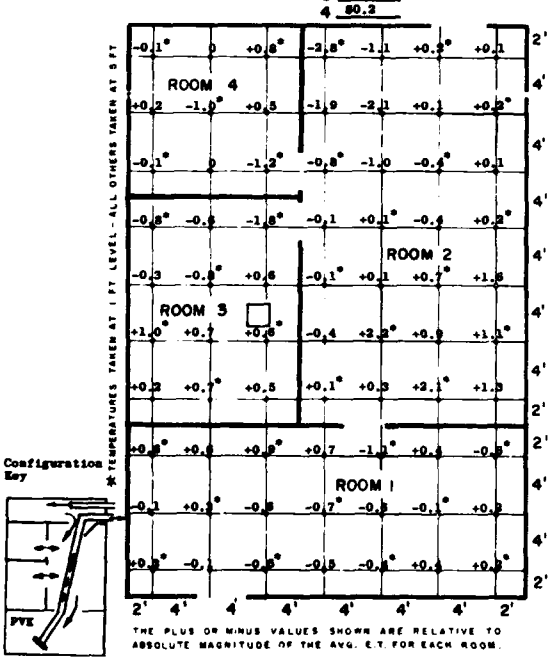

CONFIGURATION NO. 2-P
TEST NO. 50 (Maximum Shelter Response)
VENTILATION RATE 13.5 cfm/occ
AVG. SHELTER E.T. 86.0°
AVG. E.T. OF ROOM 1 87.0
2 85.6
3 87.2
4 87.0

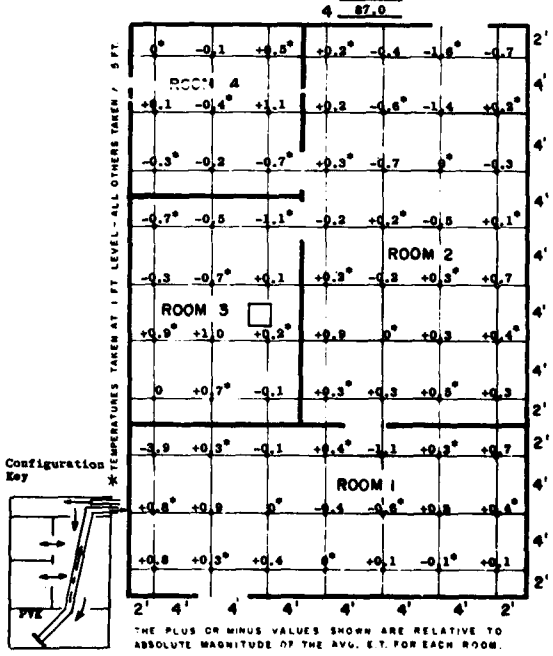

CONFIGURATION NO. 2-N
TEST NO. 51
VENTILATION RATE 22.0 cfm/occ
AVG. SHELTER E.T. 83.1°
AVG. E.T. OF ROOM 1 83.3
2 82.1
3 86.2
4 85.3

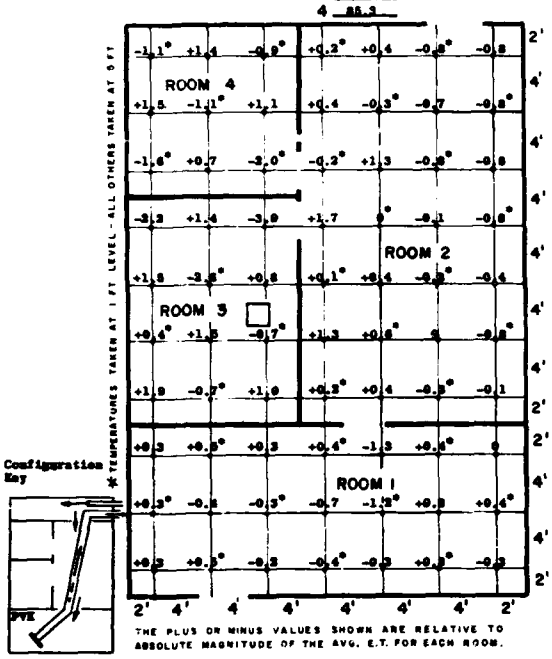

CONFIGURATION NO. 2-P
TEST NO. 52
VENTILATION RATE 22.0 cfm/occ
AVG. SHELTER E.T. 83.4°
AVG. E.T. OF ROOM 1 83.7
2 82.0
3 84.8
4 84.3

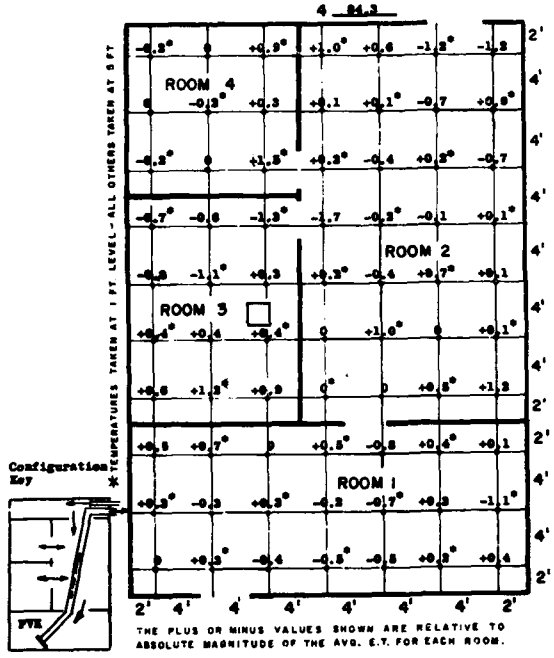

CONFIGURATION NO. 1-N
TEST NO. 53 (Maximum Shelter Response)
VENTILATION RATE 25 cfm/occ
AVG. SHELTER E.T. 86.6°
AVG. E.T. OF ROOM 1 86.2
2 85.4
3 88.9
4 88.5

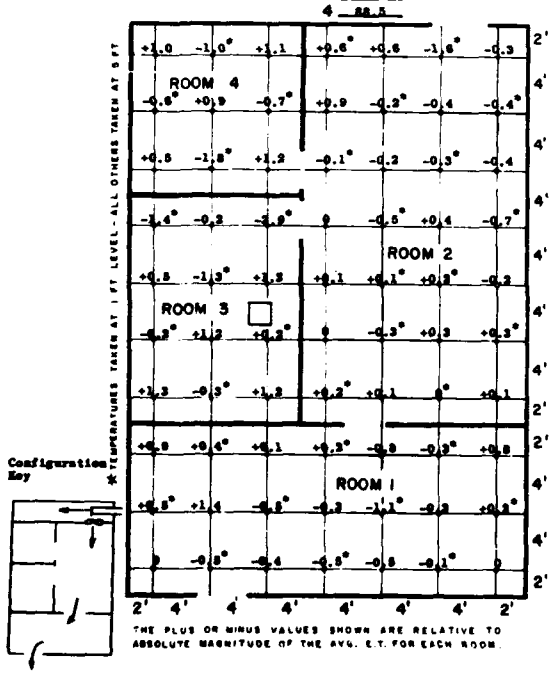

CONFIGURATION NO. 1-N
TEST NO. 54
VENTILATION RATE 8.0 cfm/occ
AVG. SHELTER E.T. 84.0°
AVG. E.T. OF ROOM 1 86.7
2 84.6
3 86.3
4 85.6

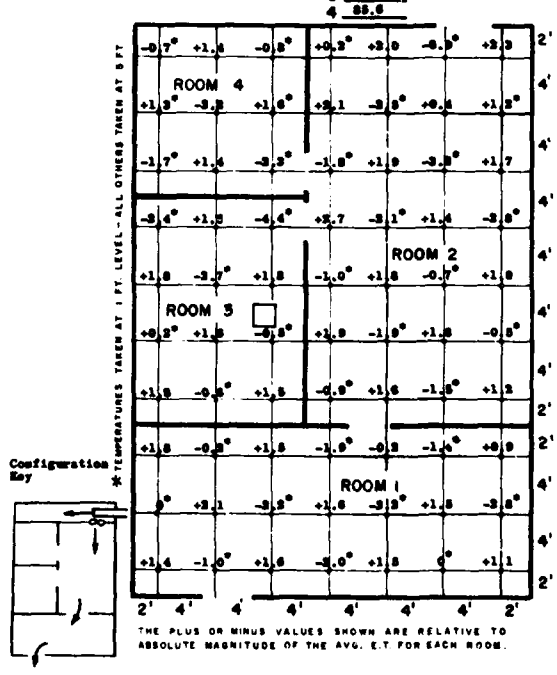

CONFIGURATION NO. 3-H
TEST NO. 55 (Minimum Shelter Response)
VENTILATION RATE 25.34 cfm/occ
AVG. SHELTER E.T. 79.7°
AVG. E.T. OF ROOM 1 80.3
2 80.9
3 77.3
4 75.9

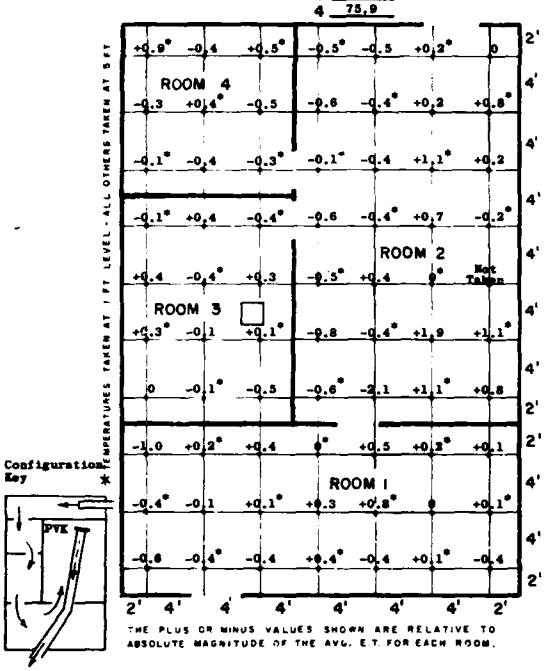

CONFIGURATION NO. 3-H
TEST NO. 55 (Maximum Shelter Response)
VENTILATION RATE 25 cfm/occ
AVG. SHELTER E.T. 85.5°
AVG. E.T. OF ROOM 1 85.2
2 86.1
3 84.8
4 84.2

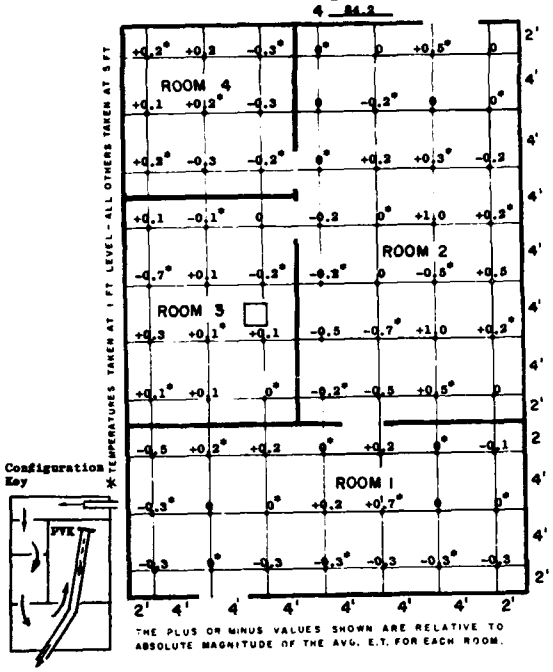

CONFIGURATION NO. 3-H
TEST NO. 56
VENTILATION RATE 18 cfm/occ
AVG. SHELTER E.T. 85.8°
AVG. E.T. OF ROOM 1 85.4
2 86.9
3 84.8
4 84.0

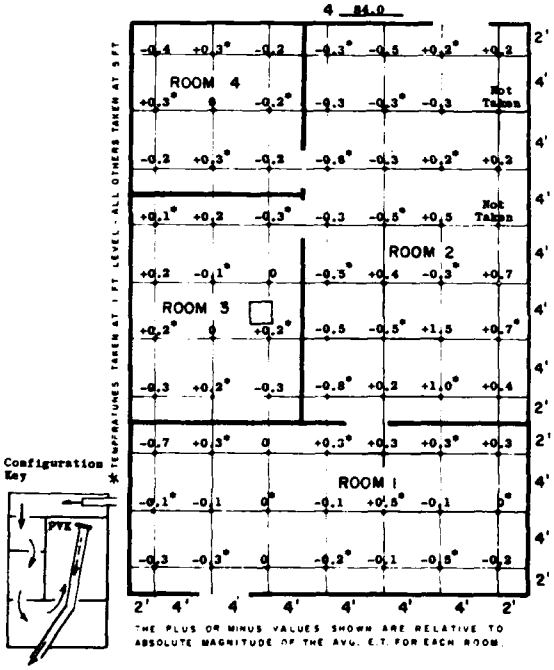

CONFIGURATION NO. 3-H
TEST NO. 57
VENTILATION RATE 18.0 cfm/occ
AVG. SHELTER E.T. 83.0°
AVG. E.T. OF ROOM 1 82.6
2 84.8
3 81.7
4 80.5

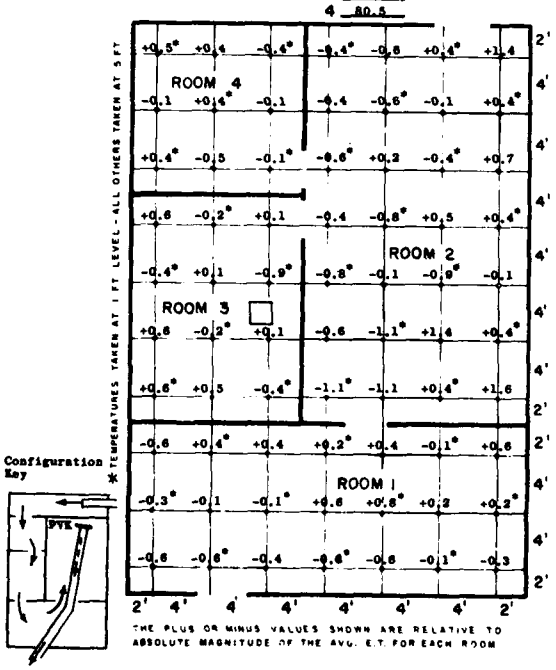

CONFIGURATION NO. 3-N
TEST NO. 58
VENTILATION RATE 18 cfm/occ
AVG. SHELTER E.T. 80.0°
AVG. E.T. OF ROOM 1 79.7
2 82.1
3 77.9
4 77.0

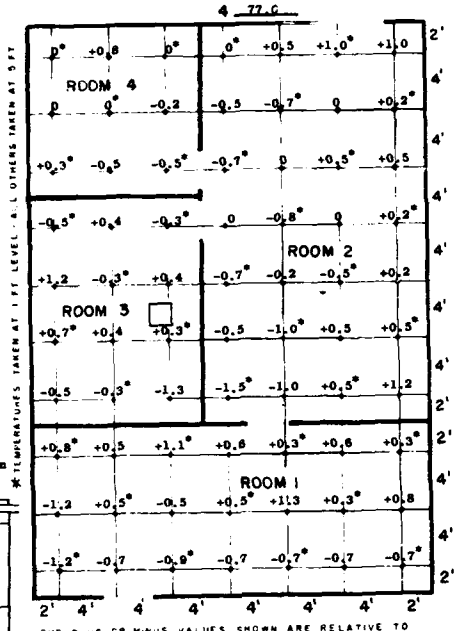

Configuration Key



CONFIGURATION NO. 3-N
TEST NO. 59
VENTILATION RATE 10.5 cfm/occ
AVG. SHELTER E.T. 82.6°
AVG. E.T. OF ROOM 1 82.0
2 85.2
3 79.5
4 76.7

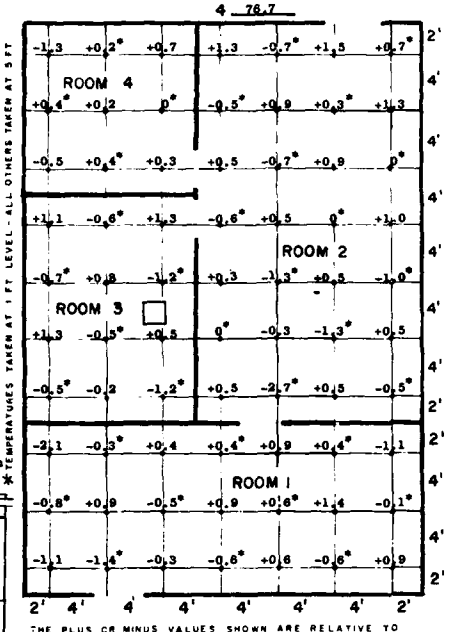

Configuration Key

CONFIGURATION NO. 3-N
TEST NO. 60
VENTILATION RATE 10.5 cfm/occ
AVG. SHELTER E.T. 84.7°
AVG. E.T. OF ROOM 1 84.5
2 87.6
3 82.5
4 81.5

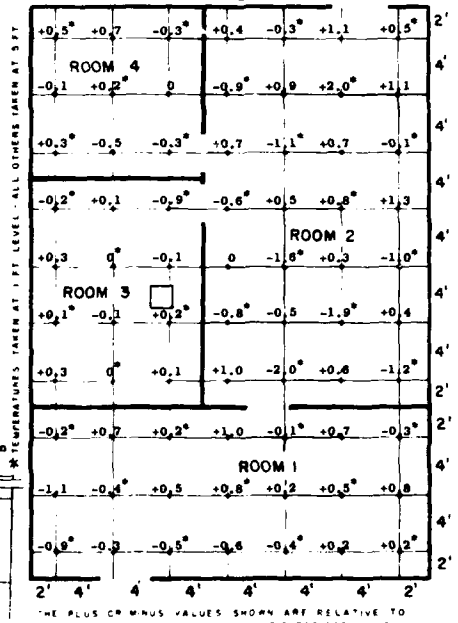

Configuration Key

CONFIGURATION NO. 3-N
TEST NO. 61
VENTILATION RATE 13.81 cfm/occ
AVG. SHELTER E.T. 86.4°
AVG. E.T. OF ROOM 1 85.8
2 87.5
3 84.8
4 84.1

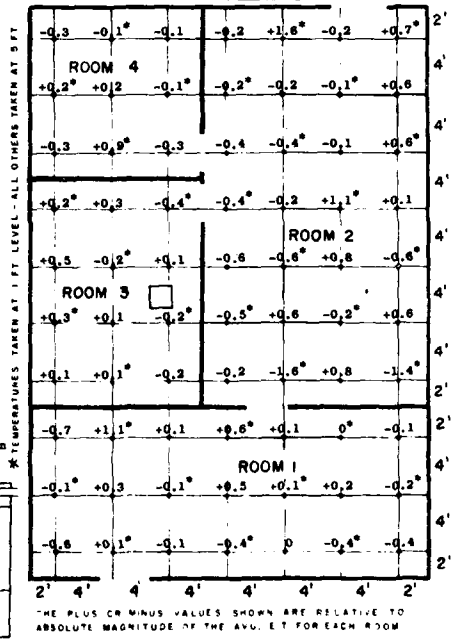

Configuration Key



CONFIGURATION NO 3-N
TEST NO. 62
VENTILATION RATE 13.5 cfm/occ
AVG. SHELTER E.T. 83.6°
AVG. E.T. OF ROOM 1 83.2
2 85.8
3 81.9
4 80.8

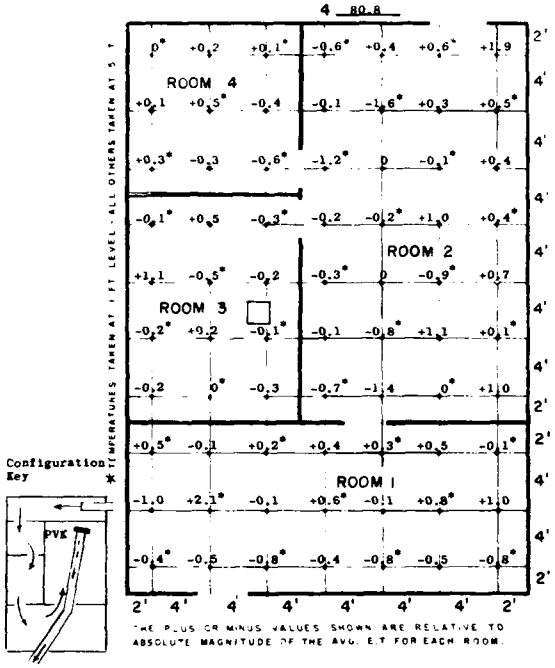

CONFIGURATION NO. 3-N
TEST NO. 63
VENTILATION RATE 13.5 cfm/occ
AVG. SHELTER E.T. 80.2°
AVG. E.T. OF ROOM 1 80.0
2 83.4
3 78.3
4 76.5

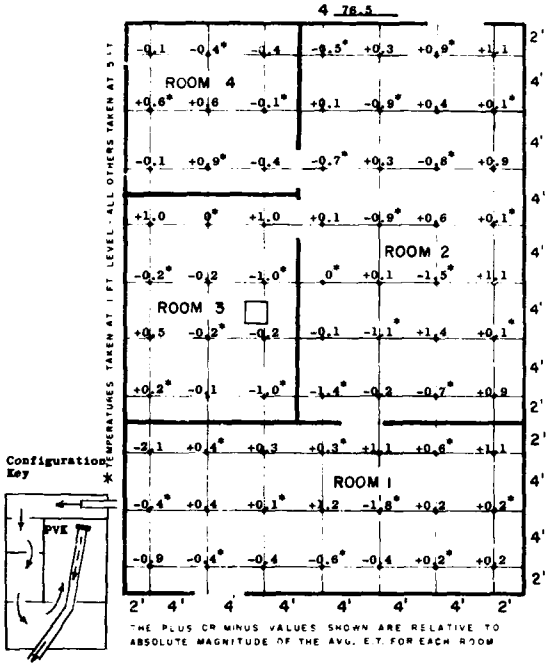

CONFIGURATION NO. 3-N
TEST NO. 64
VENTILATION RATE 8.1 cfm/occ
AVG. SHELTER E.T. 82.5°
AVG. E.T. OF ROOM 1 82.9
2 86.4
3 80.0
4 77.1

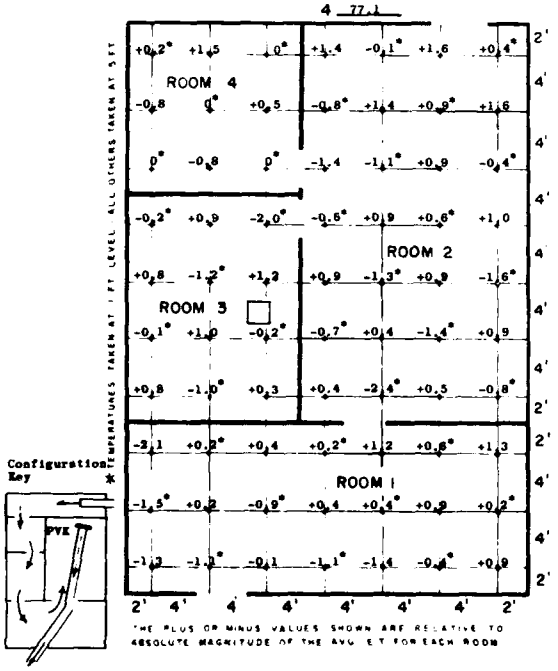

CONFIGURATION NO. 3-N
TEST NO. 65 (Maximum Shelter Response)
VENTILATION RATE 13.5 cfm/occ
AVG. SHELTER E.T. 86.5°
AVG. E.T. OF ROOM 1 86.4
2 88.3
3 85.5
4 84.7

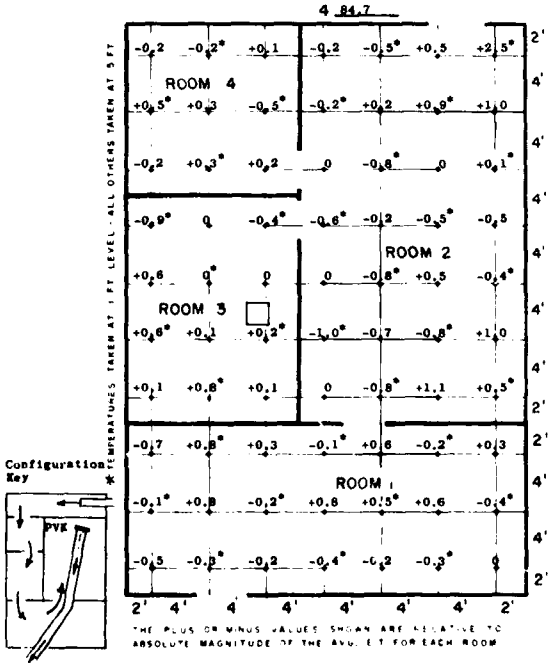

DISTRIBUTION LIST

ADDRESSEE	NO. OF COPIES
Lt. Col. Francis A. Sanders Standards and Criteria Branch Engineering Division AFOCE-ES, Room 5C365, Pentagon Washington, D.C. 20330	1
Mr. Edward R. Saunders Office of Emergency Planning Executive Office of the President Washington, D.C. 20504	1
Mr. Strode L. Ely Office of the Secretary of Defense Installations and Logistics Room 3C-771, Pentagon Washington, D.C. 20301	1
Chief, Defense Atomic Support Agency ATTN: Mr. John G. Lewis Washington, D.C. 20301	1
Dikewood Corporation 4805 Menual Boulevard, N.E. Albuquerque, New Mexico	1
The RAND Corporation 1700 Main Street ATTN: Dr. Harold Brode Santa Monica, California	1
Mr. Charles F. Coffin Planning Officer, Technical Analysis Division Office of Emergency Planning Executive Office of the President Washington, D.C. 20504	1
Director, U.S. Army Engineer Waterways Experiment Station Post Office Box 631 ATTN: Library Vicksburg, Mississippi	1
Office of the Secretary of the Army Office of Civil Defense ATTN: Assistant Director for CD (Research) Washington, D.C. 20310	42

ADDRESSEE	NO. OF COPIES
Army Library Civil Defense Unit The Pentagon Washington, D.C. 20310	3
Assistant Secretary of the Army (R & D) Washington, D.C. 20310 ATTN: Assistant For Research	1
Chief of Naval Research (Code 104) Department of the Navy Washington, D.C. 20350	1
Chief of Naval Operations (OP-07T10) Department of the Navy Washington, D.C. 20360	1
Chief, Bureau of Naval Weapons (Code RRRE-5) Department of the Navy Washington, D.C. 20360	1
Chief, Bureau of Medicine and Surgery Department of the Navy Washington, D.C. 20360	1
Chief, Bureau of Supplies and Accounts (Code L12) Department of the Navy Washington, D.C. 20360	1
Chief, Bureau of Yards and Docks Office of Research (Code 74) Department of the Navy Washington, D.C. 20360	1
U.S. Naval Civil Engineering Laboratory Port Hueneme, California	1
Civil Defense Technical Group ATTN: Mr. Paul E. Zigman U.S. Naval Radiological Defense Laboratory San Francisco, California 94135	1
Civil Defense Technical Office Stanford Research Institute ATTN: Mr. William L. White Menlo Park, California	1
Chief, Joint Civil Defense Support Group Office, Chief of Engineers Room G312, Gravelly Point Washington, D.C.	1

ADDRESSEE	NO. OF COPIES
Institute for Environmental Research ATTN: Dr. Ralph G. Nevins, Jr. Kansas State University Manhattan, Kansas	1
Department of Mechanical Engineering Syracuse University Syracuse, New York	1
Division of Health Mobilization Public Health Service Department of Health, Education, and Welfare ATTN: Chief, Research Branch Washington, D.C.	1
Engineering Research Laboratories ATTN: Professor Quentin R. Thomson College of Engineering University of Arizona Tucson, Arizona	1
The Franklin Institute ATTN: Dr. G.P. Wachtell Laboratories for Research & Development 20th & Benjamin Franklin Parkway Philadelphia 3, Pennsylvania	1
Department of Mechanical Engineering Montana State College ATTN: Professor C.F. Whitehill Bozeman, Montana	1
Division of Biology and Medicine ATTN: Dr. C.L. Dunham Atomic Energy Commission Washington, D.C.	1
Commanding Officer and Director Engineer Research & Development Lab. ATTN: Document Library Fort Belvoir, Virginia	1
Commanding Officer and Director ATTN: Document Library Quartermaster Research & Engineering Center Natick, Massachusetts	1
Mr. Walter F. Spiegel 405 Lodges Lane Elkins Park, Pennsylvania 19046	1

ADDRESSEE	NO. OF COPIES
IIT Research Institute 10 West 35th Street Chicago, Illinois	1
American Institutes for Research ATTN: Dr. James W. Altman 410 Amberson Avenue Pittsburgh, Pennsylvania 15232	1
University of Georgia Psychological Laboratories ATTN: Dr. John Hammes Athens, Georgia	1
Research Triangle Institute Post Office Box 490 ATTN: Dr. E.S. Parsons Durham, North Carolina	1
Hudson Institute Quaker Ridge Road ATTN: Mr. R.A. Krupka Harmon-on-Hudson, New York	1
Director, U.S. Army Waterways Experiment Station ATTN: Mr. G.L. Arbuthnot, Jr. Post Office Box 631 Vicksburg, Mississippi	1
ASHRAE Bibliographical Project New York University Research Building No. 1 University Heights ATTN: Mr. E.R. Kaiser	1
Mr. Carl Koontz Department of Civil Engineering Worcester Polytechnic Institute Worcester, Massachusetts	1
Mr. G.K. Vetter School of Architecture University of Colorado Boulder, Colorado	1
Mr. Charles H. Samson, Jr. Head, Civil Engineering Dept. Texas A.&M. University College Station, Texas	1
Mr. Franklin J. Agardy Department of Civil Engineering San Jose State College San Jose, California	1

ADDRESSEE	NO. OF COPIES
Chief of Engineers Department of the Army ATTN: ENGTE-E Washington, D.C. 20310	1
Protective Structures Development Center 7809 Telegraph Road ATTN: Technical Library Alexandria, Virginia 22310	20
Advisory Committee on Civil Defense National Academy of Sciences ATTN: Mr. Richard Park 2101 Constitution Avenue, N.W. Washington, D.C.	2
Defense Documentation Center Cameron Station Alexandria, Virginia 22310	20
National Bureau of Standards ATTN: Mr. Paul R. Achenbach Washington, D.C.	1
General American Research Division General American Transportation Corp. ATTN: Mr. G. Engholm 7501 North Natchez Avenue Niles, Illinois 60648	1
Department of Mechanical Engineering ATTN: Professor F.M. Flanigan University of Florida Gainesville, Florida 32603	1
Department of Mechanical Engineering ATTN: Professor Elmer Queer Pennsylvania State University University Park, Pennsylvania	1
Guy B. Panero, Inc. ATTN: Director of Research 468 Park Avenue South New York 16, New York	1
Battelle Memorial Institute ATTN: Dr. James A. Eibling 505 King Avenue Columbus 1, Ohio 43201	1

AD

UNCLASSIFIED

Protective Structures Development Center, Fort Belvoir, Va.
PSDC-TR-17, 15 July 1965
AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT, prepared by Engineering and Industrial Experiment Station, College of Engineering, University of Florida.

This report covers ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter. Individual simulated occupants were used. Conditioned ventilation air at the 1% high design day (Springfield, Va.) was delivered to the shelter at varying rates and thermal responses for shelter and individual rooms measured. A habitable thermal environment, as measured by 85° ET maximum, could not be maintained in all of the shelter rooms through a complete diurnal cycle in supply or exhaust at any ventilation rate tested (8 to 25 cfm per occupant) without auxiliary air moving devices (Punkah Pumps). At criterion 85° ET average, diurnal cycle, the entire shelter could be adequately ventilated by the PVK (exhaust) at 14 cfm per occupant with Punkah Pumps. For these same conditions with PVK as an air supply 16 cfm were required. Side rooms at diurnal cycle exceeded average 85° ET for all ventilation rates without Punkah Pumps.

1. Ventilation
   Package Ventilation Kit
   Air Distribution
   Thermal Environment
   Effective Temperature
   Punkah Pumps
   Protective Shelters

2. Contract No. DA-18-202-ENG-3580

I. Juan O. Gonzalez

II. David W. Taylor

UNCLASSIFIED

Security Classification

14. KEY WORDS	LINK A ROLE	LINK A WT	LINK B ROLE	LINK B WT	LINK C ROLE	LINK C WT
1. Ventilation						
Package Ventilation Kit						
Air Distribution						
Thermal Environment						
Effective Temperature						
Punkah Pumps						
Protective Shelters						
2. Contract No. DA-18-020-ENG-3580						
I. Juan O. Gonzalez						
II. David W. Taylor						

INSTRUCTIONS

1. ORIGINATING ACTIVITY: Enter the name and address of the contractor, subcontractor, grantee, Department of Defense activity or other organization *(corporate author)* issuing the report.

2a. REPORT SECURITY CLASSIFICATION: Enter the overall security classification of the report. Indicate whether "Restricted Data" is included. Marking is to be in accordance with appropriate security regulations.

2b. GROUP: Automatic downgrading is specified in DoD Directive 5200.10 and Armed Forces Industrial Manual. Enter the group number. Also, when applicable, show that optional markings have been used for Group 3 and Group 4 as authorized.

3. REPORT TITLE: Enter the complete report title in all capital letters. Titles in all cases should be unclassified. If a meaningful title cannot be selected without classification, show title classification in all capitals in parenthesis immediately following the title.

4. DESCRIPTIVE NOTES: If appropriate, enter the type of report, e.g., interim, progress, summary, annual, or final. Give the inclusive dates when a specific reporting period is covered.

5. AUTHOR(S): Enter the name(s) of author(s) as shown on or in the report. Enter last name, first name, middle initial. If military, show rank and branch of service. The name of the principal author is an absolute minimum requirement.

6. REPORT DATE: Enter the date of the report as day, month, year; or month, year. If more than one date appears on the report, use date of publication.

7a. TOTAL NUMBER OF PAGES: The total page count should follow normal pagination procedures, i.e., enter the number of pages containing information.

7b. NUMBER OF REFERENCES: Enter the total number of references cited in the report.

8a. CONTRACT OR GRANT NUMBER: If appropriate, enter the applicable number of the contract or grant under which the report was written.

8b, 8c, & 8d. PROJECT NUMBER: Enter the appropriate military department identification, such as project number, subproject number, system numbers, task number, etc.

9a. ORIGINATOR'S REPORT NUMBER(S): Enter the official report number by which the document will be identified and controlled by the originating activity. This number must be unique to this report.

9b. OTHER REPORT NUMBER(S): If the report has been assigned any other report numbers *(either by the originator or by the sponsor)*, also enter this number(s).

10. AVAILABILITY/LIMITATION NOTICES: Enter any limitations on further dissemination of the report, other than those imposed by security classification, using standard statements such as:

(1) "Qualified requesters may obtain copies of this report from DDC."

(2) "Foreign announcement and dissemination of this report by DDC is not authorized."

(3) "U. S. Government agencies may obtain copies of this report directly from DDC. Other qualified DDC users shall request through _____."

(4) "U. S. military agencies may obtain copies of this report directly from DDC. Other qualified users shall request through _____."

(5) "All distribution of this report is controlled. Qualified DDC users shall request through _____."

If the report has been furnished to the Office of Technical Services, Department of Commerce, for sale to the public, indicate this fact and enter the price, if known.

11. SUPPLEMENTARY NOTES: Use for additional explanatory notes.

12. SPONSORING MILITARY ACTIVITY: Enter the name of the departmental project office or laboratory sponsoring *(paying for)* the research and development. Include address.

13. ABSTRACT: Enter an abstract giving a brief and factual summary of the document indicative of the report, even though it may also appear elsewhere in the body of the technical report. If additional space is required, a continuation sheet shall be attached.

It is highly desirable that the abstract of classified reports be unclassified. Each paragraph of the abstract shall end with an indication of the military security classification of the information in the paragraph, represented as *(TS)*, *(S)*, *(C)*, or *(U)*.

There is no limitation on the length of the abstract. However, the suggested length is from 150 to 225 words.

14. KEY WORDS: Key words are technically meaningful terms or short phrases that characterize a report and may be used as index entries for cataloging the report. Key words must be selected so that no security classification is required. Idenfiers, such as equipment model designation, trade name, military project code name, geographic location, may be used as key words but will be followed by an indication of technical context. The assignment of links, rules, and weights is optional.

UNCLASSIFIED

Security Classification

S U M M A R Y

AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT

Technical Report Prepared for
The Protective Structures Development Center
Joint Civil Defense Support Group
Ft. Belvoir, Virginia

Prepared By

ENGINEERING AND INDUSTRIAL EXPERIMENT STATION
College of Engineering
University of Florida
Gainesville, Florida

This report covers ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter. Individual simulated occupants were used. Conditioned ventilation air at the 1% high design day (Springfield, Va.) was delivered to the shelter at varying rates and thermal responses for shelter and individual rooms measured. A habitable thermal environment, as measured by 85° ET maximum, could not be maintained in all of the shelter rooms through a complete diurnal cycle in supply or exhaust at any ventilation rate tested (8 to 25 cfm per occupant) without auxiliary air moving devices (Punkah Pumps). At criterion 85° ET average, diurnal cycle, the entire shelter could be adequately ventilated by the PVK (exhaust) at 14 cfm per occupant with Punkah Pumps. For these same conditions with PVK as an air supply 16 cfm were required. Side rooms at diurnal cycle exceeded average 85° ET for all ventilation rates without Punkah Pumps.

Contract No. DA-18-020-ENG-3580
Subtask 1217A

UNCLASSIFIED

Security Classification

DOCUMENT CONTROL DATA - R&D

(Security classification of title, body of abstract and indexing annotation must be entered when the overall report is classified)

1. ORIGINATING ACTIVITY *(Corporate author)* Engineering & Industrial Experiment Station College of Engineering, Univ. of Florida Gainesville, Florida	2a. REPORT SECURITY CLASSIFICATION 2b. GROUP

3. REPORT TITLE

Air Distribution in a Multi-Room Shelter Using a Package Ventilation Kit

4. DESCRIPTIVE NOTES *(Type of report and inclusive dates)*

Final report

5. AUTHOR(S) *(Last name, first name, initial)*

D. W. Taylor
Juan O. Gonzalez, Jr.

6. REPORT DATE 15 July 1965	7a. TOTAL NO. OF PAGES Eighty-three (83)	7b. NO. OF REFS Nine (9)
8a. CONTRACT OR GRANT NO. OCD-PS-65-17 b. PROJECT NO. 1200 c. Task No. 1210 d. Work Unit 1217A	9a. ORIGINATOR'S REPORT NUMBER(S) PSDC-TR-17 9b. OTHER REPORT NO(S) *(Any other numbers that may be assigned this report)*	

10. AVAILABILITY/LIMITATION NOTICES

11. SUPPLEMENTARY NOTES	12. SPONSORING MILITARY ACTIVITY Protective Structures Development Center Fort Belvoir, Virginia

13. ABSTRACT

This report covers ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter. Individual simulated occupants were used. Conditioned ventilation air at the 1% high design day (Springfield, Va.) was delivered to the shelter at varying rates and thermal responses for shelter and individual rooms measured. A habitable thermal environment, as measured by 85° ET maximum, could not be maintained in all of the shelter rooms through a complete diurnal cycle in supply or exhaust at any ventilation rate tested (8 to 25 cfm per occupant) without auxiliary air moving devices (Punkah Pumps). At criterion 85° ET average, diurnal cycle, the entire shelter could be adequately ventilated by the PVK (exhaust) at 14 cfm per occupant with Punkah Pumps. For these same conditions with PVK as an air supply 16 cfm were required. Side rooms at diurnal cycle exceeded average 85° ET for all ventilation rates without Punkah Pumps.

DD FORM 1 JAN 64 1473

UNCLASSIFIED

Security Classification

AD

Protective Structures Development Center, Fort Belvoir, Va.
PSDC-TR-17, 15 July 1965
AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT, prepared by Engineering and Industrial Experiment Station, College of Engineering, University of Florida.

This report covers ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter. Individual simulated occupants were used. Conditioned ventilation air at the 1% high design day (Springfield, Va.) was delivered to the shelter at varying rates and thermal responses for shelter and individual rooms measured. A habitable thermal environment, as measured by 85° ET maximum, could not be maintained in all of the shelter rooms through a complete diurnal cycle in supply or exhaust at any ventilation rate tested (8 to 25 cfm per occupant) without auxiliary air moving devices (Punkah Pumps). At criterion 85° ET average, diurnal cycle, the entire shelter could be adequately ventilated by the PVK (exhaust) at 14 cfm per occupant with Punkah Pumps. For these same conditions with PVK as an air supply 16 cfm were required. Side rooms at diurnal cycle exceeded average 85° ET for all ventilation rates without Punkah Pumps.

UNCLASSIFIED

1. Ventilation
   Package Ventilation Kit
   Air Distribution
   Thermal Environment
   Effective Temperature
   Punkah Pumps
   Protective Shelters

2. Contract No. DA-18-202-ENG-3580

I. Juan O. Gonzalez

II. David W. Taylor

AD

Protective Structures Development Center, Fort Belvoir, Va.
PSDC-TR-17, 15 July 1965
AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT, prepared by Engineering and Industrial Experiment Station, College of Engineering, University of Florida.

This report covers ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter. Individual simulated occupants were used. Conditioned ventilation air at the 1% high design day (Springfield, Va.) was delivered to the shelter at varying rates and thermal responses for shelter and individual rooms measured. A habitable thermal environment, as measured by 85° ET maximum, could not be maintained in all of the shelter rooms through a complete diurnal cycle in supply or exhaust at any ventilation rate tested (8 to 25 cfm per occupant) without auxiliary air moving devices (Punkah Pumps). At criterion 85° ET average, diurnal cycle, the entire shelter could be adequately ventilated by the PVK (exhaust) at 14 cfm per occupant with Punkah Pumps. For these same conditions with PVK as an air supply 16 cfm were required. Side rooms at diurnal cycle exceeded average 85° ET for all ventilation rates without Punkah Pumps.

UNCLASSIFIED

1. Ventilation
   Package Ventilation Kit
   Air Distribution
   Thermal Environment
   Effective Temperature
   Punkah Pumps
   Protective Shelters

2. Contract No. DA-18-202-ENG-3580

I. Juan O. Gonzalez

II. David W. Taylor

AD

Protective Structures Development Center, Fort Belvoir, Va.
PSDC-TR-17, 15 July 1965
AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT, prepared by Engineering and Industrial Experiment Station, College of Engineering, University of Florida.

This report covers ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter. Individual simulated occupants were used. Conditioned ventilation air at the 1% high design day (Springfield, Va.) was delivered to the shelter at varying rates and thermal responses for shelter and individual rooms measured. A habitable thermal environment, as measured by 85° ET maximum, could not be maintained in all of the shelter rooms through a complete diurnal cycle in supply or exhaust at any ventilation rate tested (8 to 25 cfm per occupant) without auxiliary air moving devices (Punkah Pumps). At criterion 85° ET average, diurnal cycle, the entire shelter could be adequately ventilated by the PVK (exhaust) at 14 cfm per occupant with Punkah Pumps. For these same conditions with PVK as an air supply 16 cfm were required. Side rooms at diurnal cycle exceeded average 85° ET for all ventilation rates without Punkah Pumps.

UNCLASSIFIED

1. Ventilation
   Package Ventilation Kit
   Air Distribution
   Thermal Environment
   Effective Temperature
   Punkah Pumps
   Protective Shelters

2. Contract No. DA-18-202-ENG-3580

I. Juan O. Gonzalez

II. David W. Taylor

AD

Protective Structures Development Center, Fort Belvoir, Va.
PSDC-TR-17, 15 July 1965
AIR DISTRIBUTION IN A MULTI-ROOM SHELTER USING A PACKAGE VENTILATION KIT, prepared by Engineering and Industrial Experiment Station, College of Engineering, University of Florida.

This report covers ventilation studies to determine the suitability of a Package Ventilation Kit (PVK) to adequately ventilate an adiabatic, compartmented, simulated protective shelter. Individual simulated occupants were used. Conditioned ventilation air at the 1% high design day (Springfield, Va.) was delivered to the shelter at varying rates and thermal responses for shelter and individual rooms measured. A habitable thermal environment, as measured by 85° ET maximum, could not be maintained in all of the shelter rooms through a complete diurnal cycle in supply or exhaust at any ventilation rate tested (8 to 25 cfm per occupant) without auxiliary air moving devices (Punkah Pumps). At criterion 85° ET average, diurnal cycle, the entire shelter could be adequately ventilated by the PVK (exhaust) at 14 cfm per occupant with Punkah Pumps. For these same conditions with PVK as an air supply 16 cfm were required. Side rooms at diurnal cycle exceeded average 85° ET for all ventilation rates without Punkah Pumps.

UNCLASSIFIED

1. Ventilation
   Package Ventilation Kit
   Air Distribution
   Thermal Environment
   Effective Temperature
   Punkah Pumps
   Protective Shelters

2. Contract No. DA-18-202-ENG-3580

I. Juan O. Gonzalez

II. David W. Taylor