



AFRL-RX-TY-TP-2009-4530

EMISSIONS PERFORMANCE OF A NOVEL COMBUSTOR BURNING SHREDDED WOOD (BRIEFING SLIDES)

Mikel Sawyer
Applied Research Associates
P.O. Box 40128
Tyndall Air Force Base, FL 32403

Chris Lindsey and Ali Schmidt
ANTARES Group Incorporated
4351 Garden City Drive
Landover, MD 20785

Paul Aubrey and Adam Webster
Clean Flame Energy
P.O. Box 335
Scarborough, ME 04070

May 2009

**Distribution Statement A:
Approved for public release; distribution unlimited.**

This work will be presented at NAWTEC17, the 17th Annual North American Waste to Energy Conference, 18-20 May 2009, Chantilly, VA.

**AIRBASE TECHNOLOGIES DIVISION
MATERIALS AND MANUFACTURING DIRECTORATE
AIR FORCE RESEARCH LABORATORY
AIR FORCE MATERIEL COMMAND
139 BARNES DRIVE, SUITE 2
TYNDALL AIR FORCE BASE, FL 32403-5323**

REPORT DOCUMENTATION PAGE


*Form Approved
OMB No. 0704-0188*

The public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing the burden, to Department of Defense, Washington Headquarters Services, Directorate for Information Operations and Reports (0704-0188), 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302. Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number.

PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ADDRESS.

1. REPORT DATE (DD-MM-YYYY) 05-MAY-2009		2. REPORT TYPE Conference Presentation		3. DATES COVERED (From - To) 01-JAN-2008 -- 31-DEC-2008	
4. TITLE AND SUBTITLE Emissions Performance of a Novel Combustor Burning Shredded Wood (BRIEFING SLIDES)				5a. CONTRACT NUMBER FA4819-07-D-0001	
				5b. GRANT NUMBER	
				5c. PROGRAM ELEMENT NUMBER 99999F	
6. AUTHOR(S) *Lindsey, Chris; +Sawyer, Mikel; *Schmidt, Ali; **Aubrey, Paul; **Webster, Adam				5d. PROJECT NUMBER GOVT	
				5e. TASK NUMBER 00	
				5f. WORK UNIT NUMBER Q240FD6G	
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) + Applied Research Associates, P.O. Box 40128, Tyndall Air Force Base, FL 32403 * ANTARES Group Incorporated, 4351 Garden City Drive, Landover, MD 20785 **Clean Flame Energy, P.O. Box 355, Scarborough, ME 04070				8. PERFORMING ORGANIZATION REPORT NUMBER	
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES) Air Force Research Laboratory Materials and Manufacturing Directorate Airbase Technologies Division 139 Barnes Drive, Suite 2 Tyndall Air Force Base, FL 32403-5323				10. SPONSOR/MONITOR'S ACRONYM(S) AFRL/RXQF	
				11. SPONSOR/MONITOR'S REPORT NUMBER(S) AFRL-RX-TY-TP-2009-4530	
12. DISTRIBUTION/AVAILABILITY STATEMENT Distribution Statement A: Approved for public release; distribution unlimited.					
13. SUPPLEMENTARY NOTES Ref AFRL/RXQ Public Affairs Case #09-064. Document contains color images. For presentation at the 17th Annual North American Waste-to-Energy Conference (NAWTEC17), 18-20 May 2009, Chantilly VA.					
14. ABSTRACT <p>This is a presentation-format of report AFRL-RX-TY-TP-2009-4508 by the same name. The Air Force Research Laboratory, Airbase Technologies Division (AFRL/RXQ) is engineering and evaluating a Transportable Waste to Energy System (TWES). This trailer-mounted system will convert military base waste and biomass waste streams to useful heat and power. The Department of Energy (DOE) Federal Energy Management Program (FEMP) is a TWES funding partner. The first stage of the project is a suspension-type combustor (furnace). The furnace has been built and tested. A key feature of the furnace system is its unique patented combustion coil design. The design is intended to maximize ablative heat transfer as well as provide increased particle residence time. The innovative features of the design are targeted at ensuring that the system can be highly fuel-flexible to convert a variety of organic and non-organic waste streams to energy while demonstrating very low emissions.</p> <p>In AD 2008, the unit underwent two days of emissions stack testing using established EPA testing protocols. During the testing extensive real-time data was also collected. This briefing and technical paper will present data and corresponding analysis of recently performed emission testing for the unit while utilizing dry wood chips as a control fuel. The data will be compared to publicly available information for similarly sized units. Key combustion efficiency factors, such as Loss on Ignition (LOI), carbon monoxide emissions and nitrogen oxide emissions are presented. Detailed emission comparisons with commercial and other experimental systems for small biomass combustion units are also presented. The in-progress construction of the TWES is discussed.</p>					
15. SUBJECT TERMS combustor, furnace, emissions, shredded wood, Transportable Waste to Energy System (TWES), air-to-fuel ratio, solid waste					
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT UU	18. NUMBER OF PAGES 25	19a. NAME OF RESPONSIBLE PERSON Waltz, Walt
a. REPORT U	b. ABSTRACT U	c. THIS PAGE U			19b. TELEPHONE NUMBER (Include area code)

Reset

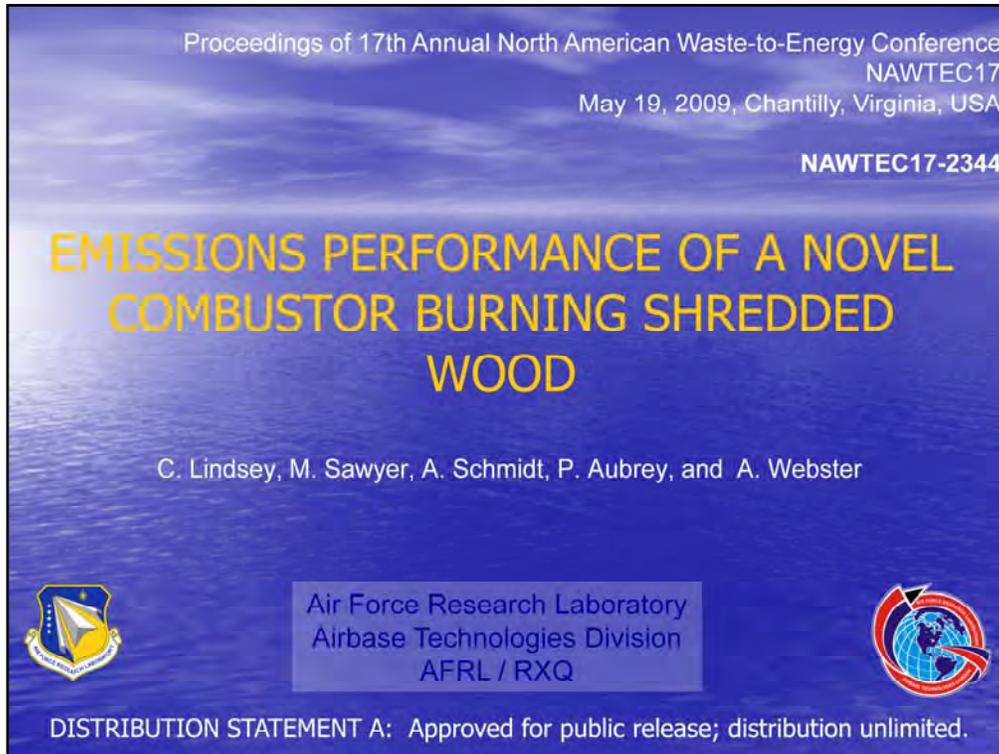

•The content of this presentation document is based on the paper by the same name. Loss-on-Ignition results have been added. This presentation also includes graphs for emissions trends that were discussed in the paper, but were not shown graphically.

Authors

C. Lindsey

ANTARES Group Incorporated
Landover, Maryland, USA

M. Sawyer

Contractor with Applied Research Associates, Inc. at Air Force Research Laboratory (AFRL),
Airbase Technologies Division (RXQ)
Florida, USA

A. Schmidt

ANTARES Group Incorporated
Landover, Maryland, USA

P. Aubrey

Clean Flame Energy Scarborough, ME

A. Webster

formerly with Clean Flame Energy Scarborough, ME

EMISSIONS -- Outline

- Purpose and Background
- Description of Furnace
- Emissions Test Execution
- Emissions Test Results
 - Data
 - Comparison with EPA & TVA
- Next Steps

NAWTEC17-2344

2

EPA = U.S. Environmental Protection Agency

TVA = Tennessee Valley Authority, small combustor tests using wood.

Disposal Need @ Deployed Military Base

- Trash *OR* Fuel!

- Shipping materials: pallets, plastic wrap, foam pellets, cardboard boxes, etc.
- Worn-out supplies: clothing, tents, wooden or plastic building materials
- Daily trash: disposable dishes, water bottles, MRE containers, old documents,
- Maintenance waste streams: dirty fuel, oil, liquid solvents.



NAWTEC17-2344

Combustible Solid Waste Disposal

Airmen	1,100
Combustor operation time	15 hrs/day
Combust. waste disposal rate	~1,000 lb/hr

3

- One man's trash is another man's treasure.
- By 'deployed' we mean located 'overseas' for short-term or medium-term operation.
- System must be transportable to move with troops.
- Reduces energy demand from local resources. Fewer trash trucks will move on and off the base.

(MRE = Meals Ready to Eat)

Project Goals



- Initial Goal: burn and reduce trash
 - *Past* -- furnace/combustor, built & tested.
 - *Now* -- Emissions testing, EPA methods
- Ultimate Goal: waste & biomass → heat & power
 - *On-Going* -- Transportable Waste-to-Energy System (TWES).


NAWTEC17-2344

4

- The furnace is a trailer mounted system.
- Building the Transportable Waste-to-Energy System (TWES) to convert waste and biomass waste to useful heat and power.
- Progress on the construction of the TWES will be discussed more at the end of the presentation.

Coiled Furnace/Combustor

- Patented combustion coil design
- Primary combustion chamber – coiled pipe
- Secondary Chamber – central region

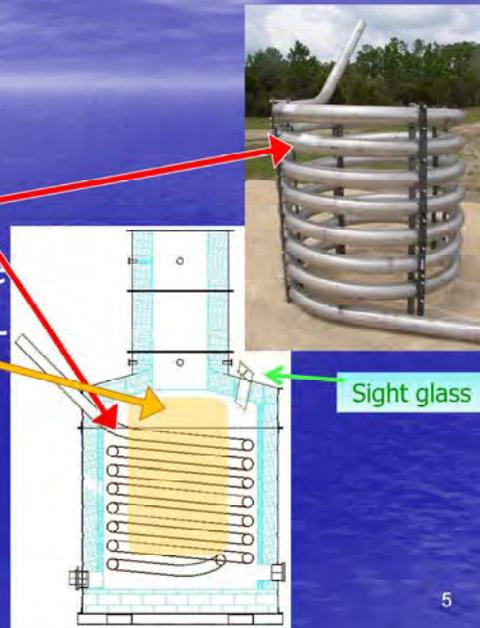


NAWTEC17-2344

5

- A key feature of the furnace system is its unique patented combustion coil design.
- The objective is to increase particle residence time near the radiant ignition source to improve particle burn-out.

Coiled Furnace/Combustor

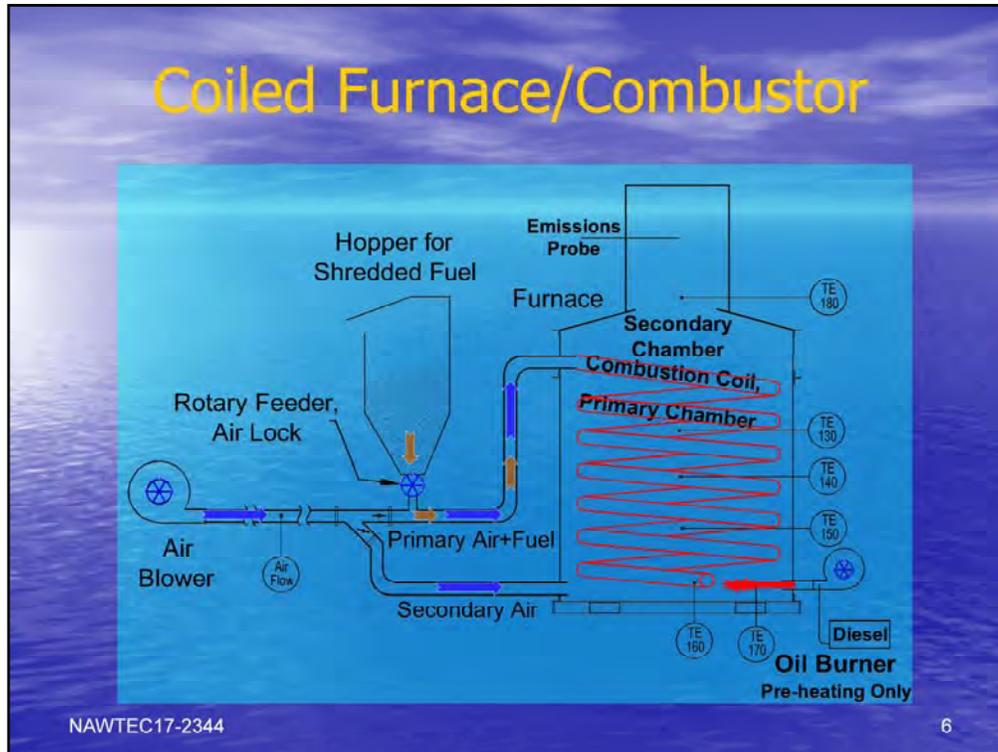

This slide depicts the generalized flow paths and instrumentation.

FLOW PATHS:

- Shredded material is vacuumed into the hopper
- Rotary air lock drops fuel into the primary air stream.
- Primary air carries fuel into primary combustion chamber (the coil) where it ignites
- Secondary air completes the combustion in the center of the furnace.

INSTRUMENTATION:

- Fuel flow to the furnace is measured using speed and geometry data for the conveyor equipment.
 - Air flow is measured with annubar sensors and cross checked w/ manufacturer blower curves & stack test measurements
 - Thermocouples (TCs) throughout the system measure temperatures inside the furnace and inside the combustion coil itself.
 - The primary TCs are shown on the sketch, TE-130 to 160 are combustion gas T's inside the coil.
 - Other TCs measured the coil surface T.
 - TE-170 is the combustion gas after exiting the coil and entering the center of the furnace.
 - TE-180 is the exhaust temperature just as it leaves the furnace.
- (TE = temperature element used in an instrumentation system, which in this case is a TC.)

Summary from paper: Transport air serves to provide primary combustion air. Air is

Emission Testing - Preparation

- Burned dry shredded wood
 - 7,600 Btu/lb, 10 to 14% moisture



- Initial tests – select fuel & air rates, plus keep furnace temp below material limits.



Two Air Blowers
NAWTEC17-2344

- Increased fuel
- Increased total air
- Increased % primary air



Valves to divide Prim. & Second. Air

7

- Only shredded wood was burned during the emissions tests
 - For a consistent fuel source, to give baseline with reduced variation in feed stock
- For the Emissions tests, the furnace was burned over a 3 day period.
- Previous tests had indicated that combustion temperatures could exceed the metallurgy of the combustion coil.
 - So, on 1st Day of operation, the operators tested and selected two (2) fuel rates and air-fuel ratios compatible with the furnace.

Emission Testing

- Two days of Emissions Testing, July AD 2008
 - 1st Day, Low-Load 157 lb/hr, Tests 1, 2, & 3
 - 2nd Day, Mid-Load 199 lb/hr, Tests 4, 5, & 6
 - Professional emission testing contractor
 - EPA Methods for PM, CO, NOx

Operating Parameters	Load Condition	
	Low Tests 1-3	Mid Tests 4-6
Avg. Fuel Flow Rates (lb/hr)	157	199
Avg. A/F Ratio (lb-air/lb-fuel)	21	19
Avg. Heat Input (kWt)	359	425
Avg. Residence time, est. (s)	0.9	0.7

NAWTEC17-2344

- Based on results from the previous day, operating parameters were selected for two days of emissions testing.
- (EPA Methods 1, 2, 3A, 5, 7E, 10, and 202)
- (Residence times were calculated)


Emission Testing - Equipment



Photo Description

- Fuel loading – shredded wood wrapped in plastic bales.
- Control panel, additional adjustments and data monitoring on a laptop computer
- Blue Tent acted as operations headquarters, important for blocking sun from computer screens
- Emissions monitoring equipment installed on the stack; emissions operators used man-lift.

Emission Testing – Day 1

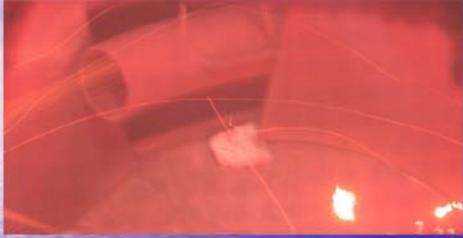

- Emissions Tests 1, 2, & 3,
Images inside the furnace
 - Combustion starts inside coil
 - Particle stream lines
 - Intermittent Flame discharge



Press for
Video Sample
of Tests 1, 2, & 3


NAWTEC17-2344

10

- Video file name “**TWES Furn Burn 22 EmTest1 2 3.wmv**”; Emissions Tests 1, 2, & 3. Photos’ & video’s time stamps are ≈12:54PM July 24, 2008, which is in between Tests 2 & 3.
- Photos were taken through a sight glass at the top of the furnace.
- Intermittent Flame discharge – due at least in part to periodic nature of fuel dropping from the hopper
- Large particles finished burning inside the Secondary chamber, i.e.: after exiting the coiled pipe.
- All lighting is from combustion radiation.

Emission Testing – Day 2

- Emissions Tests 4, 5, & 6, Images inside the furnace
 - Combustion is more steady and hotter (brighter).
 - Flame discharge is less pronounced
 - Higher volumetric flow rate → Lower residence time → more large particles survive coil, landing in secondary chamber.

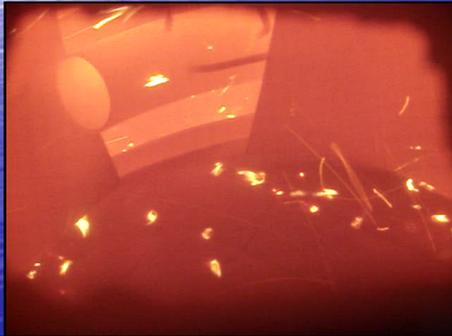

Video Sample
of Tests 4, 5, & 6


11

Video file name “**Furn Burn 24 EmTest4 5 6.MPG**”; Emissions Tests 4, 5, & 6, July 24, 2008

(Click on video image to start playing it.)

- More of the large particles finished burning inside the secondary chamber, after exiting the coiled pipe. Due to higher velocities causing lower residence times.
- All lighting is from combustion radiation.

Emission Results – T Profile

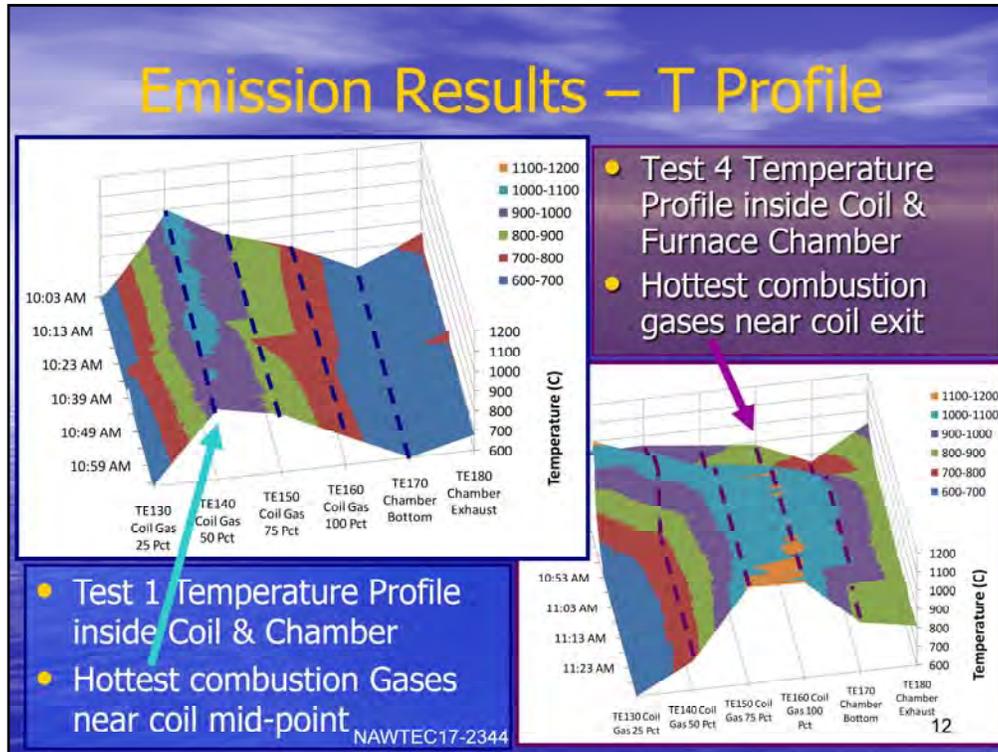


• 1st graph for Test 1 shows the changing temperature of the combustion flow, combustion gases, after they enter the coil, travel through it, and exit into the central chamber of the furnace.

- Shredded fuel and air are pre-heated and ignited in 1st half of coil (before TE140).
- Hottest combustion at mid-point, TE-140
- Beyond the mid-point, there is radiant Heat loss to furnace and to secondary air outside the coil.
- Combustion continues through the coil and outside the coil, evidenced by flame seen in sight glass.

• 2nd Graph, for Test 4, with higher fuel rate, correspondingly higher air flow AND more primary air relative to secondary air. Also, higher temperatures. (p. 5)

- Initial time, temperatures low @ start of day; System adjusting to new operating conditions.
- Hot region moved to end of coil, because:
 - More cool air must be pre-heated in the coil
 - Less residence time, so fuel + air traveled further before combustion reached similar point of maturity.
- Ability to move hot spot based on ratio of primary & secondary air may be advantageous

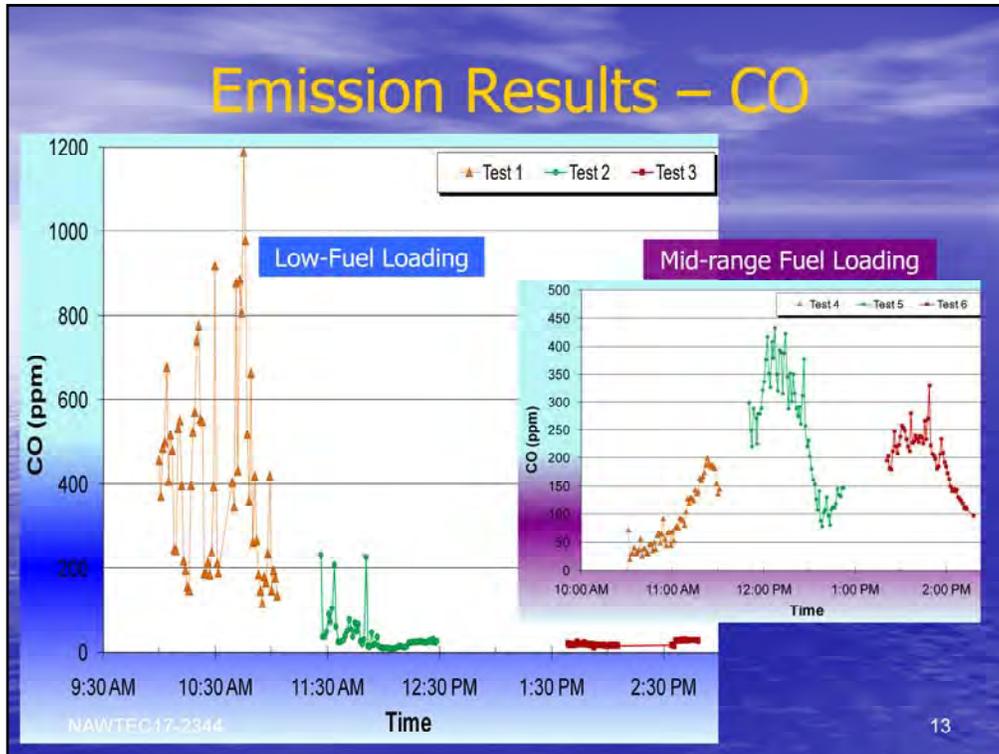


Test 1 had much more fluctuation in performance than expected, probably due to system stabilizing as result of fuel and air flow tuning.

Test 1 does not appear to be indicative of system performance. Test 2 & 3 show that a more steady operation was achieved.

Even so, in most data there is some fluctuation or undulation. Maybe due in part to the packets of fuel dropped from the feed system. The investigators tried to keep the fuel flow steady, but changes did happen.

- Aside from Test 1, the higher CO in mid-load tests compared to lower fuel load tests is believed to be result of the 22% lower residence time. (0.9 sec for low-load vs. 0.7 sec for mid-load)

As mentioned, the higher fuel rates required higher air flow, which reduces residence times in the system's fixed volume.

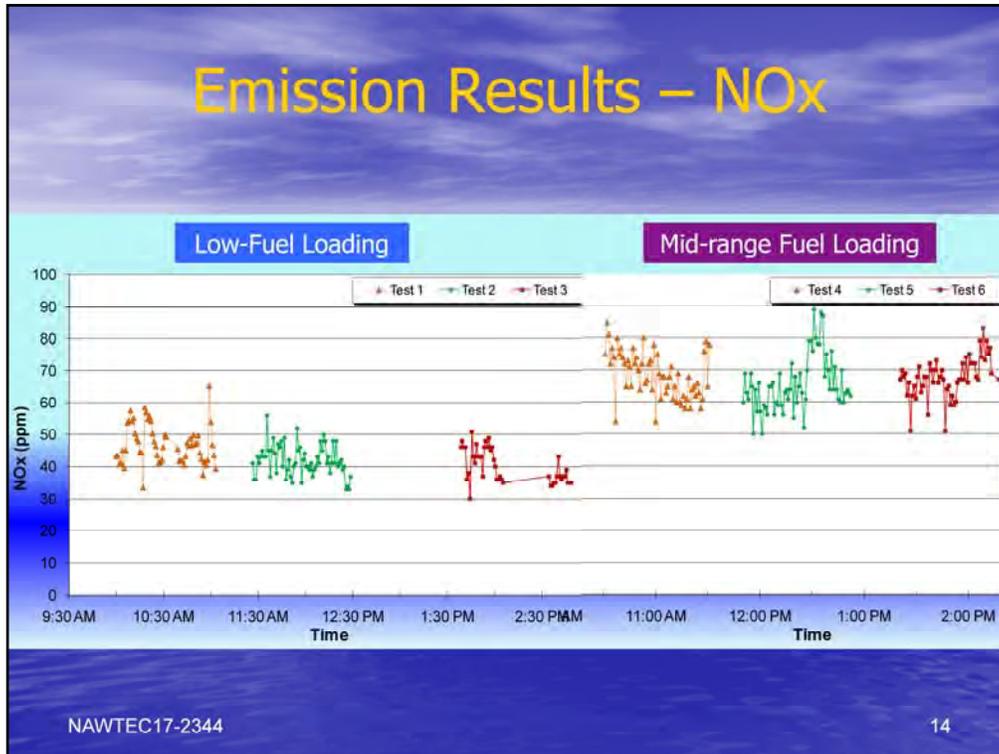

NO_x Nitrogen Oxides

Again, fluctuation is seen in all data sets, but NO_x data is more uniform than CO, especially for Test 1.

Emission Results – CO & NO_x vs. T

- Noted counter-intuitive trends in Temp, CO and NO_x formation during tests
 - 1st: *Avg.* CO and NO_x moved same direction as T
 - 2nd: *W/in* mid-Load Tests, CO with T; NO_x opposite
 - Atypical correlations w/Temp
- Graphs...


NAWTEC17-2344

15

Now that we have seen the emissions data for each test, we can observe some unique trends within the data set.

Emission Results – CO & NO_x vs. T

- 1st: Average CO & NO_x both rise with Temperature

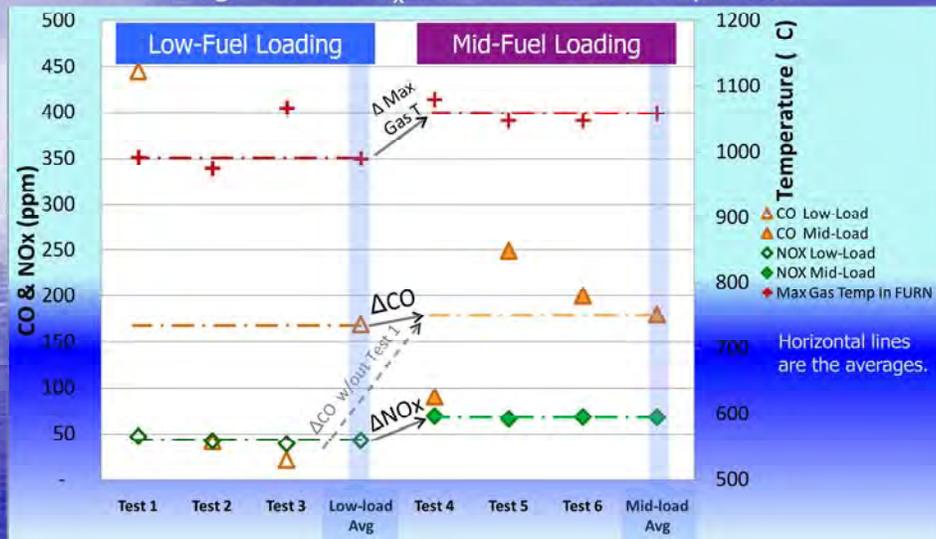


NAWTEC17-2344

16

- With a higher fuel rate, Temperatures in the second series of tests rose.
- So too, CO & NO_x both increased.
- Would expect NO_x to rise, but higher temperatures usually result in more complete combustion, reducing CO.

Emission Results – CO & NO_x vs. T

- 2nd: Mid-Load data: CO same trend as T; NO_x opposite.

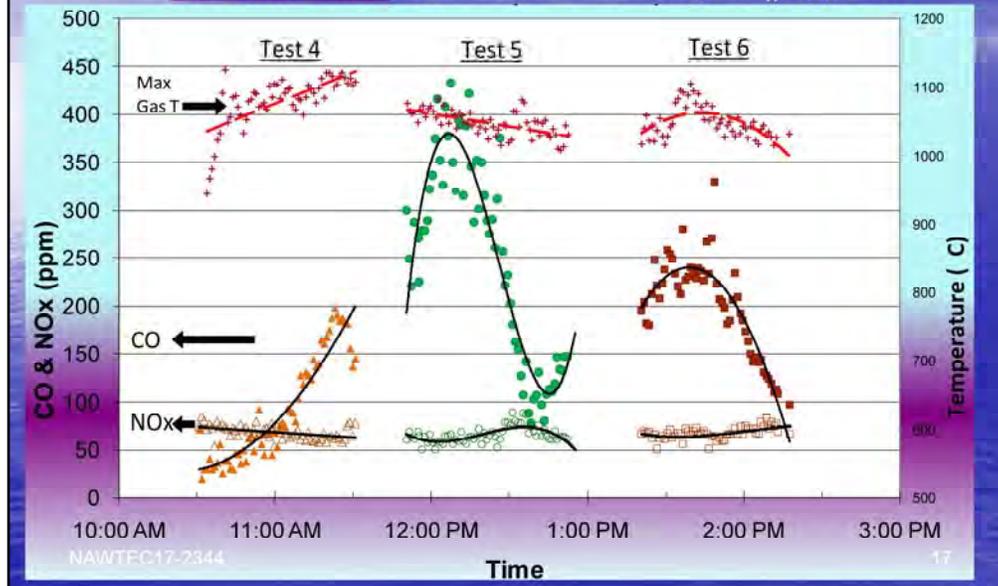

- The maximum gas temperature in the furnace was plotted. The location of this maximum T varied with burn conditions.
- The rise of CO with T, while NO_x fell, was unexpected.
 - Test 4 followed a more complicated trend.
- Memo: The author's use of linear and 2nd and 3rd order polynomial curve fits do not suggest that they represent the fundamental behavior in the data. After all, time is the sole independent variable for the curves. As such, these curves are not expected to predict future data. Instead, the curves follow observable trends in the data, trends that resulted from operator changes, system variability, and the combustion behavior of the system. The curve fits describe a "snapshot" in time.
- Comparing simultaneous trends in temperature, CO, & NO_x is valid because these three parameters are known to interact with one another, and each of these parameters experienced the same operating conditions and variations.

Emission Results – CO & NO_x vs. T

- Possible Explanations for counter-intuitive trends
 - Local Hot Spots
 - Emission behavior inside coil not observed
 - Local A/F ratio different than average A/F
 - Different temp/combustion regime inside coil
 - Higher fuel rates → higher T + higher air & lower residence times (helps explain 1st trend, the avg'd data)

NAWTEC17-2344

18

At this time, the authors can only hypothesize possible explanations for this behavior and propose issues to investigate.

Trends may be a unique feature of the coiled combustor.

Emission Comparison

- EPA AP-42 (2003): several industrial combustors
 - Fuel: mixed waste
 - Size: much larger

- TVA (1983): a small biomass combustion unit
 - Fuel: pieces of wood
 - Size: 150 kWt

Furnace Comparison

- PM competitive with AP-42, twice TVA observed.
- CO lower than AP-42 & TVA data
- NO_x lower than AP-42 & competitive with TVA
- SO₂ equivalent
- GOOD PERFORMANCE.

	Load Averages ¹		Comparison Data	
	Low-load	Mid-load	AP-42 ³	TVA ⁴
Average Heat Input (GJ/hr) ²	1.29	1.53	NA	0.4-0.6
Average Heat Input (kWt)	359	425	NA	111-167
Particulate Emissions (kg/GJ)	0.17	0.14	0.17	0.08
CO Emissions (kg/GJ)	0.17	0.19	0.26	2.12
NO _x Emissions (kg/GJ)	0.08	0.12	0.21	0.07
SO ₂ Emissions (kg/GJ)	0.01	0.01	0.01	0.01

Notes: 1) AST stack test data
 2) Based on ultimate analysis data and fuel mass flow rates
 3) EPA, emissions from stationary sources; small wood-fired boilers using dry wood pp. 1.6.6-7
 4) Wood-fired Boiler Test Report, TVA, August 1983
 5) All emissions uncontrolled

NAWTEC:17-2344

19

Data table corresponds to Table 3 in the paper

- AP-42 is the EPA emissions guidance document that includes emission factors for stationary sources

- Emission Factors are averaged, normalized emissions data collected from multiple combustion systems. The data is used to predict emissions from new or untested combustors of the same general design, but the scale (size) may vary significantly.

- Scale (size) of units summarized in AP-42 is several orders of magnitude larger than furnace reported in this article .

- The scale of the TVA heat input was similar to the furnace reported in this article

- Previous slides showed emissions in terms of parts-per-million in the exhaust gas. Common; OK for comparing results of a single unit or units operating in a similar fashion.

- For better comparison of between widely difference combustors, normalized emissions are presented here in terms of kg of pollutant per Gigajoule (heat rate) of fuel burned.

Loss on Ignition Results

- LOI is a rough measure of combustion completeness
- Limited LOI analysis (ASTM) performed on collected ash
 - Fly ash via sampler in stack
 - Bottom ash collected from furnace bottom
- Results
 - Fly Ash: 18.26% (“middle of the road”)
 - Bottom Ash: 0.47% (very good)

NAWTEC17-2344

20

LOI is measured by reheating an ash sample in an attempt to burn any remaining carbon. The loss of mass indicates the additional amount of carbon that could have been burned previously in the furnace, but was not.

Lower LOI results indicate that a more complete combustion process occurred in the furnace.

•LOI results for the TWES furnace indicate very good burnout of bottom ash and average burnout in fly ash.

This is consistent with CO emission results and suggests overall good carbon conversion.

•The bottom ash remained in the furnace through all testing and was not removed until the end. This long residence time was a strong factor in achieving low (good) LOI values for bottom ash. Other furnaces with active ash removal systems, could have higher (poorer) LOI results.


Next Steps – Building the TWES

...And Now!

Furnace



Transportable
Waste-to-Energy
System (TWES)

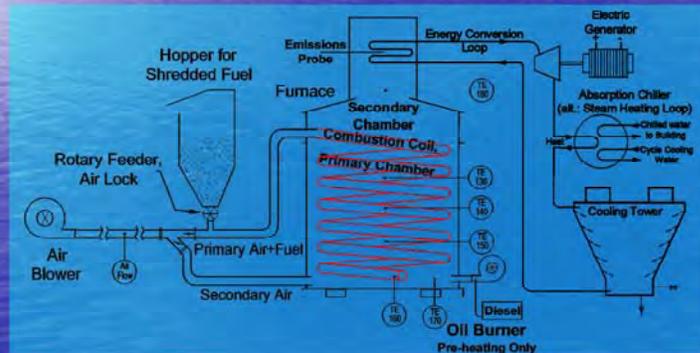

NAWTEC17-2344

21

- The furnace emissions and performance data gathered during the tests last year are guiding the design of the TWES
- Important furnace factors and how they affect the TWES design
 - Ash loading → boiler design, boiler clean-out schedule
 - Exhaust temperature → size and material selection for heat exchangers
 - System behavior → start-up and shut-down sequencing, operational control scheme, and emergency stop responses
 - System behavior → how to maximize heat production and exhaust temperature while remaining within the material limits of the furnace; how to respond if temperatures start rising

Next Steps – Building the TWES

Furnace

- Designing Heat recovery portion; Build this summer
- Energy conversion next phase

The diagram illustrates the layout of the TWES system. It is divided into two main sections. The top section, labeled 'Furnace', shows a large industrial unit with a complex network of pipes and machinery. Below it, the 'Steam Engines' and 'HRSG' (Heat Recovery Steam Generator) are shown as a long, low-profile unit. The bottom section shows the 'Absorption Chiller' and 'Heat Exchangers & Cooling Tower' as another long, low-profile unit. The entire system is mounted on a trailer.

Steam Engines HRSG

Absorption Chiller Heat Exchangers & Cooling Tower

NAWTEC17-2344 22

•The energy recovery portion of the TWES is being designed. The boiler section is being fabricated. When completed it will be joined to the furnace.

- First Trailer will have
 - Heat Recovery Steam Generator (HRSG)
 - Water treatment
 - Feed water pumps
 - Heat exchangers
 - eventually, steam engines
- Other trailers will hold
 - fan cooler
 - pumps
 - eventually, absorption chiller & cooling tower

Discussion...

NAWTEC17-2344

23